
This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from J. J. Hartley.

revisions:

notes:

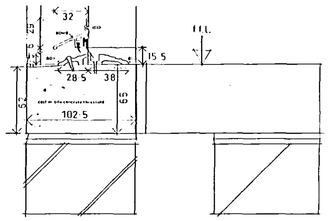

LEVEL ACCESS DETAIL (nts)

REGULATION L1 Elemental method of compliance

ROOF
250 glass wool to achieve u value 0.16 w/m² K.


EXPOSED WALLS
102.5 bwk, 75 cavity inc. 75 ROCKWOOL cavity insulation & 100 thermal blockwork to achieve max u value 0.35 w/m² K.

GROUND FLOOR
75 celotex GA 30 75Z floor insulation to achieve 0.25 w/m² K.

WINDOWS & DOORS
upvc double glazed with a 12mm air gap, argon filled with a 'soft' low-E coating to achieve 2.0 w/m² K.

LIMITING INFILTRATION
seal gaps between studwork & masonry, masonry walls at edges of window & door openings & at junctions of walls, floors & ceilings by continuous bands of fixing plaster.
draught stripping to all windows, doors & loft hatches.
seal pipes & boxing at floor & ceiling levels.


energy SAP rating to be submitted to local authority prior to completion.

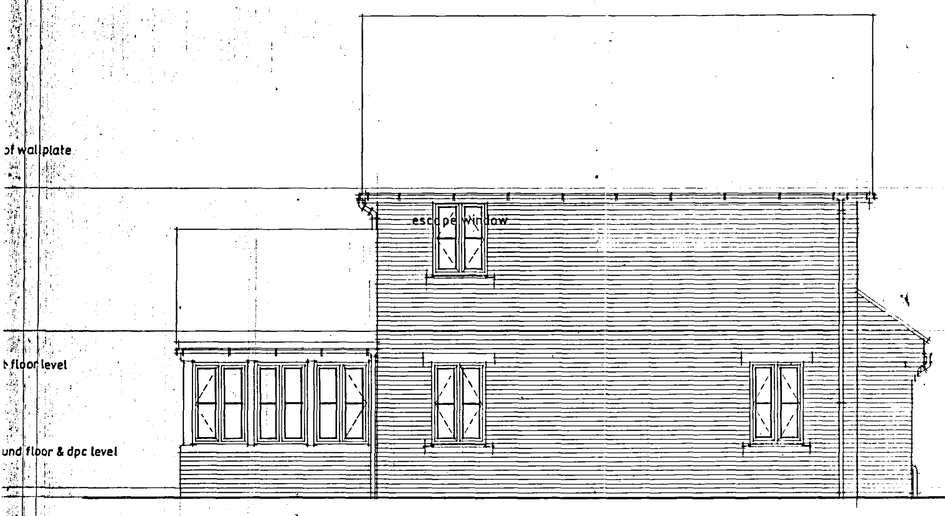

SIDE ELEVATION


artificial stone window cills, lintels & door thresholds as shown

inbetween floor joists over garage provide 100 glass wool infill, 30 mm celotex GA 30 30 & min. 25mm cavity to provide Fire, sound & thermal requirements"
new ceiling to garage in 12.5 p'bd & 6mm Masterboard inc. staggered joints.

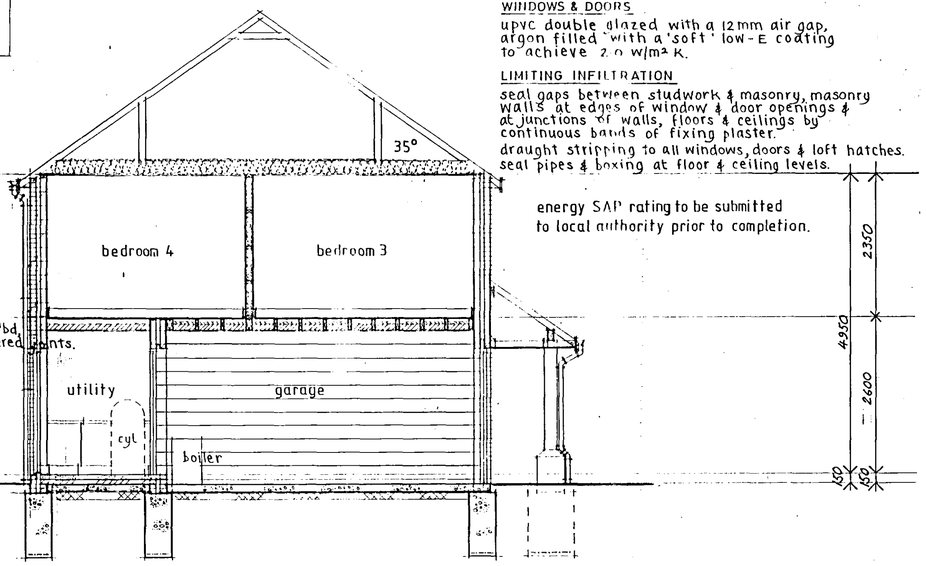


SECTION BB

escape windows to have unobstructed openable area min. 0.33m2 & min. 450 w. x 450 h. with a max. window opening height of 1100mm.



ESCAPE WINDOW

proposed roof covering in conc. interlocking roof tiles, suitable for pitch & fixed all in accordance with manufacturers instructions to 38 X 25 sw battens on KLOBER PERMO FORTE (vapour permeable membrane)

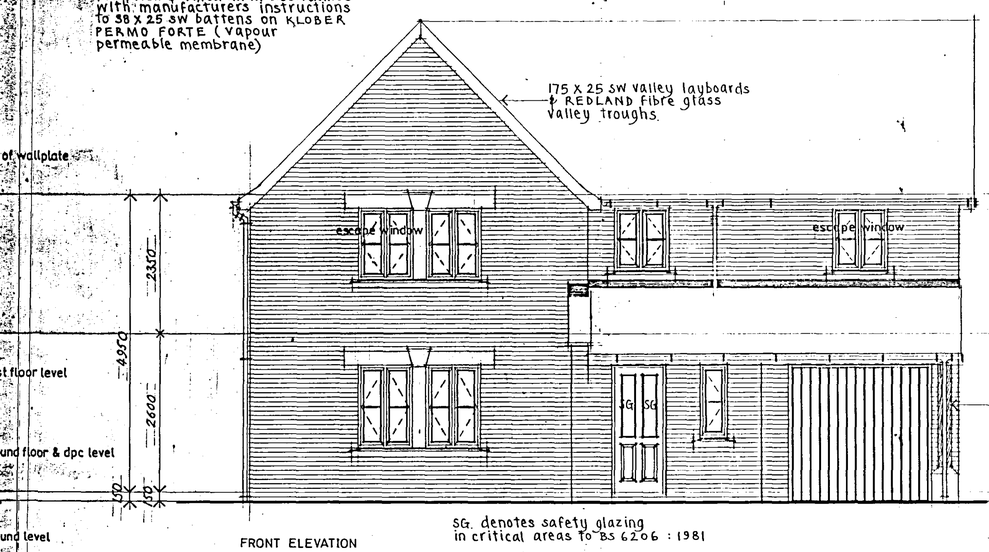


FRONT ELEVATION

SG denotes safety glazing in critical areas to BS 6206 : 1981

structural timber to be SC3 grade sw, kiln dried.

Treat exposed timbers to BS 1282 : 1975

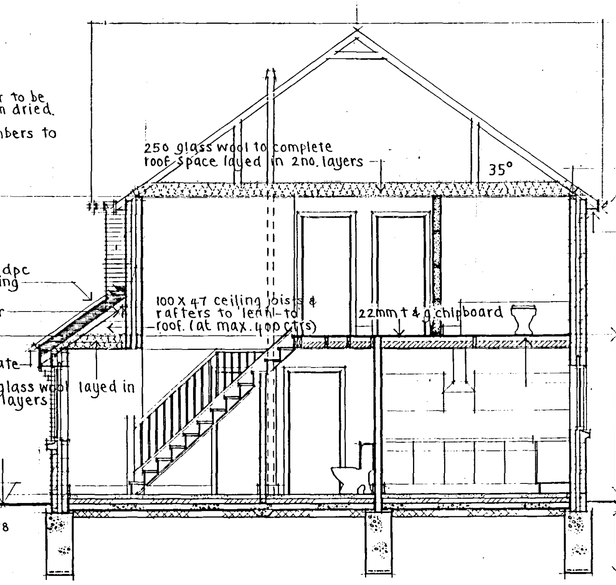

SECTION A A

450 X 1050 deep conc. trench fill foundations with 1no. layer A393 mesh reinforcement (min. 50mm) in bottom.

thin peat level 600mm below slab level ∴ traditional oversite slab satisfactory

pre fabricated attic style roof trusses at max. 600 ctrs inc. wind bracing fixed all in accordance with manufacturers instructions & BS 5268 : pt. 3 : 1985.
manufacturers design certificate to be submitted to & approved by local authority prior to site start.
strap roof trusses, wall plates & floor joists down to walls at max. 1800 ctrs with 30 X 5 ms straps inc. noggin pieces as required

100 X 65 sw wall plate.
175 X 25 sw fascia
10 mm ext. quality ply soffite
all new ceilings in 15 mm plasterboard & scrim & set.
provide cavity trays above I.G. cavity lintels
100 mm ROCKWOOL R.W.2. insulation between all floor joists (min. 10 kg/m³)
dpc min. 150 above g.l.
common bwk below g.l.
cavity to extend min. 225 below lowest dpc.
new solid floor construction: 100 well consolidated & sand blinded hardcore, 1200 gauge polythene dpm lapped & continuous with int. dpc's, 100 conc., 75 celotex floor insulation GA 30 75 Z turned up at perimeter of new solid floor & 75 screed & finish.

Building to be constructed in accordance with Robust Construction Details

i) Wall & loft insulation to be continuous where applicable.
ii) loft insulation to be installed right up to gable walls.
iii) wall insulation to extend 150 below top of perimeter insulation supported on row of wall ties.
iv) silicon sealant to front & back of all window/ext. door frames.
v) thermabate cavity closers to all external openings 40 mm frame/closer overlap.

SHDC
PLANNING & DEVELOPMENT
10 FEB 2006
Ref. 0202106

J.J. & J. HARTLEY

J. J. Hartley, M.B.I.A.T., M.C.I.O.B., M.B.I.M.
PRINCIPAL
Architectural and Project Management Services
Interior Design Consultants and Surveyors
109 Fulbridge Road, Peterborough, PE1 3LE
Fax/Tel: Peterborough 01733 707012

job:
CASTLE STREET DEVELOPMENTS LTD
Land at:
27A CHAPEL STREET
CROWLAND
CAMBS.
PE6 0AR
Detached dwelling

DETERMINED
PLAN
HOUSE TYPE-B | PLOT 1
PLOT 2

drg: Sections & elevations

scale: 1/50
date: 26/1/06
drawn by:
drg. no.: 3957/6