


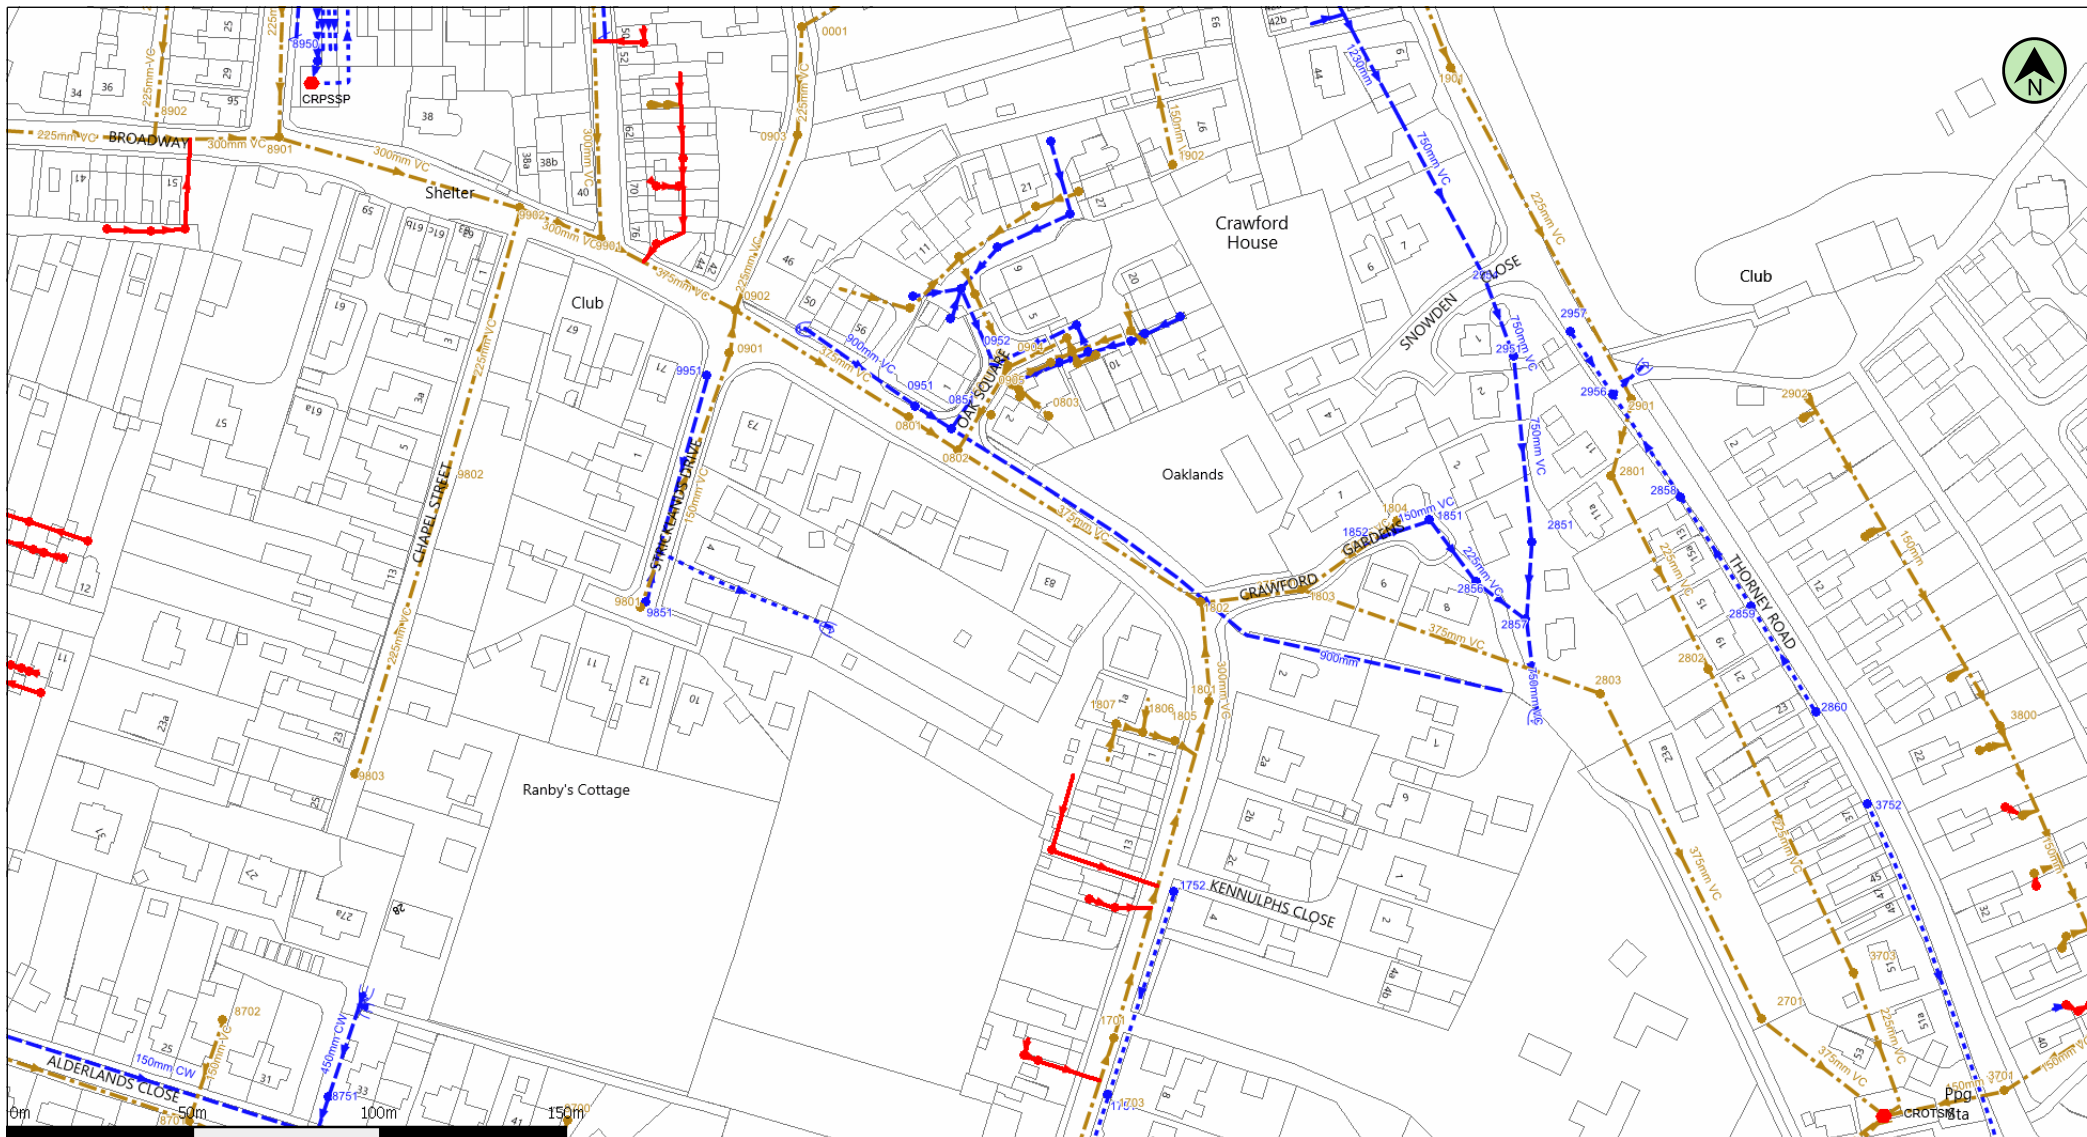

(c) Crown copyright and database rights 2024 Ordnance Survey 100022432 Date: 25/06/24 Scale: 1:2027 Map Centre: 524088,309857 Data updated: 31/05/24 Wastewater Plan A4

This plan is provided by Anglian Water pursuant to its obligations under the Water Industry Act 1991 sections 198 or 199. It must be used in conjunction with any search results attached. The information on this plan is based on data currently recorded but position must be regarded as approximate. Service pipes, private sewers and drains are generally not shown. Users of this map are strongly advised to commission their own survey of the area shown on the plan before carrying out any works. The actual position of all apparatus MUST be established by trial holes. No liability whatsoever, including liability for negligence, is accepted by Anglian Water for any error or inaccuracy or omission, including the failure to accurately record, or record at all, the location of any water main, discharge pipe, sewer or disposal main or any item of apparatus. This information is valid for the date printed. This plan is produced by Anglian Water Services Limited (c) Crown copyright and database rights 2024 Ordnance Survey 100022432. This map is to be used for the purposes of viewing the location of Anglian Water plant only. Any other uses of the map data or further copies is not permitted. This notice is not intended to exclude or restrict liability for death or personal injury resulting from negligence.

Foul Sewer	--- -- --	Outfall*	⊕	Sewage Treatment Works	□
Surface Sewer	--- -- --				
Combined Sewer	--- -- --				
Final Effluent	--- -- --	Inlet*	⊕	Public Pumping Station	⬢
Rising Main*	--- -- --				
Private Sewer*	--- -- --				
Decommissioned Sewer*	--- -- --	Manhole*	●	Decommissioned Pumping Station	⬢

*(Colour denotes effluent type)

sally.burrows@sholland.gov.uk	
David Grant	

Manhole Reference	Liquid Type	Cover Level	Invert Level	Depth to Invert
0001	F	2.896	1.496	1.4
0801	F	2.87	-0.13	3
0802	F	9.904	6.96	2.944
0803	F	-	-	-
0901	F	2.8	0.35	2.45
0902	F	2.84	-	2.84
0903	F	2.92	1.32	1.6
0904	F	9.939	8.6	1.339
0905	F	-	-	-
1701	F	2.44	-0.08	2.52
1801	F	2.94	-0.19	3.13
1802	F	3.2	-0.34	3.54
1803	F	2.27	-0.43	2.7
1804	F	2.695	0.93	1.765
1805	F	-	-	-
1806	F	-	-	-
1807	F	-	-	-
1901	F	3.38	1.33	2.05
1902	F	-	-	-
2701	F	2.519	-0.92	3.439
2801	F	2.63	0.65	1.98
2802	F	2.49	0.54	1.95
2803	F	2.31	-0.56	2.87
2901	F	2.98	0.76	2.22
2902	F	2.224	1.084	1.14
3701	F	2.69	-0.622	3.312
3703	F	2.16	-0.17	2.33
3713	F	-	-	-
3800	F	1.665	0.395	1.27
8701	F	1.861	0.521	1.34
8702	F	1.991	0.701	1.29
8901	F	2.992	0.492	2.5

Manhole Reference	Liquid Type	Cover Level	Invert Level	Depth to Invert
8902	F	3.059	0.559	2.5
9700	F	1.655	0.395	1.26
9801	F	1.974	1.02	0.954
9802	F	2.618	0.918	1.7
9803	F	2.401	1.251	1.15
9901	F	2.809	0.119	2.69
9902	F	2.786	0.196	2.59
0851	S	9.753	7.53	2.223
0951	S	-	-	-
0952	S	9.86	8.3	1.56
1751	S	2.39	1.35	1.04
1752	S	2.62	1.83	0.79
1851	S	2.55	1.42	1.13
1852	S	2.88	1.49	1.39
2851	S	2.27	0.82	1.45
2856	S	2.34	1.27	1.07
2857	S	2.2	1.19	1.01
2858	S	2.94	1.71	1.23
2859	S	2.74	1.7	1.04
2860	S	2.68	2.11	0.57
2951	S	3.01	1.13	1.88
2954	S	2.75	1.2	1.55
2956	S	3.13	1.69	1.44
2957	S	3.19	2.43	0.76
3752	S	2.65	2.17	0.48
8751	S	1.692	-	-
8752	S	1.961	0.721	1.24
8950	S	-	-	-
9851	S	2	1.49	0.51
9951	S	2.64	1.99	0.65