COPY

SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H02/0349/93 Received:19-APR-93 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Description: Proposed 11,000 volt overhead line

Location : Parishes of Crowland and Newborough

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Director of Planning and Building Control Services
15-JUN-93 H02/0349/93

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE
Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H02/0349/93 Received:19-APR-93 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Description: Proposed 11,000 volt overhead line

Location : Parishes of Crowland and Newborough

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Director of Planning and Building Control Services
10-AUG-93 H02/0349/93

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H02/0349/93

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Agent: East Midlands Electricity p
Sleaford Road
Boston
Lincs
PE21 8BR

Description: Proposed 11,000 volt overhead line

Location: Parishes of Crowland and Newborough

Type: ELECTRICITY

APPLICATION DETERMINED BY SECRETARY OF STATE - SUMMARY OF DECISION

Planning permission has been granted by the Secretary of State, or is deemed to have been granted, on conditions set out below or attached.

1 The development to which this permission relates shall be begun not later than the expiration of five years beginning with the date hereof.
Reason: To comply with the provisions of Section 91(1) of the 1990 Act.

2 The Company shall dismantle & remove from the site any redundant lines & apparatus within 6 months from the date of commissioning of the lines
Reason: To restore the land as far as practicable to its condition before the redundant lines and apparatus were installed.

APPLICATION ASSESSMENT

Notes for Case Officer

Site Inspection

Accuracy :
Neighbours :
Boundaries :
Site Features :

Inspected by PJH
Date 4-5

Site Notice posted by
Date
Expiry No Need

Individual Resident Notices required:

Addresses to be sent to –

Addresses delivered to –

Case Officer Conclusions

Anything coming down? A bit of a forest where merged Else treeless + no buildings

---

RECOMMENDATION

COMMITTEE

Departure from Policy .....

Ward Member request .....

Recommend approval against material objection .....

Other circumstances viz: .....

Change to Committee recorded:

Decision confirmed as agenda:

DELEGATED/Non-Det

Case Officer Recommendation

Approve (or equiv)

Refuse (or equiv)

Signed ..... Date.....

Notes:

☐ Disabled
☐ Prev conditions
☐ Amended plans –
Dwg no:
Received:

Conditions/Reasons (cont overleaf)

DC INSTRUCTION SHEET

APPLICATION REF:

Directions

Art 7 (Outlines)

☐ RM checklist

	Sit	Des	Ext	Acc	Land
Previous					
Current					
Required					

Reg 4 Scale drawing.... Highway S/W.... Agric appraisal....

☐ Non Std

Precise details:

Direction authorised by Senior Officer..... Date.....

Revalidation after Direction

Information satisfactory Signed..... Date.....

Valid date:

Amended description

Reconsultations:

All.....
Specified:

Unsatisfactory –
Further direction:
Signed.....
Senior Off.....

Precise details:

Consultation/Publicity Required

	Publicity:	Consultations:	
Departure	.....	County	.....
Setting of LB	.....	E Heritage	.....
Public Right of Way	.....	Societies	.....
Discretionary	.....		

Extra Consultations:

Transport	D/Transp A15	..... *		
	D/Transp A18	.....		
	B Rail	.....		
Environment	Env Services	.....		
	NRA	.....		
	Env Assess	..... G *	Specify:	
Conservation	LB Demolish	..... G *	Standard	
	Eng Heritage	.....		
	Archaeology	..... G	Specify:	
	Consultant	.....		
	Other	.....	Specify:	
Hazards	HSC Group	..... G *	Standard	
	Specific	..... G	Specify:	
Other		.....	Specify:	

Note
* Longer expiry
G Group available

Case Officer

Senior Officer Confirmed ..... Date..... Recorded DC....

ADDITION RECORD SHEET

Initial

Submitted Fee £ NIL

Receipt No

Date first Rec'd 19 APR 1993

Registration

Reference H02/0349/93

Cross-Ref N/A

Date 20/4/93

Validation

TYPE DEL

Site area
No of dwellings
Floorspace

Earlier permission – Ref:
New/Redevelop/Use/Ext/Alt/Works

Description to be recorded

Invalid — Site plans ☐ Certificate ☐ — Fee ☐ Fee (not free) ☐ — Inaccurate ☐ Incomplete ☐ Unclear ☐

Fees — Correct fee £ NIL — Nil fee ☐ Discounted ☐ — Previous app – ref: Type of app Reason:

Additional £ Refund £ — Receipt No Voucher No — Date Date

Information

380,391,

Index sheet — OS Plots
Grid ref 522650 309630

Ward A — Parish CROWLAND

Inside IBD NO — Inside LP area NO

Constraints:

CA Cons Area ☐
LB Listed – Grade: ☐
ARC Archaeology ☐
AM Ancient Mon ☐
SSI Special Int ☐

TR Rural ☐
BP TR proposed 67m ☐
LC Level Cross ☐
FP Footpath YES
TPO Tree Pres ☐

Hazards –
HAZ Site ☐
AIR Safeguard ☐
LIN Elect ☐
PIP Pipe ☐
CON Waste/contamin ☐

Linked to site — Ref 1978 — Dist Bound ☐

Linked to property — Ref — Other: ☐

Planning Records:
Earlier apps

B Reg Records:
Already submitted – Ref:
Request needed
Requested

S Holland DC

Department of Trade and Industry
Electricity Division
1 Palace Street
London SW1E 5HE

Fax No.	071 834 3771
Switchboard	071 238 3000
Direct Line	071 238 3634/3711

The Secretary
East Midlands Electricity plc
Boston

Dear Sir

Our Reference OL/266/2375

Date 24 JUN 1993

OVERHEAD LINES
ELECTRICITY ACT 1989
TOWN AND COUNTRY PLANNING ACT 1990.

With reference to the application particulars of which are specified below, I am directed by the Secretary of State to inform you that consent is hereby granted pursuant to section 37(1) of the Electricity Act 1989 ("the 1989 Act") to the installing above ground of electric lines ("the lines") particulars of which are specified below.

Pursuant to section 37(3) of the 1989 Act this consent is given subject to the following conditions:

1. The Secretary of State may review this consent at any time after a period of five years from the date hereof, and upon such review, after giving all persons concerned an opportunity of being heard, he may vary or revoke his consent.

2. If the Secretary of State revokes this consent the lines shall be removed within such period as the Secretary of State may direct.

Pursuant to section 90(2) of the Town and Country Planning Act 1990 ("the 1990 Act") the Secretary of State hereby directs that planning permission for the development shall be deemed to be granted subject to the following condition(s):

1. The development to which this permission relates shall be begun not later than the expiration of five years begining with the date hereof.

Reason: To comply with the provisions of section 91 (1) of the 1990 Act.

2. The Company shall dismantle and remove from the site any redundant lines and apparatus within six months from the date of commissioning of the lines.

Reason: To restore the land as far as practicable to its condition before the redundant lines and apparatus were installed.

PLANNING AUTHORITY REFERENCE: HO2/0349/93

APPLICANT COMPANY: East Midlands Electricity plc

DATE AND REFERENCE OF APPLICATION: 5 May 1993 EM 21/122-95288

PARTICULARS OF OVERHEAD LINES:

Situated in the Parish of Crowland

Route as indicated on Map No 93/95288 B1 or within a distance not exceeding 30 metres on either side thereof.

Voltage 11,000

Yours faithfully

D. R. JOHNSON

Authorised by the Secretary of State

APPLICATION REFERENCE: H02/0349/93 DATE RECEIVED: 19-APR-93

TYPE: Electricity

DESCRIPTION: Proposed 11,000 volt overhead line

LOCATION: Parishes of Crowland and Newborough

APPLICANT: East Midlands Electricity plc AGENT:

REASON FOR COMMITTEE CONSIDERATION

Parish Council comments.

SOUTH HOLLAND DISTRICT COUNCIL
REPORT TO PLANNING COMMITTEE
Date - 8 JUN 1993

RECOMMENDATION

No objections.

COMMENTS

1 The proposal is to erect an overhead line from a point just south of the swimming pool at The Lake southwards to the Corporation Bank. At the Corporation Bank the entire length will be underground. The Parish Council support this but question why still two power lines almost parallel between the bank and the swimming pool. However, there will be only one line because one is to be removed.

2 There are technical reasons why more of the line cannot be undergrounded and these will be verbally reported.

REPRESENTATIONS

Parish Council: Support undergrounding adjacent to Corporation Bank. Question why still two power lines almost parallel between the bank and the swimming pool.

---

416. PLANNING APPLICATIONS (Continued)

(g) **Applications approved subject to Planning Obligations** (Continued)

(It was agreed that planning permission be granted for the above development subject to the access being relocated to the southern part of the application site.)

(It was also agreed that an order be made under Section 97 of the Town and Country Planning Act 1990 revoking planning permission H14/1719/88 subject to the owners and occupiers of the land and all other persons who will be affected by the order confirming in writing that they do not object to the order and will not be claiming any compensation under Section 107 of the Town and Country Planning Act 1990.)

(h) **Observations on applications by East Midlands Electricity Plc**

East Midlands Electricity Plc be advised that this authority raises no objections to the undermentioned developments, in accordance with the recommendations of the Director of Planning and Building Control Services:-

Plan No. and Applicant	Proposal
H02/0348/93 East Midlands Electricity Plc	11,000 volt overhead line in the Parish of Crowland.
H02/0349/93 East Midlands Electricity Plc	11,000 volt overhead line in the Parishes of Crowland and Newborough.

(i) **Observations on applications by Lincolnshire County Council**

The Lincolnshire County Council be advised of this authority's views in respect of the undermentioned proposals as follows:-

Plan No. and Applicant	Proposal
H02/0390/93 G M Riddington	Lagoon for storage of abattoir washings and vegetable processing liquid waste at Decoy Farm, Postland.

(The Lincolnshire County Council be advised that this authority objects to the above proposal, in accordance with the recommendation of the Director of Planning and Building Control Services, and be requested to refer the matter back to the appropriate committee for further consideration in view of concern that this authority's views were not taken into account when the application was discussed, notwithstanding the fact that the County Council had been advised of the likely objection.)

H16/0412/93 Birse Construction Ltd	Excavation of borrow pit to provide material for by-pass, and subsequent reinstatement as lake south east of A16 Spalding by-pass and east of A1073 Cowbit Road, Spalding.

(The Lincolnshire County Council be advised that this authority objects to the above development in accordance with the recommendation of the Director of Planning and Building Control Services and in particular is concerned at the proposed location of the development which, in any event, it is understood, is situated within the area the subject of the proposed A1073 improvement scheme.)

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

H02/0349/93

ELECTRICITY

Applicant: East Midlands Electricity plc Agent: East Midlands Electricity
Tel: 0205 365181 0205 365181

Description: Proposed 11,000 volt overhead line

Location: Parishes of Crowland and Newborough

Valid date:	19-APR-93	Terminal date:	14-JUN-93
Target dates:		Target Committee:	08-JUN-93
To case officer	26-APR-93	Report deadline:	25-MAY-93
Inspected by	03-MAY-93		
Extra contacts	10-MAY-93	Case Officer:	
Report if not clear by	24-MAY-93	P J UDY	

DEVELOPMENT/CONSTRAINTS

Size:
Category:
Listed building: Other Constraints: FP
Conservation Area:

CONSULTATIONS CARRIED OUT

	Sent	Expiry
Clerk to Crowland PC 0733 210653	11-MAY-93	25-MAY-93
Clerk to Crowland PC 0733 210653	26-APR-93	10-MAY-93
Cllr B Alcock 0733 210560	26-APR-93	03-MAY-93
Cllr N H Pepper Peterborough 21	26-APR-93	03-MAY-93

Case - No objections for 28/4/93

SITE RECORD

P.T.O.

Grid ref: 522650 309630
OS Sheet: 380 391 Parcel:

BRIAN SMITH Dip TP MRTPI
D r of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire, PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

Cam

SOUTH HOLLAND DISTRICT COUNCIL

H02/0349/93
ELECTRICITY

Applicant: East Midlands Electricity plc Agent: East Midlands Electricity
Tel: 0205 365181 0205 365181

Description: Proposed 11,000 volt overhead line

Location: Parishes of Crowland and Newborough

Valid date:	19-APR-93	Terminal date:	14-JUN-93
Target dates:		Target Committee:	08-JUN-93
To case officer	26-APR-93	Report deadline:	25-MAY-93
Inspected by	03-MAY-93		
Extra contacts	10-MAY-93	Case Officer:	
Report if not clear by 24-MAY-93		*P J UDY*	

DEVELOPMENT/CONSTRAINTS

Size:
Category:
Listed building: Other Constraints: FP
Conservation Area:

CONSULTATIONS CARRIED OUT

		Sent	Expiry
L.C.C - No objections for CS		26/4/93	
Clerk to Crowland PC	0733 210653	26-APR-93	10-MAY-93
Cllr B Alcock	0733 210560	26-APR-93	03-MAY-93
Cllr N H Pepper	Peterborough 21	26-APR-93	03-MAY-93

SITE RECORD

Grid ref: 522650 309630
OS Sheet: 380 391 Parcel:

PLANNING AMENDMENT

For office use only

Application No. H02/0349/93

Date registered 25 MAY 1993

Case Officer PSJ

1. Please complete in block letters

NAME AND ADDRESS OF APPLICANT

EME

Tel. No.

NAME AND ADDRESS OF AGENT
(if form completed by agent)

Tel. No. (Contact)

Please complete in block letters

FULL POSTAL ADDRESS OF THE APPLICATION SITE

Please complete

EARLIER APPLICATION No.

This application **cannot be considered** unless the relevant reference is stated

LATE OBS: Offr..... Date.....

Salient points .....

Building Regulation reference relating to same development.

2. Please tick **one** box only

Amendment is proposed where permission already granted
If yes, submit two forms and two plans

A. ☐

or

Amendment is to a proposal currently being considered
If yes, submit four forms and four plans.
State whether amendment has been requested by the Council

B. ☐ ☐

Has a similar amendment been submitted under Building Regulations? Yes / No

Please complete

I attach the necessary plans and request that the changes described below be accepted as an amendment. I understand that the Council may require a fresh application, together with fee if appropriate.

Signed ..... Date .....

3. Please complete in block letters

FULL DESCRIPTION OF DEVELOPMENT IN ORIGINAL APPLICATION

As NOW PROPOSED, if different

State details of amendments proposed

(Give a full detailed list of the changes, and also mark these clearly on the accompanying plans)

State drawing no's of the current submission

State Officer dealing with the application, if known.

Describe any part of the original development which is excluded by virtue of the amendment, and state any alteration to plot numbers

BRIAN ITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

S.H.D.C. PLANNING DEPT.
RECEIVED
21 MAY 1993

Attention of	File Nos.
DPO NRM DOPO BS JC ACP	
Action by ..... Discuss with ..... Copy to.....	Acknowledge YES/NO by date

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H02/0349/93

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Agent: East Midlands Electricity p
Sleaford Road
Boston
Lincs
PE21 8BR

Description: Proposed 11,000 volt overhead line

Location: Parishes of Crowland and Newborough

Type: ELECTRICITY

Date received: 19-APR-93

11-MAY-93

Dear Sir/Madam

CONSULTATION WITH PARISH COUNCIL

I have received an application for the above proposal and enclose a copy for your information. Any observations which the Parish Council wish to make should be set out below and returned to me by 25-MAY-93. If no observations have been received by that date, it will be assumed that the Parish Council have no comments to make. The officer dealing with this application is P J UDY

Yours faithfully
B SMITH
Director of Planning and Building Control Services

Clerk to Crowland PC
10 Beccelm Drive
Crowland
Peterborough
PE6 0AG

FOR PARISH COUNCIL USE ONLY

Comments:

Support the undergrounding adjacent to Corporation Bank - but question why still 2 powe lines almost parallel between this bank and the Swimming pool.

Signed:

20/5/93

BRI. SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

S.H.D.C. PLANNING DEPT.
RECEIVED
10 MAY 1993
PJ
SUPERSEDED

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H02/0349/93

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8BR

Agent: East Midlands Electricity p
Sleaford Road
Boston
Lincs
PE21 8BR

Description: Proposed 11,000 volt overhead line

Location: Parishes of Crowland and Newborough

Type: ELECTRICITY

Date received: 19-APR-93

26-APR-93

Dear Sir/Madam

CONSULTATION WITH PARISH COUNCIL

I have received an application for the above proposal and enclose a copy for your information. Any observations which the Parish Council wish to make should be set out below and returned to me by 10-MAY-93. If no observations have been received by that date, it will be assumed that the Parish Council have no comments to make. The officer dealing with this application is P J UDY

Yours faithfully
B SMITH
Director of Planning and Building Control Services

Clerk to Crowland PC
10 Beccelm Drive
Crowland
Peterborough
PE6 0AG

FOR PARISH COUNCIL USE ONLY

Comments:

1. At the Northern end of the proposed route (Crowland West Bank) we object to the two lines running ~~along~~ almost parallel. This will cause major inconvenience to farmers and spoil the view from Crowland West Bank.


~~2. It is also important that~~

2. We are also very concerned about the run next to Roslark bank. This will ruin the outlook from this much used track. Why cannot this run be underground.

~~Signed:~~

Jane C Fuller
6/5/93

14th May 1993

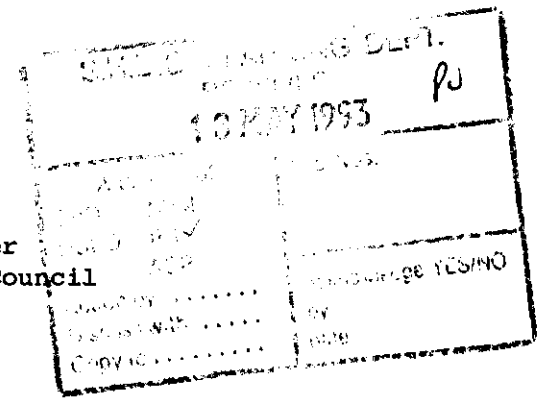

NRA

National Rivers Authority
Anglian Region

B Smith Esq
District Planning Officer
South Holland District Council
Council Offices
Priory Road
SPALDING
Lincolnshire
PE11 2XE

Our Ref: 93/1/SH/0121
Contact: GILL THORNALLEY

Dear Sir,

Planning Application No. H02/0349/93

PROPOSAL: PROPOSED 11,000 VOLT OVERHEAD LINE
LOCATION: CROWLAND & NEWBOROUGH CROWLAND
APPLICANT: EAST MIDLANDS ELECTRICITY PLC

I refer to your consultation received on 19th April 1993.

This Authority has no objection to the proposed development, as submitted.

The following planning informatives should be attached to any planning permission granted:-

Planning Informatives

Under the terms of the Water Resources Act 1991 and the Land Drainage Byelaws, the prior written consent of the NRA is required for any proposed works or structures in, under, over or within 9m byelaw distance of the main river Welland.

Advice to Applicant

The River Welland is a major flyway for water foul, especially swan and EME plc should consider the placing of cables in thrustbore below the river, to prevent obstruction and hazard in the flyway. Where this is not possible overhead cables should cross near bridges or areas where waterfowl give a wide berth. In any event bird flight indicators should be placed on overhead cables.

Warning signs should also be erected adjacent to overhead cable crossings to

contd ...

GRAINGER DAVIES, B.Sc.,
C.Eng., F.I.C.E., F.I.W.E.M.
Regional General Manager

Northern Area
Aqua House
Harvey Street
Lincoln
LN1 1TF
Tel: (0522) 513100
Telefax: (0522) 512927

NRA

warn water users of overhead hazards.

Power cables should not run within 30m of open water to avoid hazard to fishermen as recommended by the National Federation of Anglers.

Yours faithfully

R Morgan
Planning Engineer

PLANNING AMENDMENT

For office use only

Application No. HO3/1349/93

Date registered 05 MAY 1993

Case Officer PV

1. Please complete in block letters **NAME AND ADDRESS OF APPLICANT**	**NAME AND ADDRESS OF AGENT** (f form completed by agent)
Tel. No.	Tel. No. (Contact)
Please complete in block letters **FULL POSTAL ADDRESS OF THE APPLICATION SITE**	
Please complete **EARLIER APPLICATION No.** This application **cannot be considered** unless the relevant reference is stated	
Building Regulation reference relating to same development.	

2. Please tick **one** box only

A. Amendment is proposed where permission already granted ☐
If yes, submit two forms and two plans

or

B. Amendment is to a proposal currently being considered ☐
If yes, submit four forms and four plans.
State whether amendment has been requested by the Council ☐

Has a similar amendment been submitted under Building Regulations? Yes / No

Please complete

I attach the necessary plans and request that the changes described below be accepted as an amendment. I understand that the Council may require a fresh application, together with fee if appropriate.

Signed ..... Date .....

3. Please complete in block letters **FULL DESCRIPTION OF DEVELOPMENT IN ORIGINAL APPLICATION**	
As **NOW PROPOSED**, if different	
State details of amendments proposed (Give a full detailed list of the changes, and also mark these clearly on the accompanying plans)	
State drawing no's of the current submission	
State Officer dealing with the application, if known.	
Describe any part of the original development which is excluded by virtue of the amendment, and state any alteration to plot numbers	

H02/0849/93

APR 1993

Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a naminal voltage of less than 132 kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT

Name: East Midlands Electricity plc

Address: Sleaford Road
BOSTON
Lincs

Postcode: PE21 8BR

Telephone Number: 0205 365181

PART I

East Midlands Electricity plc Application Number EM122/21/95288 Date 19 April 1993

To the Chief Executive Planning Department

Council South Holland District Council
Priory Road
SPALDING, Lincs

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90) [Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of East Midlands Electricity plc.

OFFICE COPY

D. Tuley.

(D A TULEY)
Designation. Planning Engineer

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The District/Borough Council

(i) object on the grounds set out below/have no objection to make to the development described overleaf.*

(ii) request/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date Signed

*Delete as appropriate

Designation

On behalf of the District/Borough Council

(Reasons for objections)

PARTICULARS OF PROPOSED DEVELOPMENT AND REPRESENTATIONS

(To be completed by East Midlands Electricity plc)

Application is being made:

(a) for consent under section 37 of the Electricity Act 1989 to install or keep installed an electric line above ground;

(b) ~~for a direction under section 90(2) of the Town and Country Planning Act 1990 that planning permission for the proposed development be deemed to be granted;~~

1. Particulars of proposed development. (These particulars should be accompanied by such plans as may be necessary to enable the local planning authority to identify the land affected by the proposals and to appreciate the nature and extent of the proposed development and by a copy of the environment statement if the applicant has prepared one.)

To erect the proposed 11,000 volt overhead line in the parishes of Newborough and Crowland on wooden poles with a tolerance of 30m either side of the route shown on the attached plans.

2. Particulars of any representations of objections which have been made to East Midlands Electricity plc.

3. Particulars of the applicant's compliance with his duty under paragraph 1 of Schedule 9 to the Electricity Act 1989.

East Midlands Electricity plc consider that the proposed overhead line will not have any significant impact on the surrounding landscape, and that due regard has been paid to their obligations under Schedule 9.

Date 19 April 19 93 For and on behalf of East Midlands Electricity plc.

Signed D. Tuley. (D A Tuley) Designation Planning Engineer

Note: *This Part to be completed, dated and signed before submitting to the local planning authority.*

East Midlands Electricity plc Application Number EM122/21/95288

(Application dated 19 April 1993)

PART II--INFORMATION AND OBSERVATION


(To be completed by the District/Borough Council)

Planning Reference Number H02/0349/93

1. Names of interested parties consulted about the proposals with details of any observations received.

2. Particulars of any representations which have been made to the local planning authority objecting to the proposals.

3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?

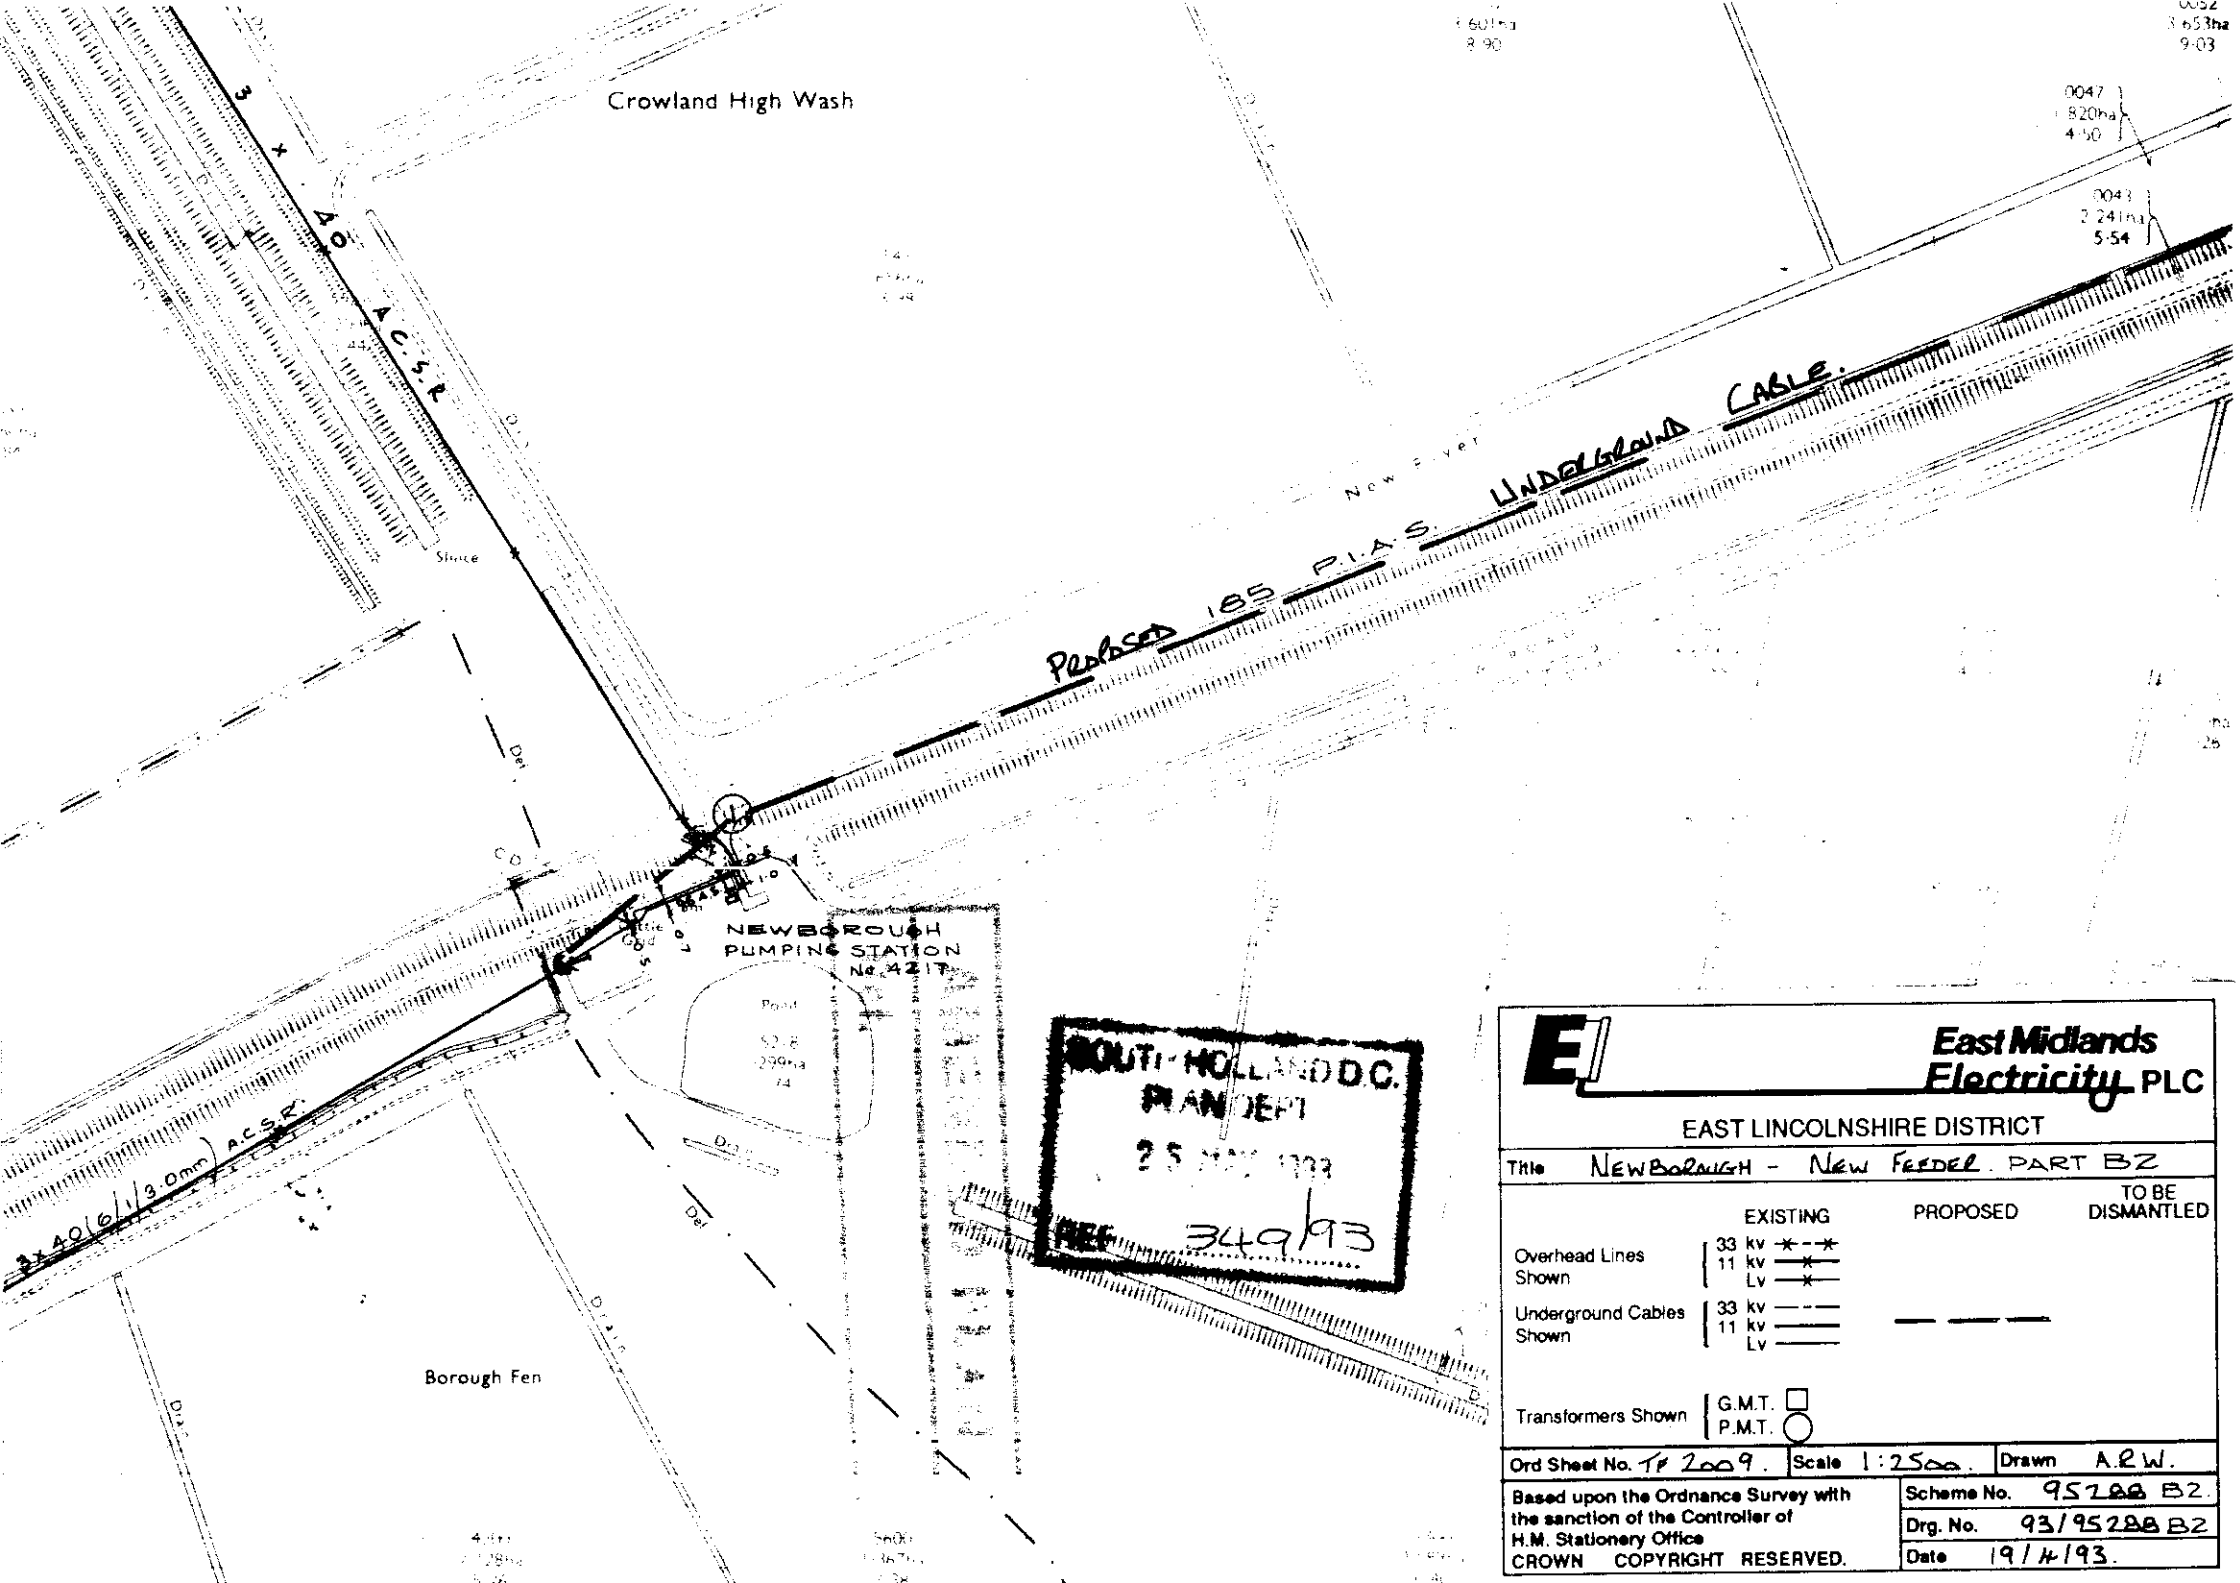

East Midlands Electricity PLC

EAST LINCOLNSHIRE DISTRICT


Title NEWBOROUGH - NEW FEEDER. PART B2

	EXISTING	PROPOSED	TO BE DISMANTLED
Overhead Lines Shown	33 kv, 11 kv, Lv		
Underground Cables Shown	33 kv, 11 kv, Lv	— — —	
Transformers Shown	G.M.T. □ P.M.T. ○		

Ord Sheet No. TF 2009. Scale 1:2500. Drawn A.R.W.

Based upon the Ordnance Survey with the sanction of the Controller of H.M. Stationery Office
CROWN COPYRIGHT RESERVED.

Scheme No. 95288 B2.
Drg. No. 93/95288 B2
Date 19/4/93.

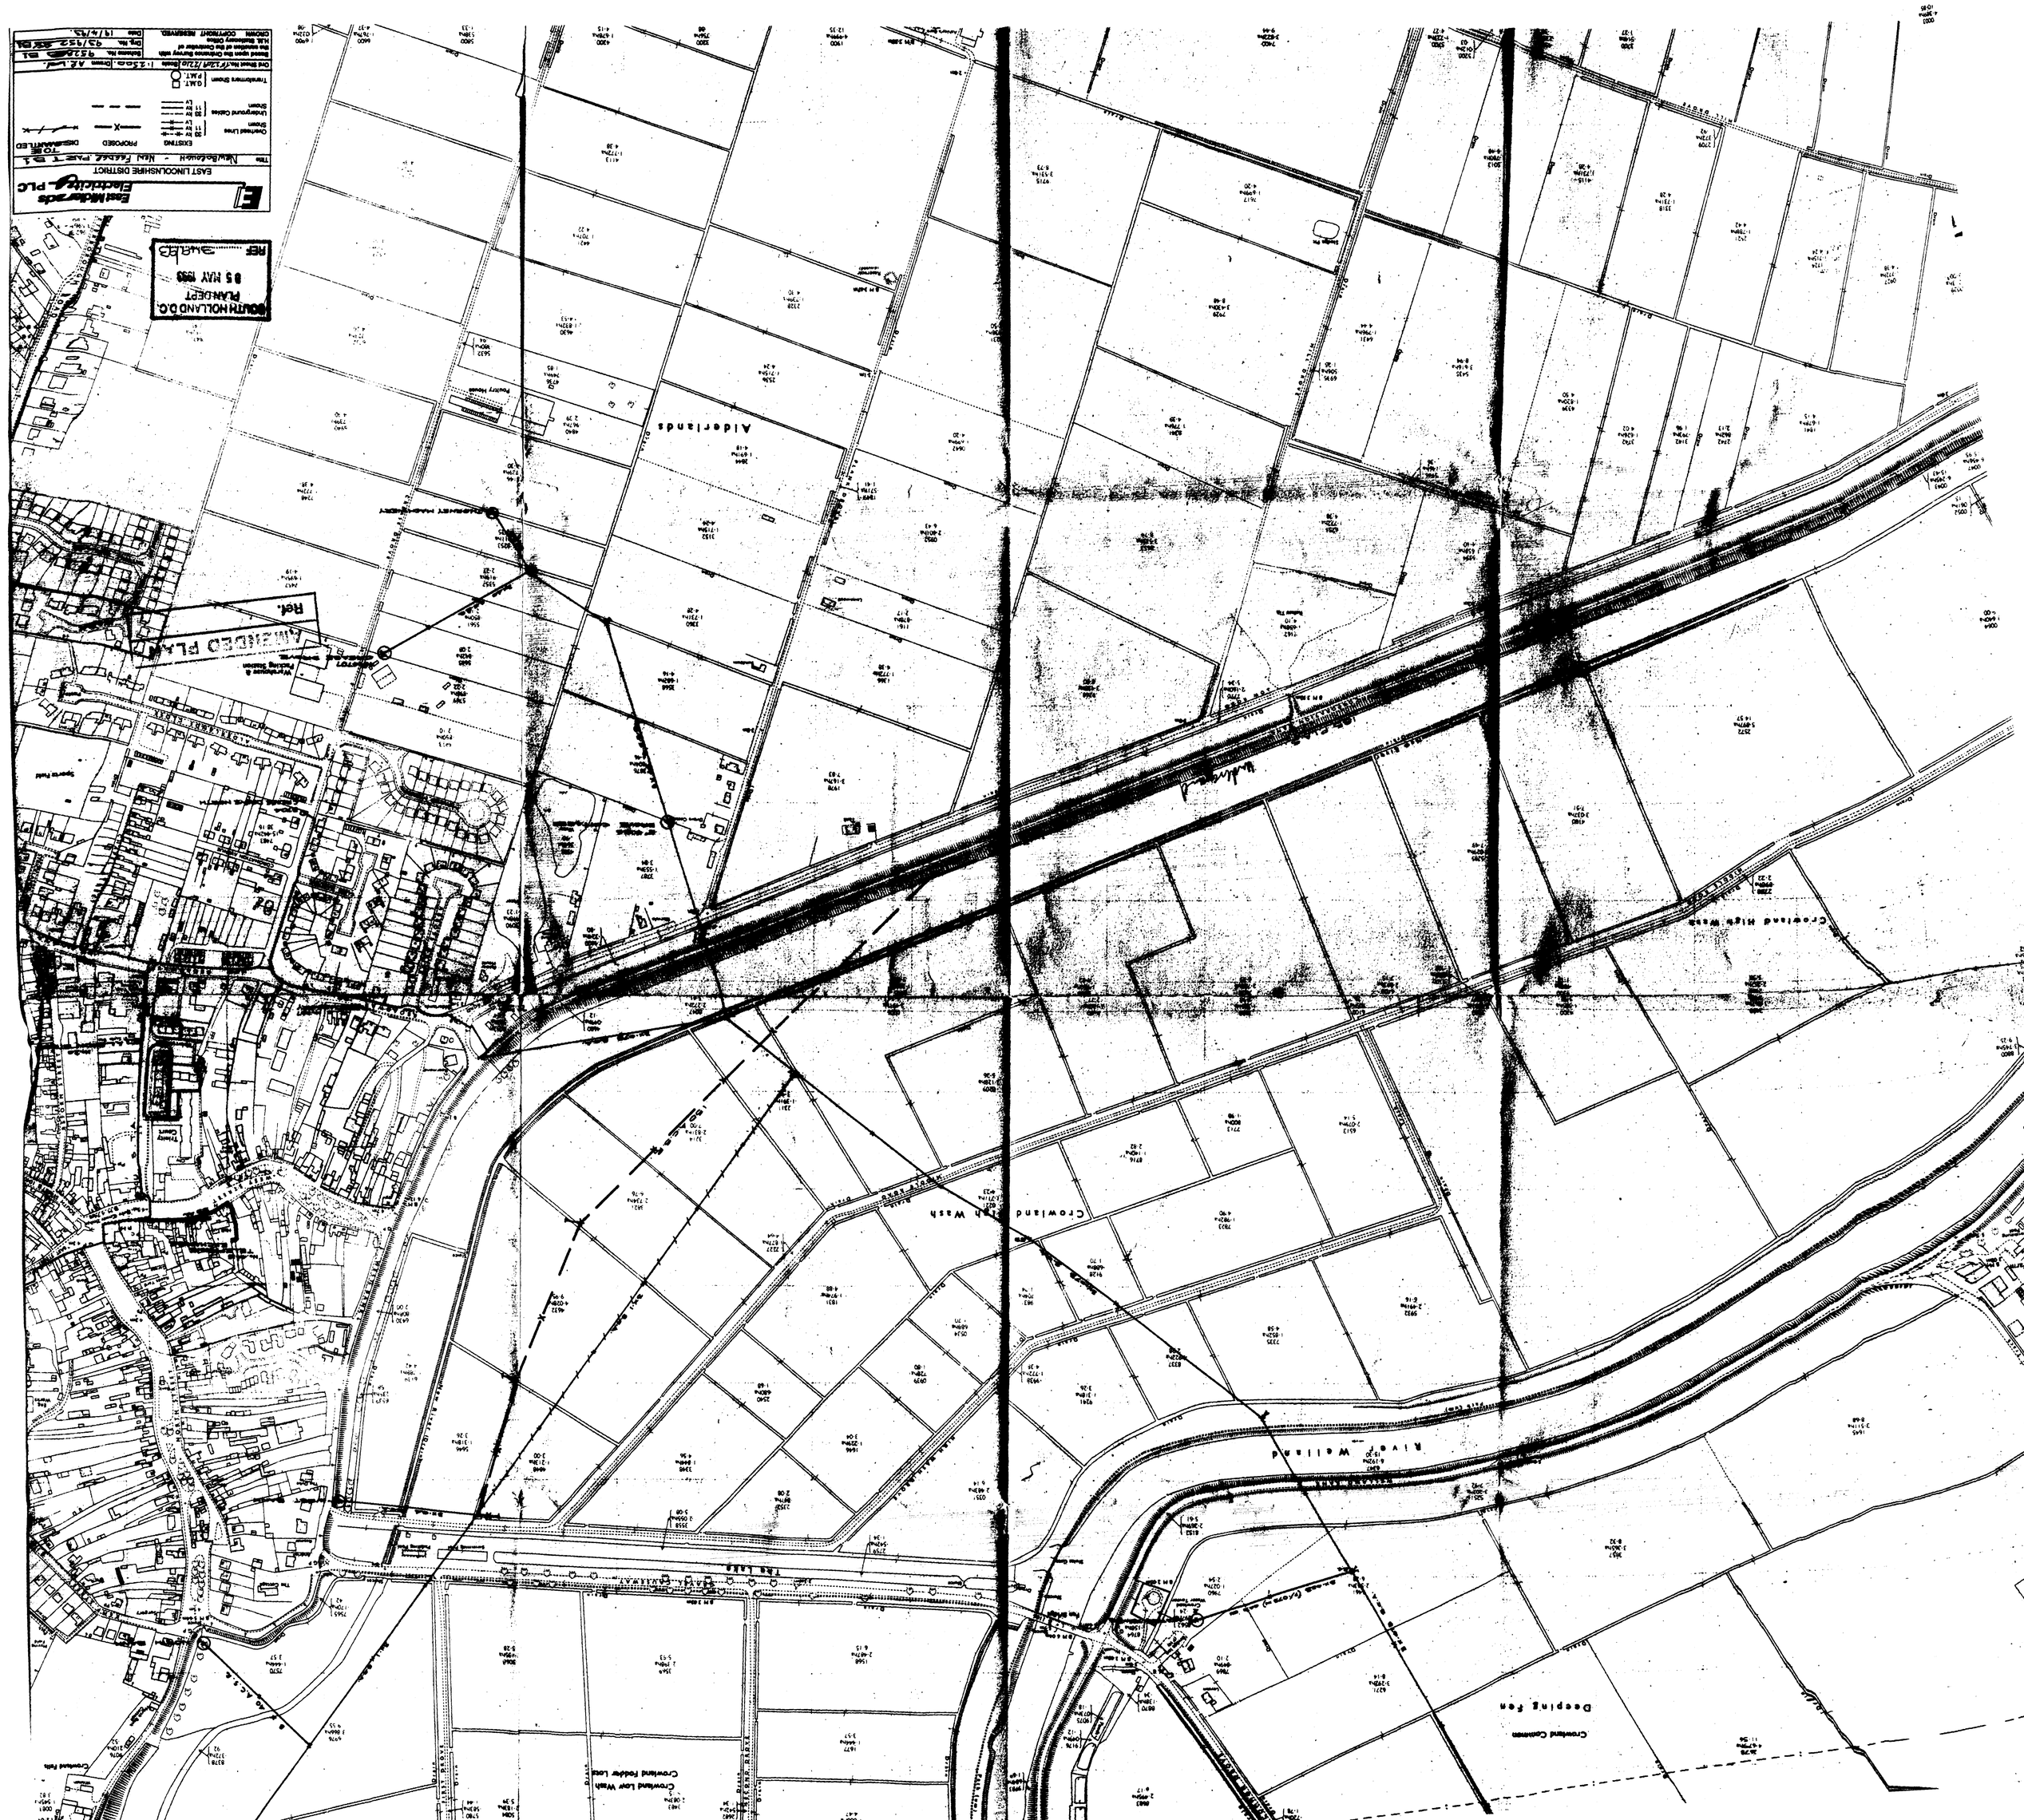
SOUTH HOLLAND D.C.
PLANNING DEPT
8 MAY 1990
Rec'd
Alderlands
Crowland High Wash
Crowland Low Wash
Crowland Fodder Lots
Crowland Common
Deeping Fen
River Welland
Crowland Abbey
Crowland Bridge
Crowland Station
Crowland Cemetery
Crowland Sewage Works
Crowland Sewage Farm
Crowland Sewage Farm
Crowland Sewage Farm