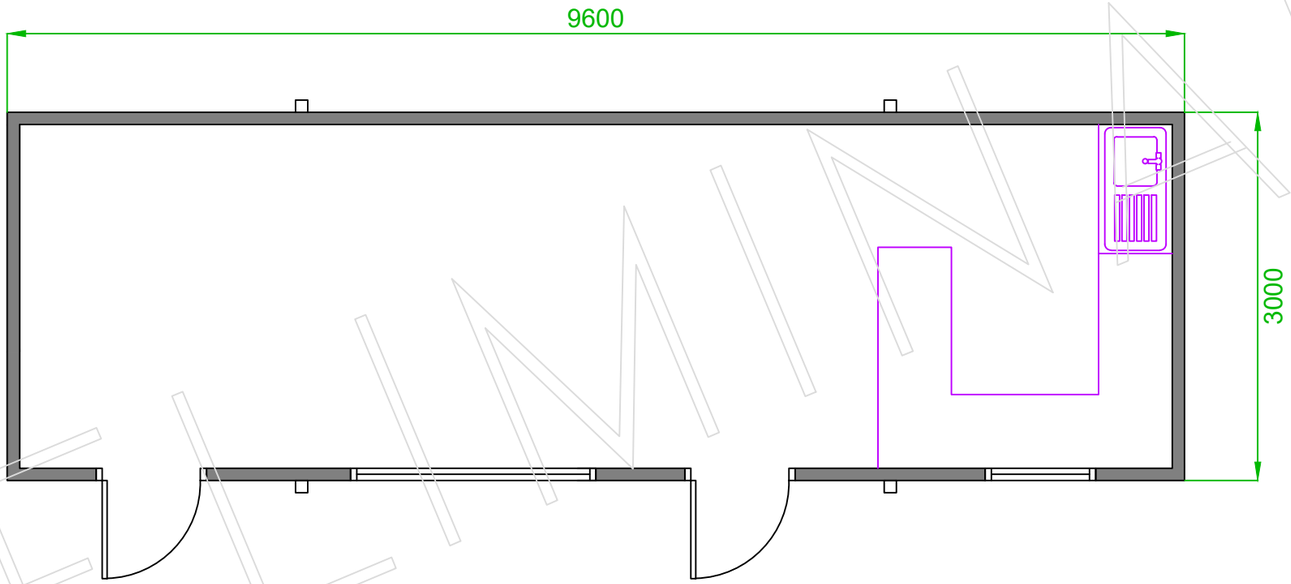


PRELIMINARY

DO NOT SCALE FROM THIS DRAWING. IF IN DOUBT, PLEASE ASK

Electrical Key:

1500 - 1500 Batten | 1500 DIFFUSER - 1500 Diffuser | - 1500 Single Cat2 | - 1500 Double Cat2 | DH - Dome Light | - Outside Light | EM - Emergency Lighting | PIR - PIR Sensor | - Light Switch | - Pull Cord | - Double Socket (450mm AFFL) | - Double Socket (1100mm AFFL) | - Consumer Unit | - Mains Incoming

- 2kw Convector Heater | - 2kw Downflow Heater | - Low Level Fuse Spur (450mm AFFL) | - Medium Level Fuse Spur (1100mm AFFL) | - High Level Fuse Spur (2100mm AFFL) | AC - Air Conditioning | - Rotary Isolator | - Extractor Fan | - Single Data Point | - Double Data Point | D - Disabled Alarm Reset+Sounder | - Trunking

Customer Signature:

Date:

Crowland Bowls

Proposed Layout

Building Description:	Date:	Scale:	Drawing Number:	Rev:	Drawn By:	Checked By:
32X10 CABIN	03 / 07 / 2024	1:50 @ A3	CGB - 10503-001	B	CH	-

Rev:	Description:	Date:

Rev: B