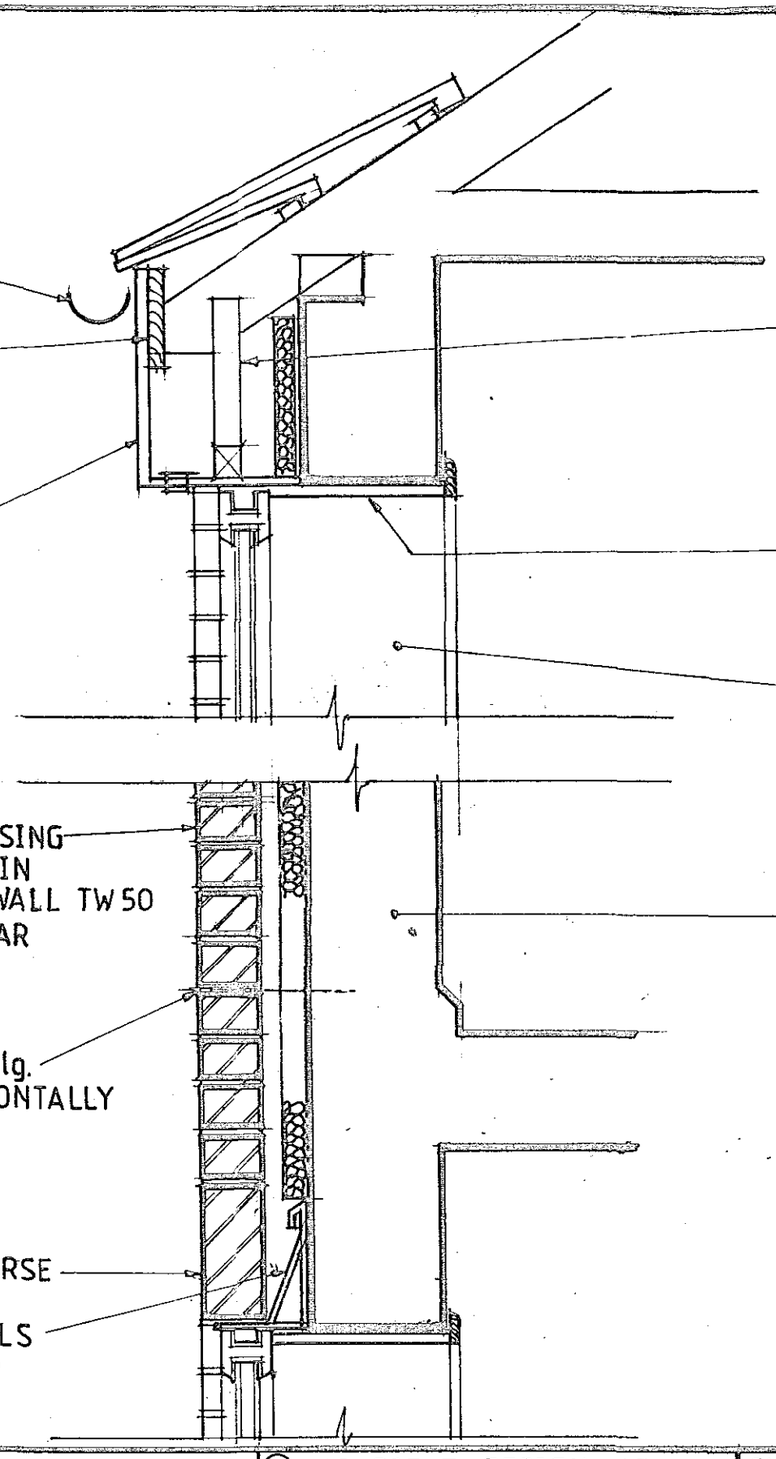


NEW PVCU RAINWATER GUTTERS AND 68mm dia. RWP's THROUGHOUT

FIX 150 × 25mm S.W. BATTEN TO ENDS OF RAFTERS.

EXISTING S.W. FASCIAS, SOFFIT AND R.W. GOODS TO BE REMOVED. REPLACE WITH PROCELL PVC FASCIA AND SOFFIT INCLUDDING SOFFIT VENTILATOR AS PER SPECIFICATION.

NEW BRICK OVERCLADDING COMPRISING 105mm FACING BRICK OUTER SKIN 75mm CAVITY WITH 50mm THERMAWALL TW50 INSULATION, MAINTAIN 25mm CLEAR CAVITY.

HARDO S.S. CAVITY TIES 210mm lg. TO BS 1243 at 900mm c/s HORIZONTALLY AND 450mm c/s VERTICALLY, STAGGERED 225mm c/s AROUND OPENINGS.

BRICK STRETCHER / SOLDIER COURSE

CATNIC CN30 OR CN31 LINTOLS (SEE SPECIFICATION) WITH 2 Nº WEEPHOLES PER LINTOL.

50mm × 50mm S.W. HANGER

12mm MDF BOARDING TO WINDOW HEAD PRIMED, UNDERCOATED AND GLOSSED.

DITTO TO WINDOW REVEAL.

REPAIRS AND SILICATE TREATMENTS TO BE CARRIED OUT BY SPECIALIST SUBCONTRACTOR AS DIRECTED BY THE CONSULTING ENGINEER.

SHDC
Planning & Development
2 3 JUN 2004
Ref: 0842/04

DETERMINED PLAN

PRC ADVISORY SERVICES LTD.

© COPYRIGHT DESIGN OF PRC ADVISORY SERVICES LTD. AND MUST NOT BE REPRODUCED IN WHOLE OR PART OR USED FOR ANY PURPOSE WITHOUT PERMISSION.

Client

scale

date
date

drawing title
EAVES / HEAD

job title
Wates House Brick Cladding Scheme

Sheet 07