



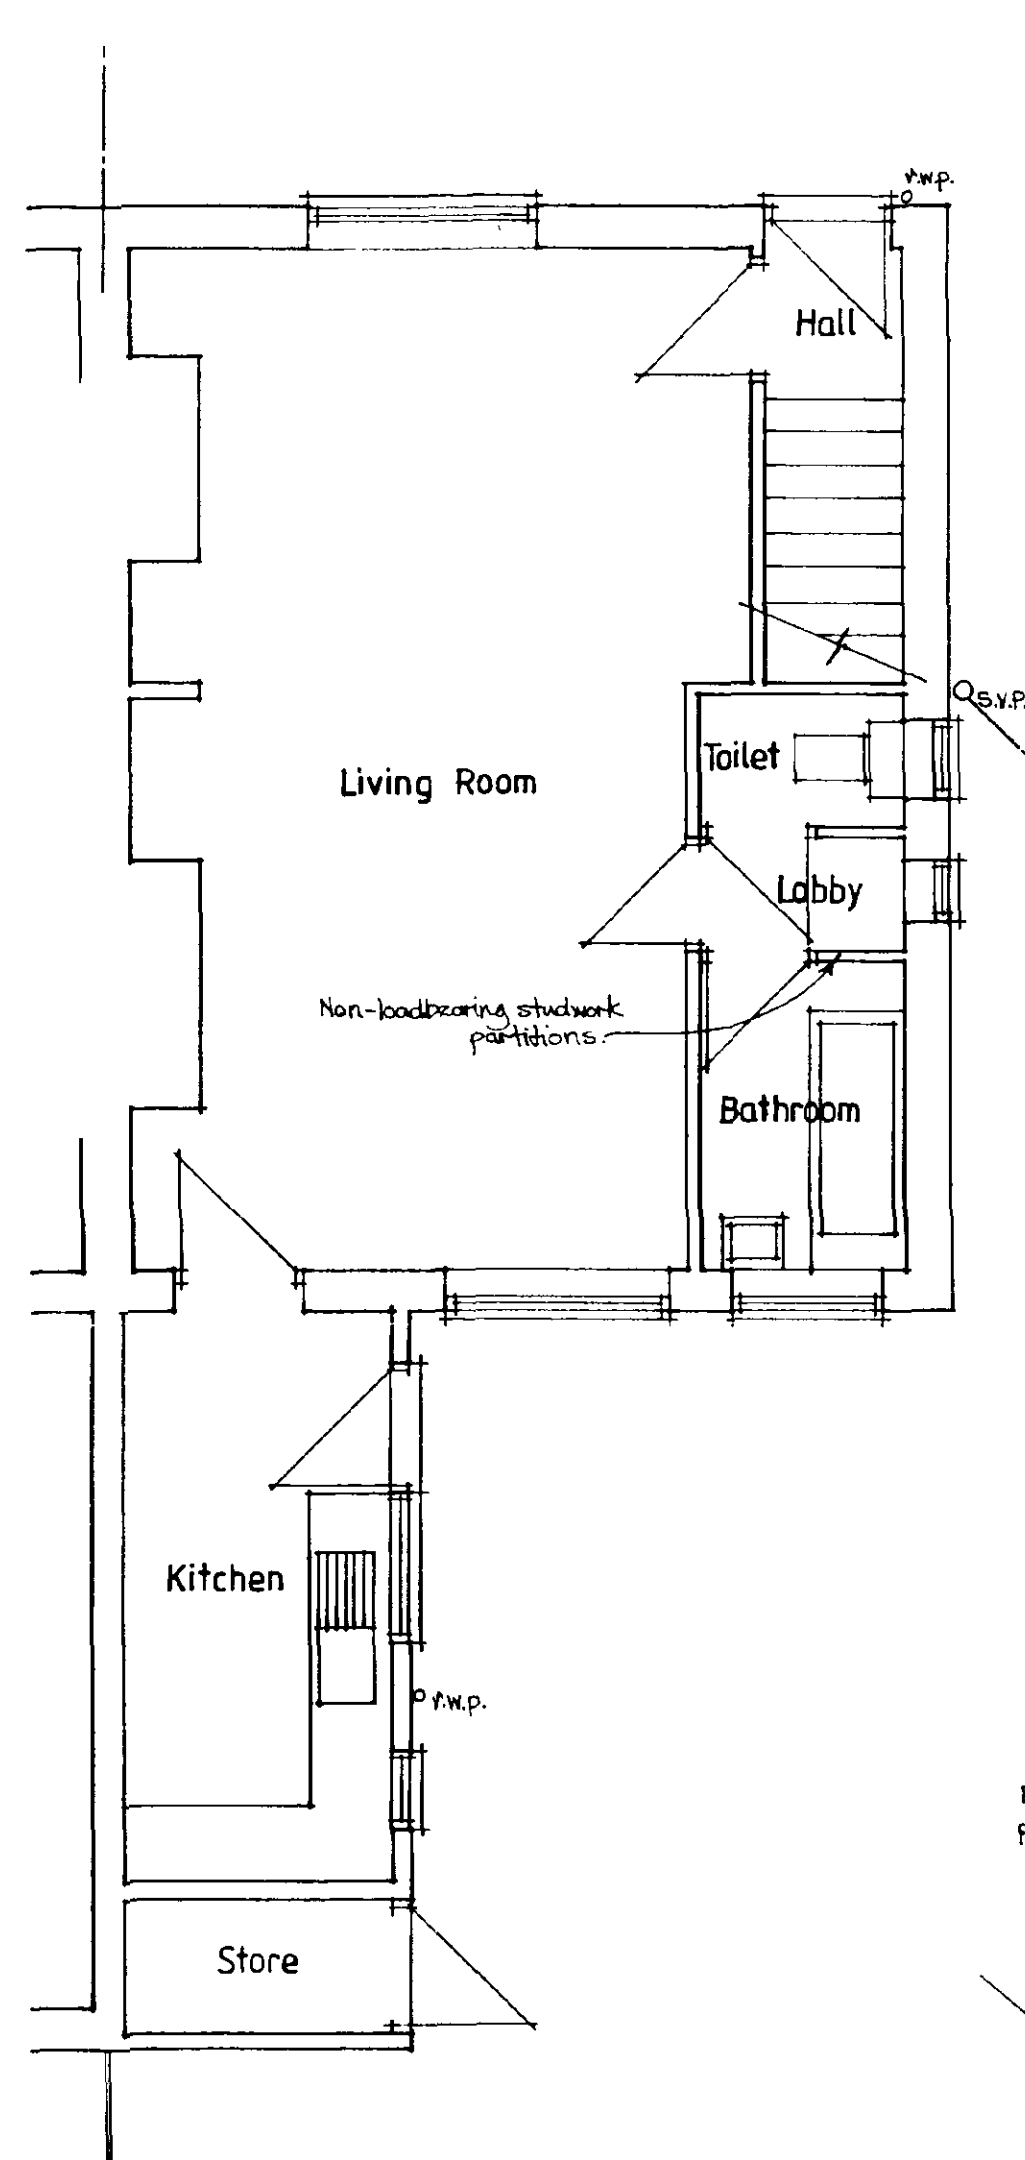

Ground Floor Plan

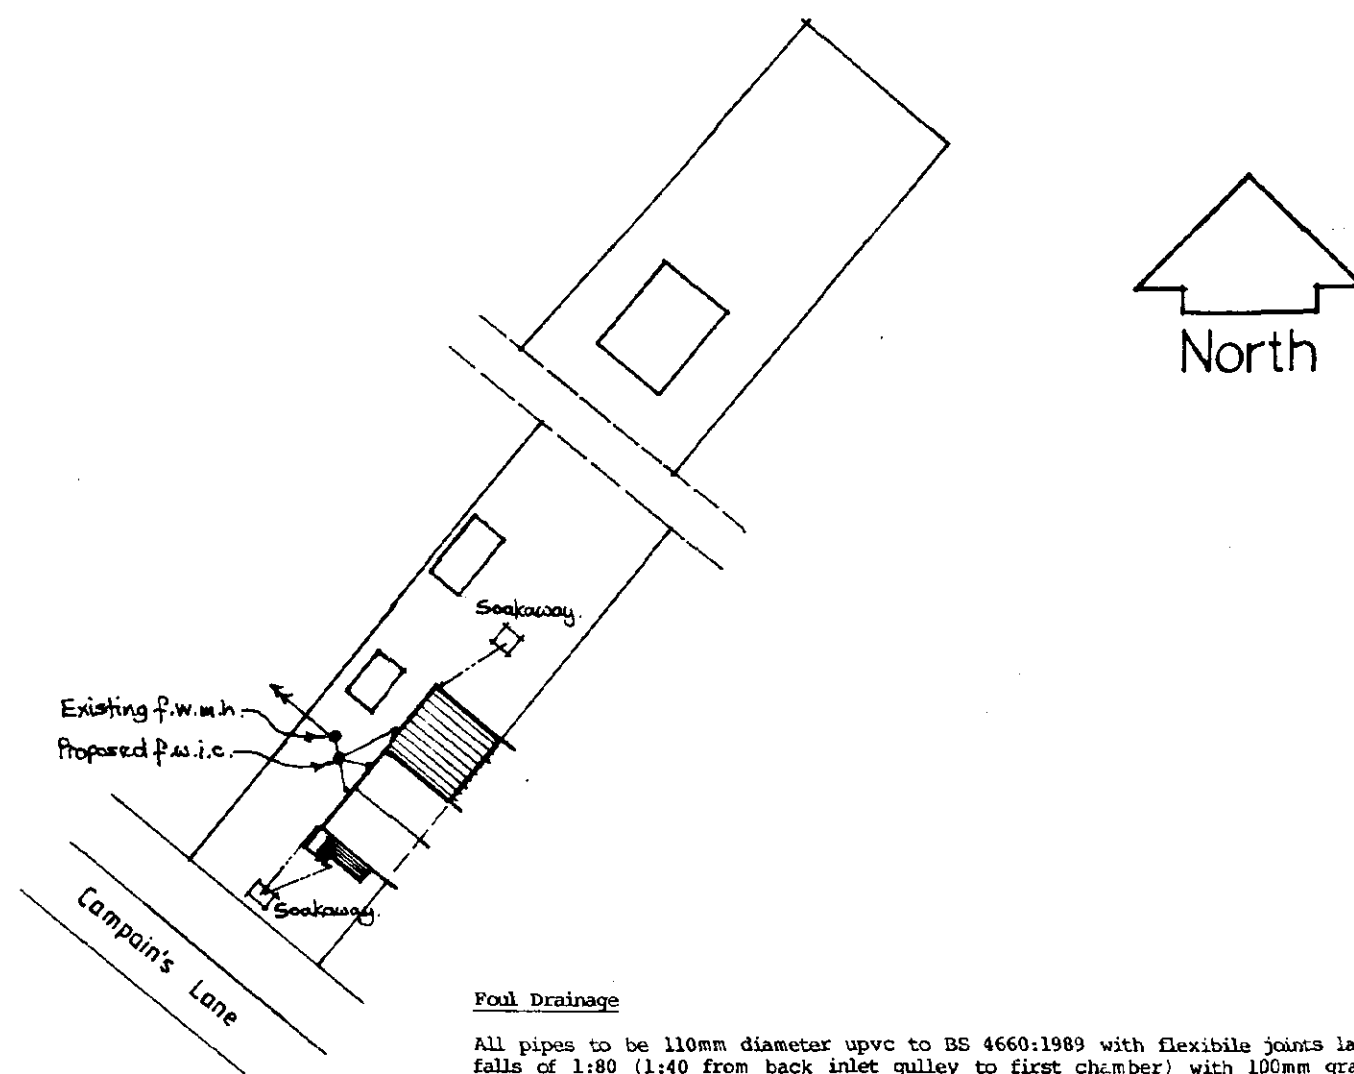

Site Plan
Scale 1:500

Poul Drainage

All pipes to be 110mm diameter upvc to BS 4660:1989 with flexible joints laid to falls of 1:80 (1:40 from back inlet gulley to first chamber) with 100mm granular bed and surround. Concrete paving slab cover to be provided when less than 600mm deep. Back inlet gulley to have rodding access. When pipes pass through foundations a 50mm gap is to be provided around pipe with concrete lintel over. Gap masked on both sides of wall with fibre cement sheet. Pipework under structure to have 100mm granular bed and surround and where the top of the pipe is within 300mm of the underside of the concrete slab the pipe is to be surrounded in concrete integral with the slab.


250mm diameter polypropylene access chamber, maximum 600mm deep, with stainless steel sealed cover and frame (Class C).

450mm diameter polypropylene inspection chamber, maximum 1000mm deep, with cast iron cover and frame (Class C).

Access chambers and inspection chambers to be fitted in accordance with manufacturers instructions.

Surface Water

100mm half round upvc gutter or similar and approved with 63mm diameter upvc down pipes to trapped gulleys with rodding access to 110mm diameter upvc pipes to BS 4660:1989 with flexible joints laid to falls of 1:80 and surrounded in 100mm pea gravel with concrete paving slab cover when less than 600mm deep. Soakaways 5.0m from any structure to be 1.5m cubed below inlet and filled with selected clean hardcore and covered with 1200 gauge polythene sheet and topsoil.

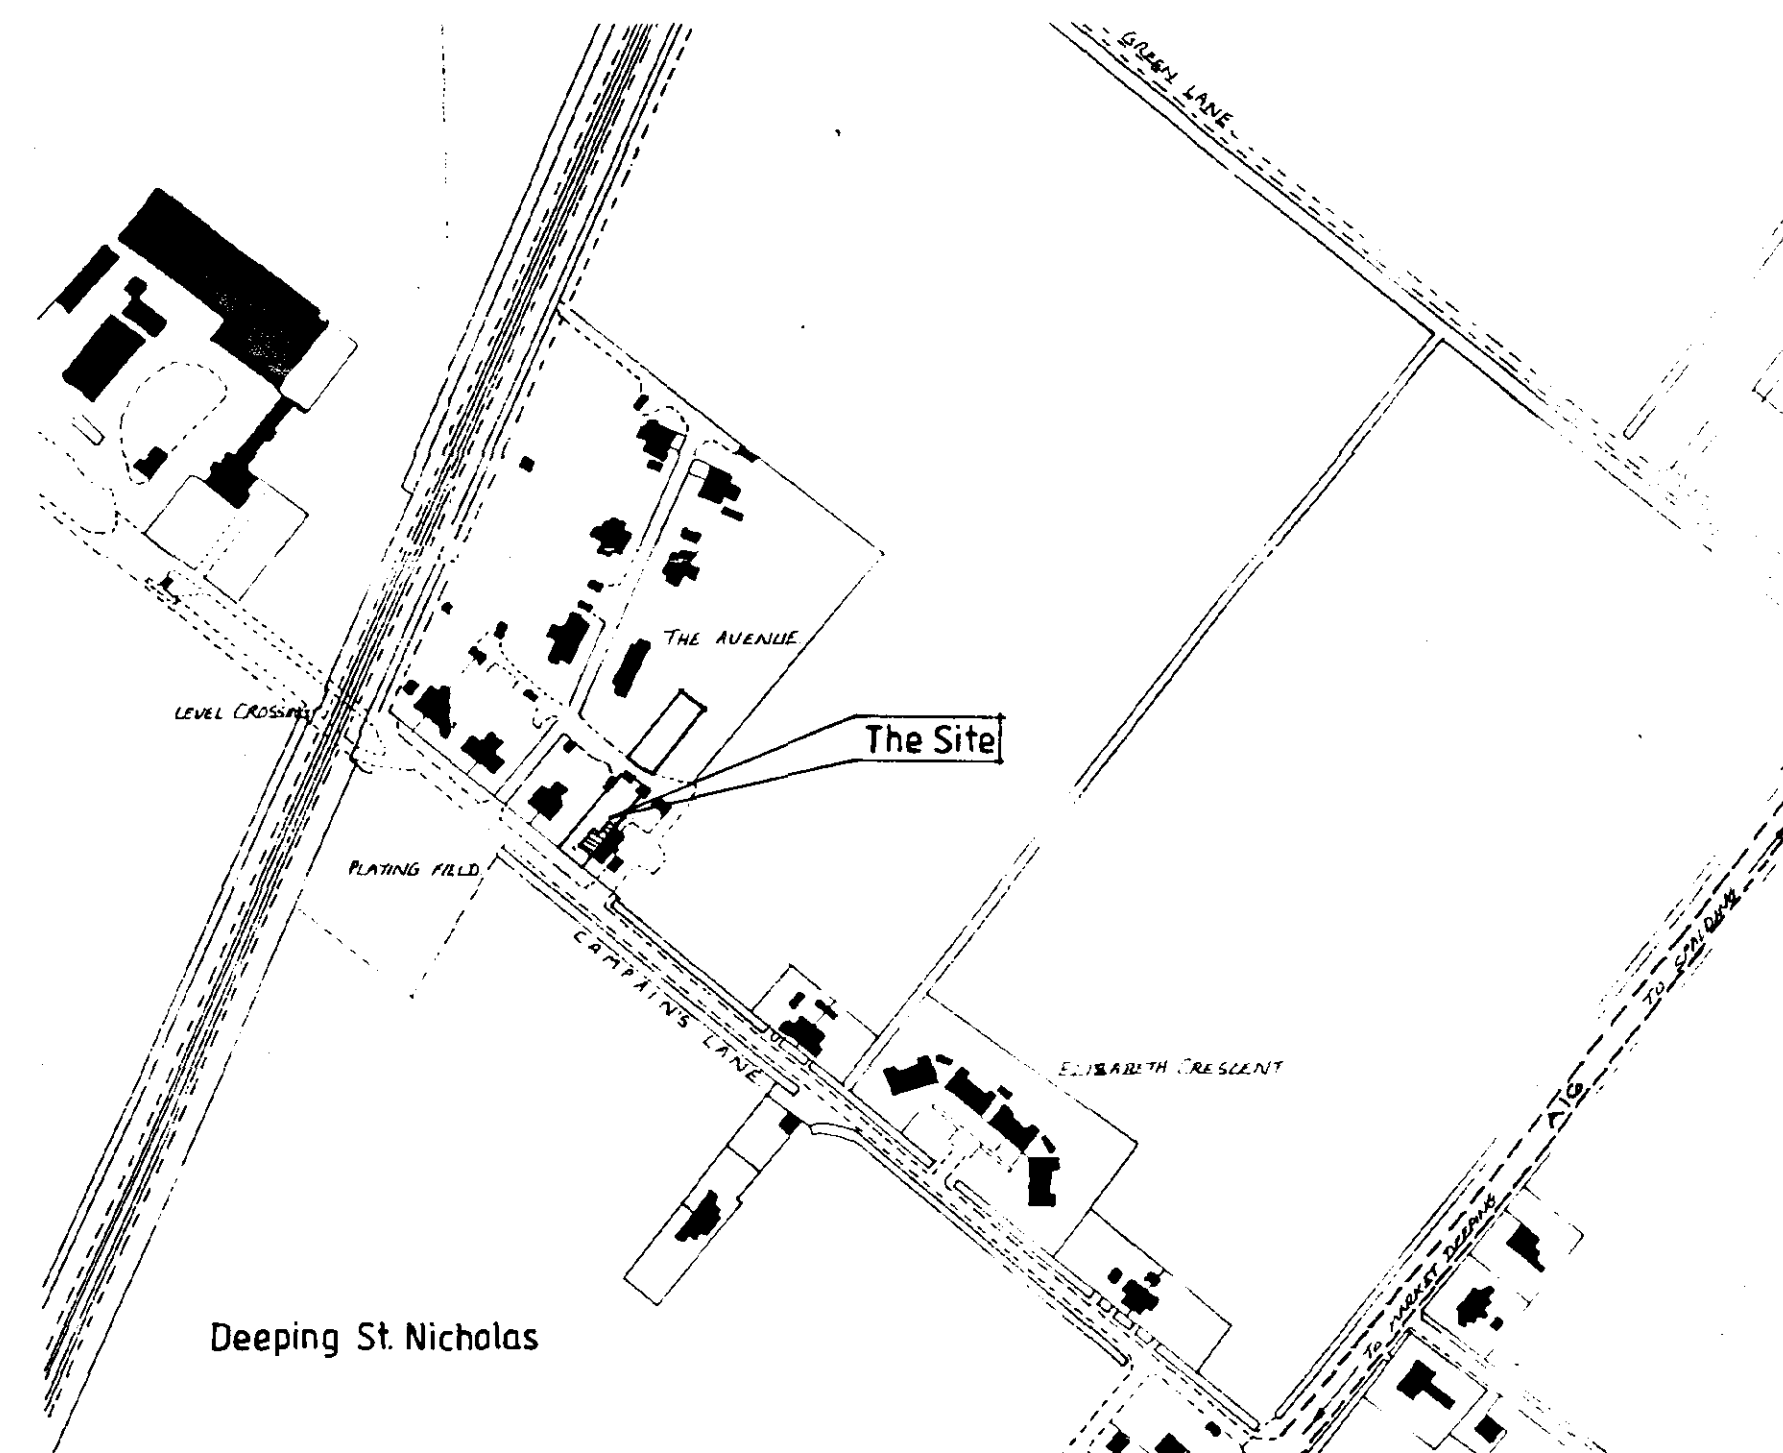

Location Plan
Scale 1:2500

General

All materials, fittings and workmanship must be to current British Standards and Agreement Certificates (where applicable) and used in accordance with all relevant Codes of Practice and manufacturers instructions. All components/products are to be fitted in a manner and location for which they are intended by the manufacturer. All work must be to the satisfaction of the Building Control Officer and supervising agent.

**DETERMINED
PLAN**

2001
0250121

Proposed Extension and Alterations 19 Campaign's Lane, Deeping St. Nicholas For Mr and Mrs M. Taylor	
EXISTING PLAN and ELEVATIONS	
1:100 1:50	RW:
February 2001	
005 01	