

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered.

Please note, this drawing is not a conveyance drawing.

Construction work to be carried out with due regard to the construction (Design and Management) Regulations 1994 (CDM) and the Health and Safety at work, etc. Act 1974 (HSW Act)

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.

Roof/Wall Abutments
Provide Code 4 lead flashings and lap over roof covering. Dress up wall a minimum of 150mm (stepped on pitched abutments) and provide d.p.c. cavity tray to make completely watertight.

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Soldier Coursing
Provide soldier course brickwork to all areas where shown on elevations.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Wall Construction
275mm cavity walls to consist of:
100mm face brickwork (see site plan for details),
75mm cavity to be filled with Crown Dritherm full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved,
100mm internal skin of Celcon standard blocks or similar approved to give 0.35 U/value. Cavity walls tied together using galvanised iron or plastic twist ties spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish.

Where door and window frames do not cloak DPC by 35mm minimum apply 22mm thick Gyproc thermal plasterboard to reveals to minimise cold bridging.

Habitable Room Trickle Ventilation
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

Kitchen/Utility/Bathroom/WC Trickle Ventilation
Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Utility Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 30 lt/sec. System to offer intermittent operation.

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.25 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Foul Water Drainage
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Surround pipes at wall abutments with 50mm compressible material. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs.

Inspection Chamber Construction
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Demolish existing single-storey outbuilding and porch shown dotted.

Build on new extension as shown.

External materials - bricks and roof tiles to match those of existing house.

Main utility/lobby/study floor to be laid level with existing house floor.

Roof pitch to match that of existing house.

Provide ½-hour fire resisting self-closing door between lobby and garage with 100mm step down into garage.

Internal garage walls to be as per main external insulated wall.

Roof overhang to match that of existing house roof. Fascias and soffits to match those of existing.

Make good to all disturbed and affected areas.

Garage Cavity Walls

275mm cavity walls of 100mm facing bricks, 75mm cavity and 100mm internal block skin.

Lintels

All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers' instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c.

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Sub-structure Walling

100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Foundations

As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing

All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved.

Brickwork below d.p.c. to be F.L. quality

Outlets from balanced flue boilers to be at least 300mm from any openings.

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

Boiler

Provide balanced flue type oil fired boiler of required rating in position indicated on drawing to be either a wall hung type or free standing on 125mm high concrete hearth above oversite. Boiler to have protective guard cover and to be minimum 600mm from any opening into the building. Read in conjunction with Approved Document J1/2/3.

Roof Construction

Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1983. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Ceilings


To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Garage Floor Construction


100mm concrete oversite on 1200 gauge polythene d.p.m. on minimum 150mm, maximum 600mm well blinded and compacted hardcore. If garage is integral to house finished floor level to be 100mm below that of house. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Ground Floor Construction

65mm sand/cement screed on proprietary 100 mm thick Jabilite floor insulation or 60mm Celotex with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

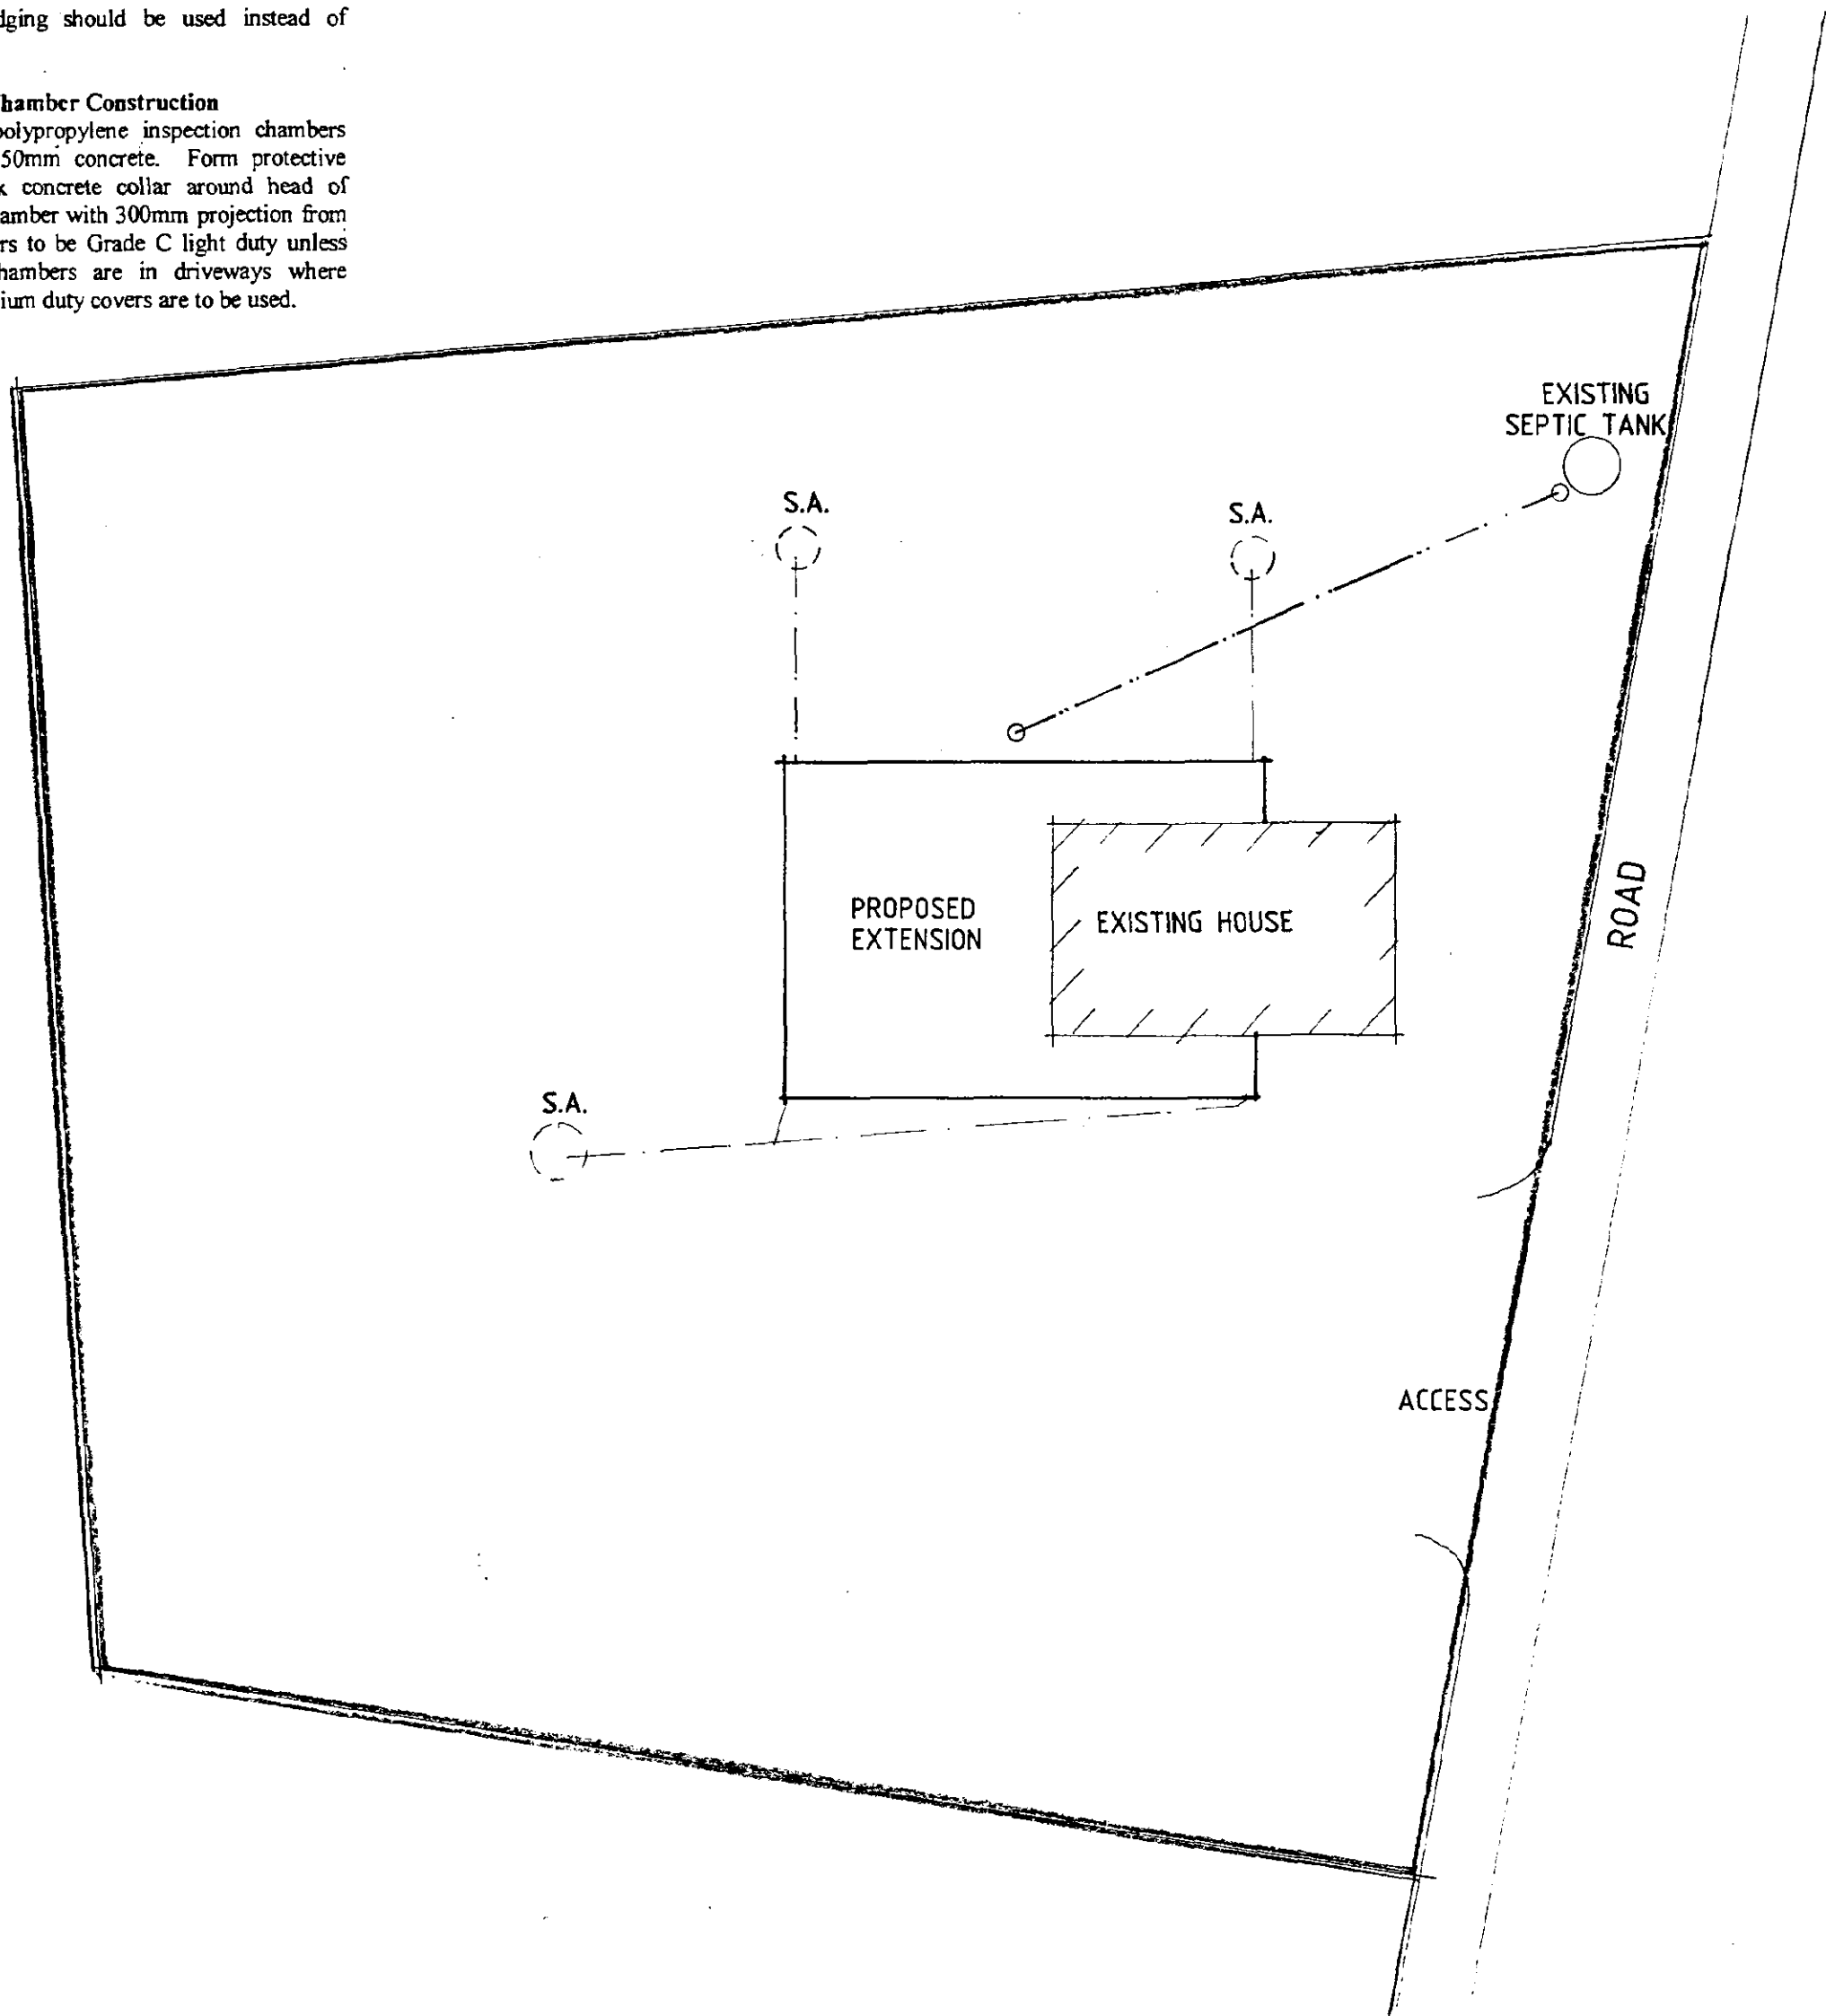

SITE PLAN

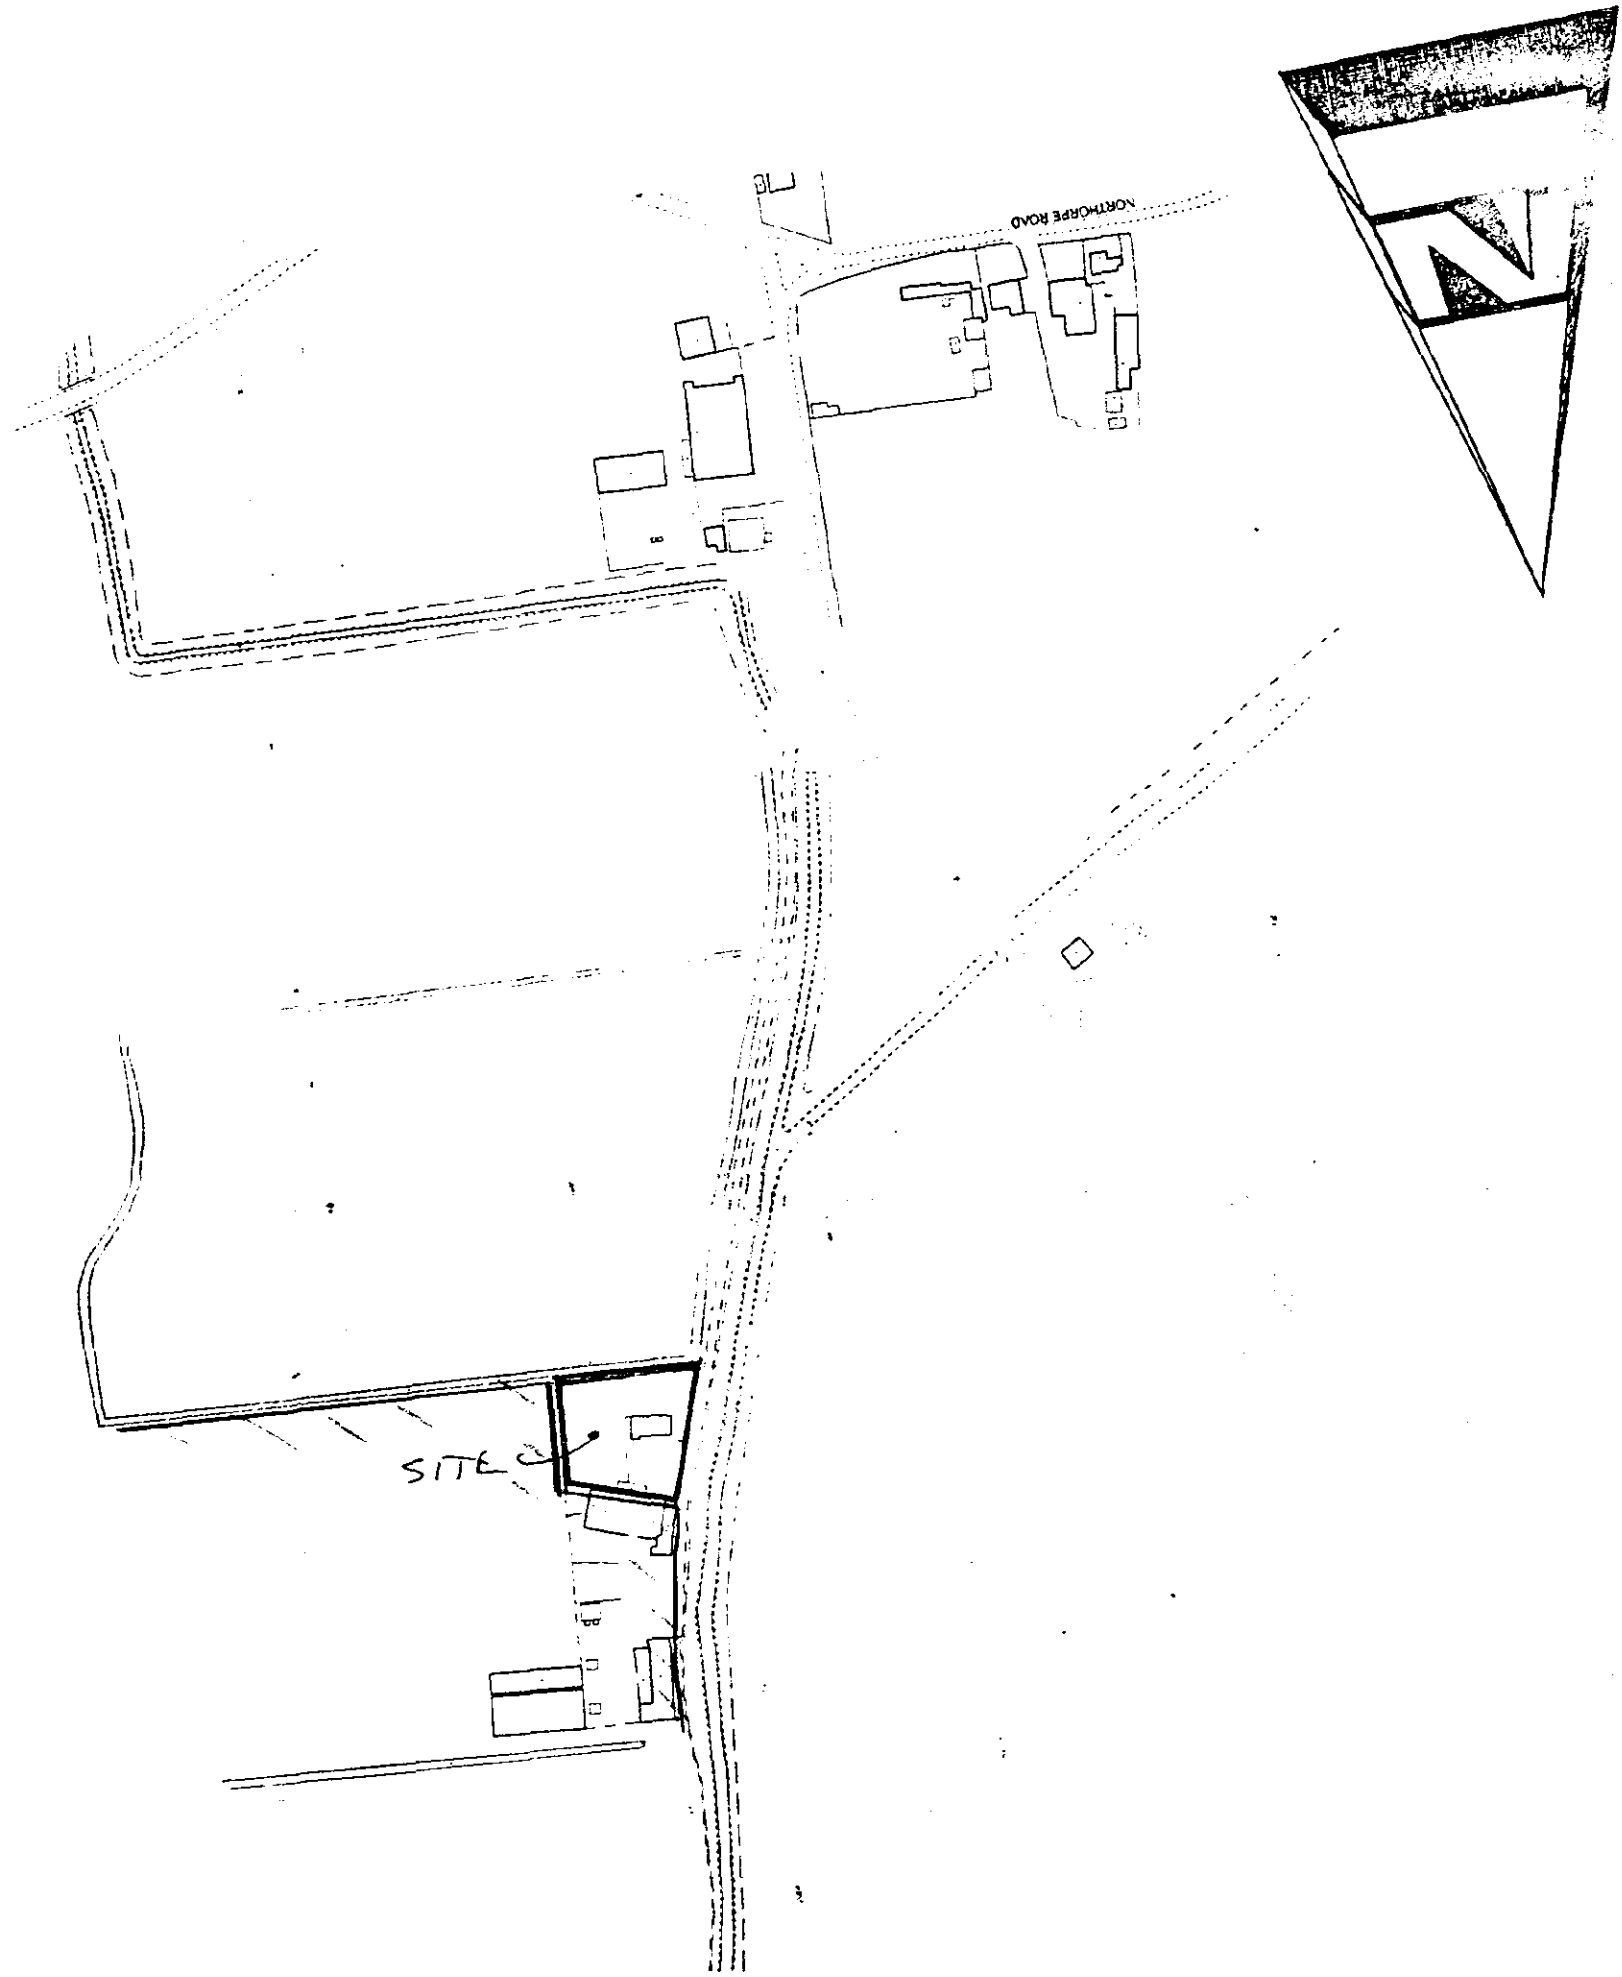

LOCATION PLAN

DESIGN **Status** CONSULTANTS IN ARCHITECTURE & PLANNING

DETERMINED PLAN

SHDC
Planning & Development
28 MAY 2002
Rel G24/02

PROPOSED EXTENSION TO
HOUSE AT BECK FARM,
NORTHORPE, DONINGTON FOR


MR. & MRS. P. LOVELL.

1:200 1:2500 SD02-001/2

MAY-02 B.GILHAM.

THIS DRG. TO BE READ IN CONJUNCTION WITH
SD02/001/1, STRUCTURAL DETAILS -REF - 846/1 & 2


2 Edinburgh Walk, Holbeach,
Spalding, Lincs PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702

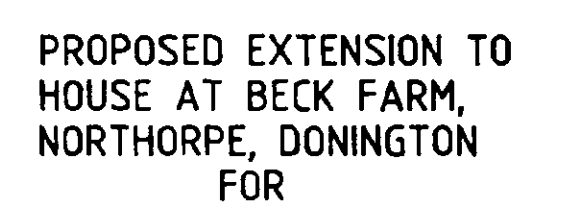

MR. & MRS. P. LOVELL.

1:50	1:100	SD02-001/1
MAY-02		B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702

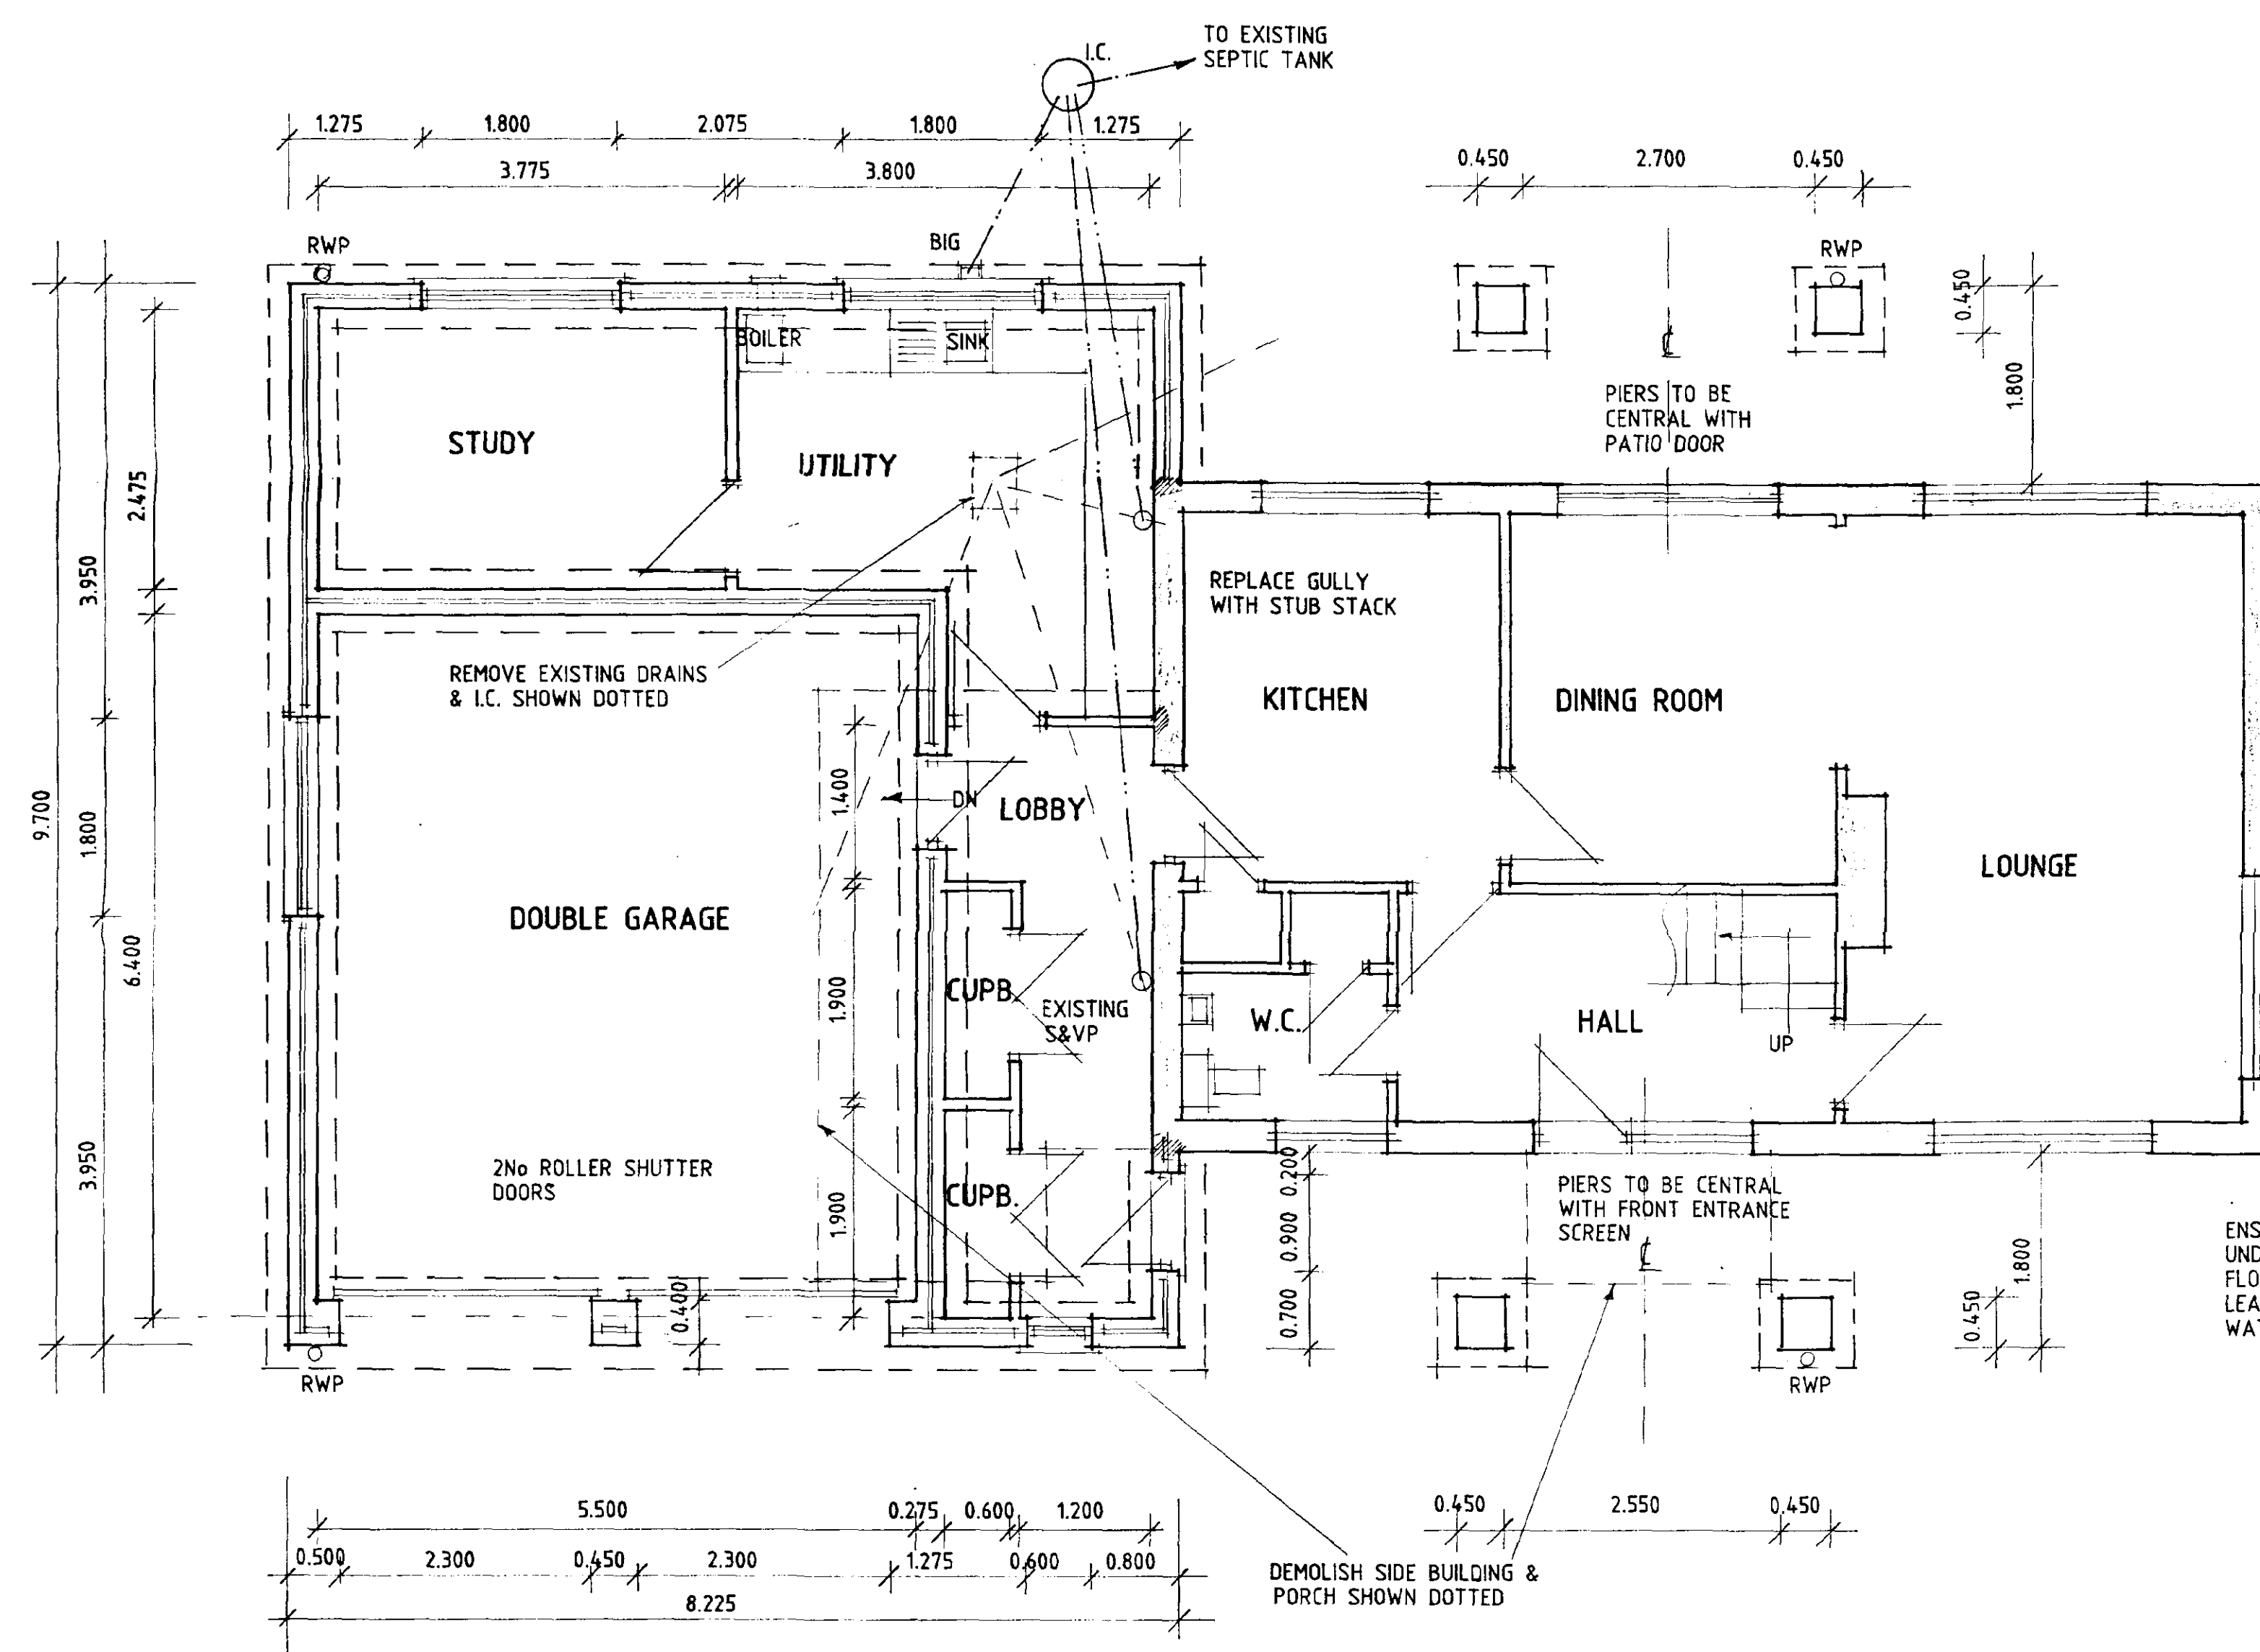


GROUND FLOOR PLAN


NOTE
FOR MOVEMENT JOINT SEE
STRUCTURAL DETAILS REF - 846/1&2



FRONT

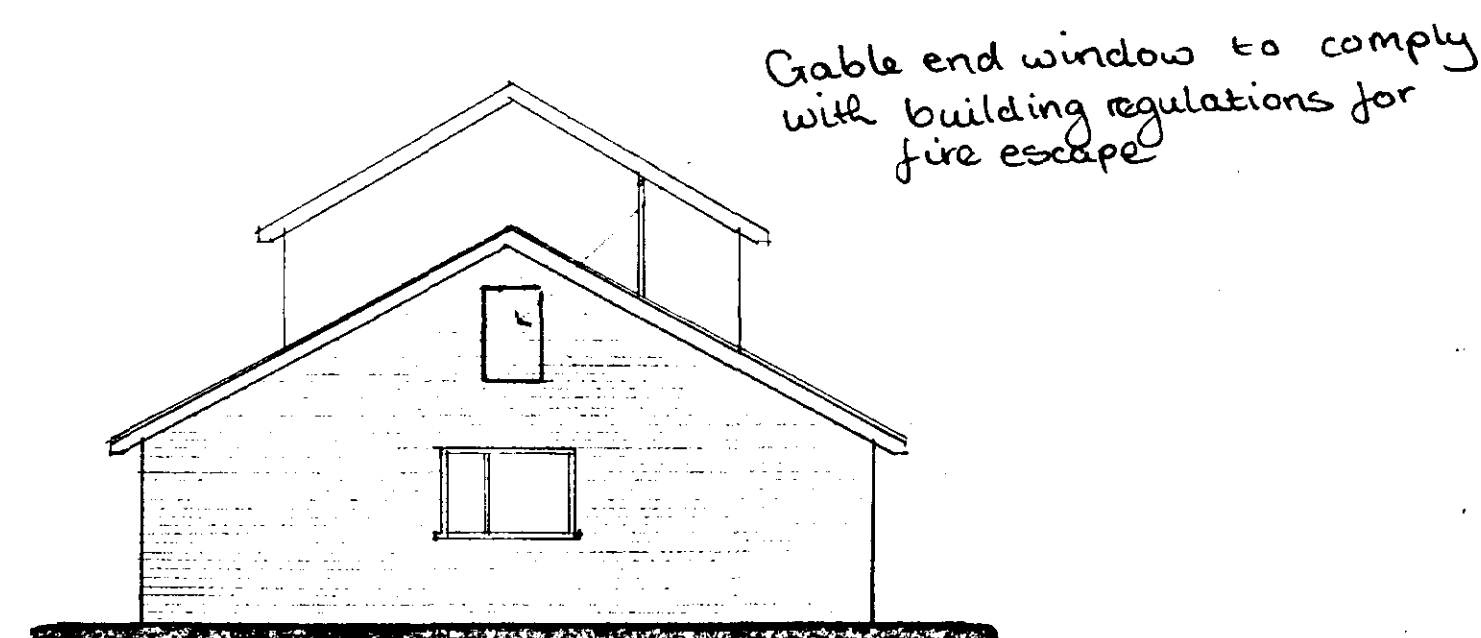

SIDE

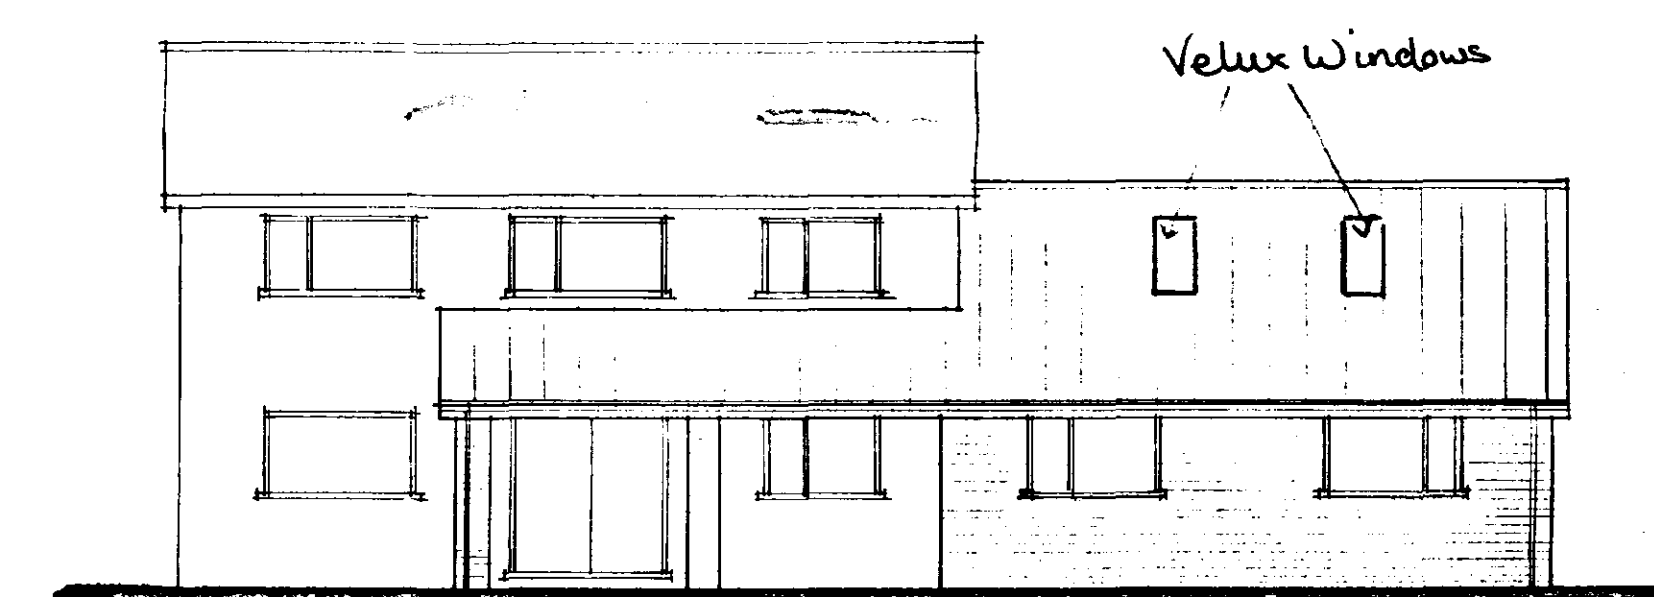

REAR

A - B.R. ALTS - 12.6.02

STATUS
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING


PROPOSED EXTENSION TO
HOUSE AT BECK FARM,
NORTHORPE, DONINGTON
FOR

MR. & MRS. P. LOVELL

1:50 1:100 SD02-001/1


MAY-02 B. GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702

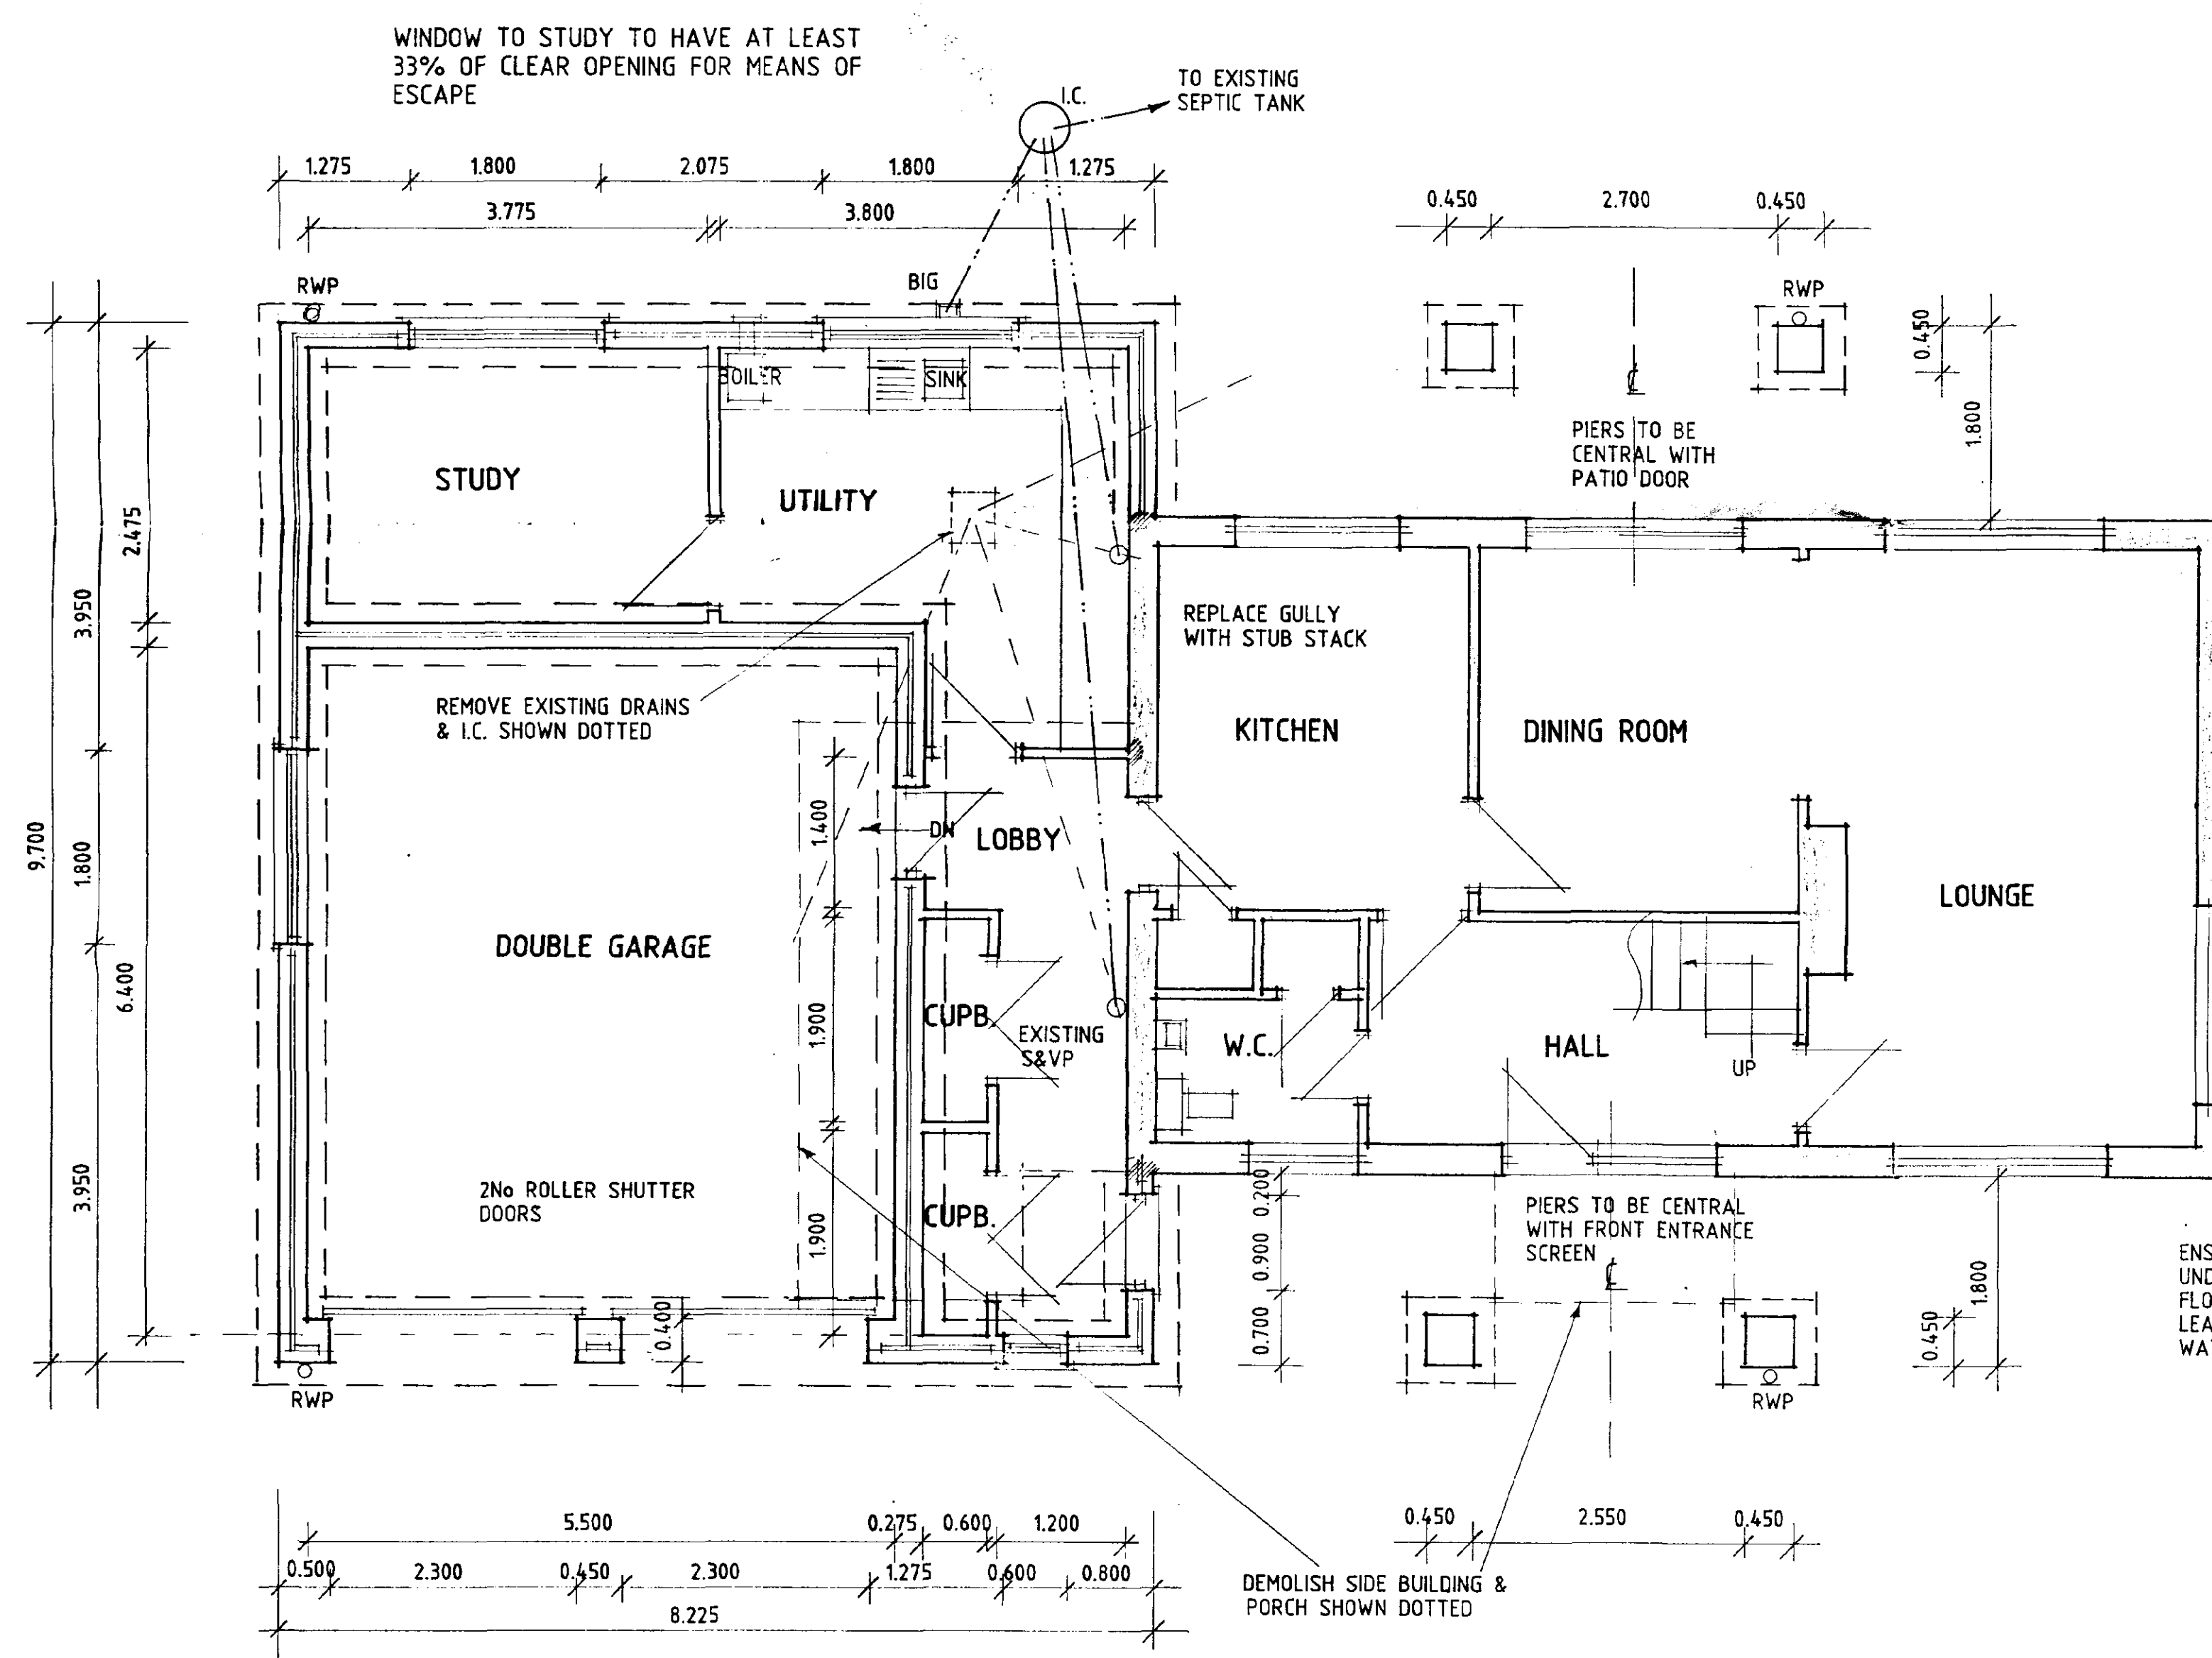

GROUND FLOOR PLAN

NOTE
FOR MOVEMENT JOINT SEE
STRUCTURAL DETAILS REF - 846/182

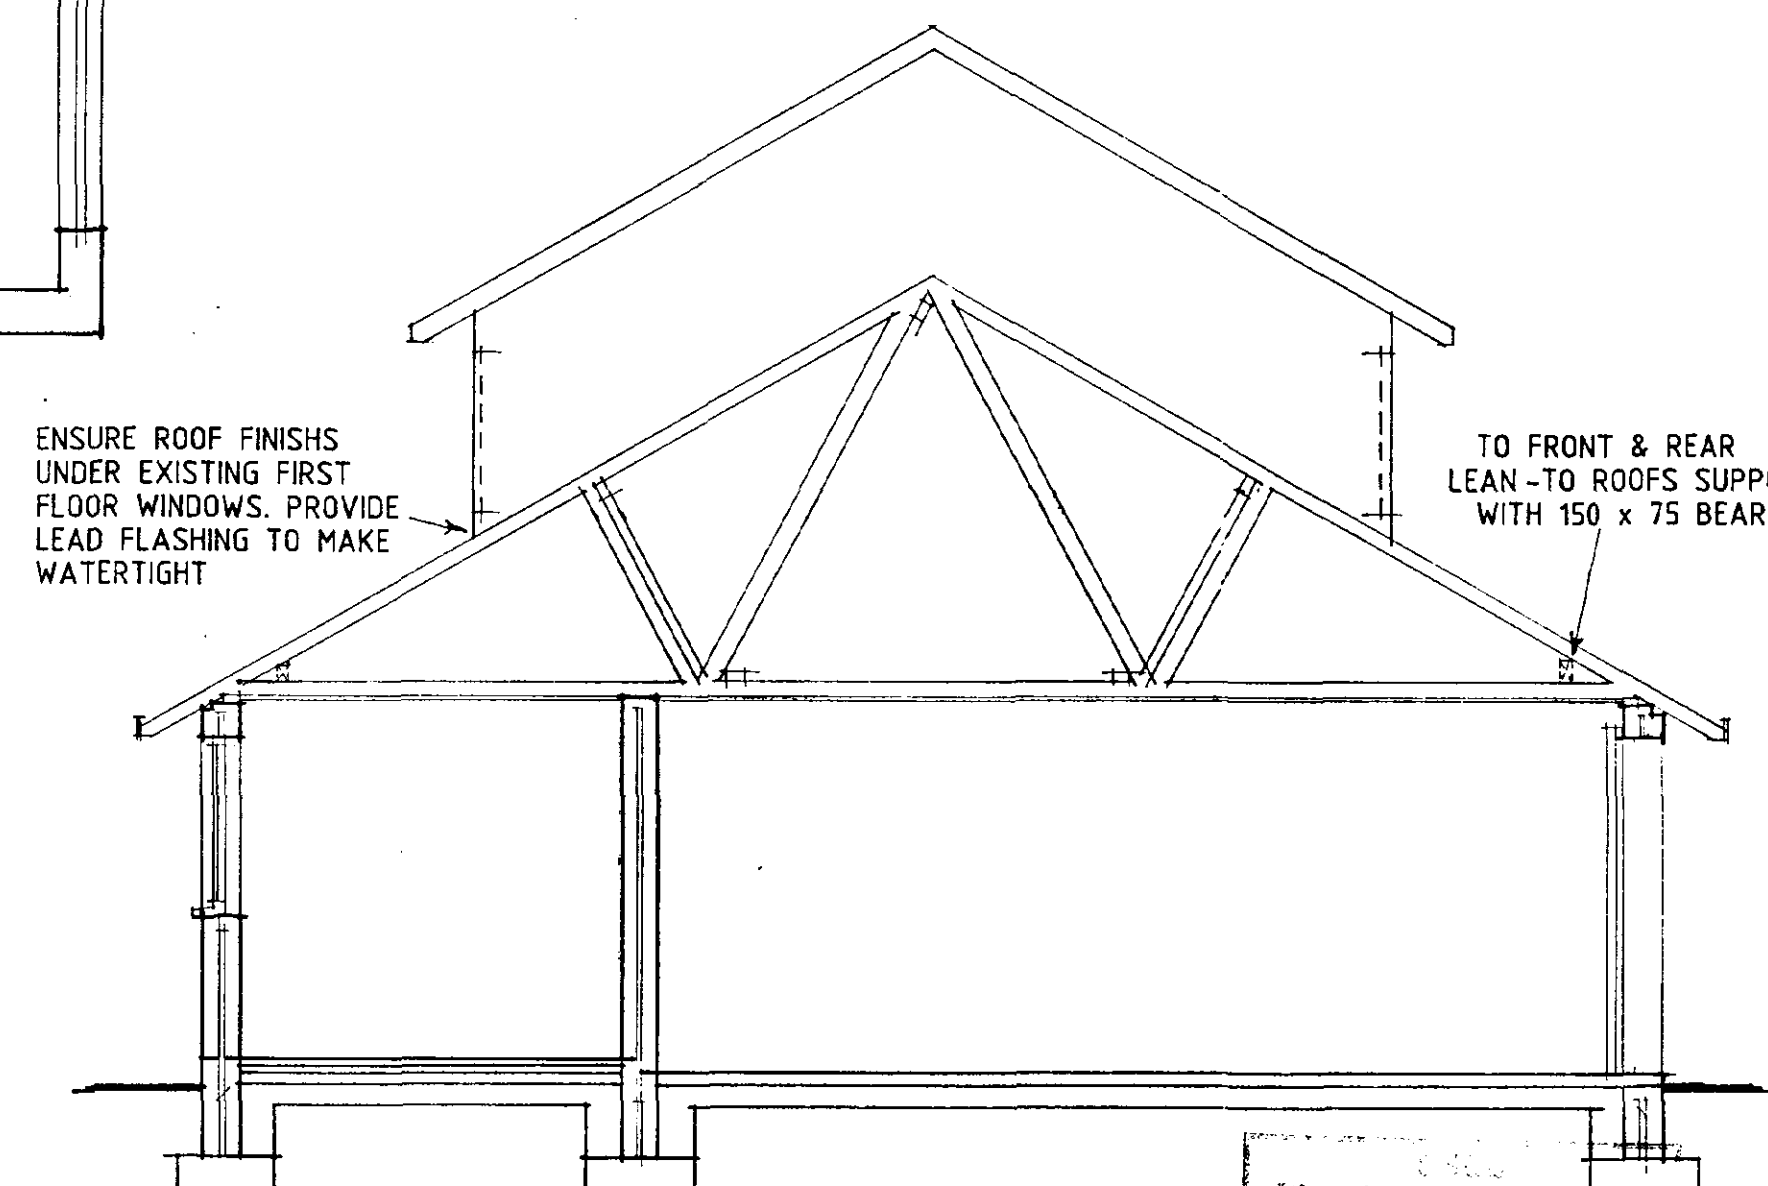

SECTION

Planning & Design
31 DEC 2002
Ref: 624/02
AMENDED PLAN
Ref: A1