

Contractor to check all Dimensions on site prior to ordering materials / commencing work.Do Not Scale from this Drawing - If in doubt then please ask

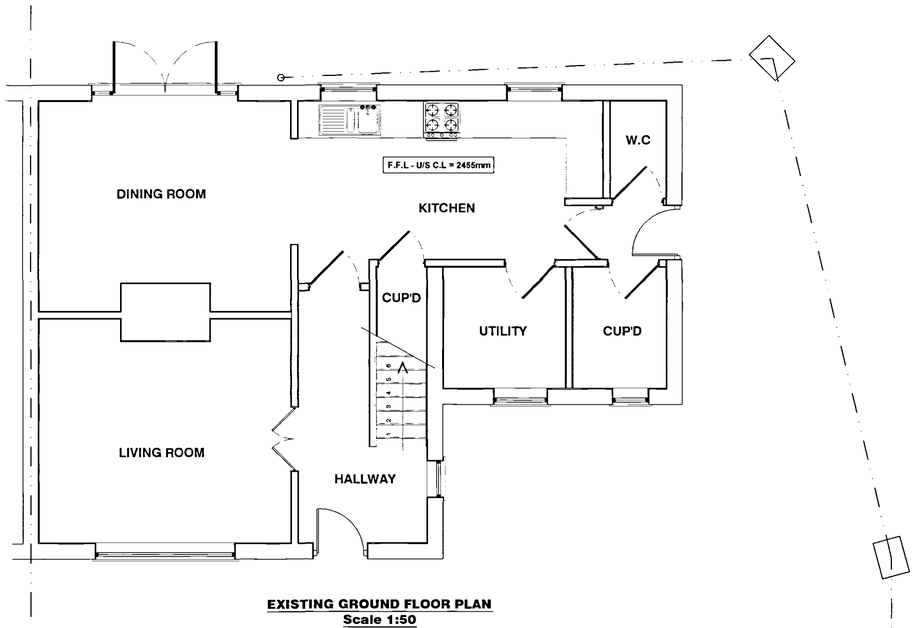

EXISTING GROUND FLOOR PLAN
Scale 1:50

Contractor to confirm exact position of I.C on site. Relocate if deemed necessary to the satisfaction of the Building Control Officer.

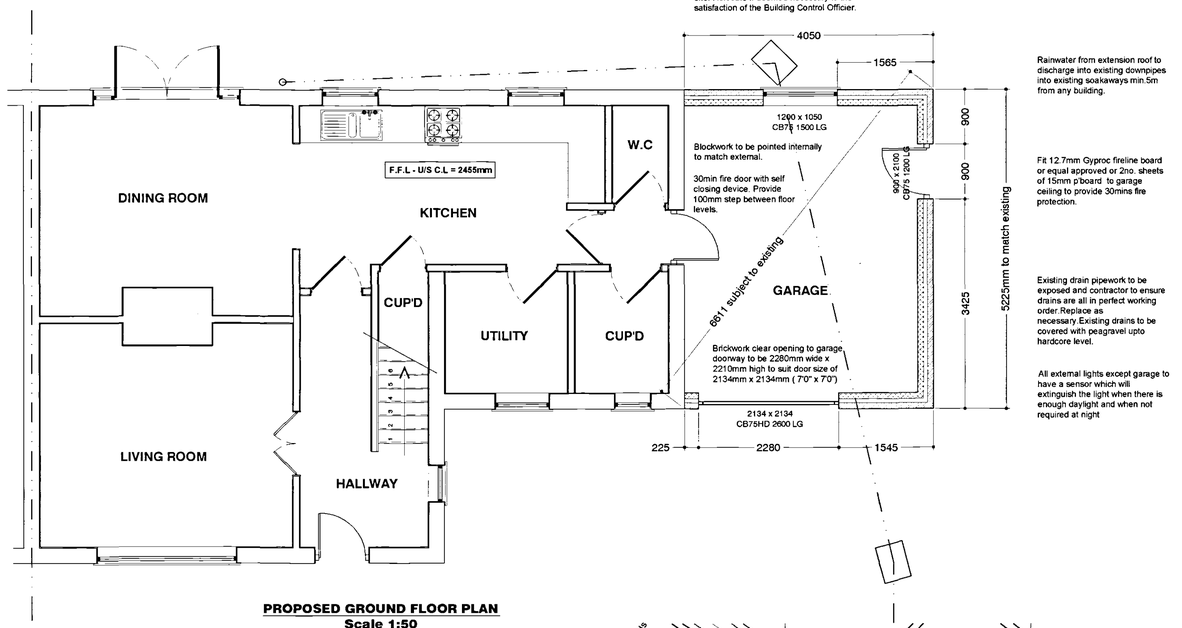


PROPOSED GROUND FLOOR PLAN
Scale 1:50

Rainwater from extension roof to discharge into existing downpipes into existing soakaways min.5m from any building.

Fit 12.7mm Gyproc fireline board or equal approved or 2no. sheets of 15mm p'board to garage ceiling to provide 30mins fire protection.

Existing drain pipework to be exposed and contractor to ensure drains are all in perfect working order.Replace as necessary.Existing drains to be covered with peagravel upto hardcore level.

All external lights except garage to have a sensor which will extinguish the light when there is enough daylight and when not required at night

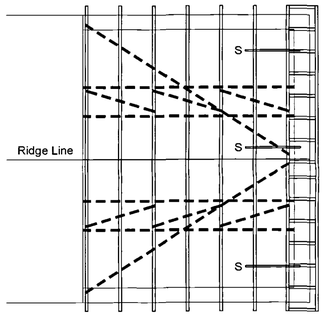

30x5 m/s straps (S) over 3no. trusses at max 2m ctrs to gable ends and ceiling level. At least 1no.gable strap to be within 500mm of ridge.Fit solid noggings to suit truss depth at all strap positions and between end truss and wall face.

Solid pack void between last rafter and blockwork with mineral fibre insulation.

Ladder frames to be fixed direct to last truss at 400mm ctrs.


Pre-fabricated Trussed Rafters to be fixed plumb (max. deviation 25mm) at max.600mm ctrs.Roof construction to be designed strictly in accordance with BS5268 Part 3 1985 and to specialist manufacturers design drawings. Calculations to be submitted to the L.A building inspectors approval prior to any materials being placed on order.

Note provide 50x50 timber noggings for partition head fixing and pendant light fixings position of light fixings to be agreed on site with client.

All 25X100 diagonal and longitudinal wind bracing,and chevron bracing to be free from all major defects and any weak points and fixed all in accordance with manufacturers details Lap joints (if required) to be taken over 2no trusses all in accordance with BS5268 Part 3 - 1985 Bracing to be fixed with 2no. 3.35 x 65mm galvanised round wire nails at each cross over and to be fixed as close to the truss node points as possible


Soffit and fascia profile to match existing fitted strictly in accordance with manufacturer's recommendations

PROPOSED ROOF PLAN
Not to Scale

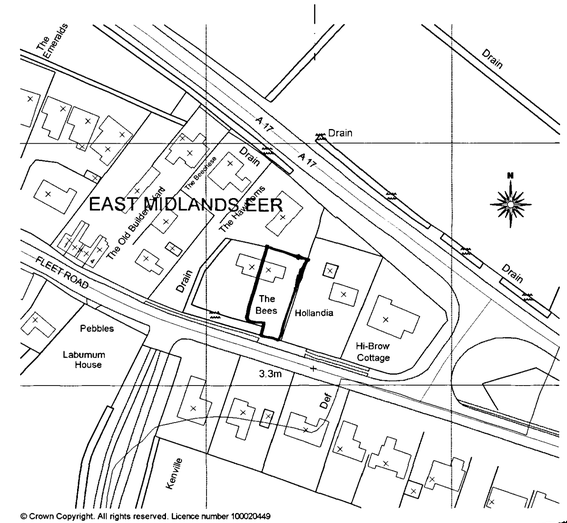

© Crown Copyright. All rights reserved. Licence number 100020449

LOCATION PLAN
Scale 1:1250

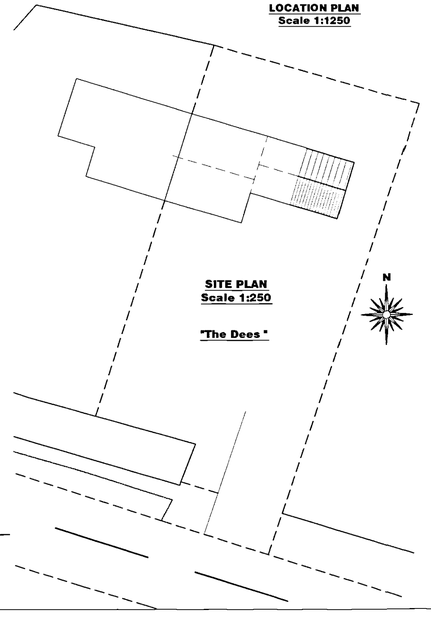


SITE PLAN
Scale 1:250

"The Dees "



EXISTING FRONT ELEVATION
Scale 1:100

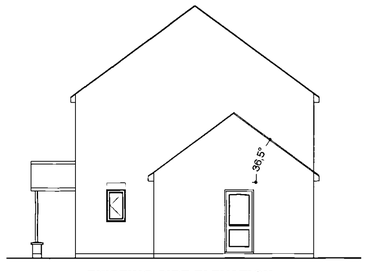

EXISTING SIDE ELEVATION
Scale 1:100



EXISTING REAR ELEVATION
Scale 1:100



PROPOSED FRONT ELEVATION
Scale 1:100



PROPOSED SIDE ELEVATION
Scale 1:100



PROPOSED REAR ELEVATION
Scale 1:100

SMOKE ALARMS
To be self contained,interconnected and wired to a separately fused circuit with a battery back up.Smoke alarms to be fitted to u/side of plasterboard ceiling to the ground floor max 7m from the kitchen / lounge and to be max. 3m from any bedroom door. All alarms to be strictly in accordance with BS 5446 and to be wired that when one alarm is triggered all alarms are activated.

NOGGINGS
Fix 38x38mm timber noggings to all potential loose plasterboard ceiling edges and light fittings.Position of light fittings to be advised by client on site.

INTERNAL JOINERY ,SKIRTING & ARCHITRAVES
All internal finished timber to be free from all defects and to clients approval prior to ordering any materials.

ELECTRICAL INSTALLATION
To be in strict accordance with the latest I.E.E Regulations and Engineer to advise if any appliance or position of appliance does not conform to regulations. Contractor to seek advice from Client with regard to lighting requirements.

ROOF / LOFT ACCESS
Provide insulated roof access trap door with a fully weathered sealed frame and a 38mm brass bolt or to clients requirements.

ROOF VENTILATION
Roof ventilation to be achieved via fascia level ventilators complete with integral insect proof screens which will supply the roof space with ventilation equivalent to a continuous 10mm gap.Provide at both sides of roof to ensure cross ventilation.

CEILINGS
All ceilings to be 12.7mm plasterboard to BS1230.
Ceilings to be have Coving and an Artex finish to clients requirements.Plasterboard sheets to be fixed with joints staggered and must be layed perpendicular to all joist runs.Fix boards at a min.150mm centres.

SOAKAWAYS
All rainwater to discharge into soakaways and to be min of 5m from any building & a min.of 1m³ filled with rubble to within 450mm of external ground level.Overlay rubble with polythene sheet and backfill with clean topsoil.Note the soakaway inlet pipe must discharge to the centre of the soakaway in all directions.

RAINWATER DRAINAGE
uPVC guttering and downpipes to clients approval.Falls for guttering to be 1:600 and brackets fixed at max. 2m ctrs.Downpipes to be connected into underground drains via reducing adapter.Underground drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm peagravel and min 150mm surronds laid to 1:100 falls to new soakaway.Soakaway specification detailed elsewhere.

ROOF INSULATION
Lay 300mm mineral fibre insulation to roof area to achieve a 'U' value of 0.16w/m²K.100mm between rafters and 200mm over rafters at right angles to first layer.Fix Dovetail rafter tray in accordance with manufacturers instructions or similar approved where insulation meets roof slope to maintain roof ventilation.

ROOF FINISH
Concrete interlocking roof tiles to Clients requirements / approval in accordance with manufacturers instructions on 50x25 preservative treated timber battens on untearable sarking felt type IF with min.150mm overlaps.Generally all tiles at perimeter of roof to be clipped and nailed.

PLEASE NOTE:
Due to areas of the structure being covered, unexposed or otherwise inaccessible the notes / specifications of existing materials are subject to confirmation on site when it is feasible to expose the relevant areas of construction.

BUILDING CONTROL SPECIFICATION

FOUNDATIONS
Existing building area to be stripped of all vegetable matter and rubbish to a min.depth of 150mm before excavation commences.Concrete mix for foundatons to be GEN3 in accordance with BS5328:1981 Foundations to external wall to be min.700mm wide x 225mm deep.Excavate down to solid firm strata i.e 750mm deep (min.1000mm if soil is of a shrinkable nature).Exact depth to suit conditions on site and to the strict approval of the L.A Building Inspector.Any irregularities in subsoil during excavation to be brought to the immediate attention of the Building Inspector & advice to be sought from a Chartered Structural Engineer.

WALLS BELOW D.P.C
3no.Courses of Class B brickwork below D.P.C on outer face and 1no.course of 7N/mm2 on inner skin of cavity face.Elsewhere to be either 7N/mm2 concrete blockwork or full width trench blocks.Both to be within 225mm of DPC level.Cavity to be filled to within 225mm min. of below DPC with lean concrete mix.

GROUND FLOOR
65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge polythene separating layer on a 50mm Celotex Double R GA2000 rigid insulation board or similar approved, provide 30mm thick perimeter insulation between screed and floor insulation upto d.p.c level on 100mm thick GEN3 concrete sub-floor on a 1200 gauge DPM lapped onto DPC within walls on min.150mm clean and well compacted hardcore.Depth of hardcore must not exceed 600mm and must be compacted in 150mm thick layers.All service entries to be sealed with pressure sensitive tape. Floor to achieve a min U Value of 0.25w/m²K.

DAMP PROOF COARSE (D.P.C)
Horizontal heavy duty polythene DPC "Hyload" or similar approved to all walls in accordance with BS 6515 and set min.150mm above all external ground levels.DPC in walls must be linked / lapped with DPM in ground floor.Provide performed cavity wall trays above windows & doors with weep vents at a max.of 2m centres with a min.of 2no.per opening.

EXTERNAL WALLS
All external walls to be 265mm overall thickness comprising of:
-100mm Brickwork to match existing
-65mm cavity filled with Crown Dritherm (or equal approved) built in as work progresses.Insulation batts should be kept clean and free from mortar droppings, all joints should be closely butted. Any cutting and fitting should be neatly done and not distort the layers of glass wool which comprise the material. All DPC's should be installed to ensure that penetrating water is directed only to the outer leaf.
-100mm Thermalite Shield insulating blockwork.
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties.
External wall to achieve a min 'U' value of 0.35w/m²K.

CAVITIES
Close all cavity walls at jambs with Thermabate or similar approved Insulated cavity closers fitted strictly in accordance with manufacturers instructions. Roof insulation to be continuous with wall cavity insulation.Install Insulated Cavity Closers by Thermabate or equal approved, 25mm thick x 65mm wide (to equal cavity width) at jambs and cills of all openings in masonry cavity walls. Secure with the proprietary clips provided at maximum 500mm centres. Ensure that closers fit tightly to each other and to the lintel. The closer at the jamb must completely lap the closer at the cill.

MORTAR
All mortar to be 6:1:1 sand/cement/lime or equally approved and to be a consistent colour throughout duration of contract.Finish mortar joints as agreed with Client on site.

WALL TIES
Stainless steel cavity wall ties to BS1243:1978.To be built into cavity wall as works proceeds and spaced at 900mm centres horizontally,450mm centres vertically and 300mm staggered around all openings.Ensure wall ties are level or at least sloping to the outside leaf.Bed ties a minimum of 50mm into each leaf and ensure wall ties are completely free from mortar droppings.

LINTELS
All lintels to cavity wall to be factory insulated Birtley Supergalv range unless noted otherwise or equalled approved.All lintels must have a min.150mm endbearing and installed in accordance with manufacturer's instructions.Do not allow masonry to overhang lintel by more than 25mm. Note: lintels are not to have a continuous baseplate.

WINDOWS & DOORS
All windows to be uPVC to clients requirements based on styles shown on elevations.Fit with 4000mm² trickle ventilators to Kitchen, Utility,Bathroom & En-Suite windows and 8000mm² elsewhere all in accordance with manufacturer's recommendations.Patio doors to be fitted with 10000mm² ventilators.Opening vents to give 1/20 th of floor area rapid ventilation to all rooms.All glazing within 800mm of floor level and within 300mm of a door to a height of 1500mm of ground level to have toughened glass in accordance with Section N of the Building Regulations and BS8206 class B.All double glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a soft Low 'E' coating on glass inner pane to achieve a min 'U' value of 2.0 w/m²K.Note all windows to have a perimeter weatherseal both internally and externally and to be fully draught sealed.Provide frosted glass to all Bathroom, W.Cs and En-suite windows.Ensure windows & doors are fitted within masonry reveal to overlap cavity closer by min.10mm to avoid cold bridging.Provide reconstuted stone subcills to windows as shown.Subcill to clients approval. Ensure subcills are fully protected throughout duration of building works.

TIMBER WALLPLATES
All timber wallplates supporting roof trusses to be 100mm x 50mm bedded on top of wall.Timber to be SC3 grade and use a min. length of 3m and half-lap plates at joints and corners. Provide anchor straps as described in notes elsewhere.

LATERAL RESTRAINT STRAPS
Tie roof structure to blockwork wall with 30X5 galvanised mild steel straps at max 1.8m ctrs where rafters and ceiling joists run parallel to blockwork walls.Also fit at max 1.8m ctrs to anchor wallplate to blockwork wall with min 3no. fixings per strap.

DETERMINED PLAN

SHDC PLANNING & DEVELOPMENT 13 FEB 2004 Ref. 0195/04

REV DESCRIPTION:

GENERAL CONDITIONS
Contractors are resonsible for checking all dimensions on site when work commences and before ordering any materials.Any discrepancies should be brought to the attention of the Client for remedial action before commencing further.

All details shown are based on typical site conditions for that area, any abnormal conditions should be brought to the attention of the Client and Local Authority.

The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification.

No allowance has been made for any Structural Calculations,a "SAP" calculation, Soil Investigation or Flood Risk Assessment.If deemed necessary then these will be a chargeable extra.All steel beam sizes shown on drawing are all subject to confirmation from Structural Engineer.

All materials not specified to be of a standard suitable for the work proposed and be fit for purpose.All work to be in accordance with good building practise and all necessary BS codes for Workmanship on Building Sites.

remway design Ltd
Plans drawn for: Local Authority - Planning permission & Building Control.
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 056
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Project: Proposed Garage Extension

Client: Mr & Mrs Spector
"The Dees"
Old Main Road
Fleet Hargate
PE12 8LL

Date: Jan04 | DRG No.: SP01 | REV: