FILE COPY

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H05/0524/92

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Description: 11,000 KV overhead line

Location: Parish of Fleet

Type: ELECTRICITY

APPLICATION DETERMINED BY SECRETARY OF STATE - SUMMARY OF DECISION

Planning permission has been granted by the Secretary of State, or is deemed to have been granted, on conditions set out below or attached.

1 Development shall be begun not later than the expiration of five years beginning with the date of this letter.
Reason: Comply with provisions of Section 91(1) of the 1990 Act.
2 Dismantle/remove from the site any redundant lines/apparatus within six months from the date of commissioning of lines.
Reason: Restore the land as far as practicable to its previous condition.

10 June 1992

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

APPLICATION ASSESSMENT

Notes for Case Officer

Site Notes: Accuracy — **Neighbours** — **Other**

Boundaries — **Site Features**

Inspected by: KW — No Observations
date: 28.5.92 — Open land.

Case Officer Conclusions (issues)

Case Officer Recommendations (summary) GRANT
(details overleaf) REFUSE

Recommended approvals –

Departure from policy — Yes .... — No ....

Ward member request — Yes .... — No ....

Recommend approval against material objection — Any objection received? No / If yes, is any obj. material? Yes / No — Yes .... — No ....

[Reason:

Other circumstances needing Committee decision — Yes .... — Flagged by Senior Officer Signed ..... — No ....

ALL OF ABOVE ⇩

Recommended refusals –

Refusal on adopted policy grounds on first applic. — No .... — Nil fees (not first Submission) / Other info. viz: Signed ..... — Yes ....

ANY ONE OF ABOVE ⇩

Committee report
Sub-Committee:
SV recommended .....
Est/Ind. recommended.....

Delegation confirmed by Senior Officer
..DC 1/6.....

Recommendation/draft report produced.....

F U R T H E R I N F O R M A T I O N / C O N S U L T A T I O N S

APPLICATION REF:

DIRECTIONS

Art 7 (Outlines)

RM Checklist:

	Siting	Design	Ext App	Access	Lands
Previous					
Current					
Required					

Reg 4 Scale drawing ..... Highway S/W ..... Agric appraisal .....

[Indicate if other Regs]

Precise details, for non-standard direction:

CONSULTATION/PUBLICITY REQUIRED DMG 19/5 P2-15

Publicity : General
Departure
Setting of LB Viz

Residents (Postal):

Residents (Delivery):

Consults : Dept of Transport
Env Health
Conservation consults : Local
Local & National
English Heritage LBC I, II*
Setting I, II*
Major CA

Consultant : Name
Order No:

Other :

R E V A L I D A T I O N A F T E R D I R E C T I O N

Information satisfactory/unsatisfactory Signed .....

Further direction: Precise details

Amended description:

Reconsultations required -
Parish Council
Ward Members
Residents
Advertise
Other

New valid date ..... Re-Registered .....
Ack/Reception .....

ADMIN RECORD SHEET

INITIAL

Submitted Fee £ NIL

Receipt Issued ..... No. .....

Date First Received 11 MAY 1992

REGISTRATION

REFERENCE HOS/0524/92

Cross-Ref N/A

Date 12/5

VALIDATION Date 11/5/92

Type DEL Earliest permission date (Cert B) .....

Site area ..... No. of dwellings ..... Floorspace .....

New build/site enlargement/redevelopment/change of use/extension/alteration

Earlier permission ref .....

HM:-	Siting	Design	Ext app	Access	Lands
Previous					
Current					

Description

Technical:
- Certificate ☐
- Site plans ☐
- Description ☐
- Accuracy ☐
- Incomplete form ☐
- S65 Advert required ☐ Expiry date .....

Fees:
- Nil fee – previous app ☐ Ref .....
- – type ☐
- Discounted fee ☐ Reason .....
- Correct fee £ NIL Additional £ ..... Receipt no. .....
- Refund £ ..... Issued .....

CONSTRAINTS Date 13.5

Index Sheets 307 OS Nos ..... Grid Ref E 319300 N 229000

Part D Parish Ealing

Inside CPZ No Inside CA Area No

TR Rural ☐ C1 ☐
TR Bypass ☐ C3 ☐ Grade
Level crossing ☐ CPO ☐
Footpath ☐ Other:

Linked to site..... Ref. 526 Linked to property..... Ref.....

Planning Records:
Earlier apps

3 Rec Records:
Already submitted Ref.....
Requested .....

Inputs completed.....

Department of Trade and Industry
Electricity Division
1 Palace Street
London SW1E 5HE

Fax No. 071 834 3771
Switchboard 071 238 3000
Direct Line 071 238 3634/3711

The Secretary
East Midlands Electricity plc
Boston

Dear Sir

Our Reference OL/266/2222

Date 10 JUL 1992

OVERHEAD LINES
ELECTRICITY ACT 1989
TOWN AND COUNTRY PLANNING ACT 1990.

With reference to the application particulars of which are specified below, I am directed by the Secretary of State to inform you that consent is hereby granted pursuant to section 37(1) of the Electricity Act 1989 ("the 1989 Act") to the installing above ground of electric lines ("the lines") particulars of which are specified below.

Pursuant to section 37(3) of the 1989 Act this consent is given subject to the following conditions:

1. The Secretary of State may review this consent at any time after a period of five years from the date hereof, and upon such review, after giving all persons concerned an opportunity of being heard, he may vary or revoke his consent.

2. If the Secretary of State revokes this consent the lines shall be removed within such period as the Secretary of State may direct.

Pursuant to section 90(2) of the Town and Country Planning Act 1990 ("the 1990 Act") the Secretary of State hereby directs that planning permission for the development shall be deemed to be granted subject to the following condition(s):

1. The development to which this permission relates shall be begun not later than the expiration of five years begining with the date hereof.

Reason: To comply with the provisions of section 91 (1) of the 1990 Act.

2. The Company shall dismantle and remove from the site any redundant lines and apparatus within six months from the date of commissioning of the lines.

Reason: To restore the land as far as practicable to its condition before the redundant lines and apparatus were installed.

PLANNING AUTHORITY REFERENCE: HO5/0524/92

APPLICANT COMPANY: East Midlands Electricity plc

DATE AND REFERENCE OF APPLICATION:16 June 1992 EM 21/73-90370

PARTICULARS OF OVERHEAD LINES:

Situated in the Parish of Fleet

Route as indicated on Map No 91/90370 or within a distance not exceeding 30 metres on either side thereof.

Voltage 11,000

Yours faithfully

D. R. JOHNSON

Authorised by the Secretary of State

BRIAN SMITH Dip T RTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

FILE COPY

SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H05/0524/92 Received:11-MAY-92 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Description: 11,000 KV overhead line

Location : Parish of Fleet

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Director of Planning and Building Control Services
10-JUN-92 H05/0524/92

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH *Dip TP , ..TPI*
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H05/0524/92 Type: ELECTRICITY

Applicant: East Midlands Electricity Agent: East Midlands Electricity
Tel:

Description: 11,000 KV overhead line

Location: Parish of Fleet

Valid date:	11-MAY-92	Terminal date:	06-JUL-92
Target dates:		Target Committee:	24-JUN-92
To case officer	16-MAY-92	Report deadline:	10-JUN-92
Inspected by	21-MAY-92		
Extra contacts	26-MAY-92	Case Officer:	
Report if not clear by	15-JUN-92	~~D M GEDNEY~~ KW	

DEVELOPMENT/CONSTRAINTS

Size:
Category:
Listed building:
Conservation Area:

CONSULTATIONS CARRIED OUT

		Sent	Expiry
Clerk to Fleet PC	Holbeach 26739	14-MAY-92	28-MAY-92
Cllr B A Paul	0406 23100	14-MAY-92	28-MAY-92

L C C — No objections jo dS 21/5/92

SITE DETAILS

Grid ref: 537830 322200
OS Sheets: 207 Parcel:

Town and Country Planning Act etc

DRAFT DECISION

Reference: H05/0524/92 Received:11-MAY-92 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Description: 11,000 KV overhead line

Location : Parish of Fleet

South Holland District Council hereby give notice that permission has been granted/refused etc on the following conditions/reasons:

Authorised to issue:

05-JUN-92 H05/0524/92

AD...A.....DC..DD...
5/6 8/6

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H05/0524/92

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs PE21 8EG

Description: 11,000 KV overhead line

Location: Parish of Fleet

Type: ELECTRICITY

Date received: 11-MAY-92

14-MAY-92

Dear Sir/Madam

CONSULTATION WITH PARISH COUNCIL

I have received an application for the above proposal and enclose a copy for your information. Any observations which the Parish Council wish to make should be set out below and returned to me by 29-MAY-92. If no observations have been received by that date, it will be assumed that the Parish Council have no comments to make. The officer dealing with this application is D M GEDNEY

Yours faithfully
B SMITH
Director of Planning and Building Control Services

Clerk to Fleet PC
Parish Council Office
2 Spalding Road, Holbeach
Spalding, Lincs

FOR PARISH COUNCIL USE ONLY

Comments:

NO OBJECTIONS

Signed:

S.H.D.C. PLANNING DEPT.
RECEIVED
28 MAY 1992

Attention of	File Nos.
DPO NRM DOPO BS JC ACP	
Action by ..... Discuss with ..... Copy to	Acknowledge YES/NO by date

11 MAY 1992 H05/0524/92

Form B (Type III)

tes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a naminal voltage of less than 132 kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT

Name: East Midlands Electricity plc

Address: Sleaford Road
BOSTON
PE21 8EG

Postcode:

Telephone Number:

OFFICE COPY

PART I

East Midlands Electricity plc Application Number EM73 21/90370 Date 8 May 1992

To the Chief Executive Planning Dept

Council South Holland District Council
Priory Road
SPALDING, PE11 2XE

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90) [Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of East Midlands Electricity plc.

D A Tuley
Designation. (Planning Engineer)

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The District/Borough Council

(i) [redacted] have no objection to make to the development described overleaf.*

(ii) [redacted] do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date 9 June 1992 Signed B Smith

*Delete as appropriate

Designation Director of Planning & Building Control Services

On behalf of the South Holland District/[redacted] Council

(Reasons for objections)

1992 H05/0524/92

East Midlands Electricity plc Application Number EM73 21/90370

(Application dated 8 MAY 1992)

PART II—INFORMATION AND OBSERVATION
(To be completed by the District/Borough Council)

Planning Reference Number H05/0524/92

1. Names of interested parties consulted about the proposals with details of any observations received.

Fleet Parish Council - No objections


Highways Department - No objections

2. Particulars of any representations which have been made to the local planning authority objecting to the proposals.

None


3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?


No

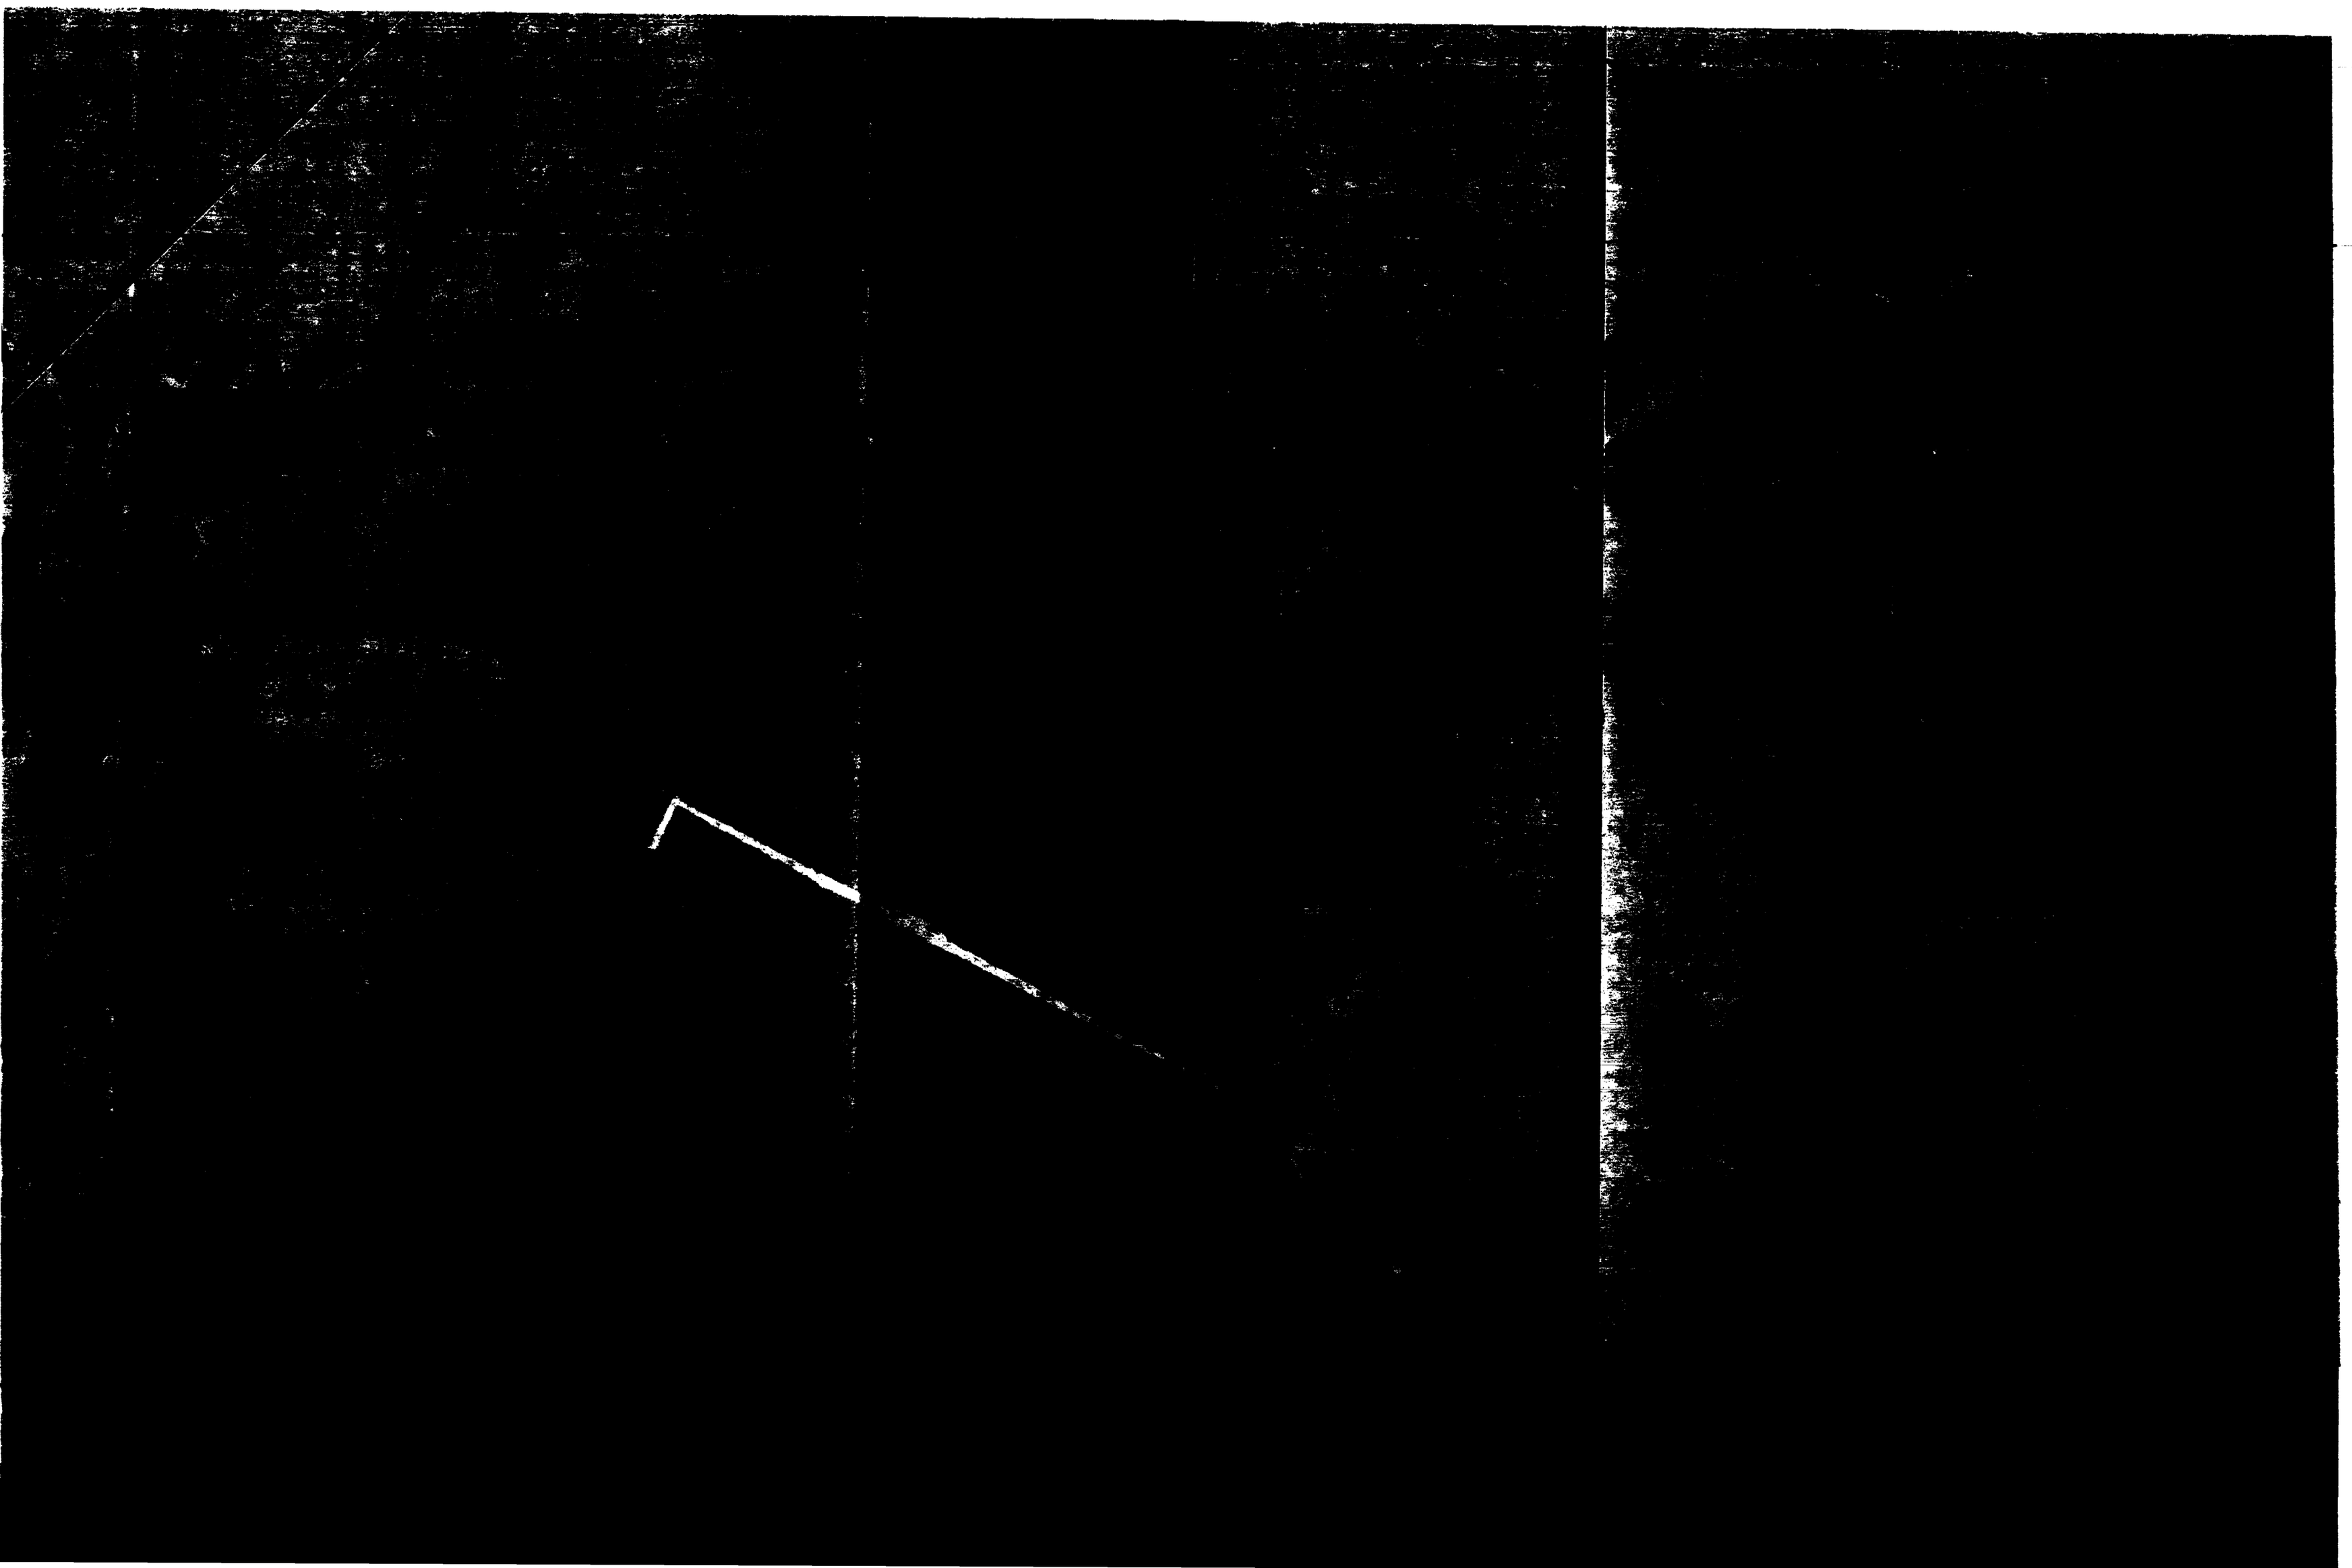

t Fen

Fle

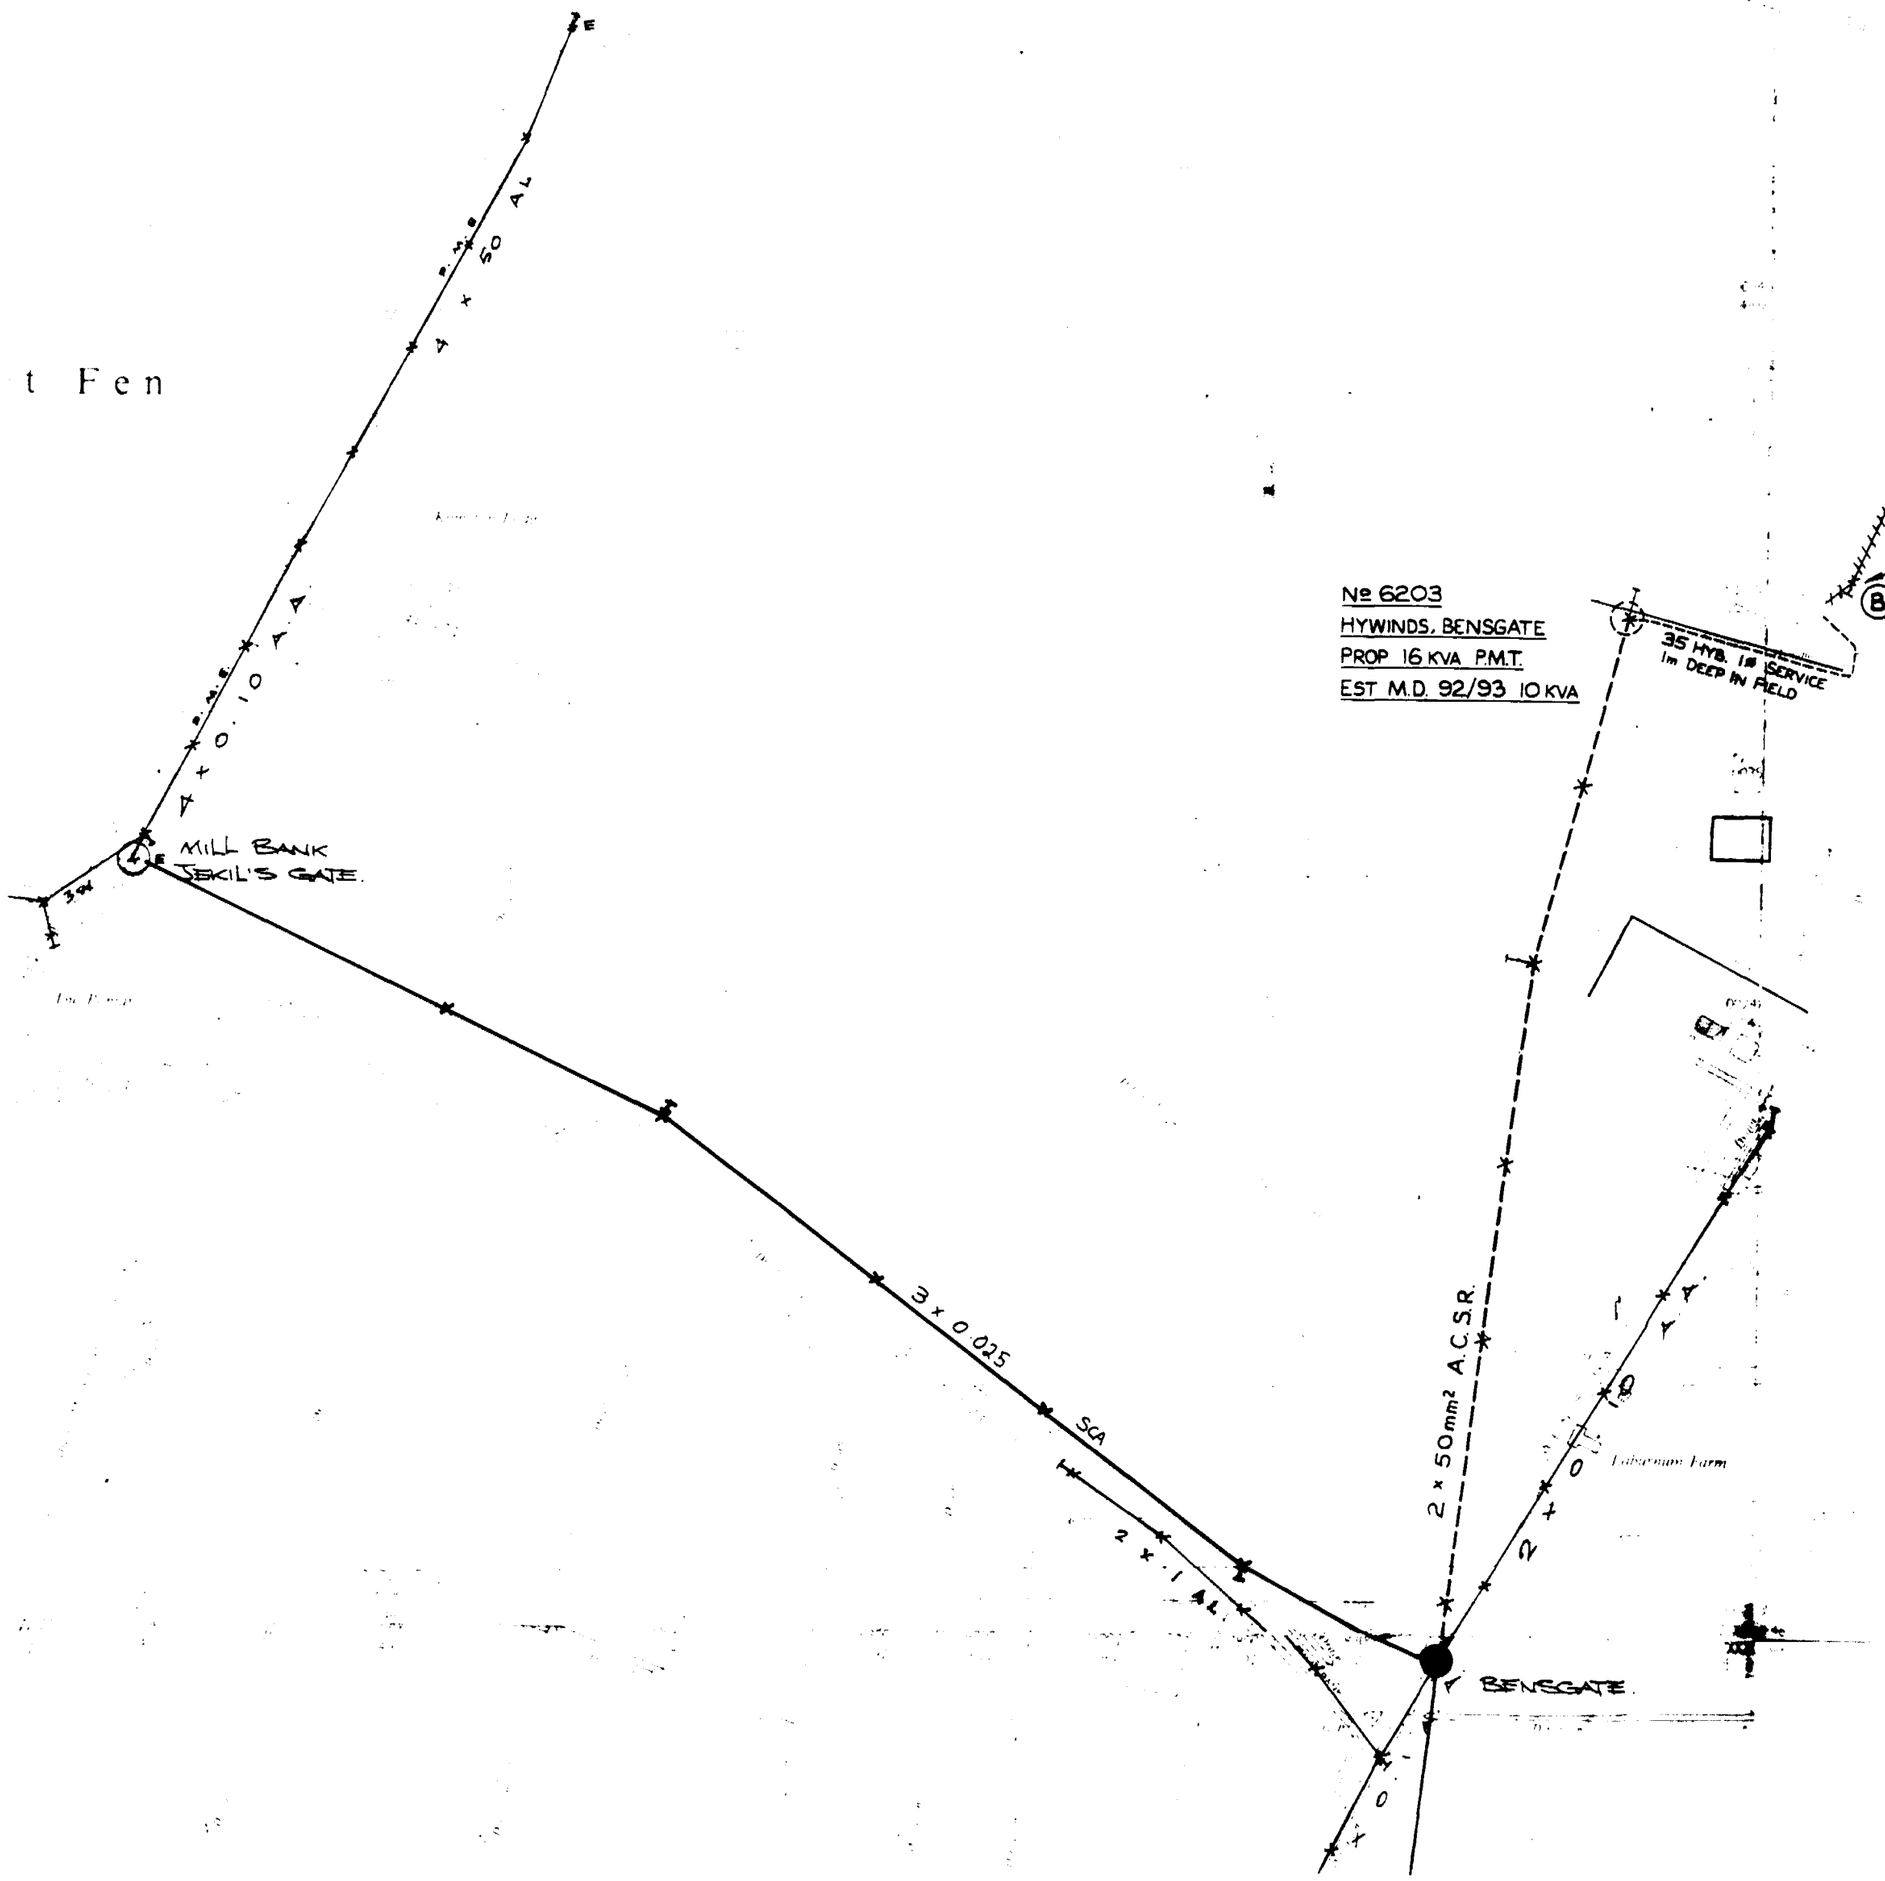

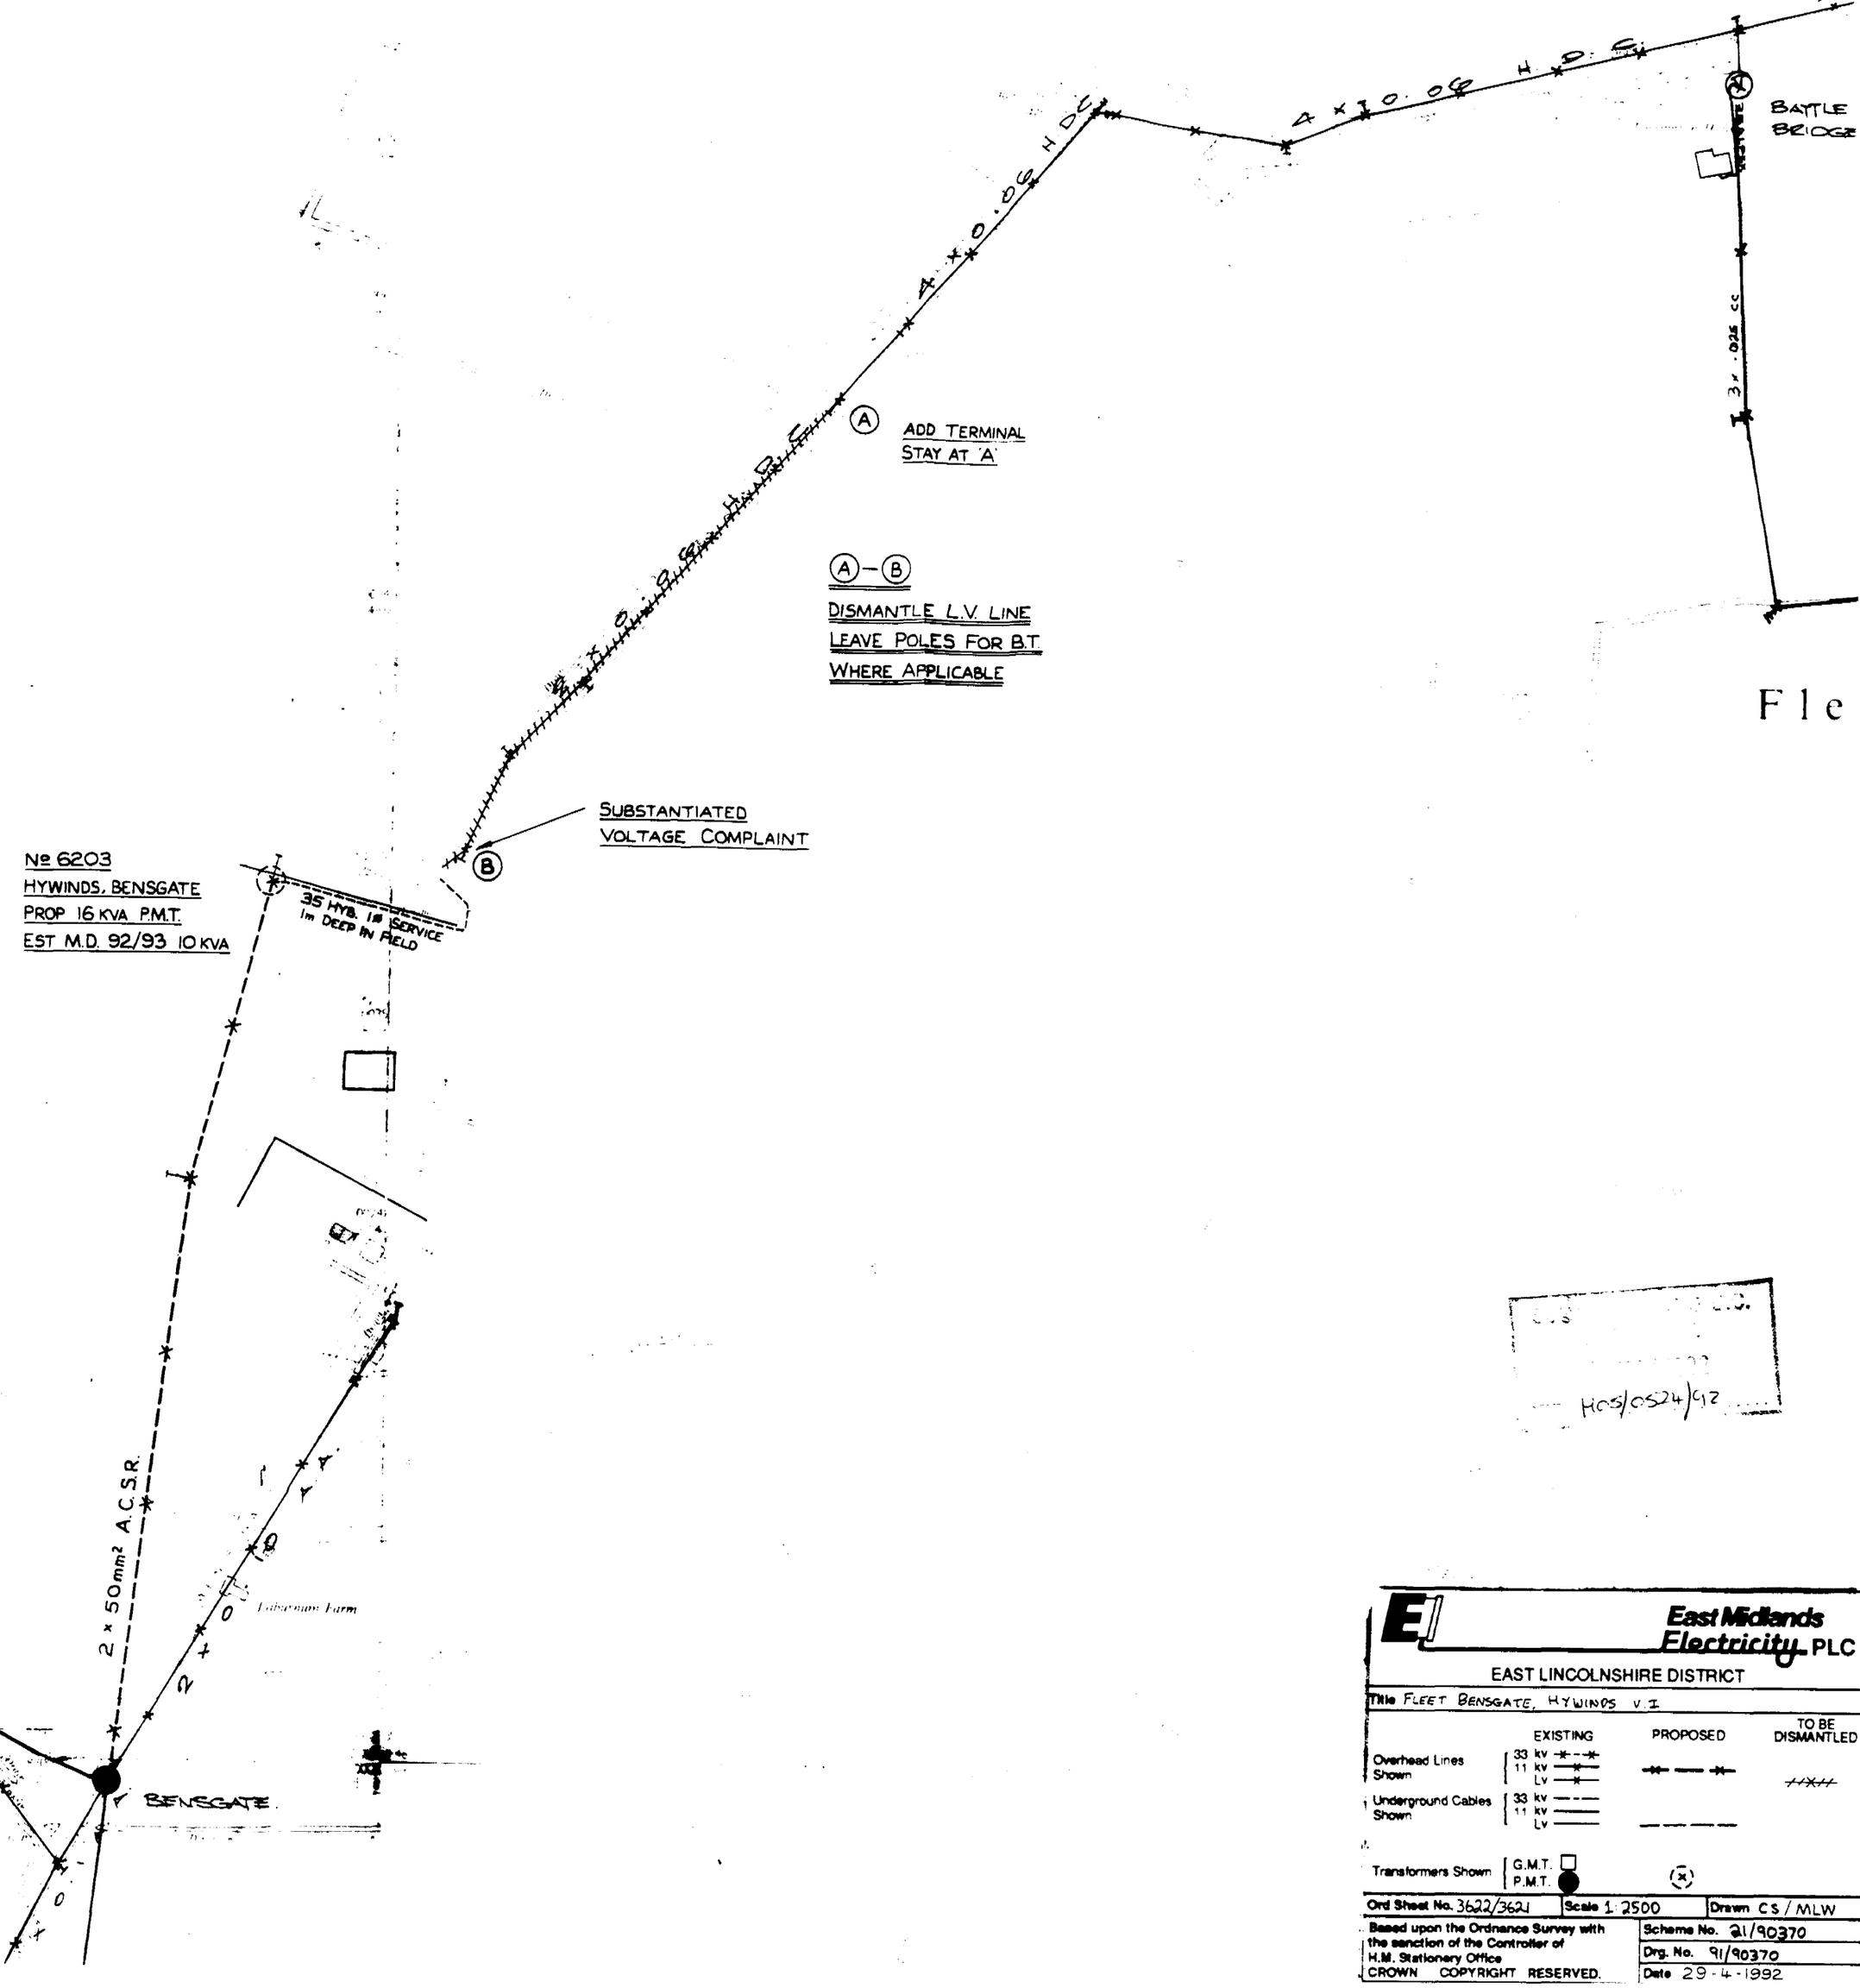

H05/0524/92

East Midlands Electricity PLC

EAST LINCOLNSHIRE DISTRICT

Title FLEET BENSGATE, HYWINDS V.I

		EXISTING	PROPOSED	TO BE DISMANTLED
Overhead Lines Shown	33 kv			
	11 kv			
	Lv			
Underground Cables Shown	33 kv			
	11 kv			
	Lv			
Transformers Shown	G.M.T.			
	P.M.T.			

Ord Sheet No. 3622/3621	Scale 1: 2500	Drawn C.S. / M.L.W.
Based upon the Ordnance Survey with the sanction of the Controller of H.M. Stationery Office	Scheme No. 21/90370	
	Drg. No. 91/90370	
CROWN COPYRIGHT RESERVED.	Date 29-4-1992	