

Remove existing flat roof to make way for proposed extensions.

Build on new first-floor extension and room-in-roof in the manner shown.

Roof pitch to match that of existing.

Main house extension to have fascia line and overhang all to match that of existing.

First floor to be level with existing.

External materials
Roof tiles and facing bricks to match those of existing.

Existing foundations to be exposed and checked for adequacy and, if found to be inadequate, to be suitably underpinned.

To openings below proposed first-floor extension existing lintels to be checked for adequacy and, if found inadequate, to be replaced with suitable new lintels.

Existing chimney to the rear to be completely removed and all affected areas to be made good.

Existing bathroom and landing windows to be removed and openings bricked up to match existing.

Provide opening for new landing window, as shown; support over with suitable IG L1/S or Box 200 lintel.

Form opening in existing rear wall for access into extension and on-suite; support over with suitable IG L1/S or Box 200 lintel.

Existing bathroom to be altered in the manner shown to en-suite and access to extension by providing new stud partition.

First-floor joists to be 175mm x 50mm SC3 grade at 400mm centres.

Connect foul drains to existing foul drainage system, as shown. If depth found to be inadequate provide new foul drainage system to public sewer, as necessary.

Dormer Wall Construction
Vertically hung tiles (manufacturer same as main roof tiles) on 19mm x 38mm timber battens on breather membrane on sheathing ply fixed to studs with GA3050Z Celotex between studs, maintain a 50mm cavity. 50mm x 125mm vertical studs at 400mm centres built off doubled-up rafters as stated. GA3012Z fixed to internal face of studs with taped joints and finished with plasterboard and skim.

Dormer Roof Construction
Tiles, battens and underlay as for main house roof on 25 x 200mm ridge, 38 x 100mm rafters and ceiling ties. Provide 25 x 100mm longitudinal binder plus 25 x 100mm diagonal rafter binder. At roof intersection provide 32 x 175mm valley lay boards plus suitable reducing rafters. Support rafters on 50 x 125mm header/wallplate. Provide 38 x 100mm noggins from last rafter over gable wall to take bargeboards @ 400mm c/c. Provide restraint straps as main roof. Provide 300mm fibreglass insulation plus ventilation as main. All timber SC3 grade.

Roof/Wall Abutments
Provide Code 4 lead flashings and lap over roof covering. Dress up wall a minimum of 150mm (stepped on pitched abutments) and provide d.p.c. cavity tray to make completely watertight.

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Roof Ventilation to Sloping Ceiling
At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.

Valleys
Use proprietary fibreglass valleys or provide Code 4 lead to valleys to make completely watertight.

Bathroom/En-suite Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 15 l/sec. System to offer intermittent operation.

Heating System
Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Insulated Pipes and Ducts
All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5839 Part 6, 2006 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Roof Insulation to Sloping Ceiling
To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

Foul Water Drainage
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bresing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Internal Lighting
Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Provide energy efficient lights of one per 25m² of floor area or one per four fittings whichever is the largest.

Excludes garages, lofts and outhouses.

Sound Insulation to single Dwelling
The intermediate floor should be provided with 100mm thickness mineral wool between the joists. In addition internal stud walls should be suitably sound resisting to walls around bedrooms, WC and en-suites (unless the wall contains a door).

Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either-
a) an electrical installation certificate issued under a competent person's scheme has been issued or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

Stud Walls between Habitable Rooms
To have 15mm plasterboard finish to both sides of 50mm x 100mm studs with 100mm fibreglass between to reduce sound transmission

Wall Constructions (300mm Cavity)
300mm cavity walls to consist of:-
100mm facing brickwork (see site plan for details)
100mm cavity - to be filled with Crown Dritherm 32
100mm internal skin of Tarmac Durox Supabloc or similar approved.
Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243:1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

External Cavity Wall Lintels for 300mm Cavity Walls
IG type L1/S100 unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Purge ventilation to windows
For a hinged or pivot window that opens 30° or more the height and width should be at least 1/20th of the floor area of the room.
For a hinged or pivot window that opens less than 30° the height and width should be at least 1/10th of the floor area.

Make good to all disturbed and affected areas.

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Escape windows to be within 1.1m of floor.

Internal wall between garage and dwelling to achieve a 'U' value of 0.35W/m²K.

Smoke detectors to be to BS5839/6:2004, Grade D, Category LD3.

UNION STREET

FLEET ROAD

SITE PLAN

SHDC
PLANNING & DEVELOPMENT
04 JUN 2008
Ref. 0660/08

DETERMINED
PLAN

A - 30.5.08 - IMF. ADDED

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED EXTENSION TO
26 FLEET ROAD, HOLBEACH
FOR

MR. & MRS. A.J. FREEMAN.

SECTIONS / SITE PLAN

1:50 1:200 SD08-017/3
MAY-08 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architect so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.


This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturer's instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.


The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc. Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.


These notes relate to this drawing and all associated drawings.

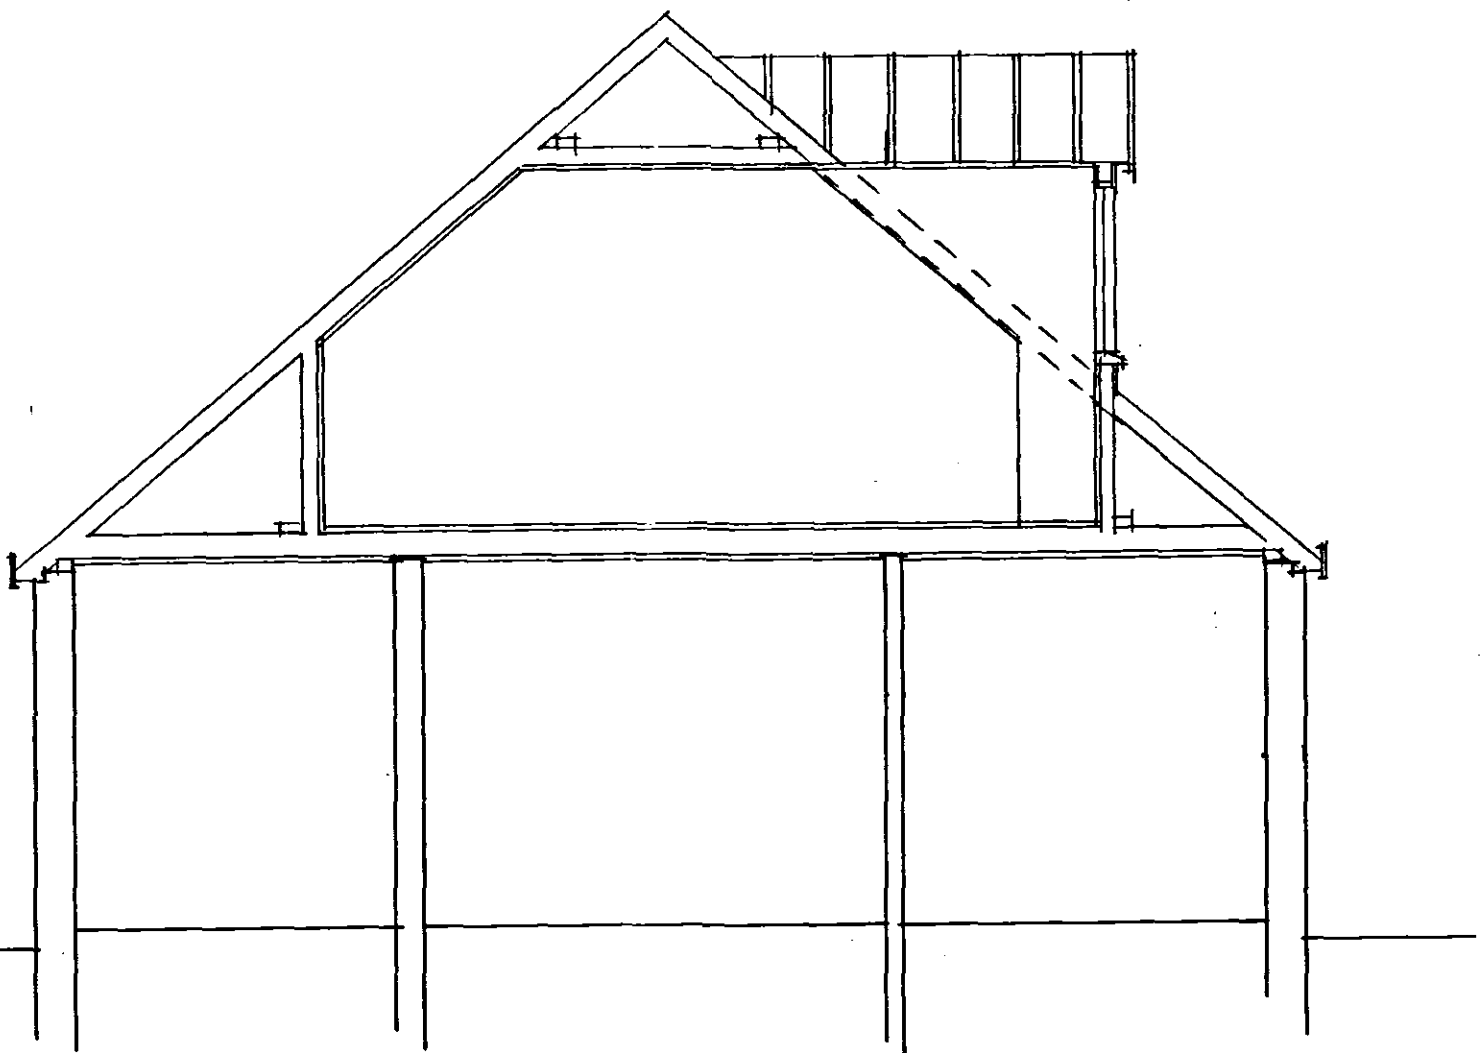

SECTION

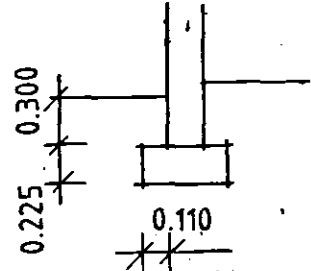

EXISTING FOUNDATION

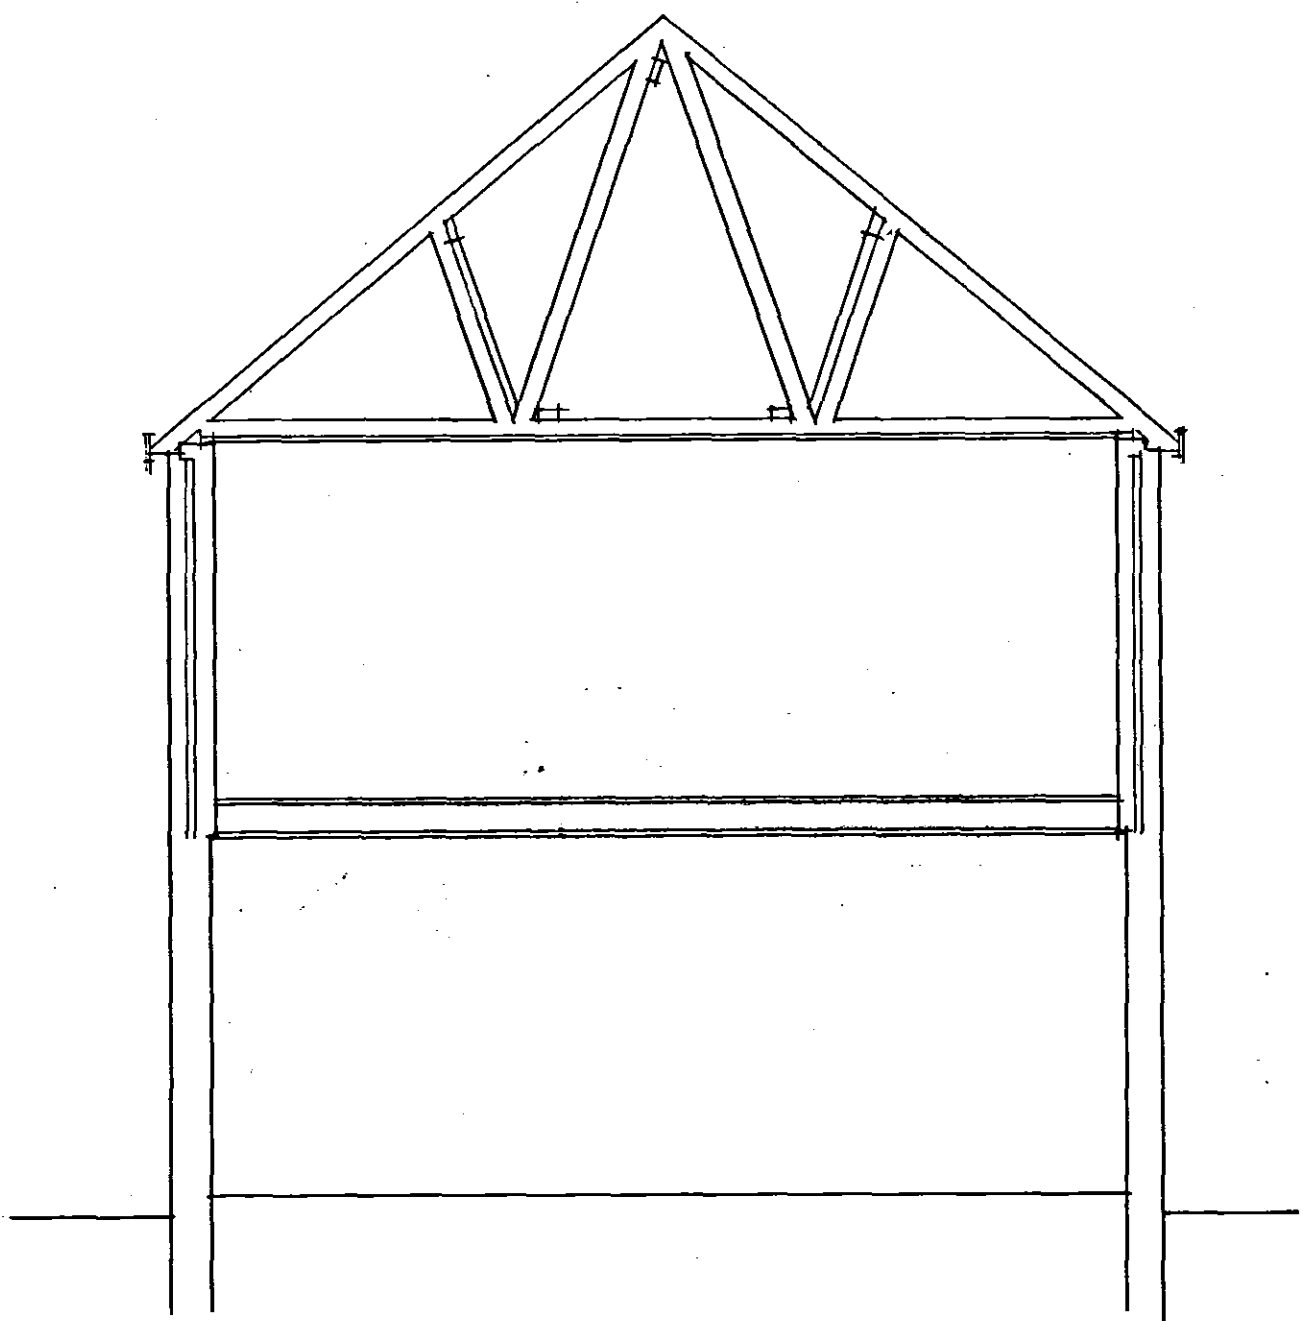

SECTION

THIS DRG. TO BE READ IN CONJUNCTION WITH
SD08-017/1, SD08-017/2