

LINESTYLE THUS – – – – – – DENOTES FUTURE.

TOWER ORIENTATION AND WIRE AND DOWNLEAD CLEARANCES TO BE CONFIRMED.

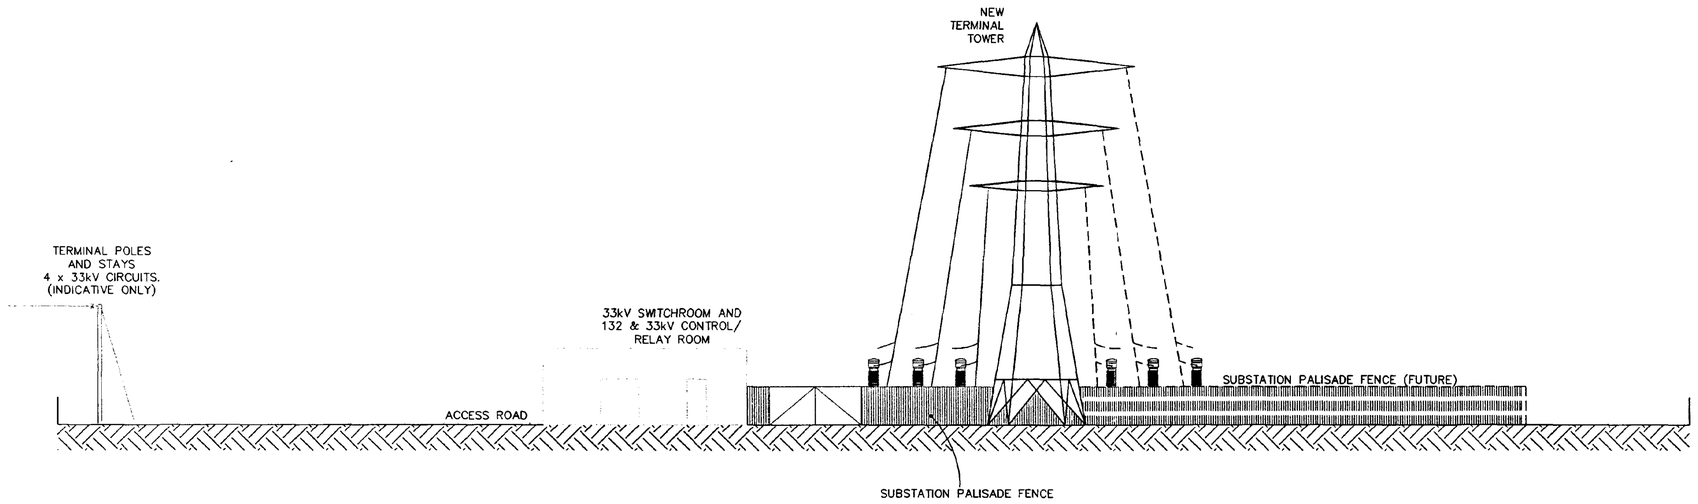

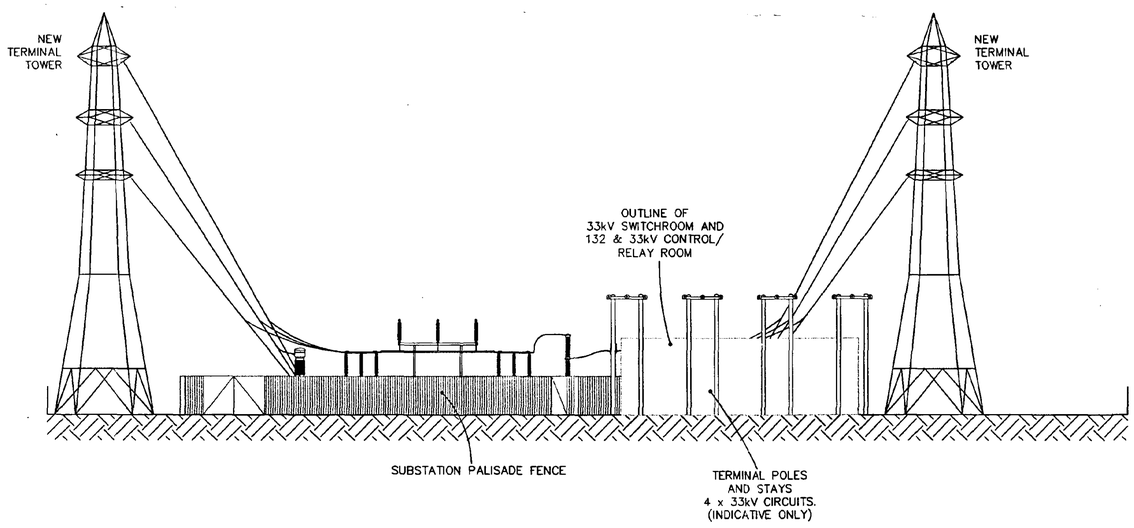

DETERMINED PLAN

SOUTH ... AND DC HOUSE... PLANNING 15 JAN 1998 Ref: 0042/98

ELECTRICAL CLEARANCES		132kV	33kV
PHASE TO EARTH		1200mm	500mm
PHASE TO PHASE		1400mm	430mm
SECTION/SAFETY	VERTICAL	3800mm	2900mm
	HORIZONTAL	2900mm	2300mm

This drawing is copyright of East Midlands Electricity plc and may not be reproduced in any form without the written permission of East Midlands Electricity plc.

POWER SYSTEM UNIT

East Midlands Electricity

FLEET 132/33kV SUBSTATION PROVISIONAL SUBSTATION LAYOUT ELEVATIONS PLANNING DRAWING

REVISION																			
DATE																			
CHECKED																			
APPROVED																			

DRAWN BY	JPW	12.11.97	SCALE : 1:200	CLASS:
CHECKED BY			DRG NO.	
APPROVED BY			95180.513	
SITE DRAWING NO.				

A1

TREES TO BE PLANTED
TO BE EQUAL MIX OF POPULUS NIGRA,ENGLISH OAK(QUERCUS ROBUR)
AND HORSE CHESTNUT(AESCULUS HIPPOCASTANUM) PLANTED AS STANDARDS
AT APPROX 10 METRE CENTRES

ABOVE STANDARDS TO BE UNDERPLANTED WITH A
MIX OF CRATAEGUS MONOGYNA(40%),SALIX XCHRYSOCOMA(25%)
ALNUS GLUTINOSA(25%) AND POPULUS NIGRA(10%)
PLANTED AS WHIPS AT 2-3M CENTRES

TOWER ORIENTATION AND WIRE AND DOWNLEAD CLEARANCES TO BE CONFIRMED.

OIL INTERCEPTOR TANK

STOCKPROOF FENCE

NEW FENCE AND THORN HEDGE

GATE

FIELD

GRASS

DITCH

HEDGE

JIGGLES

BIGGS BANK'S BANK

LITTLE SOUTH HOLLAND DRAIN

KEY TO SERVICES
WATER
BRITISH TELECOM

NOTE :
DETAILS OF THE UNDERGROUND SERVICES ARE OBTAINED FROM THE VARIOUS UTILITY DRAWINGS. WHILST THE INFORMATION GIVEN IS BELIEVED TO BE CORRECTIN NO GUARANTEE CAN BE GIVEN TO THE ACCURACTO AND ARE SUBJECT TO THE UTILITY DISCLAIMERS NOTED ON THEIR DRAWINGS.

ALL LEVELS SHOWN ARE EXISTING GROUND LEVELS.

Coordinate Table				
Station	Description	Easting	Northing	Level
SC1		500.000	500.000	2.330
SC2		492.150	387.737	1.746

PLAN
Ref.

RECEIVED
24 FEB 1998
Ref: 0042 C/A

This drawing is copyright of East Midlands Electricity plc and may not be reproduced in any form without the written permission of East Midlands Electricity plc.

POWER SYSTEM UNIT

East Midlands Electricity

PROPOSED FLEET 132KV SUBSTATION.
PLANNING DRAWING + LANDSCAPING

REVISION	DATE	CHECKED	APPROVED	DESCRIPTION
C	17/2/98	DWK		TREEPLANTING AMENDED
B	5/2/98	DWK		LANDSCAPING ADDED
A	4/12/97	DWK		DOORS REPOSITIONED IN SW/ROOM

DRAWN BY JPW 12.11.97 | SCALE: 1/250 | CLASS: 10
CHECKED BY
APPROVED BY
SITE DRAWING NO.
DRG NO. 95180.512

A0

DETERMINED