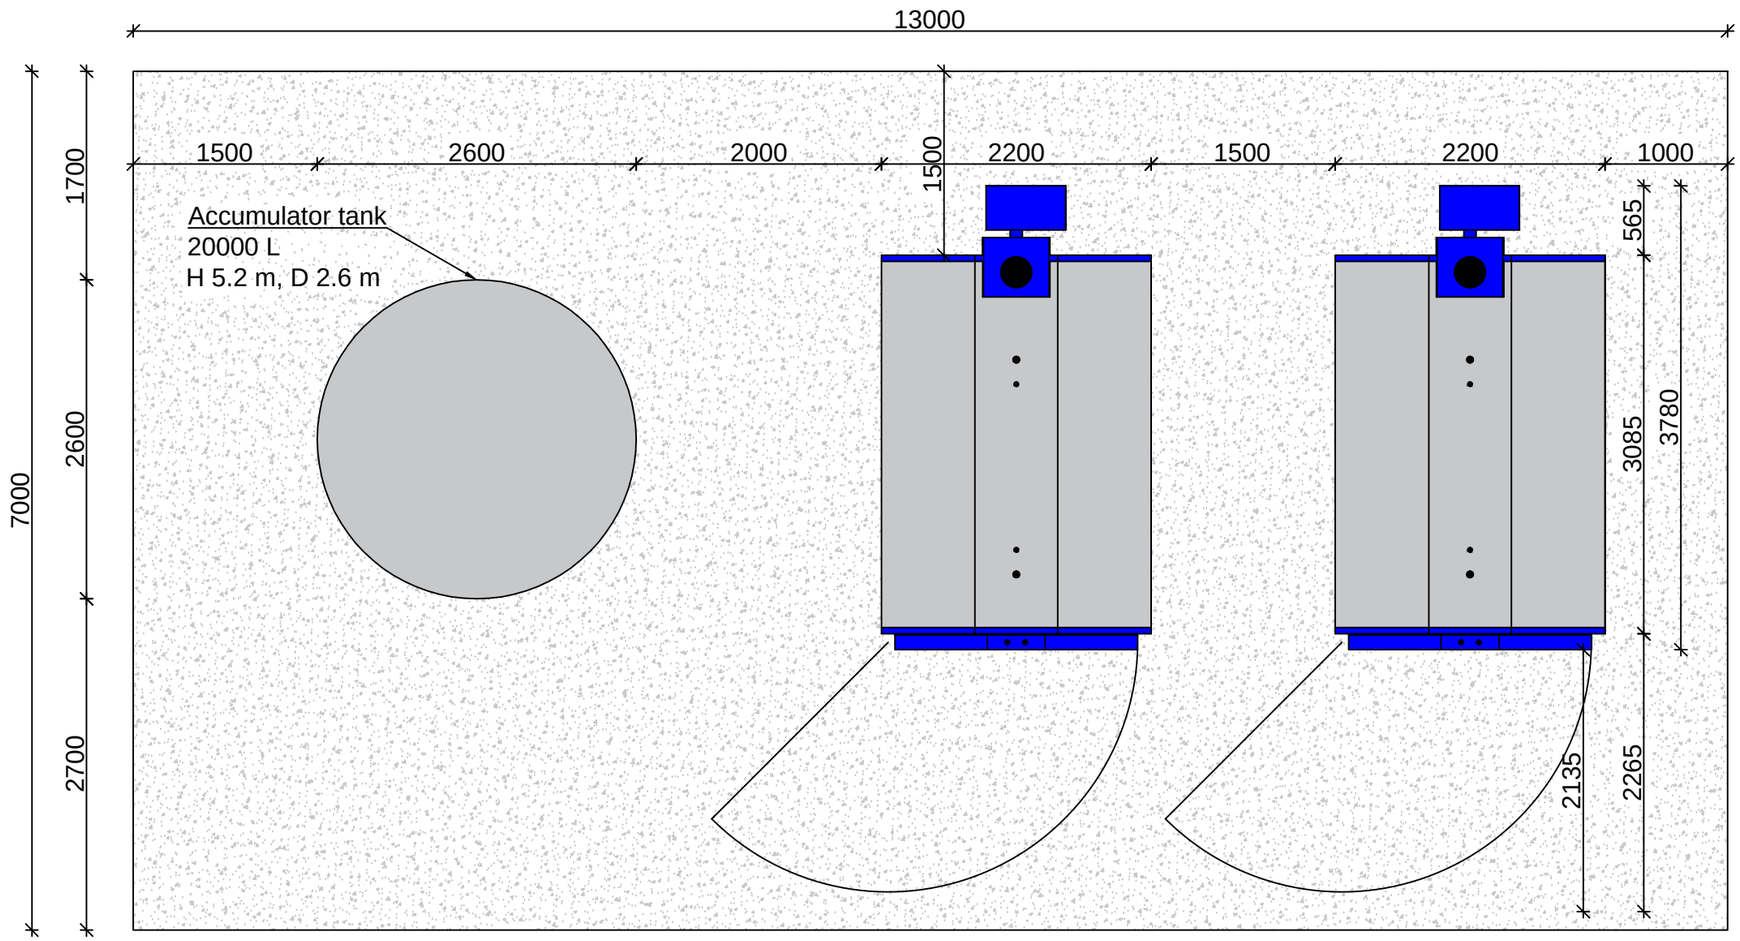


NOTES:

-

Circulator

Direction of Flow

Isolation Valve

Temperature Spore

Valve

Flow Meter

Eligible Use

Inegrator

P.R.V.

Motorised Valve

Plate Heat Exchanger

FCU Fan Coil Unit

Non Return Valve

GlenFarrow
Spalding Road, Pinchbeck, Spalding, Lincs. PE11 3UE

Plumbing, Heating, Irrigation, Water & Pumping Services

Tel: 01775 722327 Fax: 01775 725444
email: info@glenfarrow.co.uk

CLIENT:

PROJECT:

2x GF295 and 20 000 L Acc Tank Layout

SCALES:	DRAWN:	DATE:
1:50	AL	05/04/2018

DRAWING NO:	REV:	
GF-Bio Rook1	-	A3

NOT FOR CONSTRUCTION