


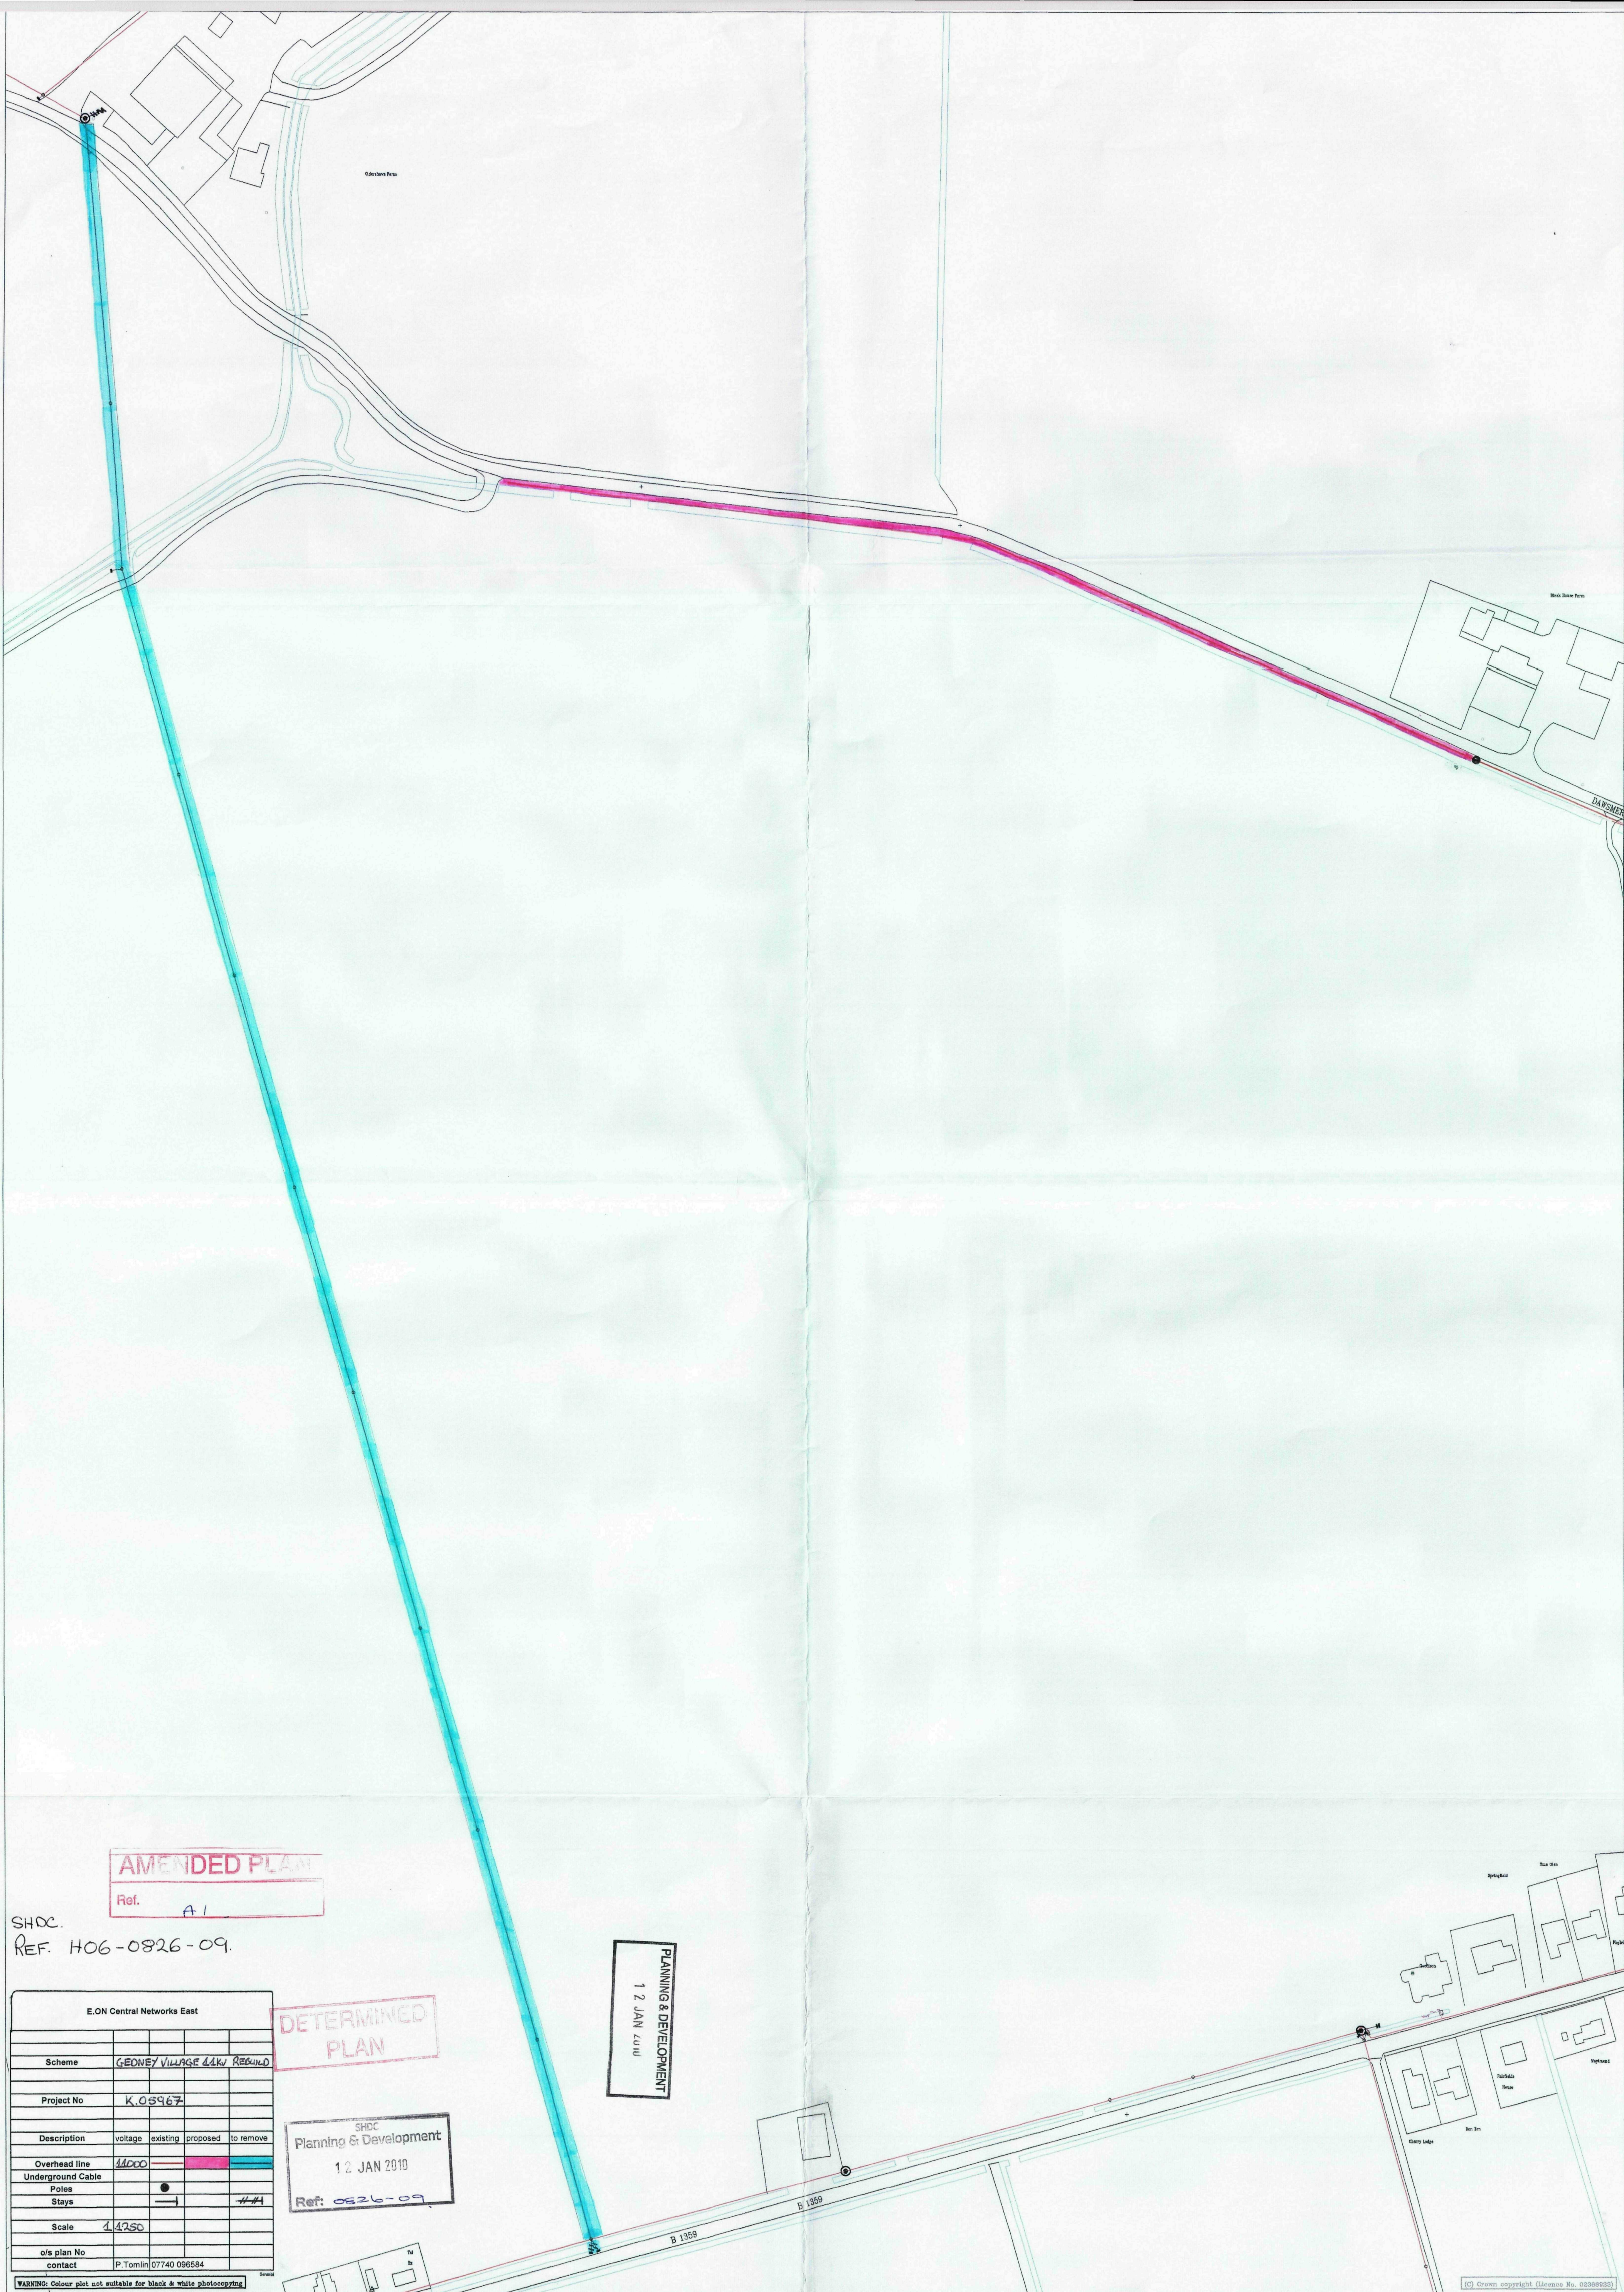

AMENDED PLAN
Ref. A1

SHDC.
REF. H06-0826-09.

E.ON Central Networks East				
Scheme	GEDNEY VILLAGE 44kV REBUILD			
Project No	K.05967			
Description	voltage	existing	proposed	to remove
Overhead line	44kV			
Underground Cable				
Poles				
Stays				
Scale	1:1250			
o/s plan No				
contact	P.Tomlin 07740 096584			

DETERMINED
PLAN

SHDC
Planning & Development
12 JAN 2010
Ref: 0826-09

PLANNING & DEVELOPMENT
12 JAN 2010