
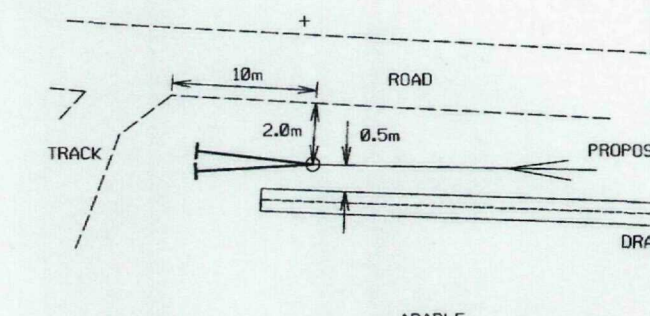
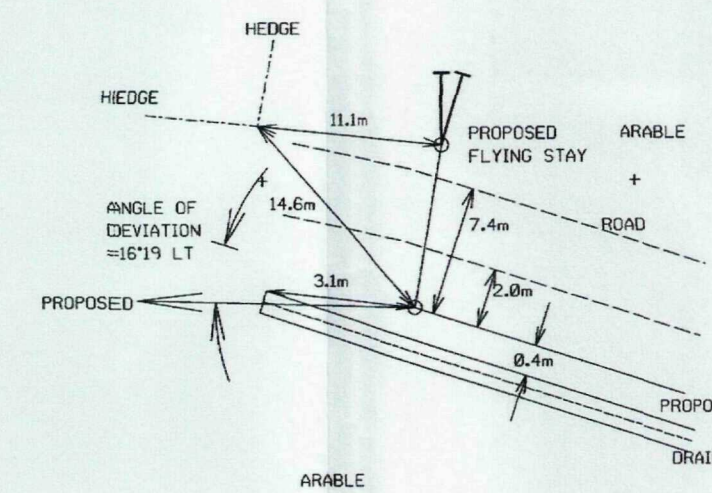
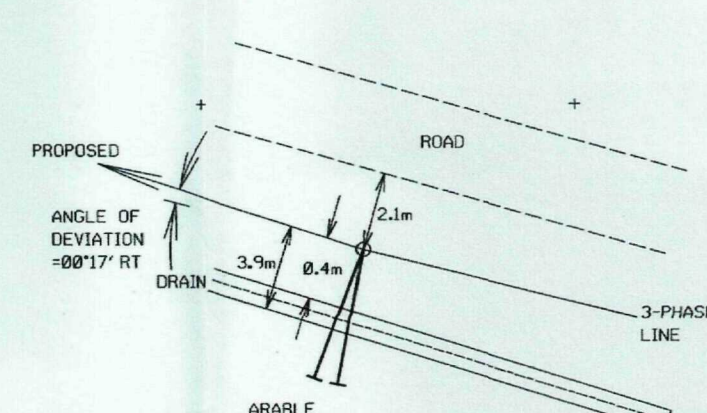


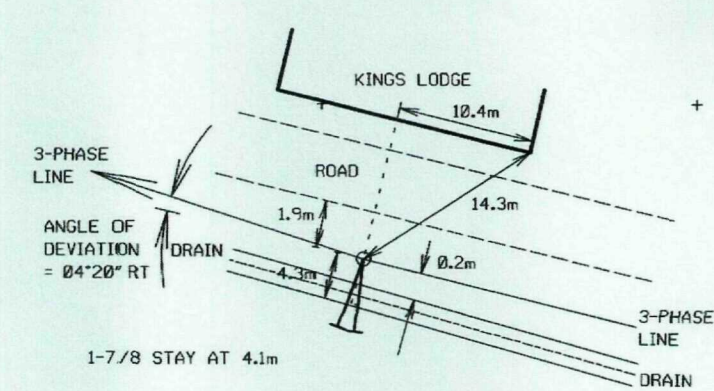

ANGLE POLE No4
EXISTING
4
217.05
S
11x240 (M)
PIN ANGLE
A002
2-7/4 STAYS AT 5.0m

EXISTING
5
318.67
S
11x240 (M)
INTER
A010

TERMINAL POLE No6+
REPLACEMENT
6
389.55
S
13x340 (E)
PIN ANGLE
A002
2-7/4 STAYS AT 6.1m +
P.M.T.
L.V. U/G OFF




NEW	+	NEW
7		8
467.25		544.95
S		S
13x260 (M)		12x250 (M)
INTER		INTER
A010		A010

ANGLE+ POSITION No9 (A)
NEW
9
622.65
S
11x240 (M)
SECT ANGLE
A003
2-7/4 STAYS AT 5.0m
C/W FLYING STAY OVER ROAD

NEW
10
720.43
S
12x250 (M)
INTER
A010

TERMINAL POSITION
 NEW
 11
 818.22
 S
 11x295 (S)
 TERMINAL
 A008
 2-7/4 STAYS AT 8.6m
 H.V. U/G


NOTE:
IF BT POLE IS MOVED AWAY FROM 11KV LINE
THEN POLE AND CONSEQUENTLY STAY CAN BE
SHORTENED

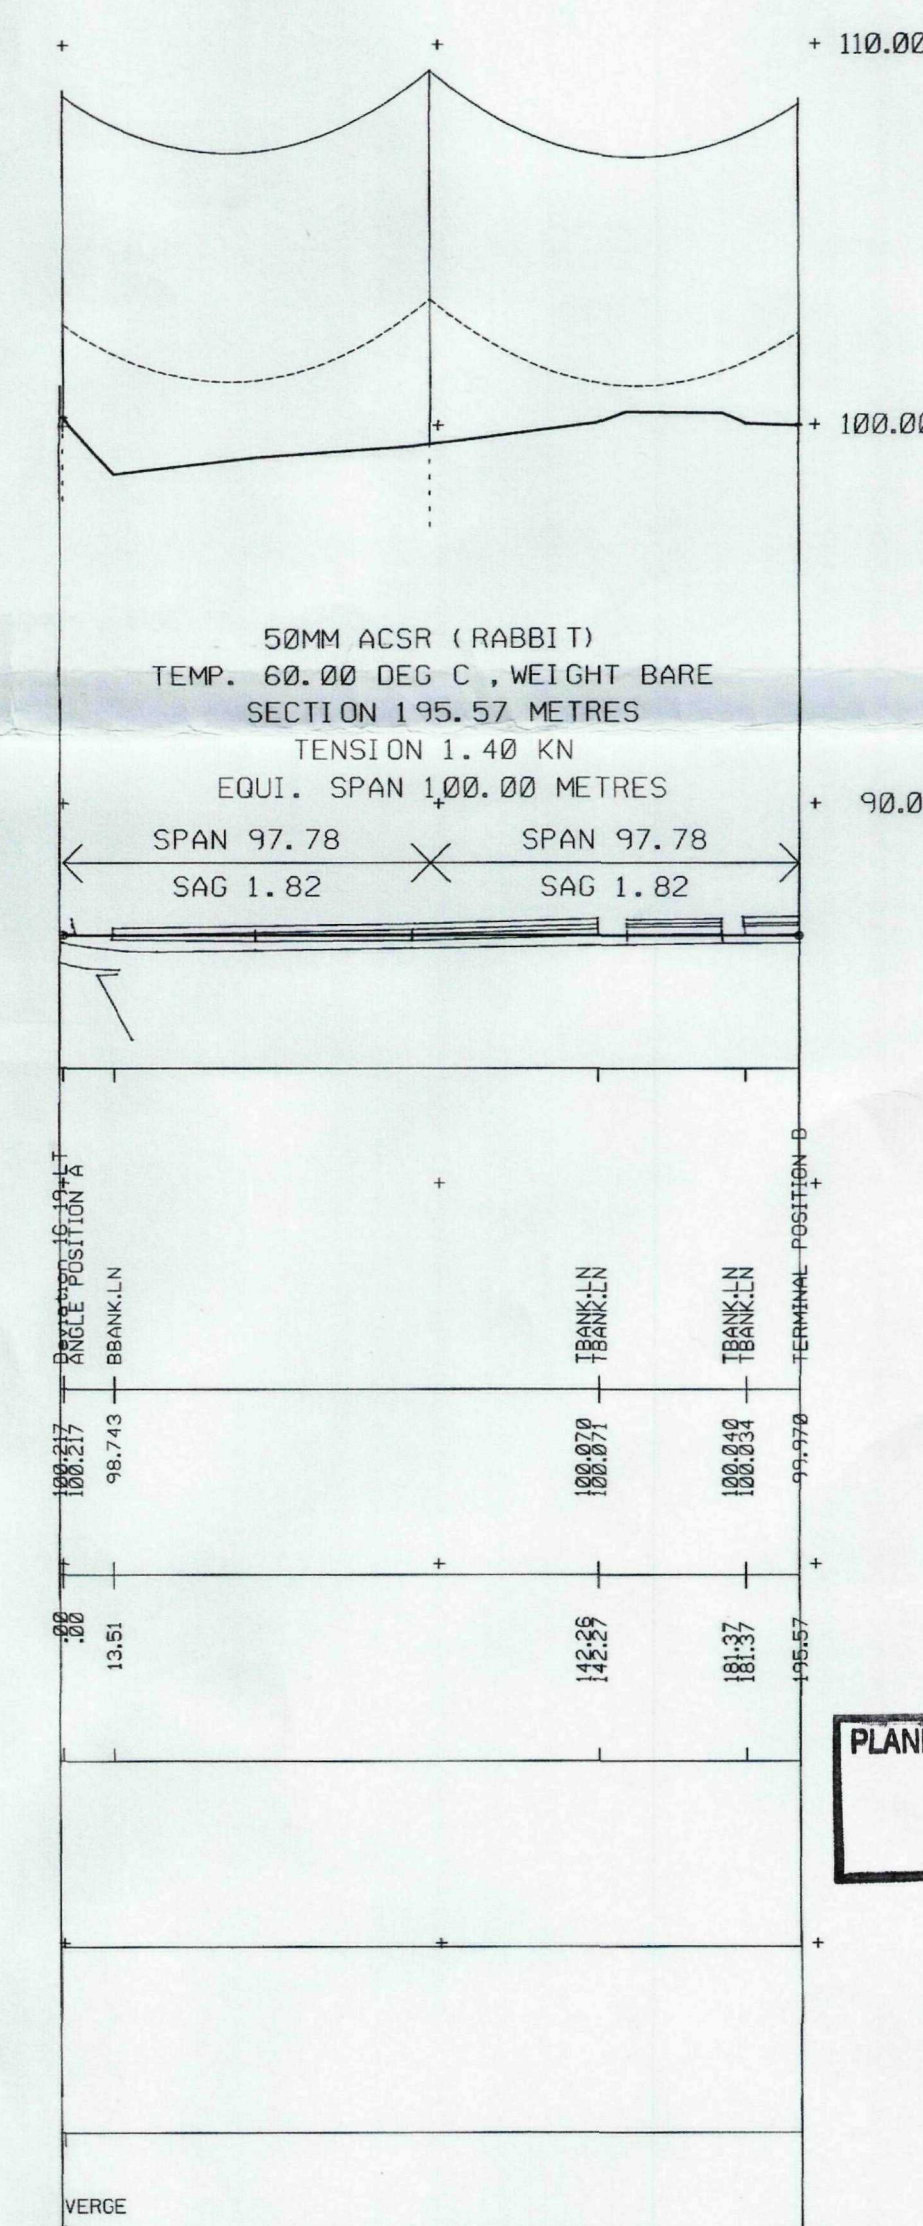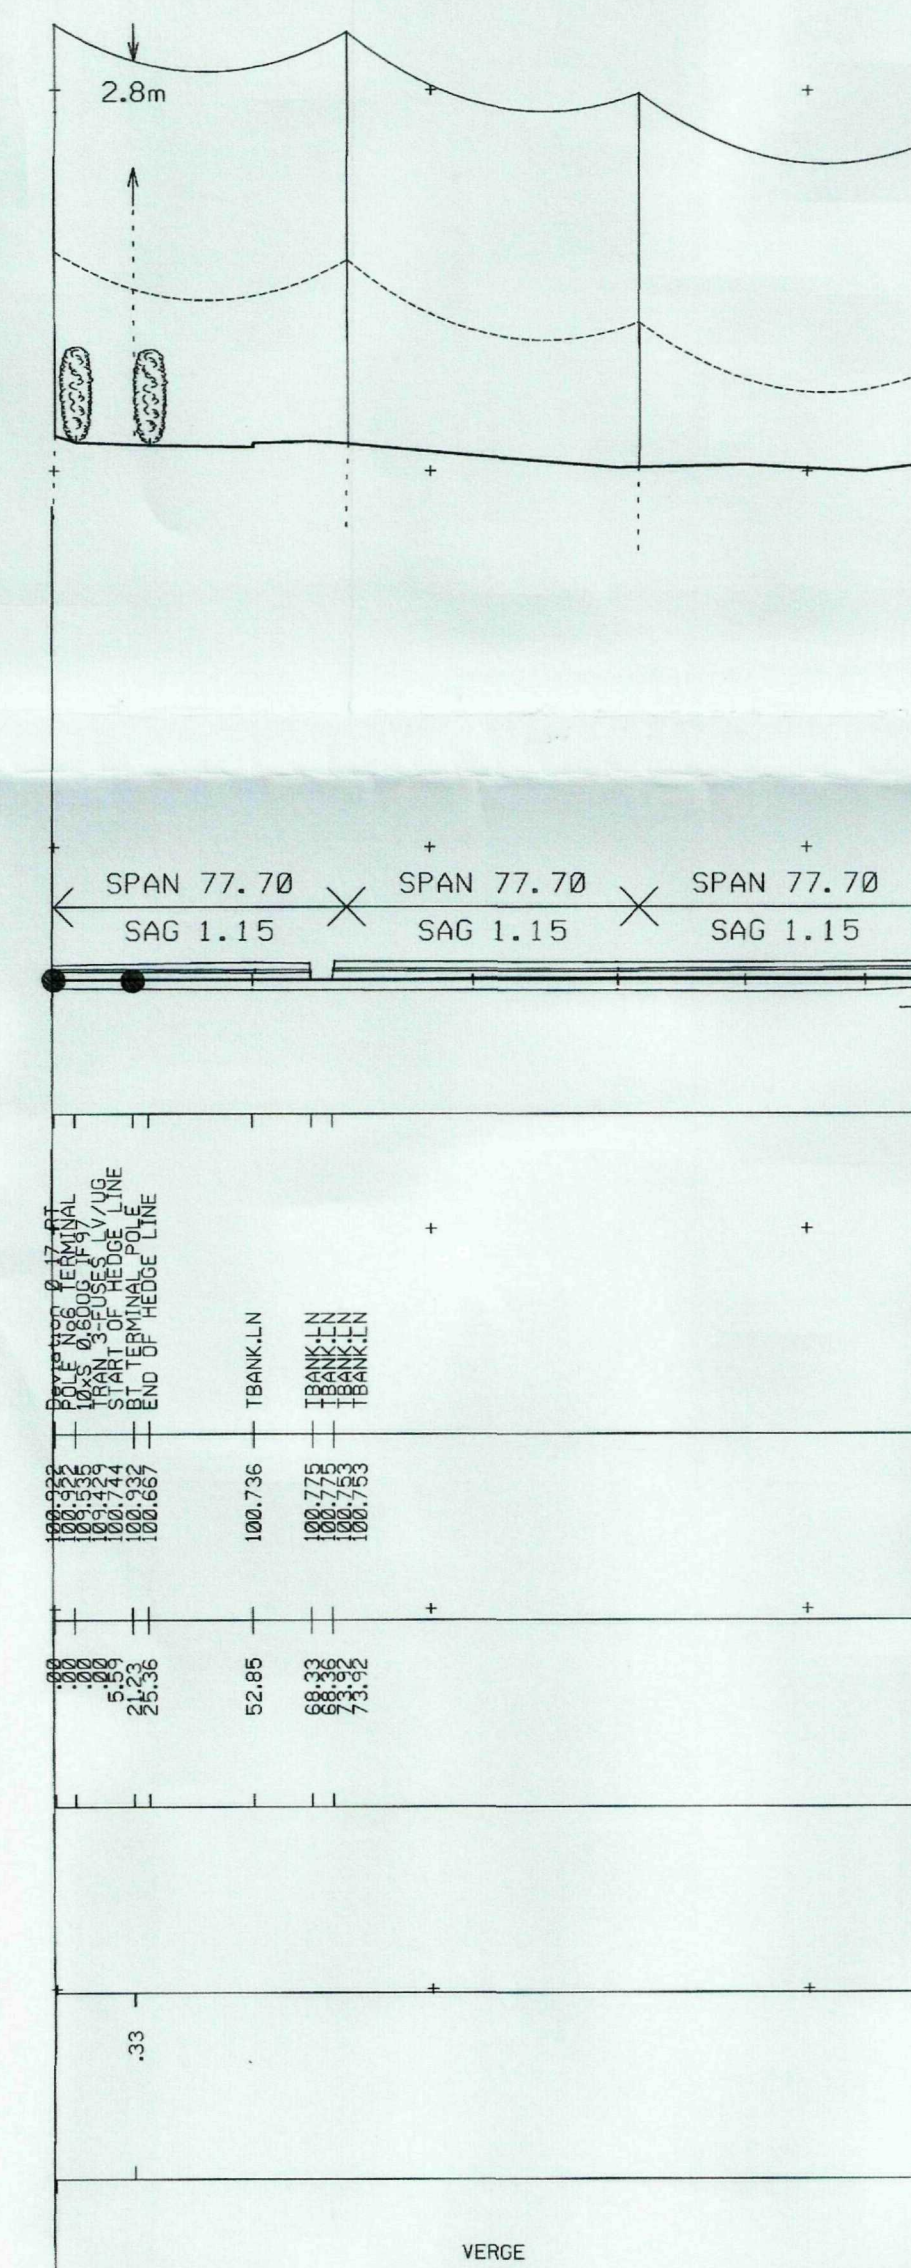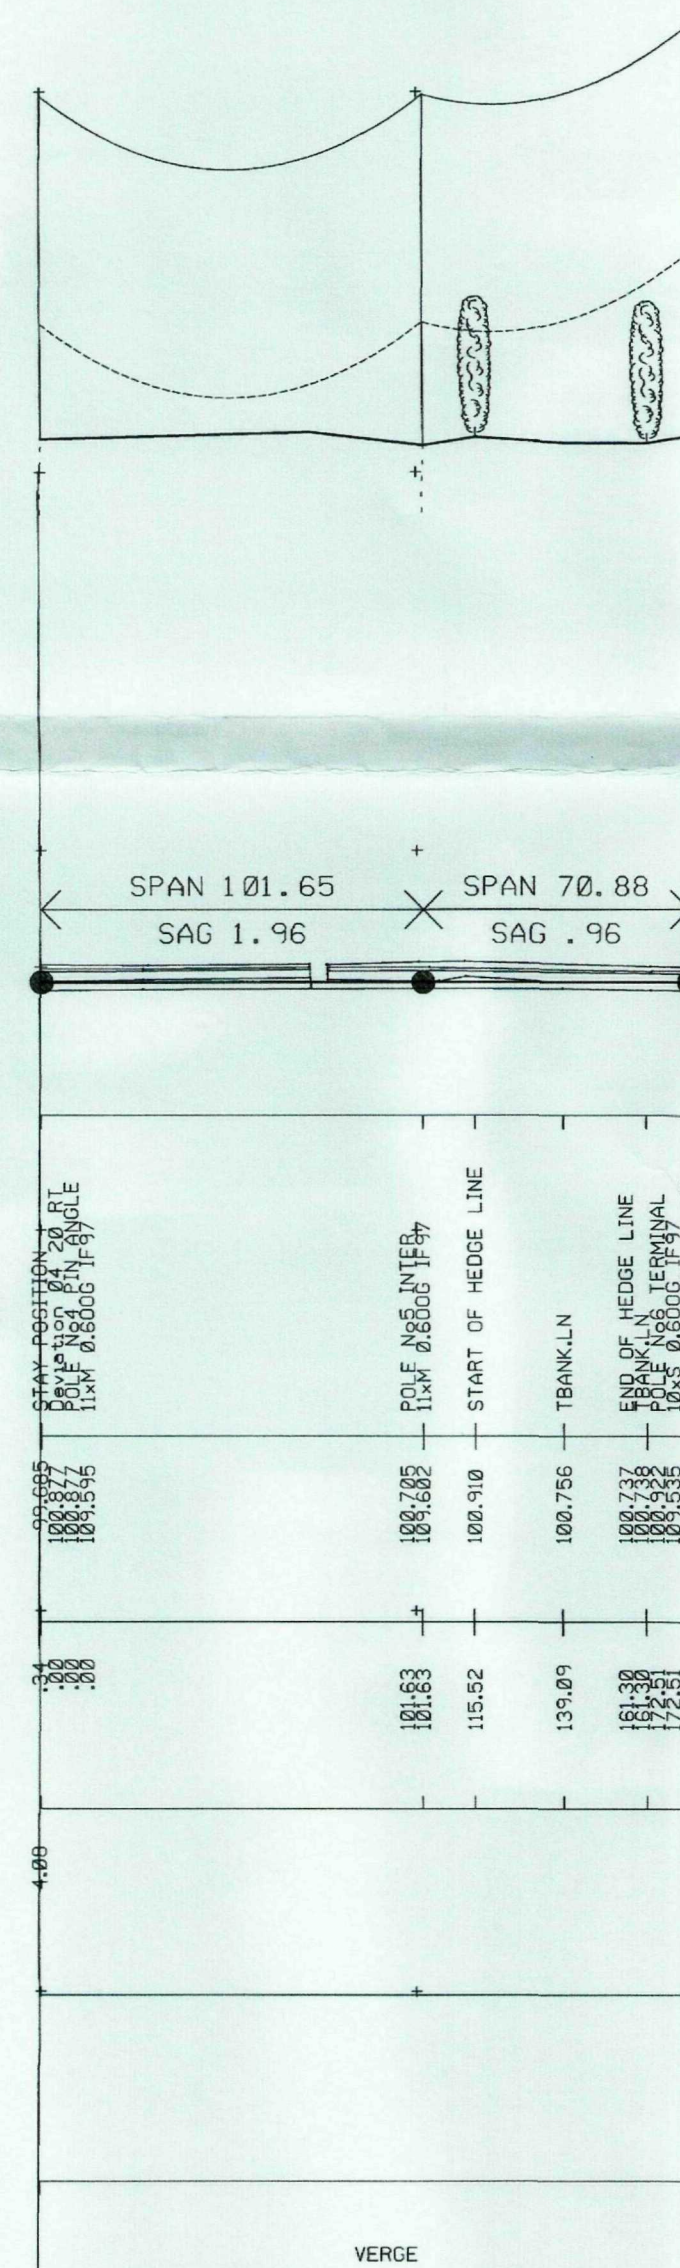

PLANNING & DEVELOPMENT
12 JAN 2010

SHDC REF H06-0826-09

FIRST ISSUE	ORIGINAL	SECOND ISSUE		THIRD ISSUE		FOURTH ISSUE		FIFTH ISSUE	SUBMIT LSTC SUBMIT	SPECIFICATION : OH MANUAL VOLUME 1 CONDUCTOR : RABBIT 50mm ACSR AT 60 C GROUND CLEARANCE 6.0m	Surveyed and drawn by: YORKSHIRE HOUSE YORK ROAD LITTLE DRIFFIELD EAST YORKSHIRE YO25 5XA TEL: 01377 253617 FAX: 01377 259555	PROP. No.	DATE	SEPT 2009	TITLE
											BK REF	CNE TRACKER No	K.05967		11KV OVERHEAD LINE REBUILD AT GEDNEY VILLAGE JOB NoCNE-09-291
											SCALE	H = 1:2000 V = 1:200	DRAWING No SHEET	01.09291.01 1 OF 1	SURVEYED FOR CENTRAL NETWORKS

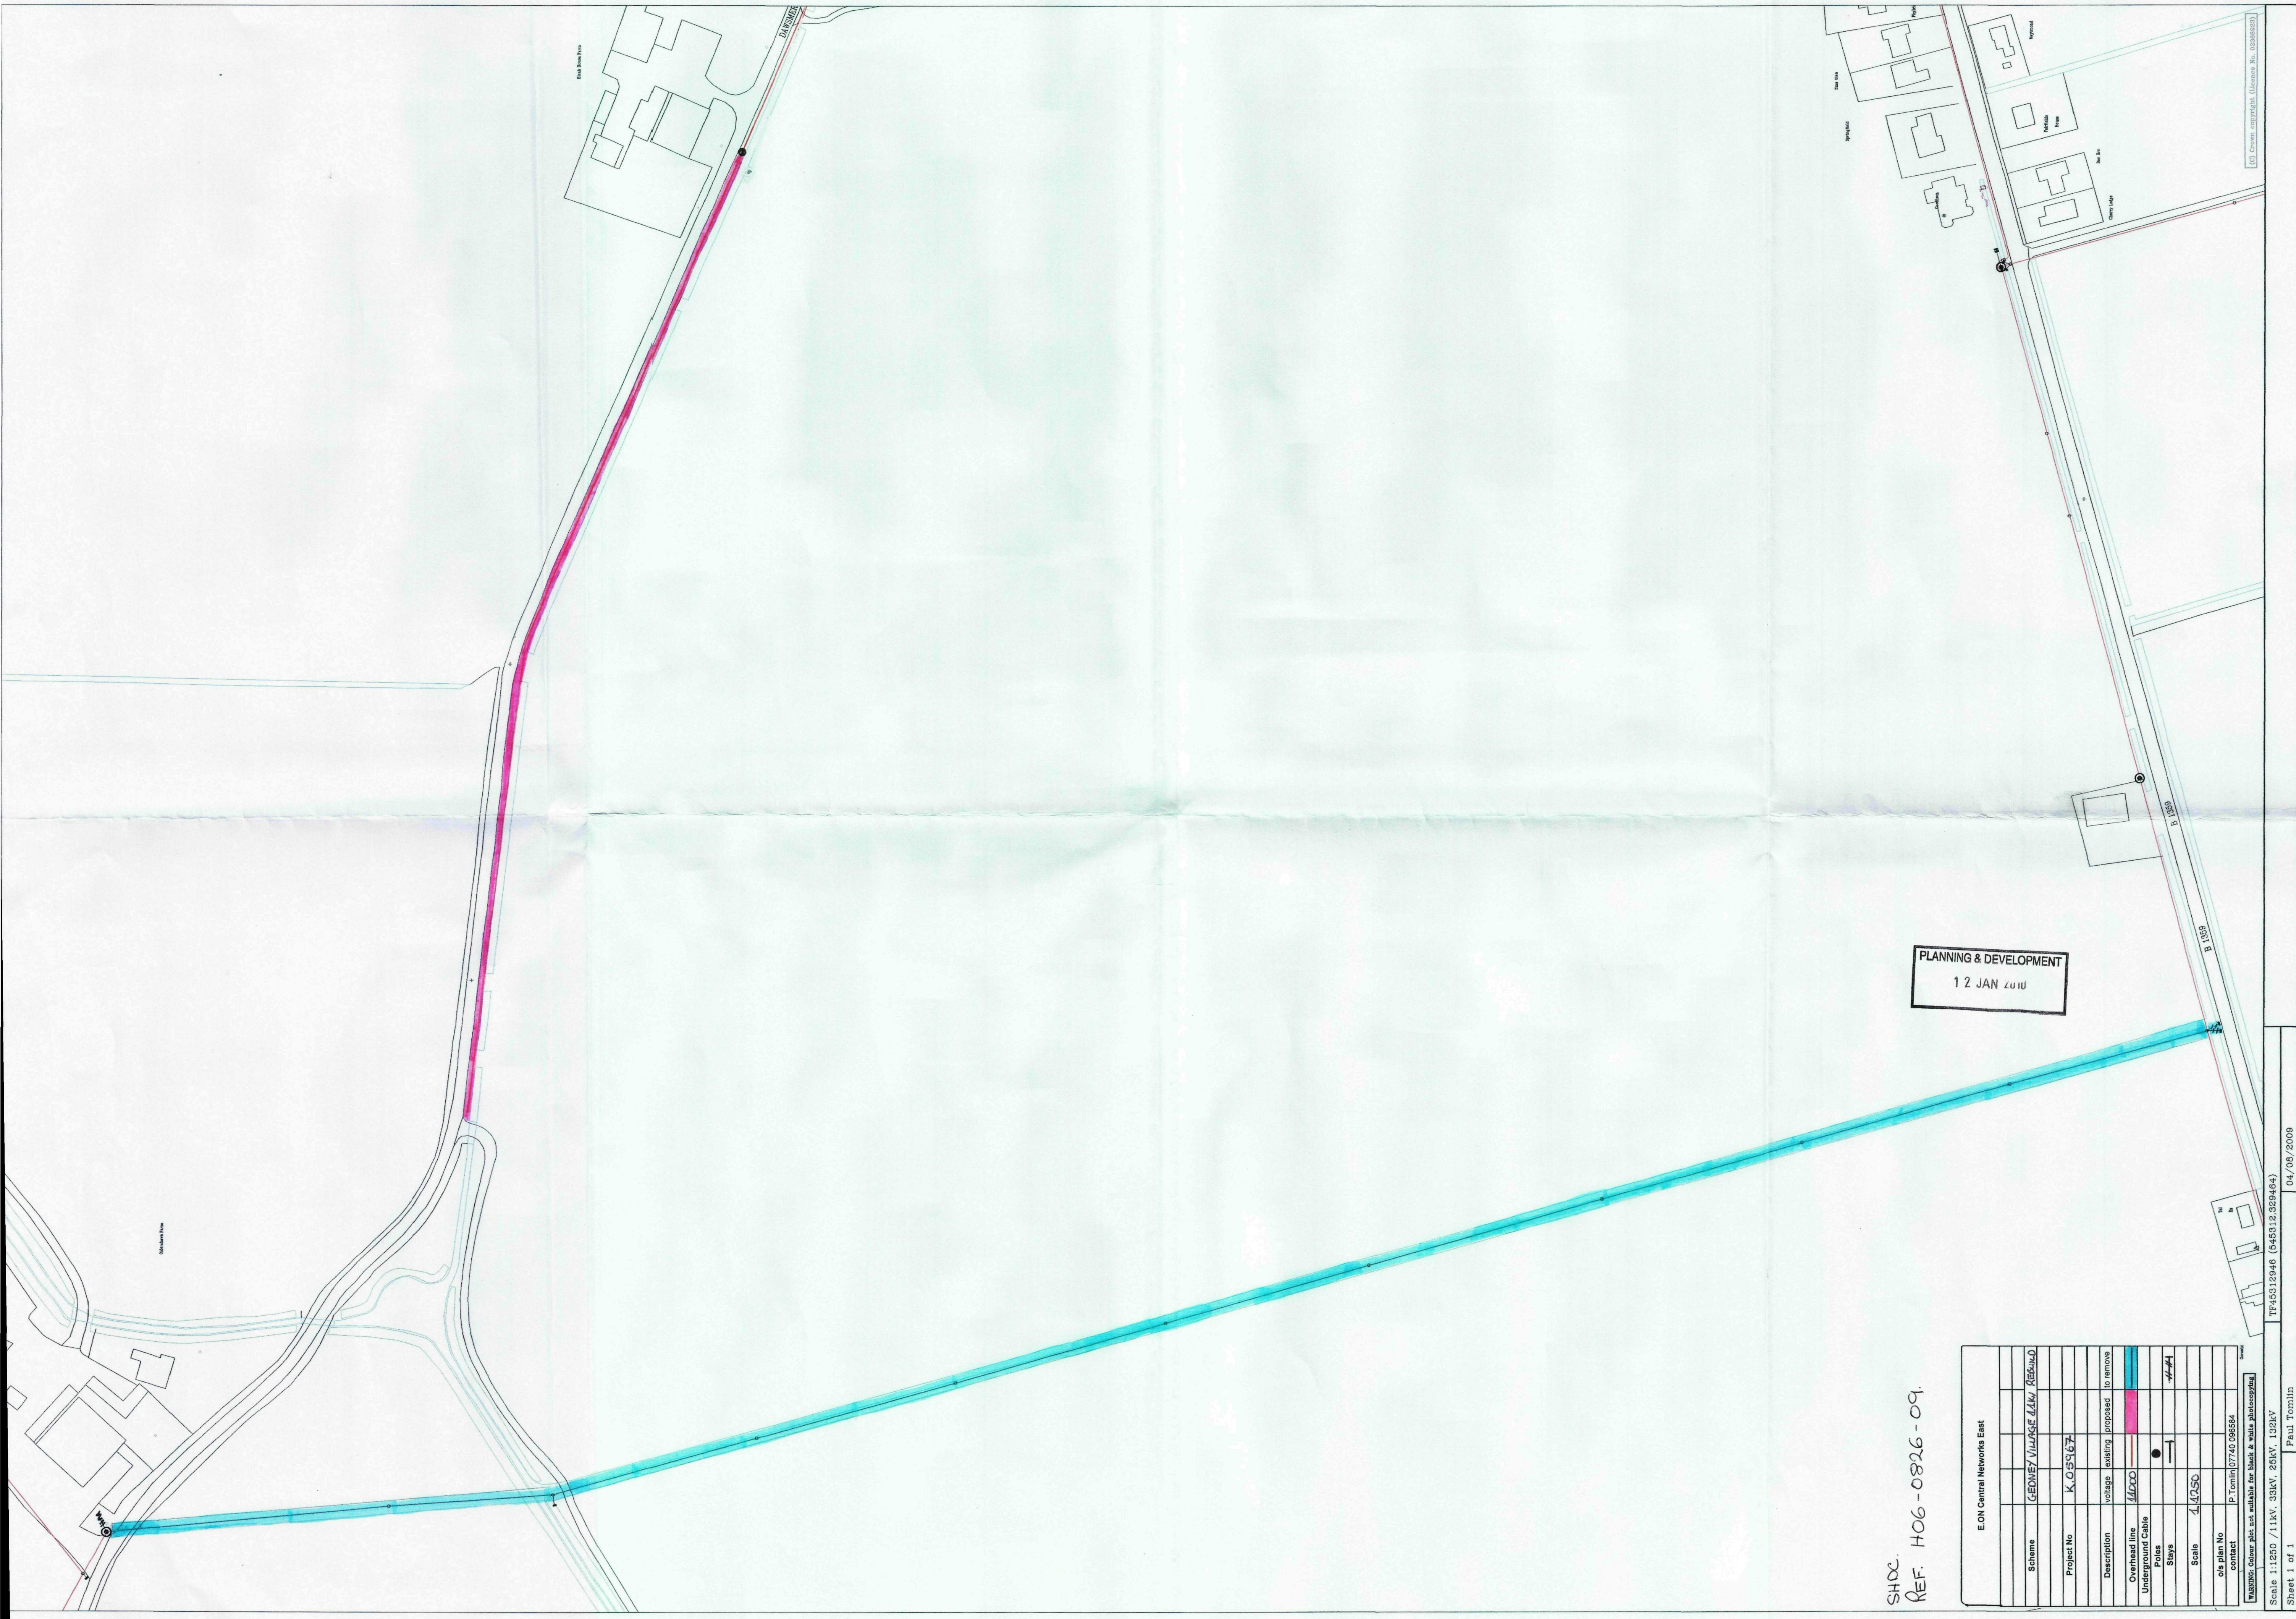

SHDC.
REF. H06-0826-09.

PLANNING & DEVELOPMENT
12 JAN 2010

EON Central Networks East									
Scheme	GEDNEY VILLAGE 4kV	REBUILD							
Project No	K.05967								
Description	Overhead line	Existing	Proposed	No remove					
Underground Cable									
Poles									
Stays									
Scale	1:1000								
of plan No									
contact	P. Tomlin 07740 08684								

Scale 1:1000 / 11kV, 33kV, 20kV, 132kV
Sheet 1 of 1
TP45313946 (045312359464)
04/08/2009
Paul Tomlin