
Proposed Residential Development West Drove, Gedney Hill, Spalding Lincs 30/10/2019



Proposed Residential Development West Drove, Gedney Hill, Spalding Lincs
30/10/2019

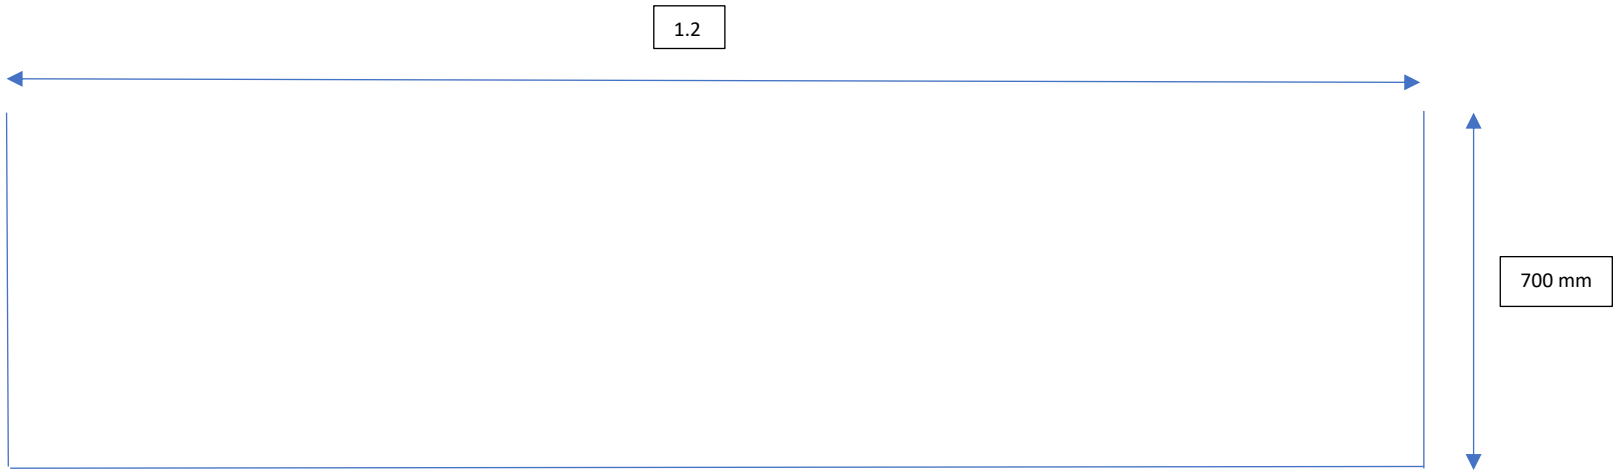

Section diagram

PLAN ON SA 1,2,3

Each trial hole was filled with water to a depth of 300mm and timed from 75% filled down to 25%

Proposed Residential Development West Drove, Gedney Hill, Spalding Lincs
30/10/2019

Hole 1

Time in mins	Depth of water
0	225
110	75

Time in seconds 6600/150mm = 44 (v) seconds to drop every mm

Hole 2

Time in mins	Depth of water
0	225
118	75

Time in seconds 7080/150mm = 47.2 (v) seconds to drop every mm

Hole 3

Time in mins	Depth of water
0	225
125	75

Time in seconds 7500/150mm = 50 (v) seconds to drop every mm

Average V Value = 47.06