
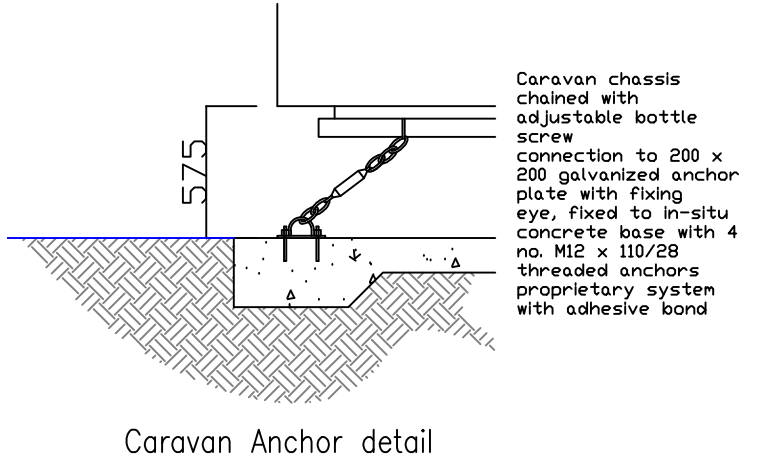
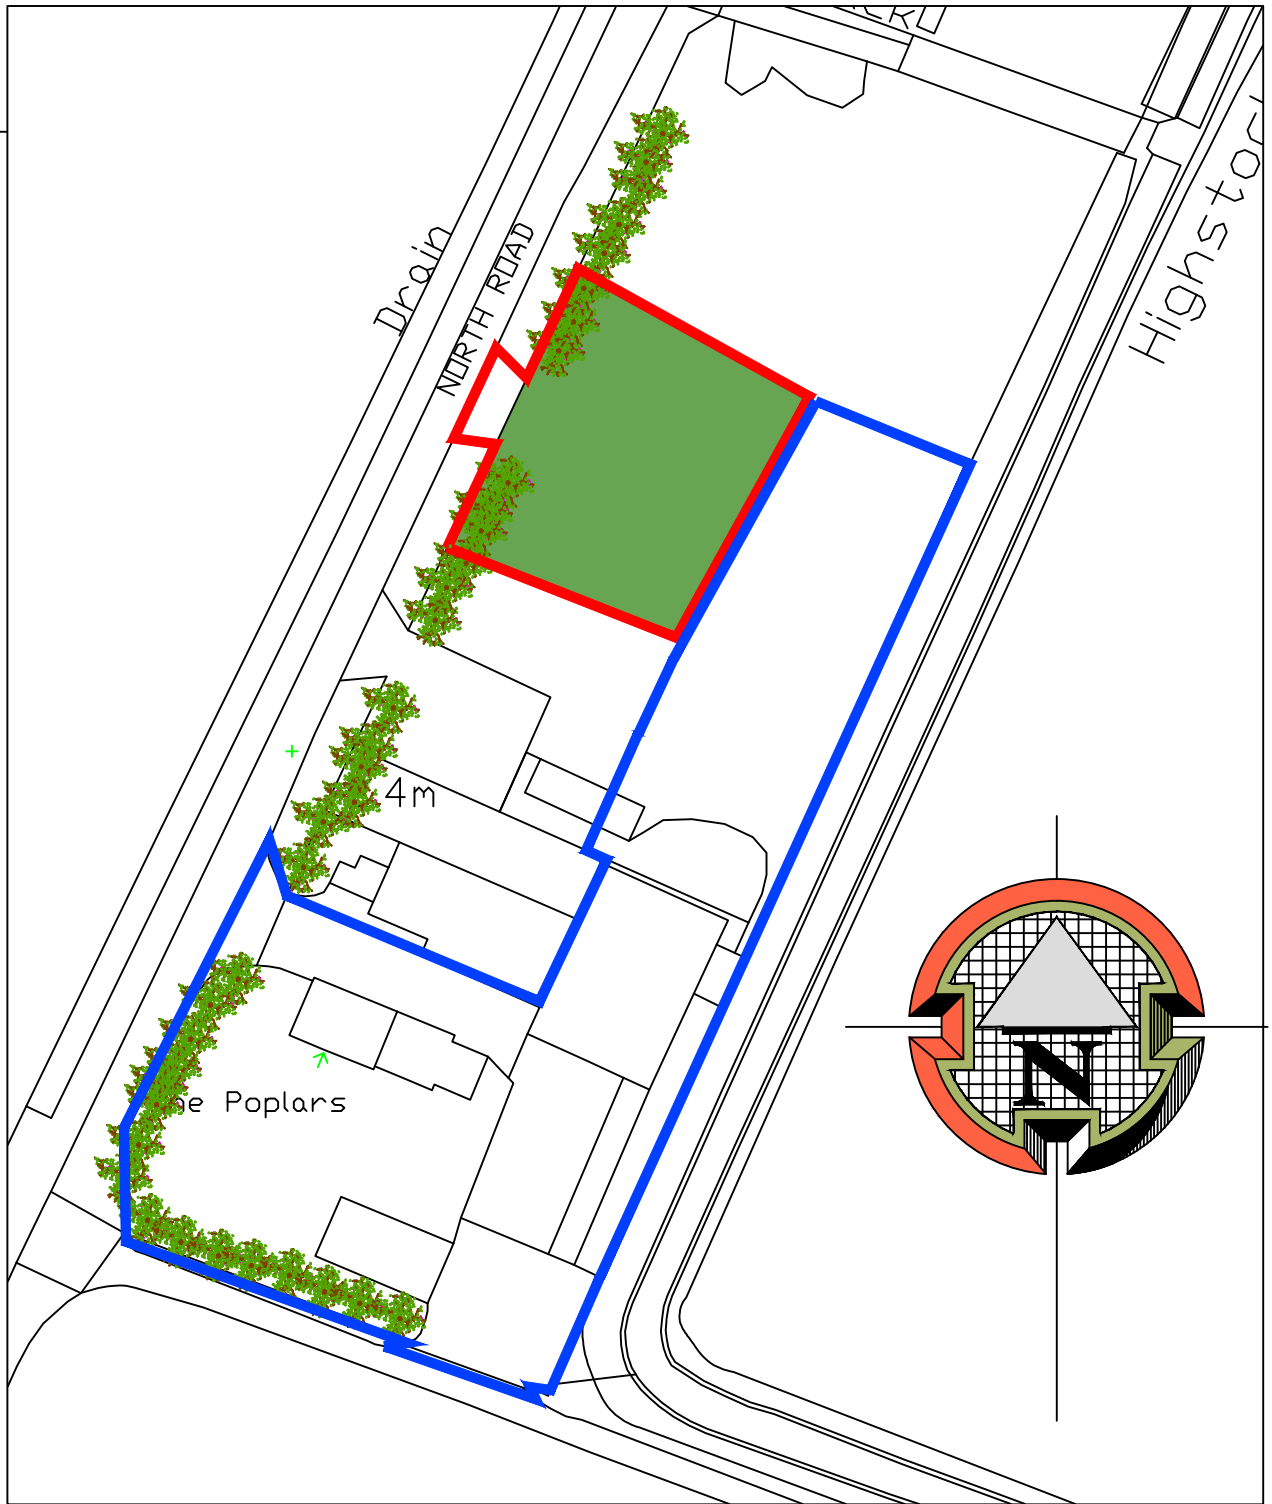
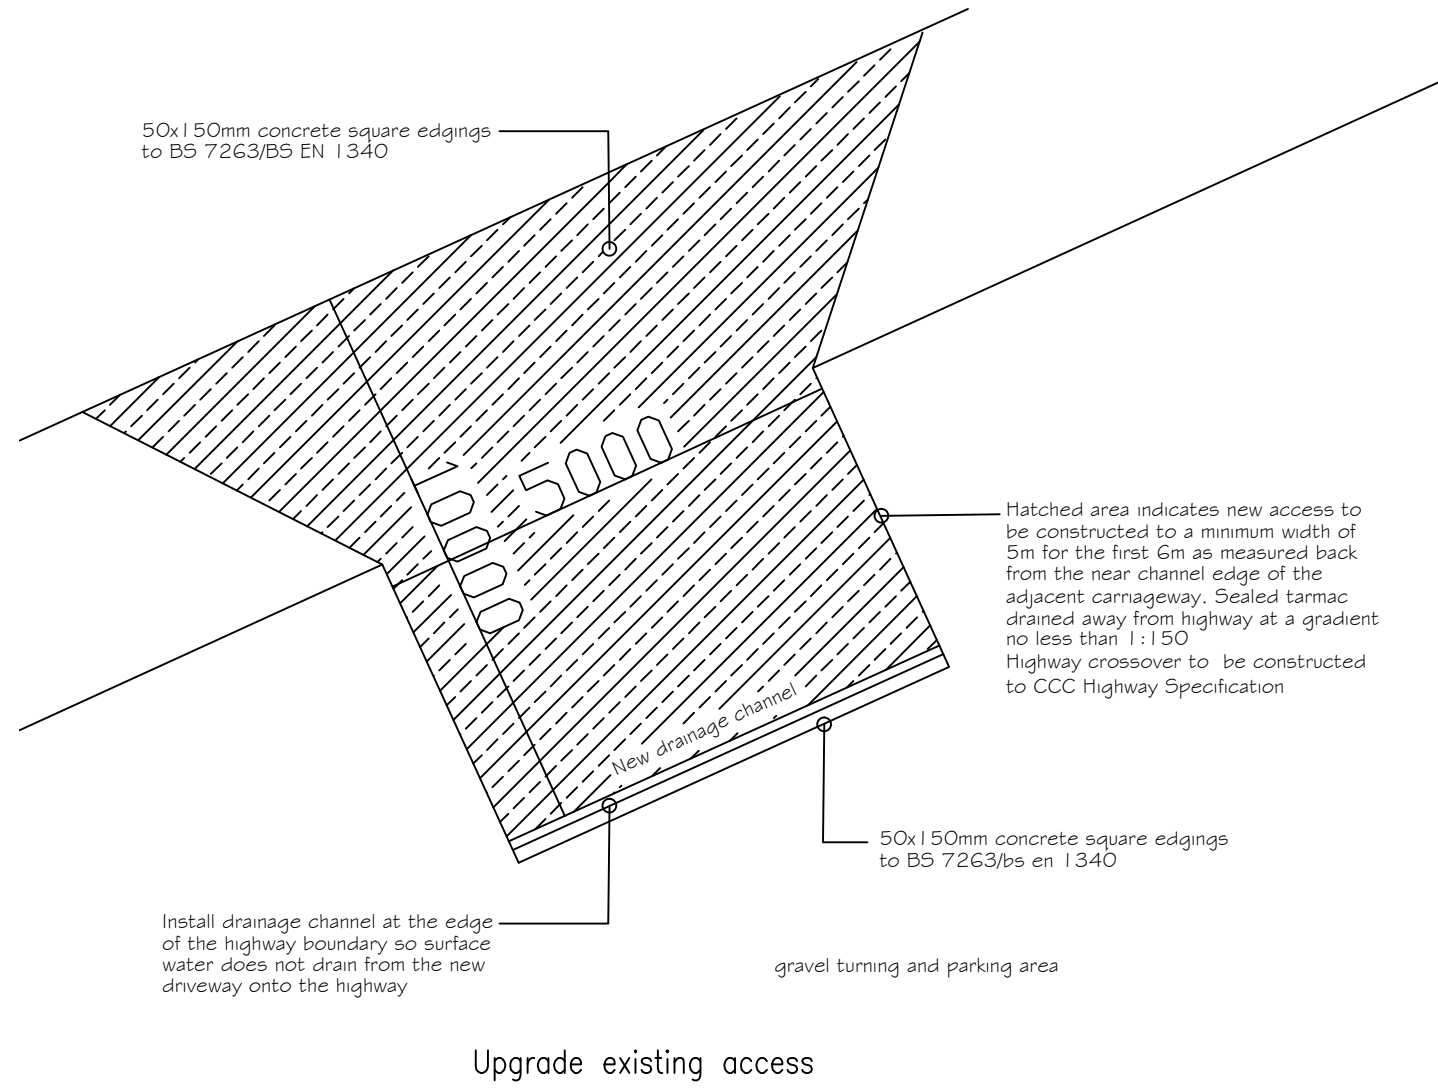
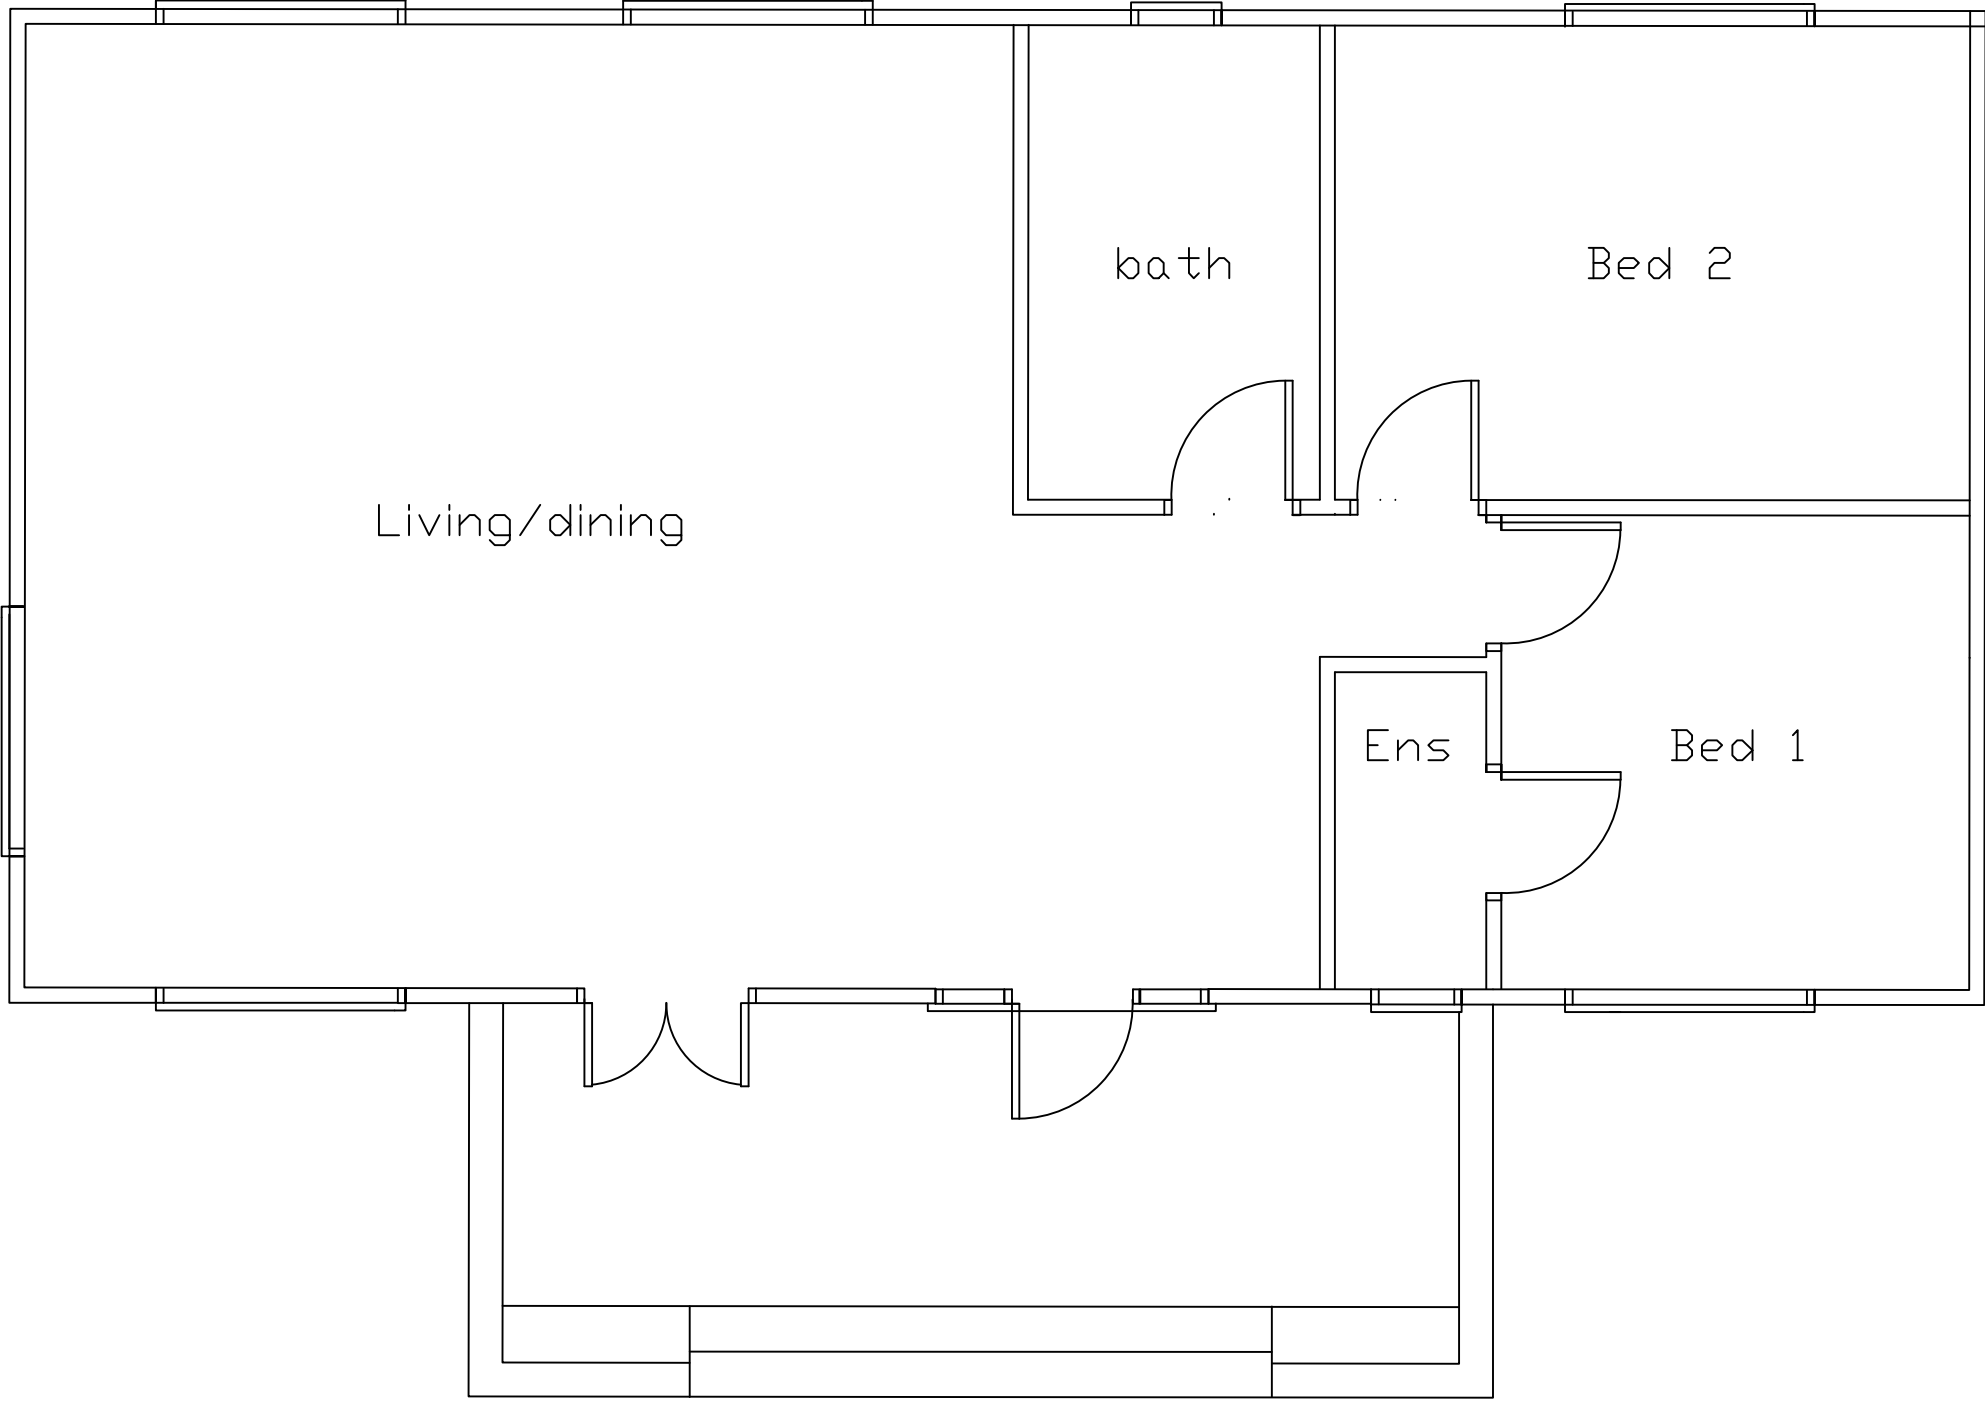


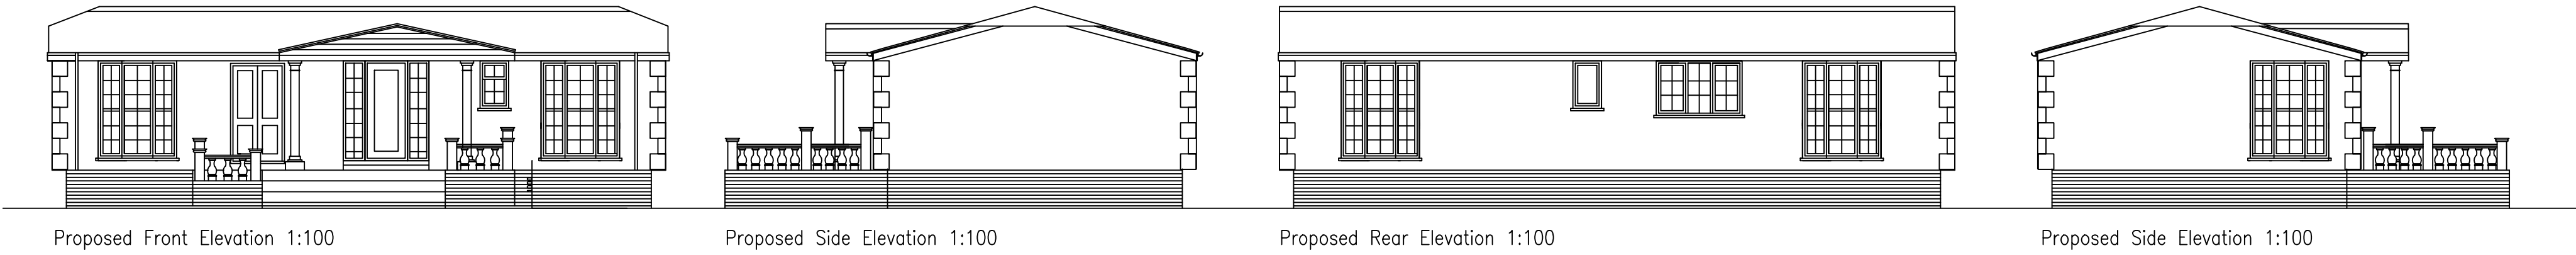

- General Notes:
- Dimensions on all drawings are shown in "mm".
 - The contractor,sub-contractor and supplies must verify all dimensions before commencement of any works on site.
 - This drawing is to be read in conjunction with any relevant engineers and specialist sub-contractor drawings and specifications.
- Landscaping Key (hard and soft)
- Lawn area
 - Access
 - Driveway/Parking/Courtyard permeable loose gravel or similar to aid
- Native hedgerow retention
- Hedgerow planted with a balanced mix of:
- Black thorn
- Native hedgerow 10% gain, perimeter plantage
- Blackthorn
 - Hazel
 - Hawthorn
 - Field Maple


- Asphalt Access Area construction detail.
1. Refer to BS EN 13108–1 for material spec for asphalt concrete.
 2. Refer to BS EN 13108–4 for material spec for hot rolled asphalt.
 3. Refer to BS EN 13108–5 for material spec for stone mastic asphalt.
 4. Refer to BS 594987 for transport,laying and compaction of all asphalts.
 5. Bond coats to be used in accordance (no.4) to be applied on all kerb and edging faces along with gully and cover frames. Bond coats to be applied on top of base and binder courses. Joints in binder and base course to be over banded.
 6. Construction thicknesses based on CBR value.
 7. If CBR value is less than 2.5% special engineer measurements will be required.
 8. If sub-grade is deemed to be frost susceptible sub-base thickness to be thickened to provide min. construction depth of 450mm.
 9. Footpath sub-base to be thickened to 150mm under vehicular crossings.
 10. SMA t be gritted whilst material is hot–1–2kg per m2 applied by roller mounted hopper.

Revisions:	
Reference: 187/PL01/Rev B	Pages: 1
Scale: as shown	
Project: Proposed annex for carer accomodation	
Site Address: Land adjacent The Poplars Gedney Hill Lincs	
Client: Mr Depear	

ALEXANDRA
Design

Southfork Farm
Seadye Bank
Murrow
Cambridgeshire
PE13 4SD

T: 07891175649
E: info.alexandradesign@gmail.com

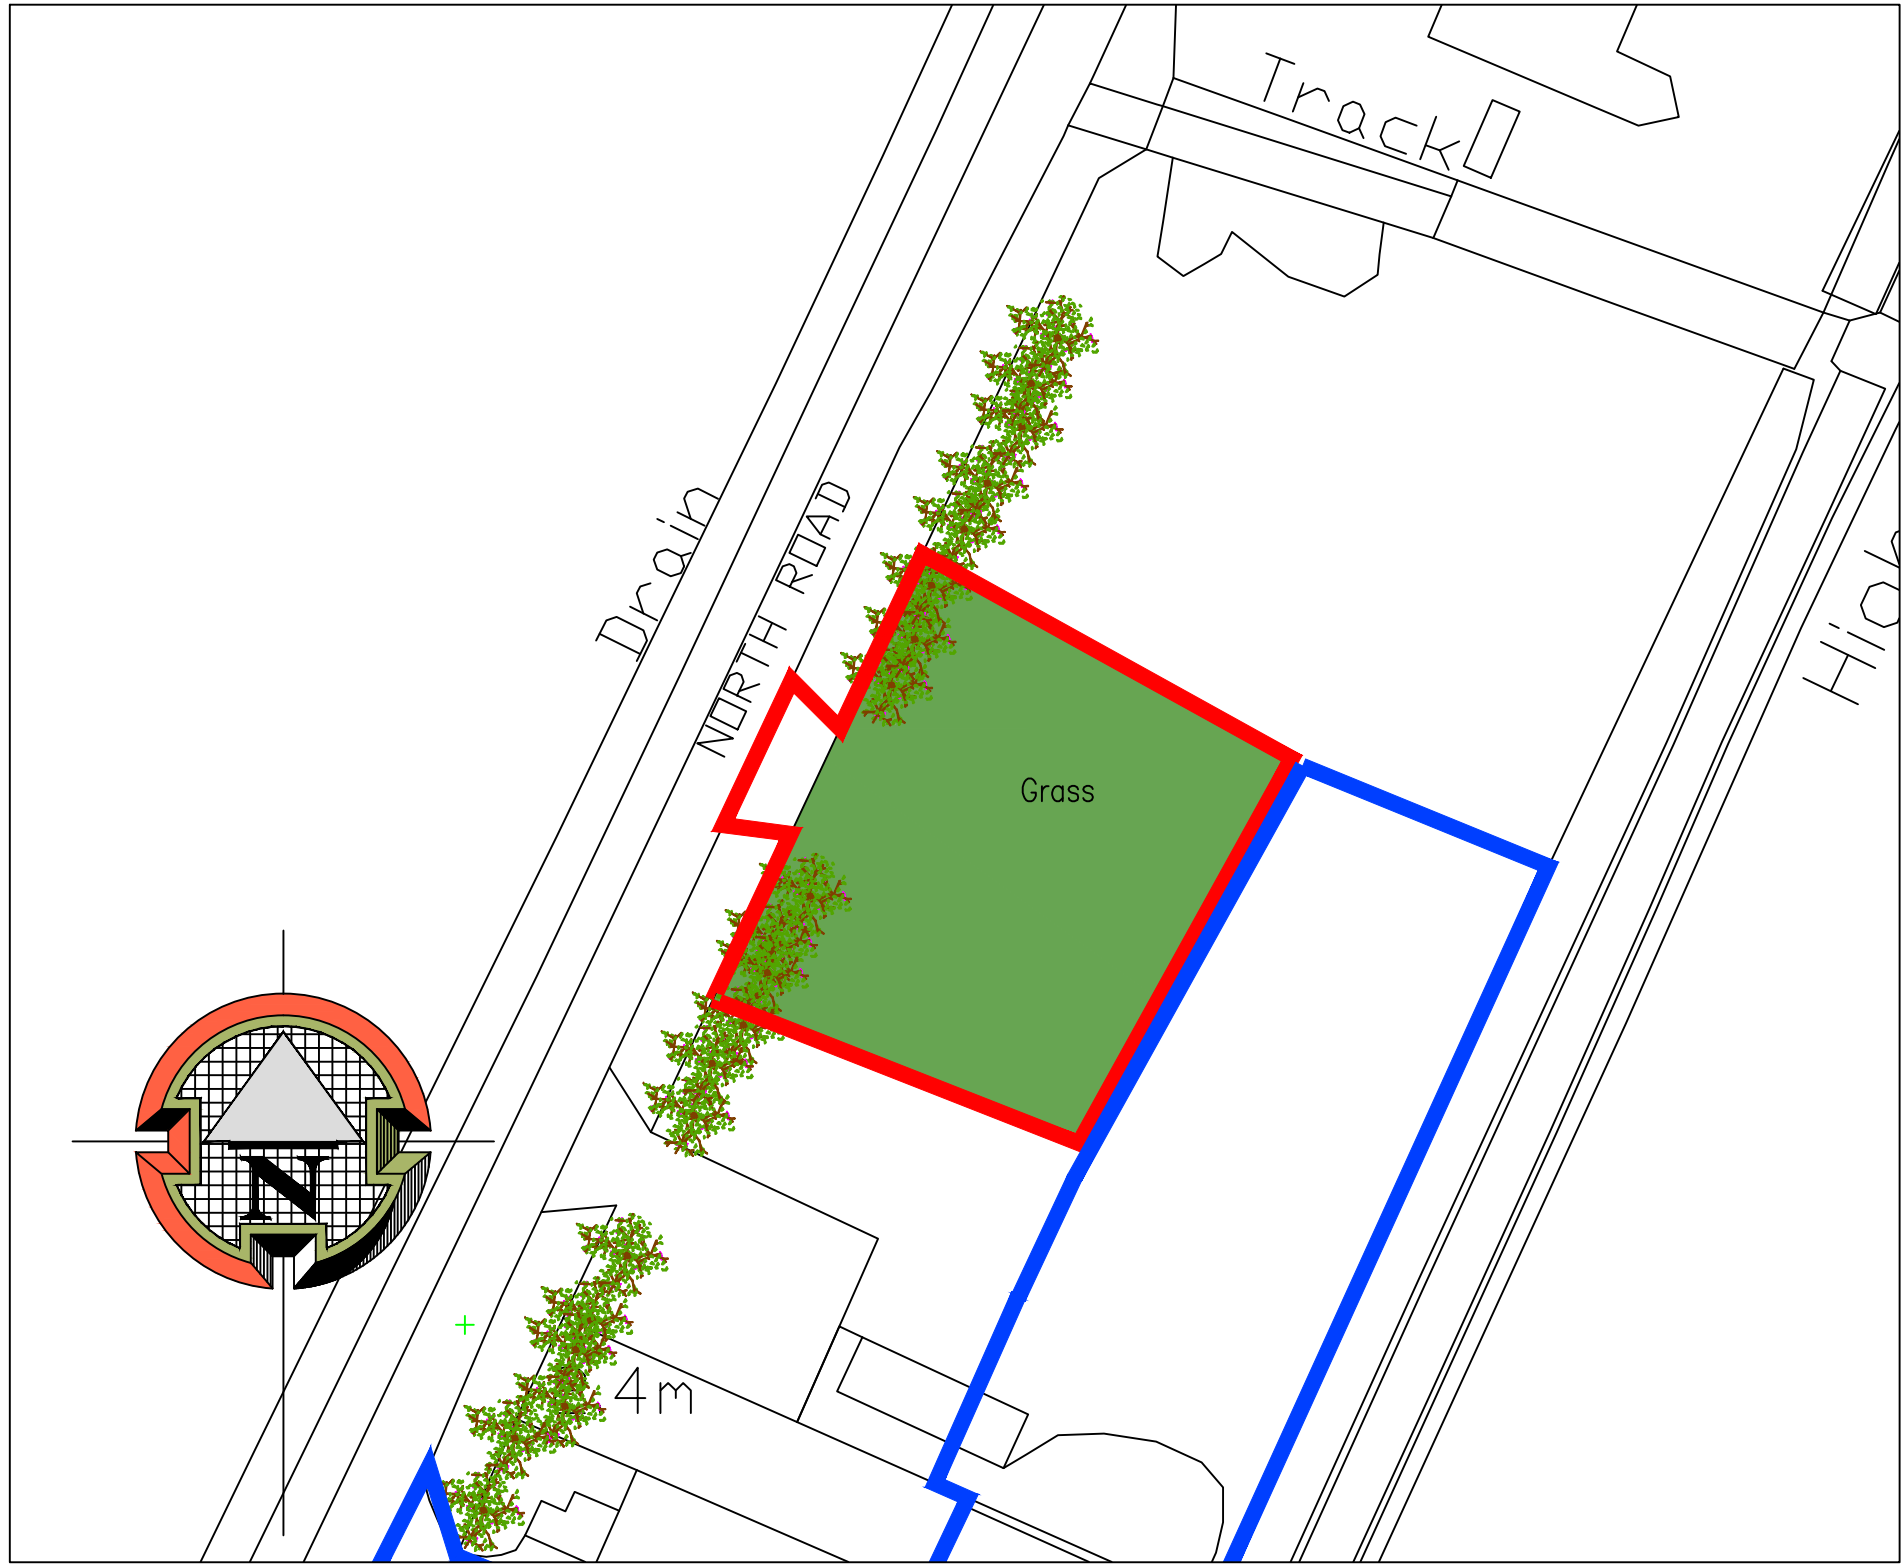

Asphalt Access Area Section Detail 1:20		
LAYER	SPECIFICATION	THICKNESS
1. surface course	SMA 6 surf 40/60 to section D3 of PD 6691(4)(5)(11), min PSV50 to give texture depth of 0.6–0.1 SHW clause 921 table 9/3. (measured by sand patch method)	25mm
2. binder course	AC 20 dense bin to BSEN13108–1 and PD6691 with 50 pen binder.	90mm
3. sub-base	Granular sub-base type 1 to clause 803(1) certified as nonfrost susceptible, spread evenly on the foundation and compacted. compact to clause 802(1) to achieve a min CBR value of 30%. formation to be treated with an approved weed killer prior to laying sub-base.	365mm

