



RAINWATER SOAKAWAYS :- TO BE 1.50 M FROM DWELLING, EACH ONE T. BE MIN 1.0 M²
 FILL WITH GRAVEL OR SIMILAR TO APPROX 225 FROM GROUND LEVEL. COVER OVER WITH
 POLY MEMBRANE. REPLACE TOP SOIL.
 SEPTIC TANK :- 900 GALLS MIN. 15.24 M. FROM DWELLING. INSTALL AS PER
 MANUFACTURERS SPECIFICATION.

0389-10

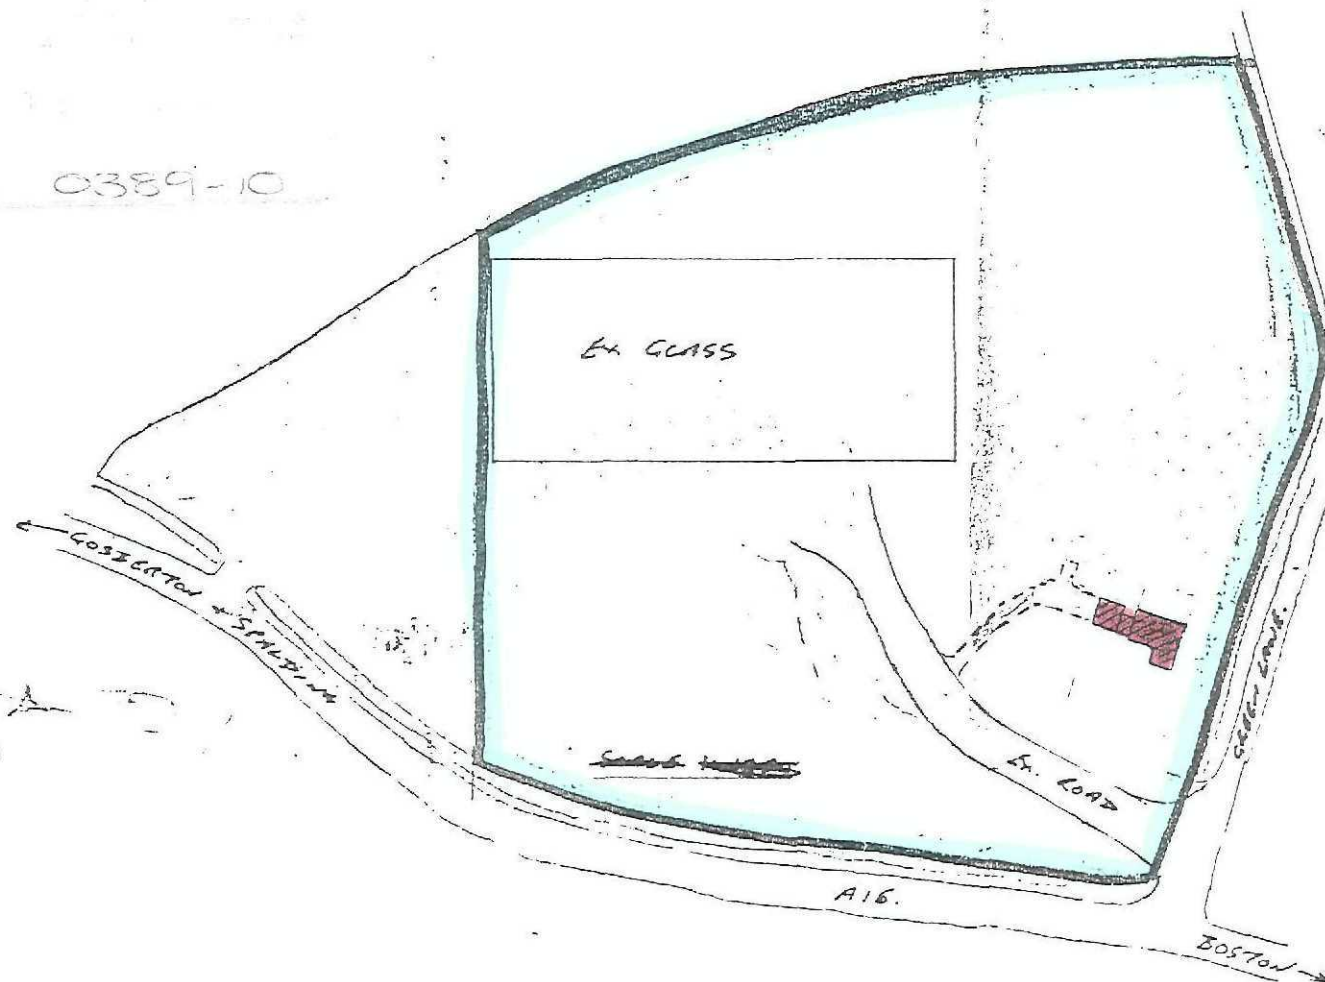

SOUTH HANTS D.C.
 PLAN DEPT.
 12 MAY 1993
 0411/93

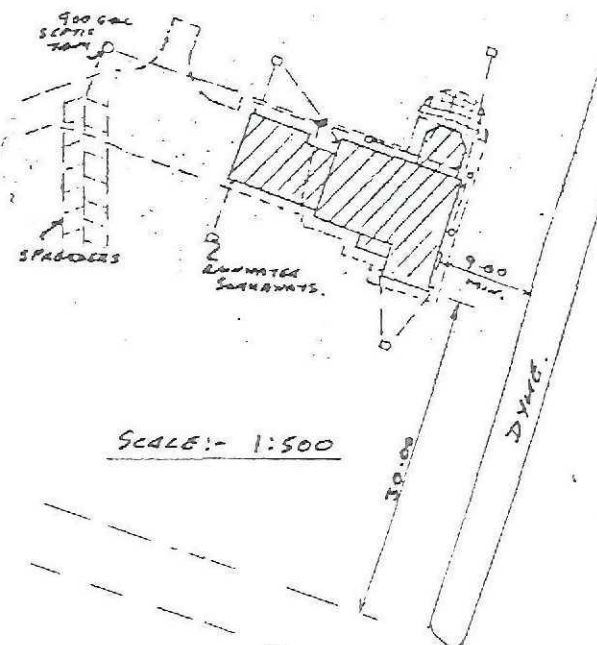

SCALE:- 1:500

FLOCK PLANS
FOR - MR. M. BARNEY
AT - BOSTON ROAD,
GOSBETON N. Lincs.

J. P. PURKISS
 CIVIL ENGINEER
 15, ST. LAURENCE
 TOLSON BRIDGE 290 307
 Lincs