



WALLING: Cavity wall construction to consist of 100 face brickwork to BS:3921:1974 for clay bricks. 85mm cavity with 85mm Dritherm 32 full fill cavity wall insulation bats in complete accordance with the makers instructions. Inner leaf from 100mm solid insulation blocks Tarmac Toplite standard or similar with 13mm dense plaster giving U-Value = 0.29w/m2k. Cavity walls tied together using stainless steel twist ties set at 600 mm horizontally for the first row and 750mm horizontally thereafter and 450mm vertically to BS:1243:1978. Wall ties to be positioned at 225mm vertical centres at all unbonded closures of cavity. To all closures of cavity provide Damcor or similar to makers instructions.

WINDOWS/DOORS/GLASS: Standard pattern framing in pvcu all double glazed with minimum 28mm thermal break and Energy glass (Pilkington K) or similar. Toughened or laminated glass to all doors and side screens and to any areas falling within 800mm of floor. Glass to BS:6206:1981 and to Approved Document Part N of the Building Regulations. Provide 100% draught proofing. Provide purge ventilation equal to 1/20th of floor area part of which is at least 1.75M above floor level. Provide controllable background ventilation with an equivalent area of 5000 sq.mm to habitable rooms and 2500 sq.mm to Wet rooms. Provide escape hinges to windows with minimum unobstructed openable areas of at least 0.33 sqM (450 x 750) U-Value = 1.8w/m2k.


MECHANICAL VENTILATION: To Kitchen provide mechanical ventilator with and extract rate of at least 60 litres per second of 30 litres in a cooker hood. To Bathrooms/wc's provide mechanical ventilators offering minimum 3No. air changes per hour controlled via light switch and isolation switch. Ensure an extract ate of at least 15 litres per second. To Utility Room if applicable provide mechanical ventilator with an extract rate of at least 30 litres per second.

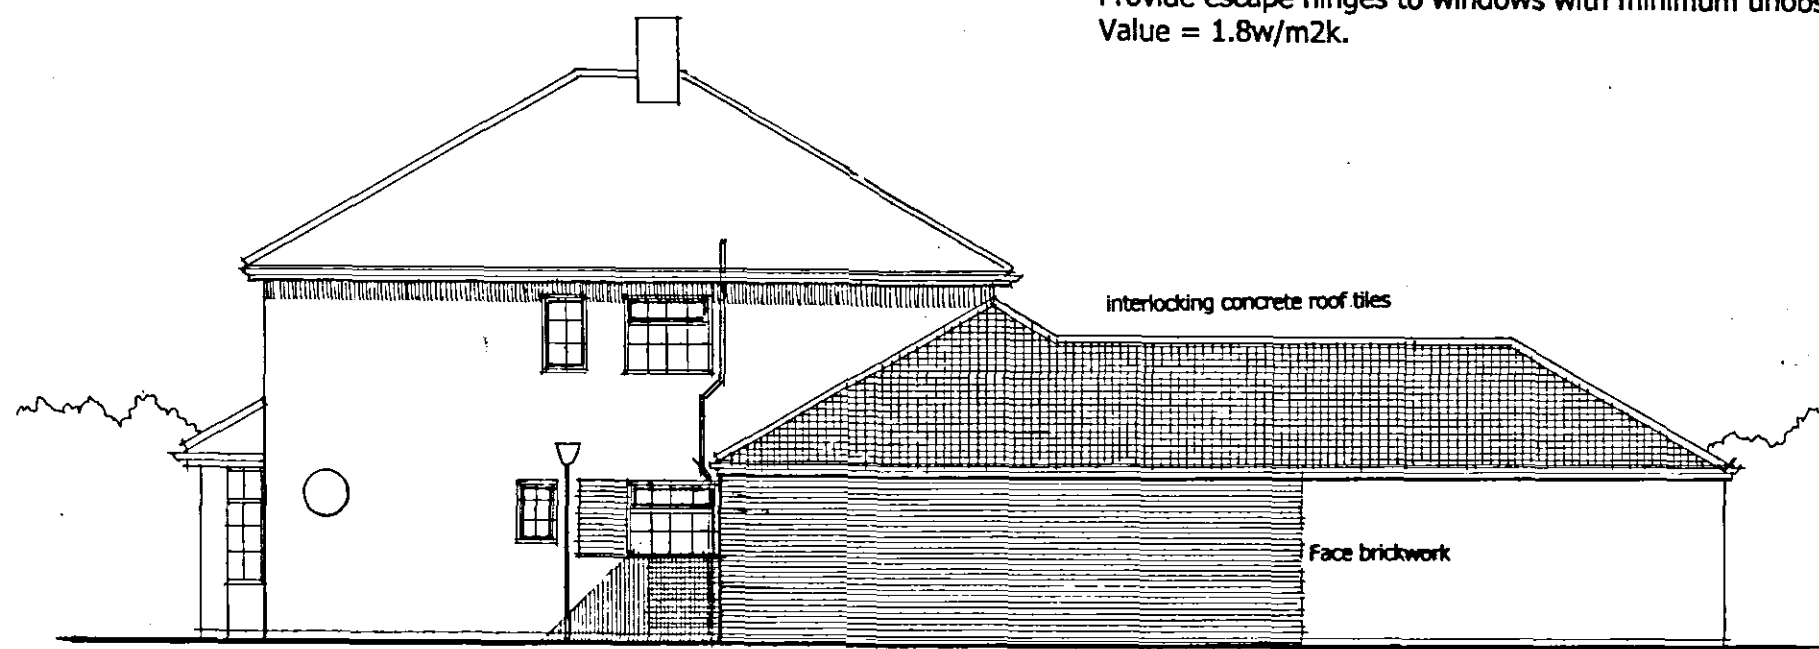


SIDE

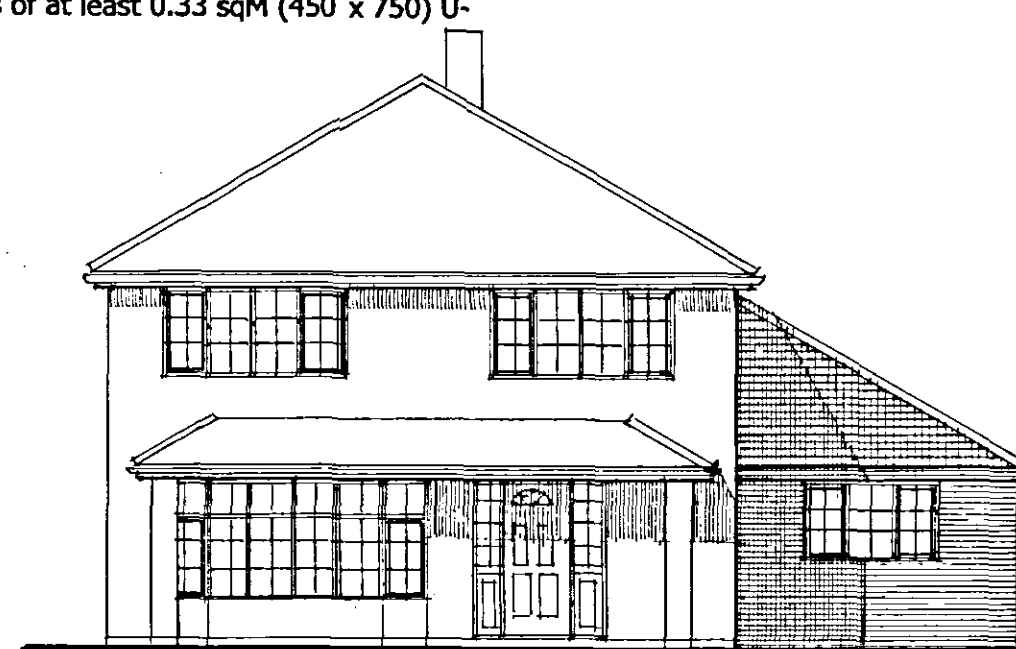

FRONT

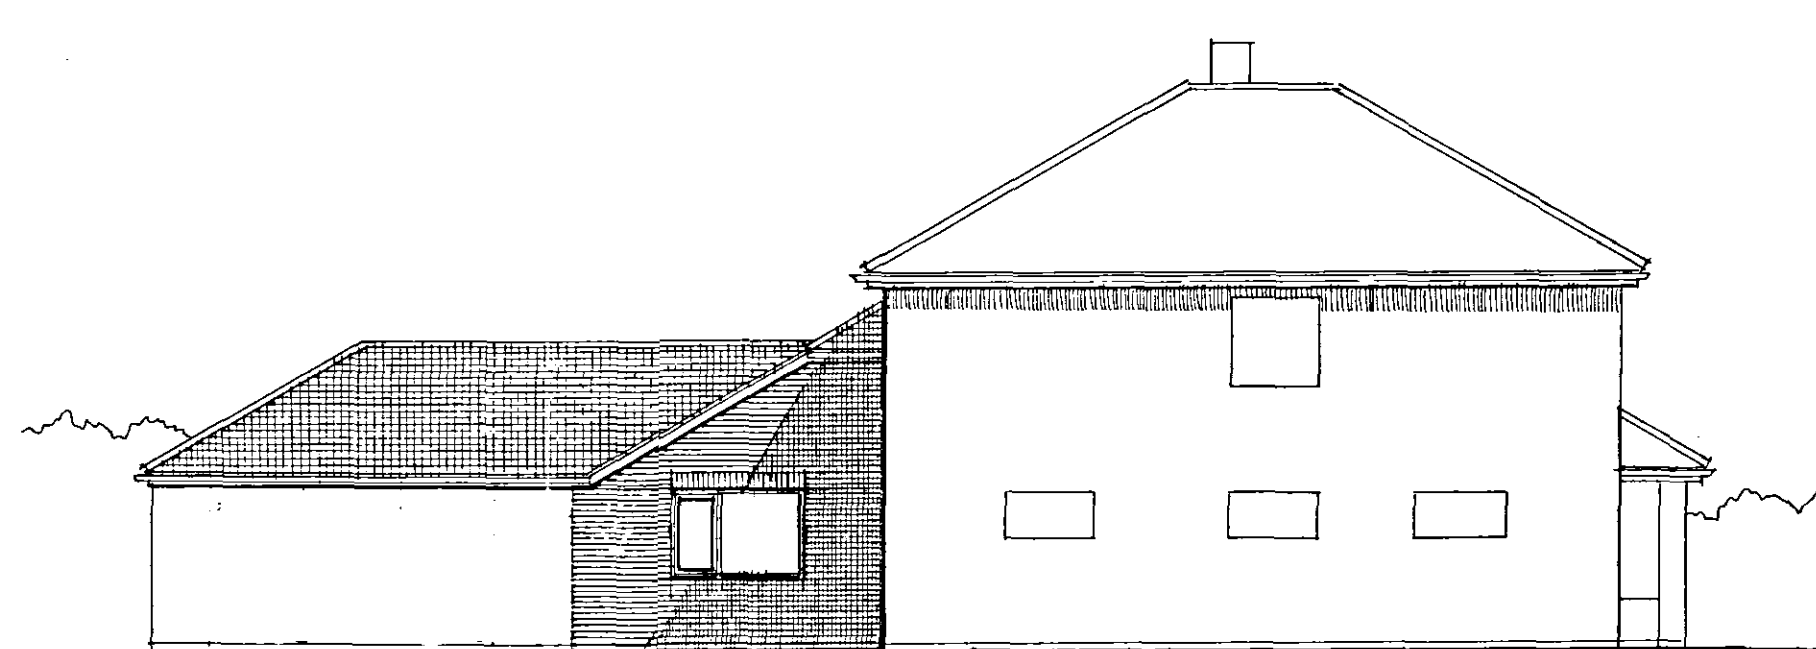


SIDE

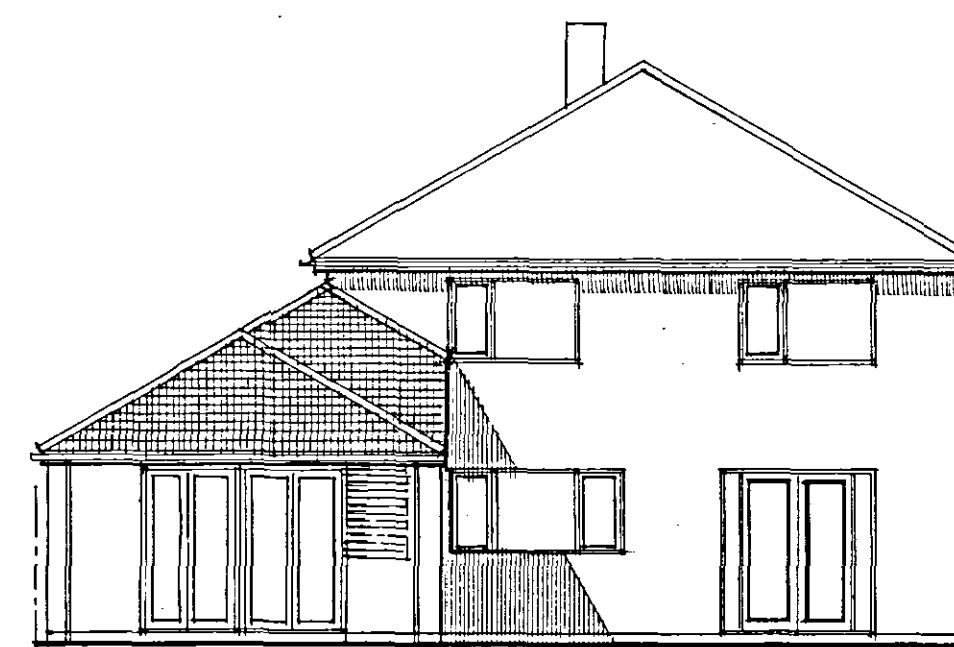

REAR

FOUL DRAINS: any Inspection chamber construction shall be Bartol or similar to the makers instructions and the internal dia. related to the depth to BS:8301:1985. Pipes to be 110 dia plastic laid to falls and flexibly jointed to BS:4660:1983 with bed and surround of 150mm pea gravel and connecting to adjacent existing foul drainage. Provide suitable bridging where pipes pass through external walls. Svp to be 100 dia. pvc to BS:4514:1983 and to extend min. 900 above any window head and terminate with pvc balloon or use air admittance valve. Waste pipes to be 38mm internal dia with rodding eyes at changes of direction. 75mm deep seal traps to appliances. 50mm waste to showers. Gullies to be rodable. Encase any drains under driveway in 150 m concrete.

HOT WATER / HEAT: Existing circuits to be extended through to new accommodation and provide thermostatic radiator valves and insulate all pipes not contributing to useful heat: output. Hot water systems shall be checked to ensure that they are working correctly before completion and this work shall be carried out by a suitably qualified person and a signed notice by this person shall be provided. In addition the owner shall be provided with all necessary operating and maintenance information needed to ensure that they can make the most efficient use of the system.

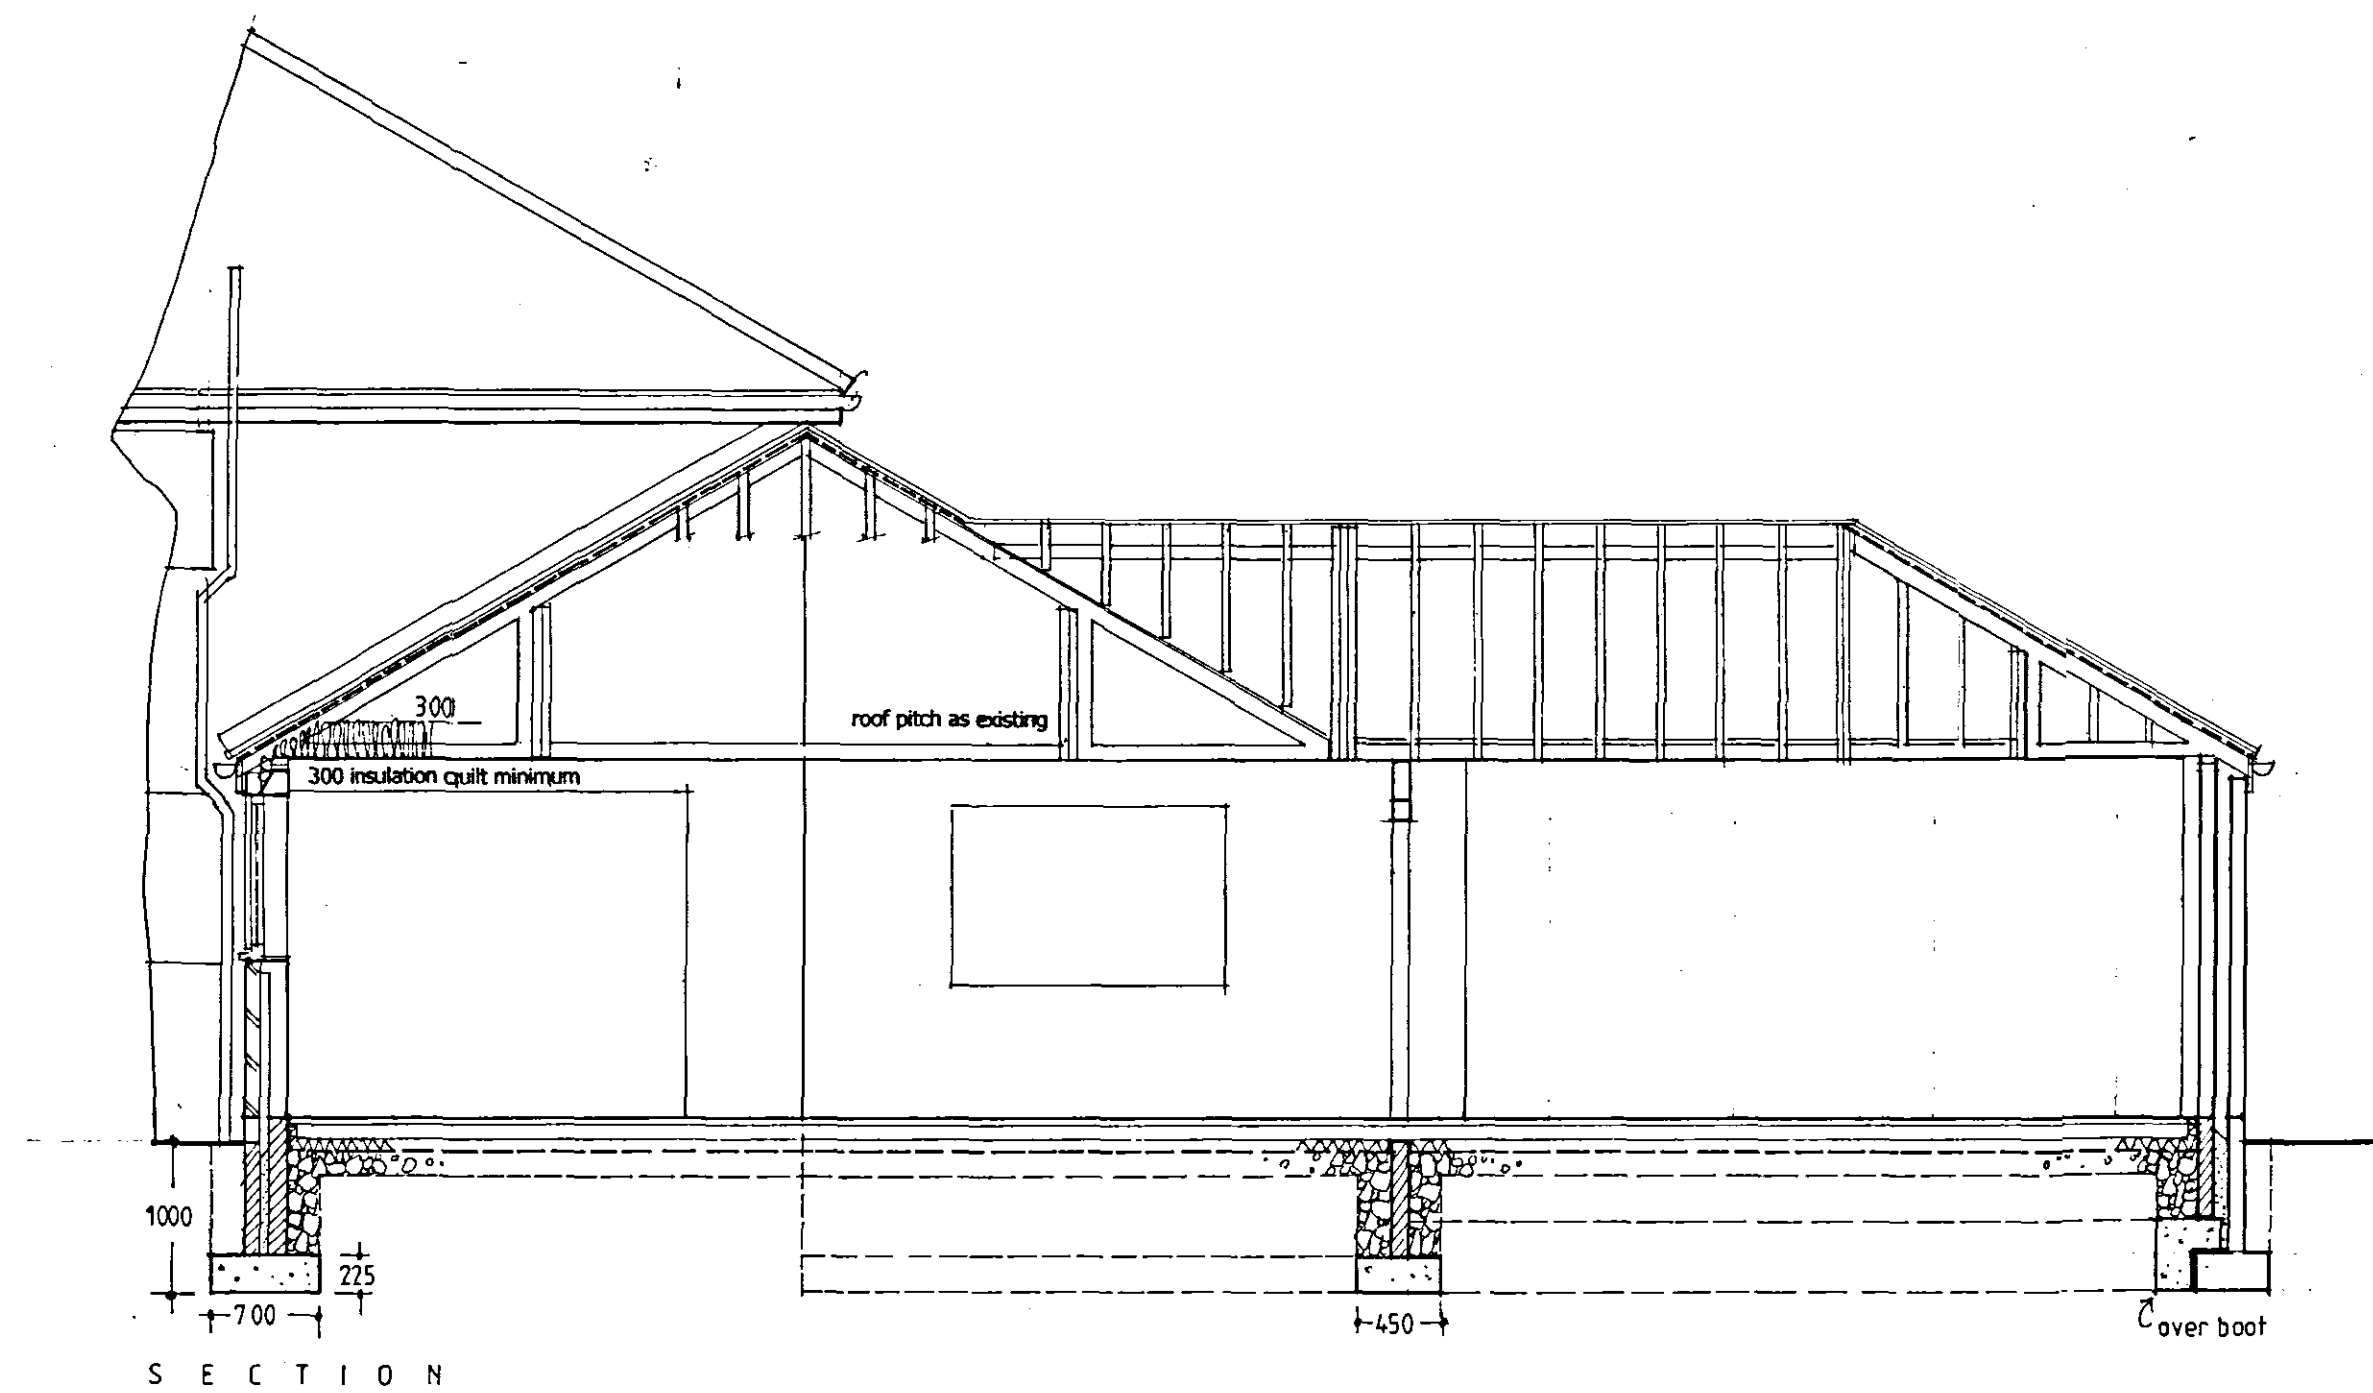

SECTION

NOTES:

Roger Williams
31 Stephenson Close Boston Lincolnshire PE21 7SY
Architectural Design Consultant
Phone: 01205 363602 Mobile: 07757 886684 / 07818 866680 Fax: as phone
E-mail: draw@rdw.papers.com

Client: Mr. & Mrs. Appleyard

Project: Proposals at:

19 Bowgate
Gosberton
Lincs.
PE10 4ND

Scale: 1:50 & 1:100

Date: May 2008

Drawing Number: 003

Notes:

WORKING DRAWING

c This drawing is copyright
All dimensions are to be checked and verified on site prior to commencement of works. Ground bearing capabilities are assumed to be normal unless declared or found to be otherwise whereafter due account shall be given to. All drawings are issued where appropriate subject to local authority approvals.
The works shall comprise of that shown on the drawings and include any works that whilst not specifically shown but may be reasonably inferred as being necessary to carry out the works shall be deemed to be included. The drawings are limited in the amount of information contained and are specifically for the purpose of obtaining consents or considerations from local authorities.
The works are not fully specified and drawings should not be used for contract purposes.
Unless specified no formal flood risk assessment has been carried out.
The Party Wall etc. Act 1996
You are advised that if any of the works related to this project affect a party wall or a boundary condition then the ACT applies.
Full copies of the ACT are available from:
www.communities.gov.uk/publications/planningandbuilding/partypwall
CDM Regulations 2007 (Health & Safety)
This project may fall within the requirements of the above regulations and accordingly, if appropriate should be registered with The Health & Safety Executive
On site safety is a statutory requirement
The CDM Regulations 2007 replace the CDM Regulations 1994 and The Construction (Health, Safety and Welfare) Regulations 1996

DETERMINED PLAN

SHDC
Planning & Development
- 9 JUN 2008
Ref: 0674/08

ELECTRICAL: All electrical works shall be carried out to the latest and current regulations and to Approved Document Part P of the Building Regulations. Reasonable provision shall be made in the installation of electrical installations in order to protect persons from fire or injury. Fixed internal lighting shall include energy efficient light fitting to at least 25% of the total number provided plus an additional one fitting for each 25 square metres of floor area and shall be fitted in areas of most frequent use and not in cupboards etc.. Fixed external lighting shall have either a lamp capacity of 150w or less and which automatically turns off in daylight hours or when not in use at night or a fitting which can only accept lamps with an efficiency of 40 lumens per circuit watt or better. A certificate must be issued on completion by a person competent to do so.

SMOKE DETECTORS: In positions shown and marked s.d. provide mains operated smoke detectors interconnected and wired back to the distribution board and fused on a separate circuit. **ADVISORY NOTE:** Provide in suitable positions Carbon Monoxide detectors.


LINTELS: As manufactured by Messrs. Catnic and to be installed in complete accordance with the makers instructions and have minimum 150 mm end bearings and cavity tray dpc's to external positions.

ROOF CONSTRUCTION: Interlocking concrete/ roof tiles to BS:473:500part 2:1972 on 25 x 50 softwood treated battens and breather membrane in complete accordance with the makers instruction including all head laps etc.. Tiles to be laid with a minimum head lap of 75mm and be fixed with regard to wind speed roof pitch and exposure category as detailed in BS:6399 part 2:1985. Specialist made prefabricated roof trusses set at max. 600 mm centres to BS:5268 part 5:1985. 25 x 100 ridge node and intermediate binders. Wind bracing to Truss Plate Association Technical Bulletin. If span exceeds 5.0 M Provide additional bracing within the plane of the web and 25 x 100 ceiling ties at 45 deg. 25 x150 lay boards. Vulcanal fibreglass trough valleys. 50 x 100 wall plate bedded on sand and cement. 30 x 5 galvanised metal straps to act as anchor and lateral restraint straps set at maximum 2.0 M centres.. Lateral straps to be over minimum 3No. members with solid bridging beneath. Straps down walls to be minimum 900 mm long. All structural timber to be minimum SC3 grade. 300 mm insulation quilt to roof space laid between and over ceiling members and to lap integral with wall insulation at the eaves. Any access traps to the roof space to be fully insulated and 100% draught proofed. 12.5 mm plasterboard and skim finish. 112mm half round plastic rain water gutters to 68mm down pipes to 110 underground pipes laid to falls and flexibly jointed with bed and surround of 150mm pea gravel. Discharge to existing surface water drains or to 1.2m dia. properly formed soakaways set min. 5 M from buildings. Code 4 lead flashing to any abutments with minimum upstands of 150mm.

GROUND FLOOR: Floor to be from minimum 150 mm well consolidated hardcore with sand or dust blinding. 1200g polythene membrane laid to lap continuous with the dpc by 100mm. Provide 70mm Kingspan Kooltherm K3 floor insulation boarding in complete accordance with the makers instructions and cut to lap up walls at perimeters. 500g membrane. 100 mm concrete laid oversite. 50mm sand and cement screed. U-Value=0.22w/m2k.

FOUNDATIONS: 700 x 225 and 450 x 225 strip concrete foundations taken down to bear on suitable load bearing strata deemed to be 1.0M below natural ground level or as on site conditions or local authority Building Inspector dictates. Gen 3.conc

SUBSTRUCTURE: Tarmac trenchbloc and 100mm Class A dense concrete blocks to BS:6703 part 1:1981. Dpc to be set minimum 150mm above finished ground level. Weak mix infill to base of cavity and to come no closer to dpc than 225mm. Dpc's to BS:6398/8215:1991

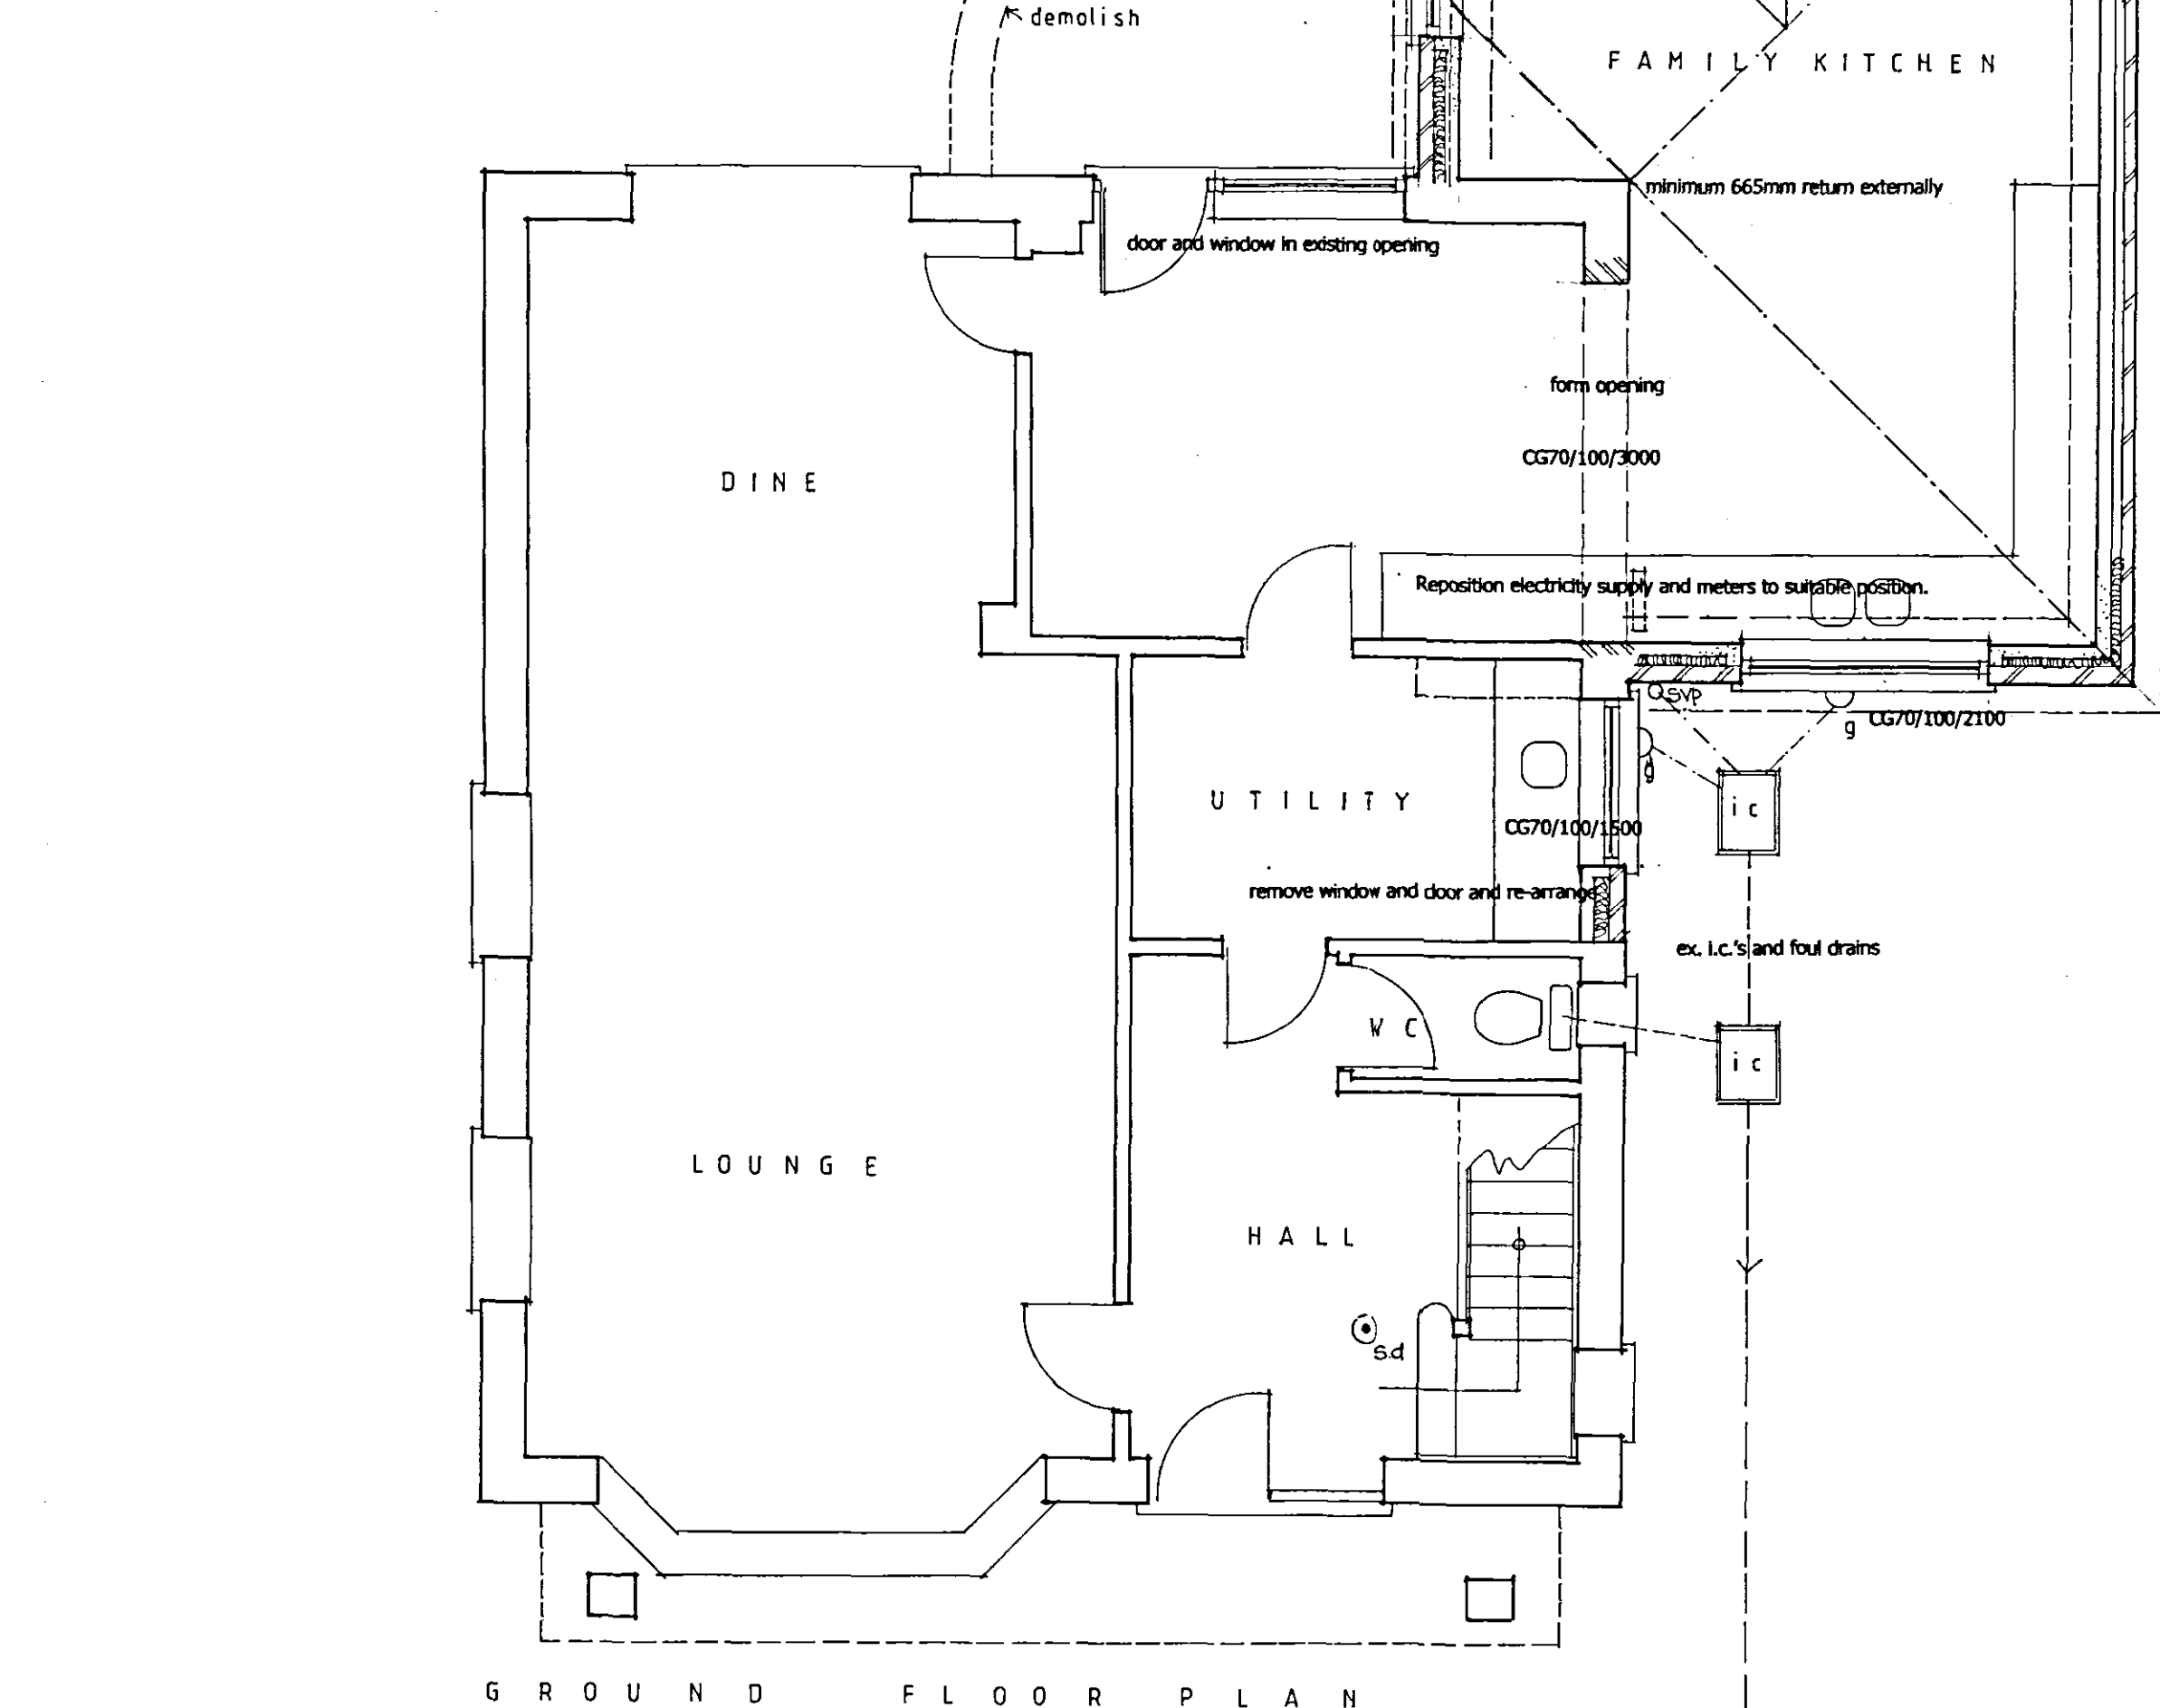

GROUND FLOOR PLAN