




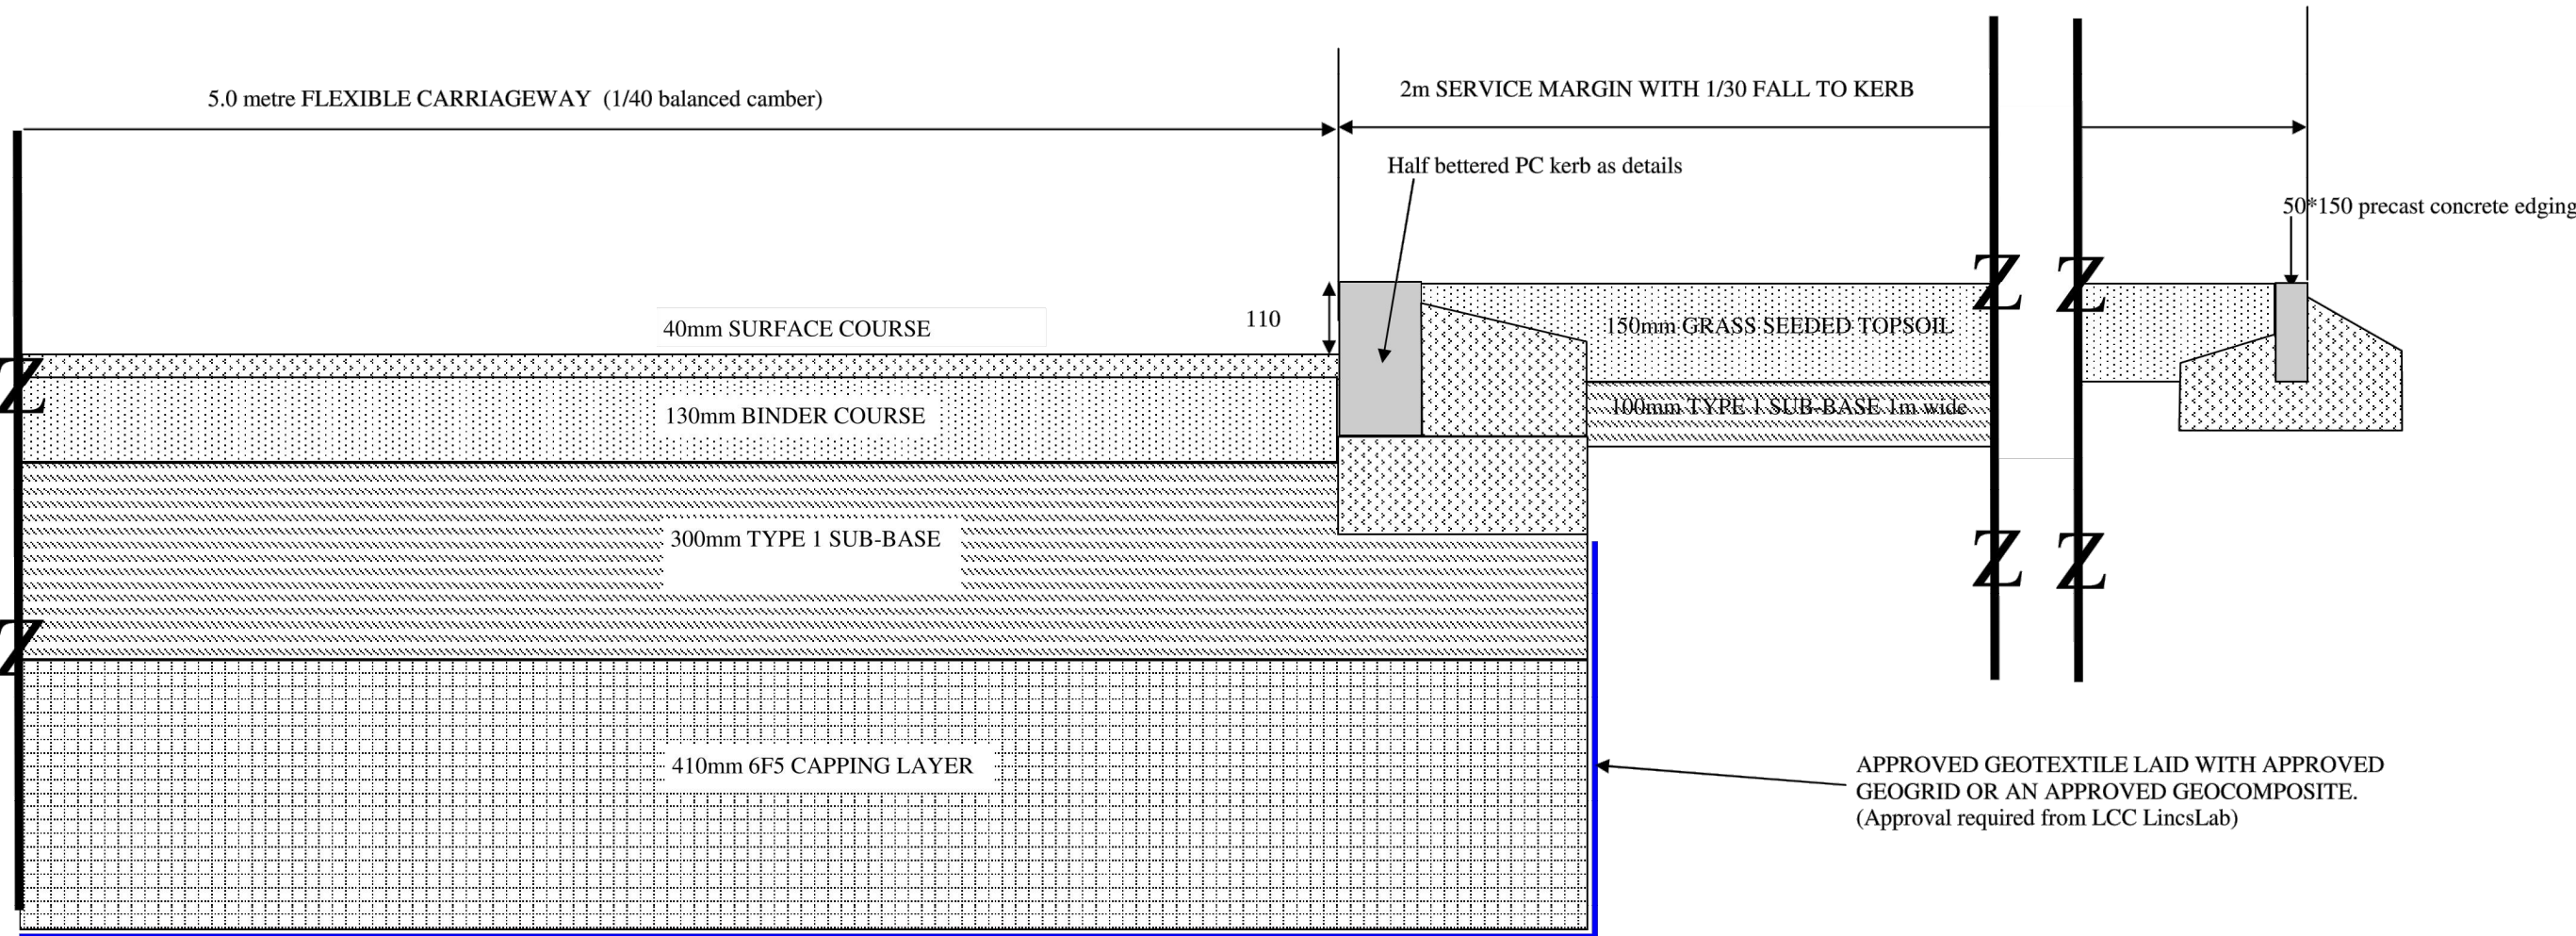

DETAIL OF CARRIAGEWAY Scale 1/10

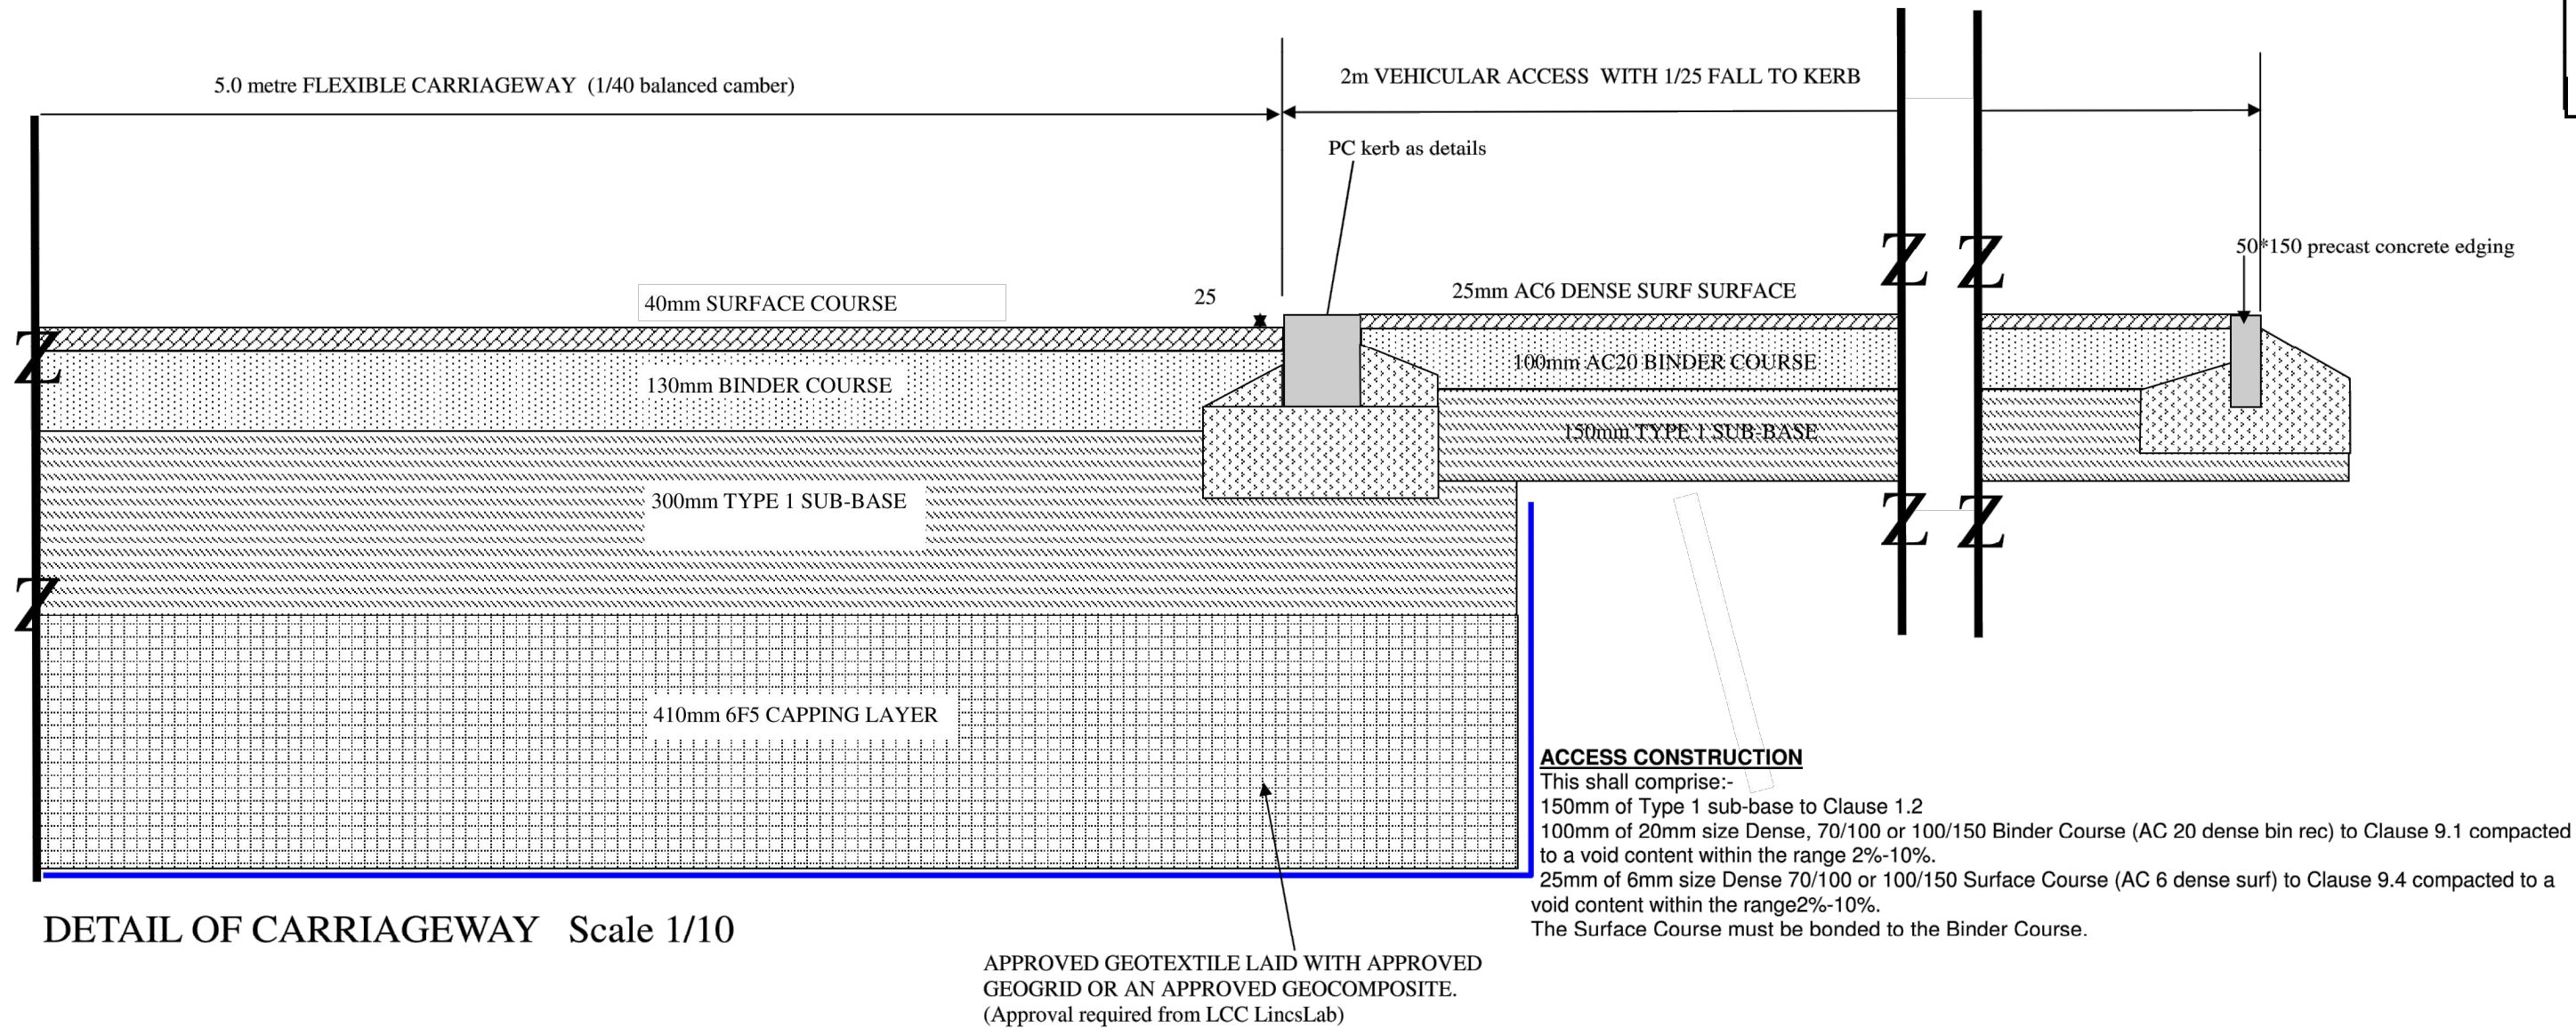

DETAIL OF CARRIAGEWAY Scale 1/10

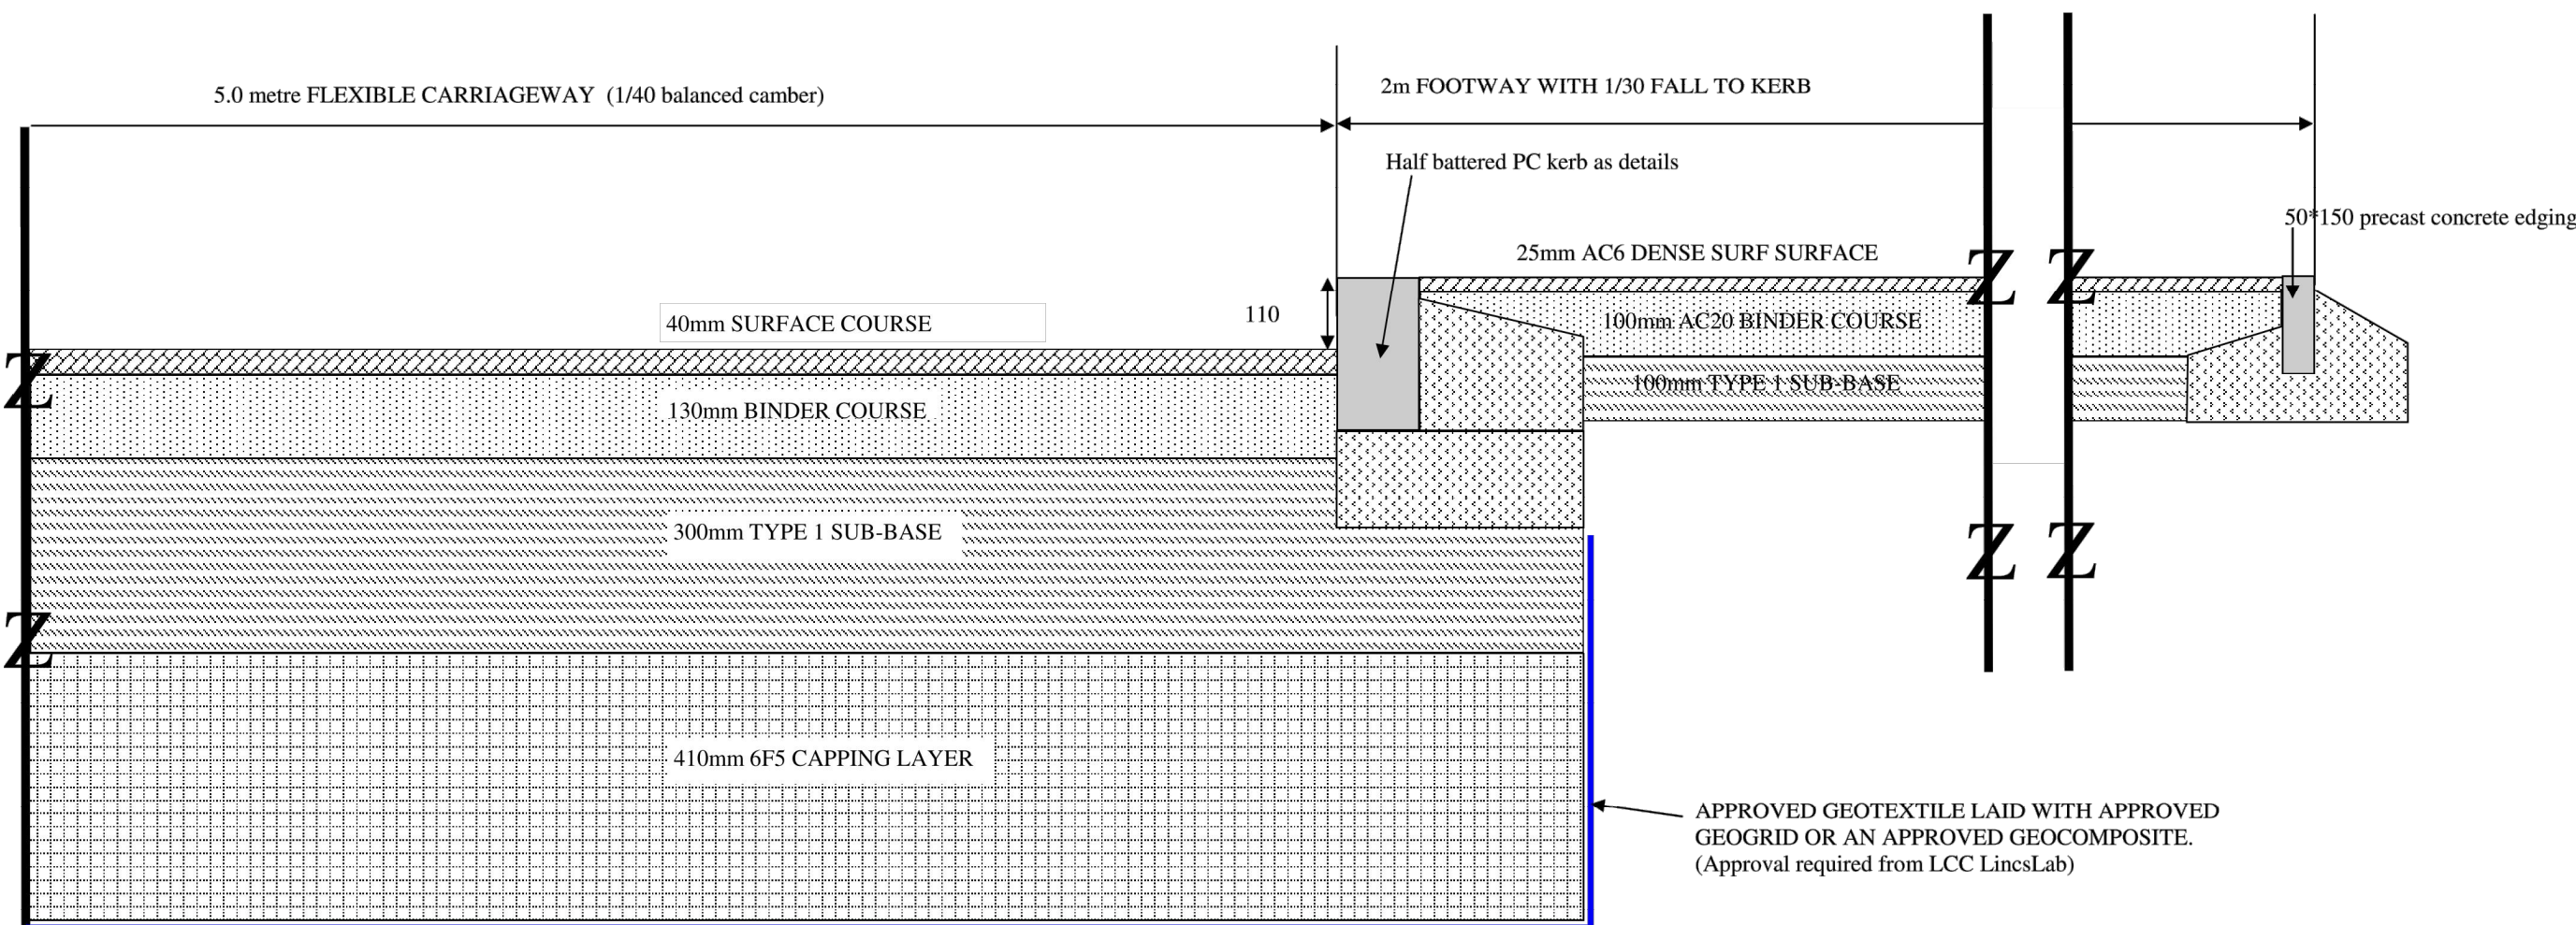

DETAIL OF CARRIAGEWAY Scale 1/10

S38 DETAILS

- LCC DRS GENERAL NOTES:
- The specification in all respects shall be in accordance with the current Lincolnshire "Development Road and Sustainable Drainage Design Guide" and "Development Road and Sustainable Drainage Specification and Construction" publications in force in the county at the time of construction.
 - The minimum longitudinal fall for highways, without channel blocks shall be 1 in 150, and with channel blocks 1 in 250 (see Clause 10.1).
 - In addition, ensure that the first section of any side road falls away from the road to which it is connecting. If general topography requires it to rise, this change of direction should take place after the first set of gullies. This is to ensure a 'false channel' with associated drainage problems is not created in the bedmouth of junctions.
 - General deterioration of the existing highway/footway/verges created through construction of the new Section 38 Development will be reinstated to the current Development Road Specification at the developers' own cost at the agreement of the inspecting Highway and Flood Authority Officer.
 - "No Private surface water shall discharge onto the adoptable highway".
 - "No private, structural features shall overhang the adoptable highway".
 - "No private retaining walls exceeding 1.37m shall be within 3.68m of the highway boundary".

CONSTRUCTION DETAILS

S38 ADOPTABLE ROAD

40mm OF 10mm SIZE DENSE 70/100 OR 100/150 SURFACE COURSE (AC 10 DENSE SURF) TO CLAUSE 9.3 COMPACTED TO A VOID CONTENT WITHIN THE RANGE2%-10%. ON 130mm OF 20mm SIZE DENSE, 40/60 BINDER COURSE (AC 20 DENSE BIN REC) TO CLAUSE 9.1 COMPACTED TO A VOID CONTENT WITHIN THE RANGE 2%-8%. TO BE LAID IN TWO LAYERS ON 300mm TYPE 1 SUB-BASE ON 410mm 6F5 CAPPING LAYER ALL IN ACCORDANCE WITH CURRENT EDITION OF LCC's DEVELOPMENT ROAD SPECIFICATION (THIS IS BASED ON A CBR BELOW 1.5%. THIS MAY BE REDUCED IF CBRs ARE PROVEN TO BE GREATER IN ACCORDANCE WITH CONSTRUCTION CHART 3, LCC's DEVELOPMENT ROAD SPECIFICATION – See below)

S38 ADOPTABLE FOOTWAYS / PATHS

25mm OF 6mm SIZE DENSE 70/100 OR 100/150 SURFACE COURSE (AC 6 DENSE SURF) TO CLAUSE 9.4 COMPACTED TO A VOID CONTENT WITHIN THE RANGE2%-10% ON 100mm OF TYPE 1 SUB-BASE TO CLAUSE 1.2 on 100mm OF 20mm SIZE DENSE, 70/100 OR 100/150 BINDER COURSE (AC 20 DENSE BIN REC) TO CLAUSE 9.1 COMPACTED TO A VOID CONTENT WITHIN THE RANGE 2%-10%

CONSTRUCTION CHART 1 NON PERVIOUS ROADS UP TO 0.25 m.s.a - NORMAL FLEXIBLE COSTRUCTION

SUB-GRADE ^{NOTE 1}	SUB-BASE (mm)		SURFACING (mm)		TOTAL THICKNESS REQUIRED (mm)	
	Without geotextile	With geotextile	Binder Course	Surface Course	Without geotextile	With geotextile
Below 1% & soft spots	<i>Not suitable</i>	710 ^{NOTES 2&3}	<i>Notes 4</i>	40	<i>Not suitable</i>	880 ^{NOTE 2,3&4}
1%&	<i>Not suitable</i>	440	130	40	<i>Not suitable</i>	610 ^{NOTE 4}
2%	400	340	130	40	550 ^{NOTE 5}	510 ^{NOTE 4}
3%	310	300	130	40	480 ^{NOTE 5}	470 ^{NOTE 4}
4% ^{NOTE 6}	300	300 ^{NOTE 6}	130	40	470 ^{NOTE 5}	470 ^{NOTE 4}
5% ^{NOTE 6}	300	300 ^{NOTE 6}	130	40	470 ^{NOTE 5}	470 ^{NOTE 4}
6-15% ^{NOTE 6}	300	300 ^{NOTE 6}	130	40	470 ^{NOTE 5}	470 ^{NOTE 4}
Above 15% ^{NOTE 6}	300	300 ^{NOTE 6}	130	40	470 ^{NOTE 5}	470 ^{NOTE 4}

Note 1

See Clauses 1.1.6, 1.1.7 and 1.1.8

Note 2

See Clauses 1.1.6 - Assumes no improvement is possible using either sub-soil drainage or soil strengthening technique. 710mm is 410mm of 6F5 Capping Layer Granular Fill to clause 6.8 and 300mm of Type 1 sub-base. The thickness of 710mm can be reduced to 620mm if all Type 1 sub-base is used.

Note 3

For soft-spots and sub-grades with a CBR of less than 1%, the geotextile shall be laid with an approved geogrid or shall be an approved geocomposite. Approved specialist design can be used with the agreement of the authority.

Note 4

Initial Binder Course layer thickness **70mm** if the **alternative kerbing intiltation method** (two stage construction - kerbing to be laid at a later stage) is used. **Total Binder Course thickness remains 130mm** in these circumstances. **See Clause 1.1.17.**

Note 5

The use of a geosynthetic with a sub-grade with this bearing capacity offers no advantage or economy.

FILTER MEMBRANE (GEOTEXTILE)

All membranes, textiles and liners should be designed, manufactured and installed in accordance with the relevant Standards, Codes of Practice and Manufactures Guidance. They should be selected in accordance with specific site conditions and be fit for purpose. All proposals need written technical approval from the Highway and Flood Authority prior to installation and use.

Geotextiles used in infiltration features shall be selected on the infiltration rate confirmed in the ground investigation stage. This shall also be compatible with the soil particle size on site.

All woven geotextiles shall have a minimum tensile strength of 30kN/m in each direction. Non-woven geotextiles shall have a minimum tensile strength of 15kN/m when tested in accordance with BS EN ISI 10319: 1996.

For woven geotextiles the pore size shall be 90% finer than 200/um.Non-woven geotextiles shall have a pore size 90% finer than 100/um

All Geotextiles shall have a CBR puncture resistance of 3 kN.

SERVICE AND SERVICE DUCTS

Utility services and service ducts shall not be installed within the carriageway or footway construction. They shall be placed within the underlying subgrade. Capping layers classified as part of the construction. The location of dedicated service crossing points requires approval in order to limit/control the number in road construction

DELIVERY TICKETS FOR APPROVED MATERIALS

Delivery tickets and, when applicable, evidence of C E Marking, shall be available on request by the Highway and Flood Authority Officer.

TREE PLANTING and ROOT BARRIERS

Where trees are to be planted within 5m of footways or highways a root barrier is required between the tree root system and the highway structure. A proprietary, high strength, photo and bio degradation resistant root barrier 2mm thick with a minimum width of 1.0m should be used. Where individual trees are to be planted in tree pits with highway or footways adjacent, the use of preformed root directors may be more appropriate.

A	08.07.21	Issued for Planning RM			
	05.07.21	First Issue - Preliminary Issue for Approval			
rev.	date	Description	Drawn	Chk.	

WARD & COLE consulting engineers ■ LINCOLN □ LONDON □ NOTTINGHAM		
Fosse House Roman Wharf Lincoln LN1 1SR tel 01522 513032 fax 01522 513559 e-mail structures@wardcole.co.uk		
client: Woodgate Developments Ltd		
project: Residential Development Land off Boston Road & High St Gosberton, Lincs.		
drawing title: Section 38 Agreement Works Standard S38 Details Drawing 3 of 6		
scale: NTS@A1	status: APPROVAL	
job number: 10-5549	drawing number: 305	revision: A