


Wire mesh supported synthetic media (EU4) pleated panel prefilter. Must be replaced every 3-4 weeks.

Activated carbon filter box 207 coconut shell type carbon filter panels Dwell time is calculated 0,18 S. Carbon panels must be replaced every 8-12 months.


45JM / 16 / 4 / 5 / 32 -BT9 FlaktWoods kitchen extraction fan outlet side connected to the silencer. Noise level of the fan 52 dB(A) @ 4 meter distance without silencer.

DS251401 Silencer 450 mm long to reduce the noise level 7 to 10 dB (A)

Flexible canvass connection between duct and silencer.

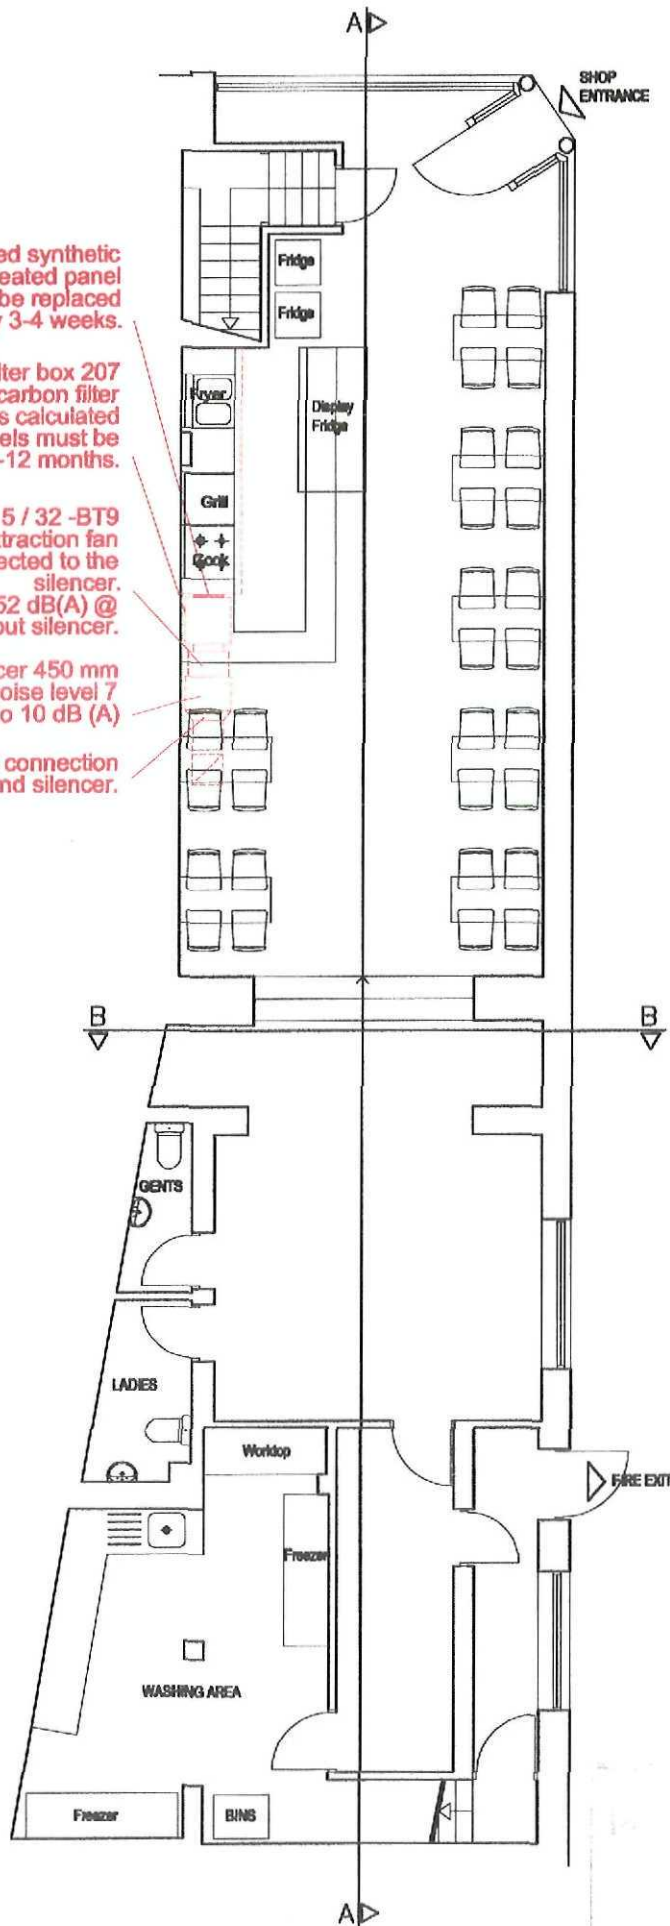

GROUND FLOOR PLAN

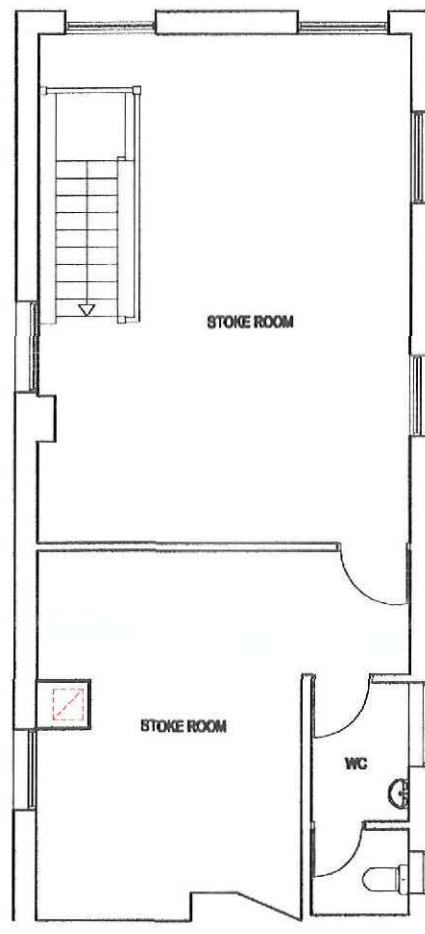

FIRST FLOOR PLAN

DETERMINED PLAN

27 MAR 2010

AMENDMENTS	
A	Extractor fan details revised 12/08
B	Extractor fan details revised 03/10
C	Extractor fan details revised 03/10
D	
E	
F	
G	
H	
J	
K	
L	
M	
ARCHIPEK ARCHITECTURE + INTERIORS 88 STOKES MEADOWS HIGH STREET LONDON W10 6SL T - 020 7825727 F - 020 7825725 E - info@archipek.com	
CONTRACT 20 HIGH ST-2 ALBERT ST HOLBEACH, SPALDING LINCOLNSHIRE PE12 7DN	
DRAWING PROPOSED GROUND AND FIRST FLOOR PLANS	
SCALE	DATE
1:100	11/09
DRAWN BY	CHECKED
EM	CI
DRAWING No.	
1003 P 1c	

Revised to provide more information.




SIDE ELEVATION

boundary line



A-A SECTION

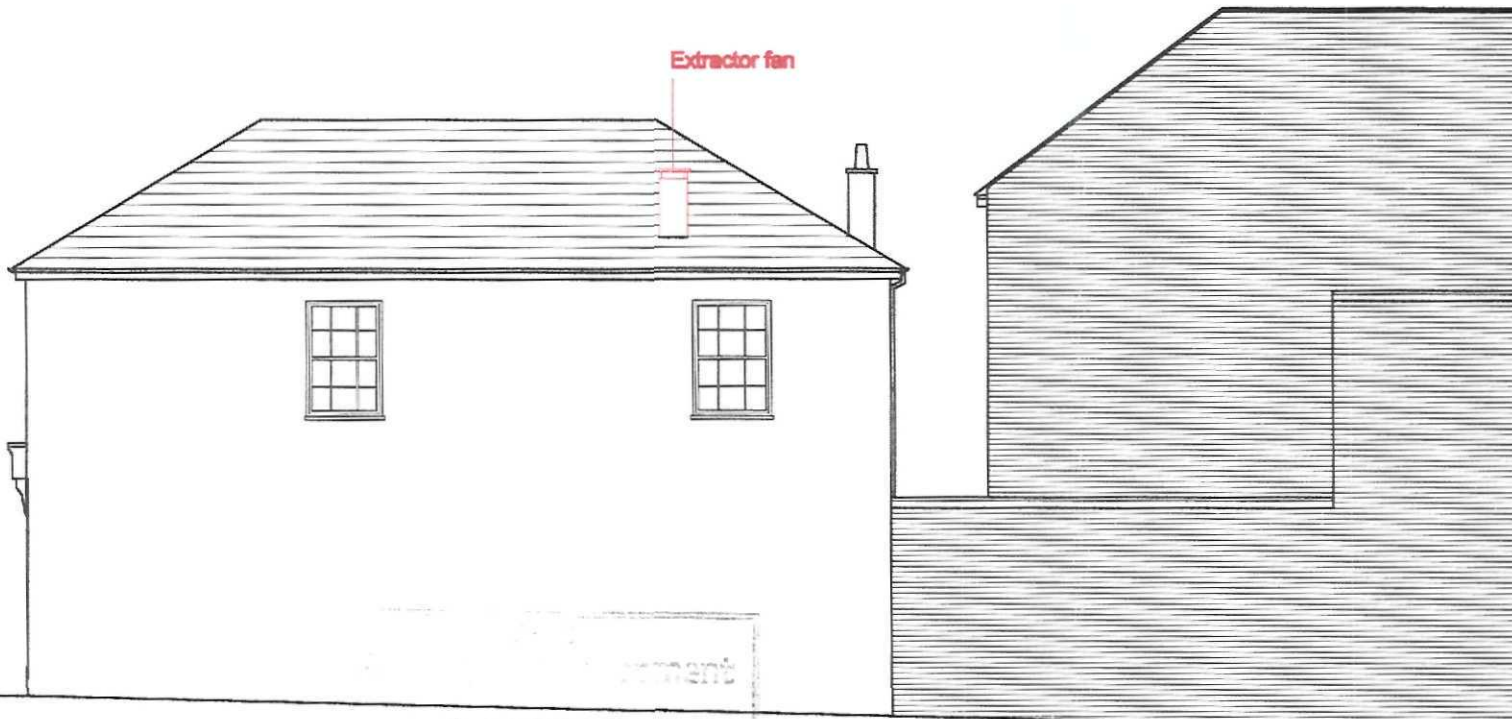

SIDE ELEVATION

AMENDMENTS	
A	Extractor fan details revised 12/08
B	Extractor fan details revised 03/10
C	Extractor fan details revised 03/10
D	
E	
F	
G	
H	
J	
K	
ARCHIPEK ARCHITECTURE + INTERIORS 65 BRIDGE NEWINGTON HIGH STREET LONDON W1G 9SL T - 020 73357327 F - 020 72412855 E - info@archipek.com	
CONTRACT 20 HIGH ST-2 ALBERT ST HOLBEACH, SPALDING LINCOLNSHIRE PE12 7DN	
DRAWING PROPOSED A-A & B-B SECTION AND SIDE ELEVATION	
SCALE	DATE
1:100 @ A3	11/08
DRAWN BY	CHECKED BY
EM	CI
DRAWING NO. 1003 P 2c	

0009-10
additional information.

DETERMINED
PLAN