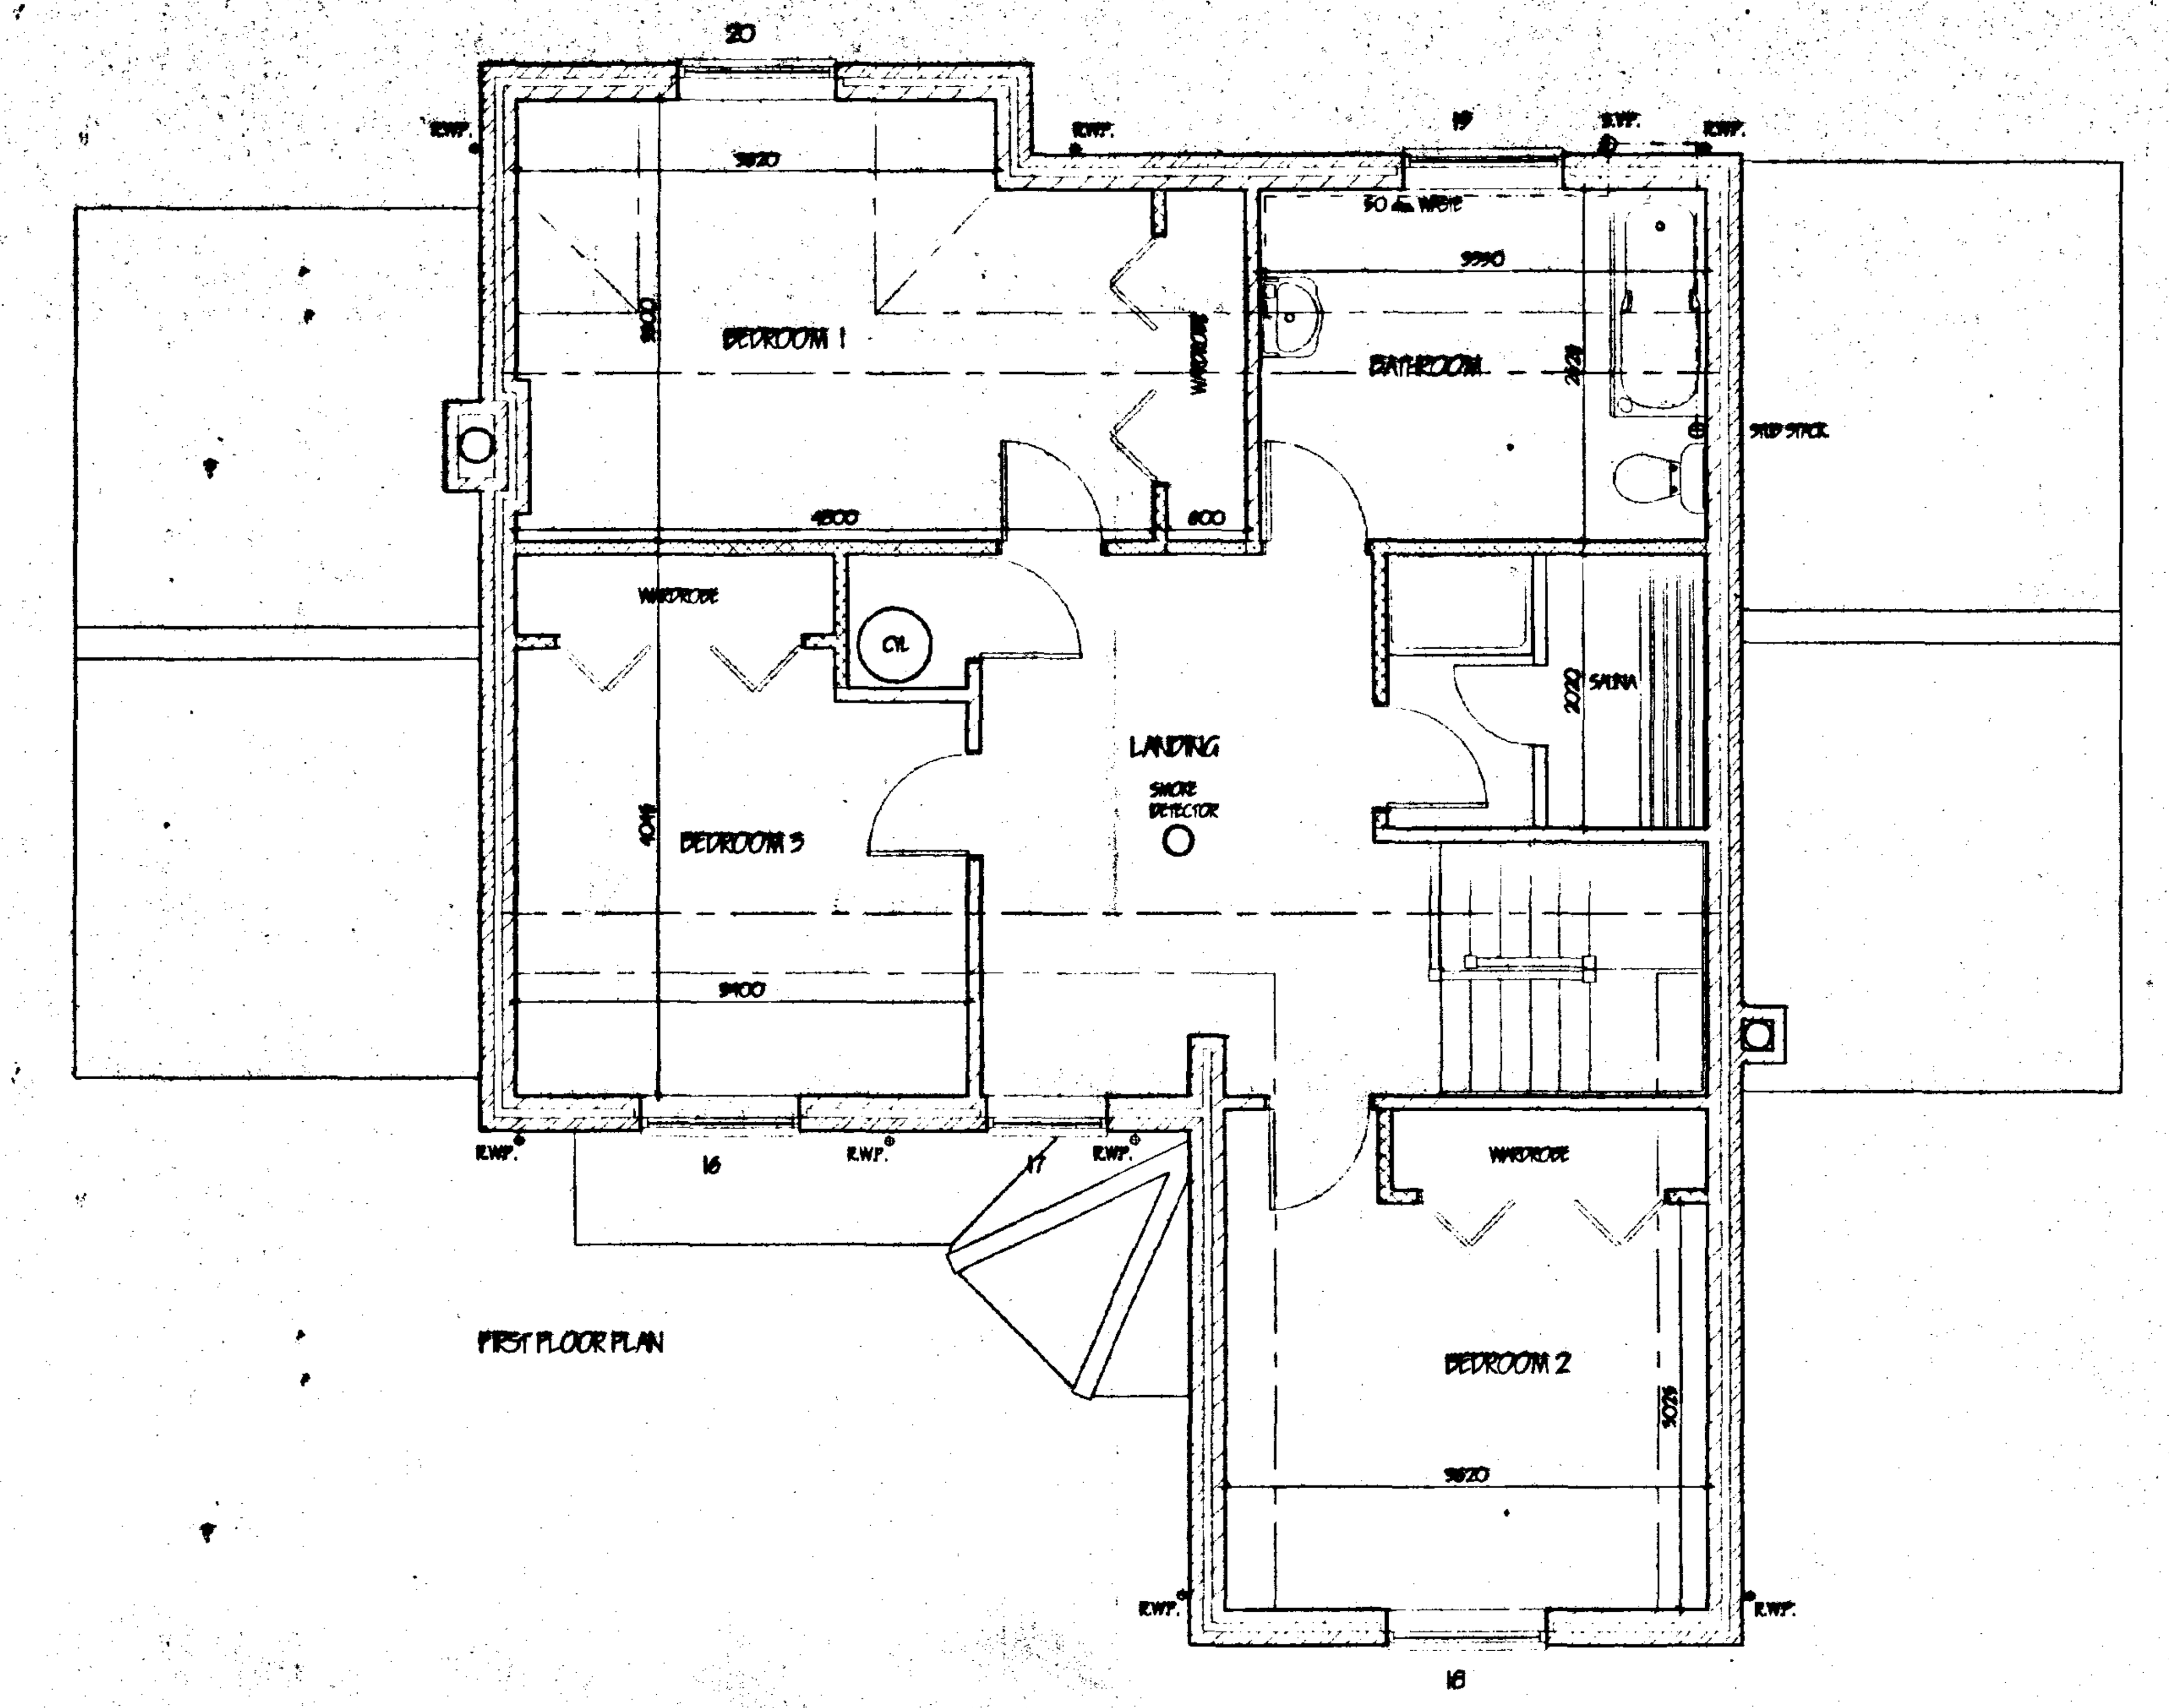

FIRST FLOOR PLAN

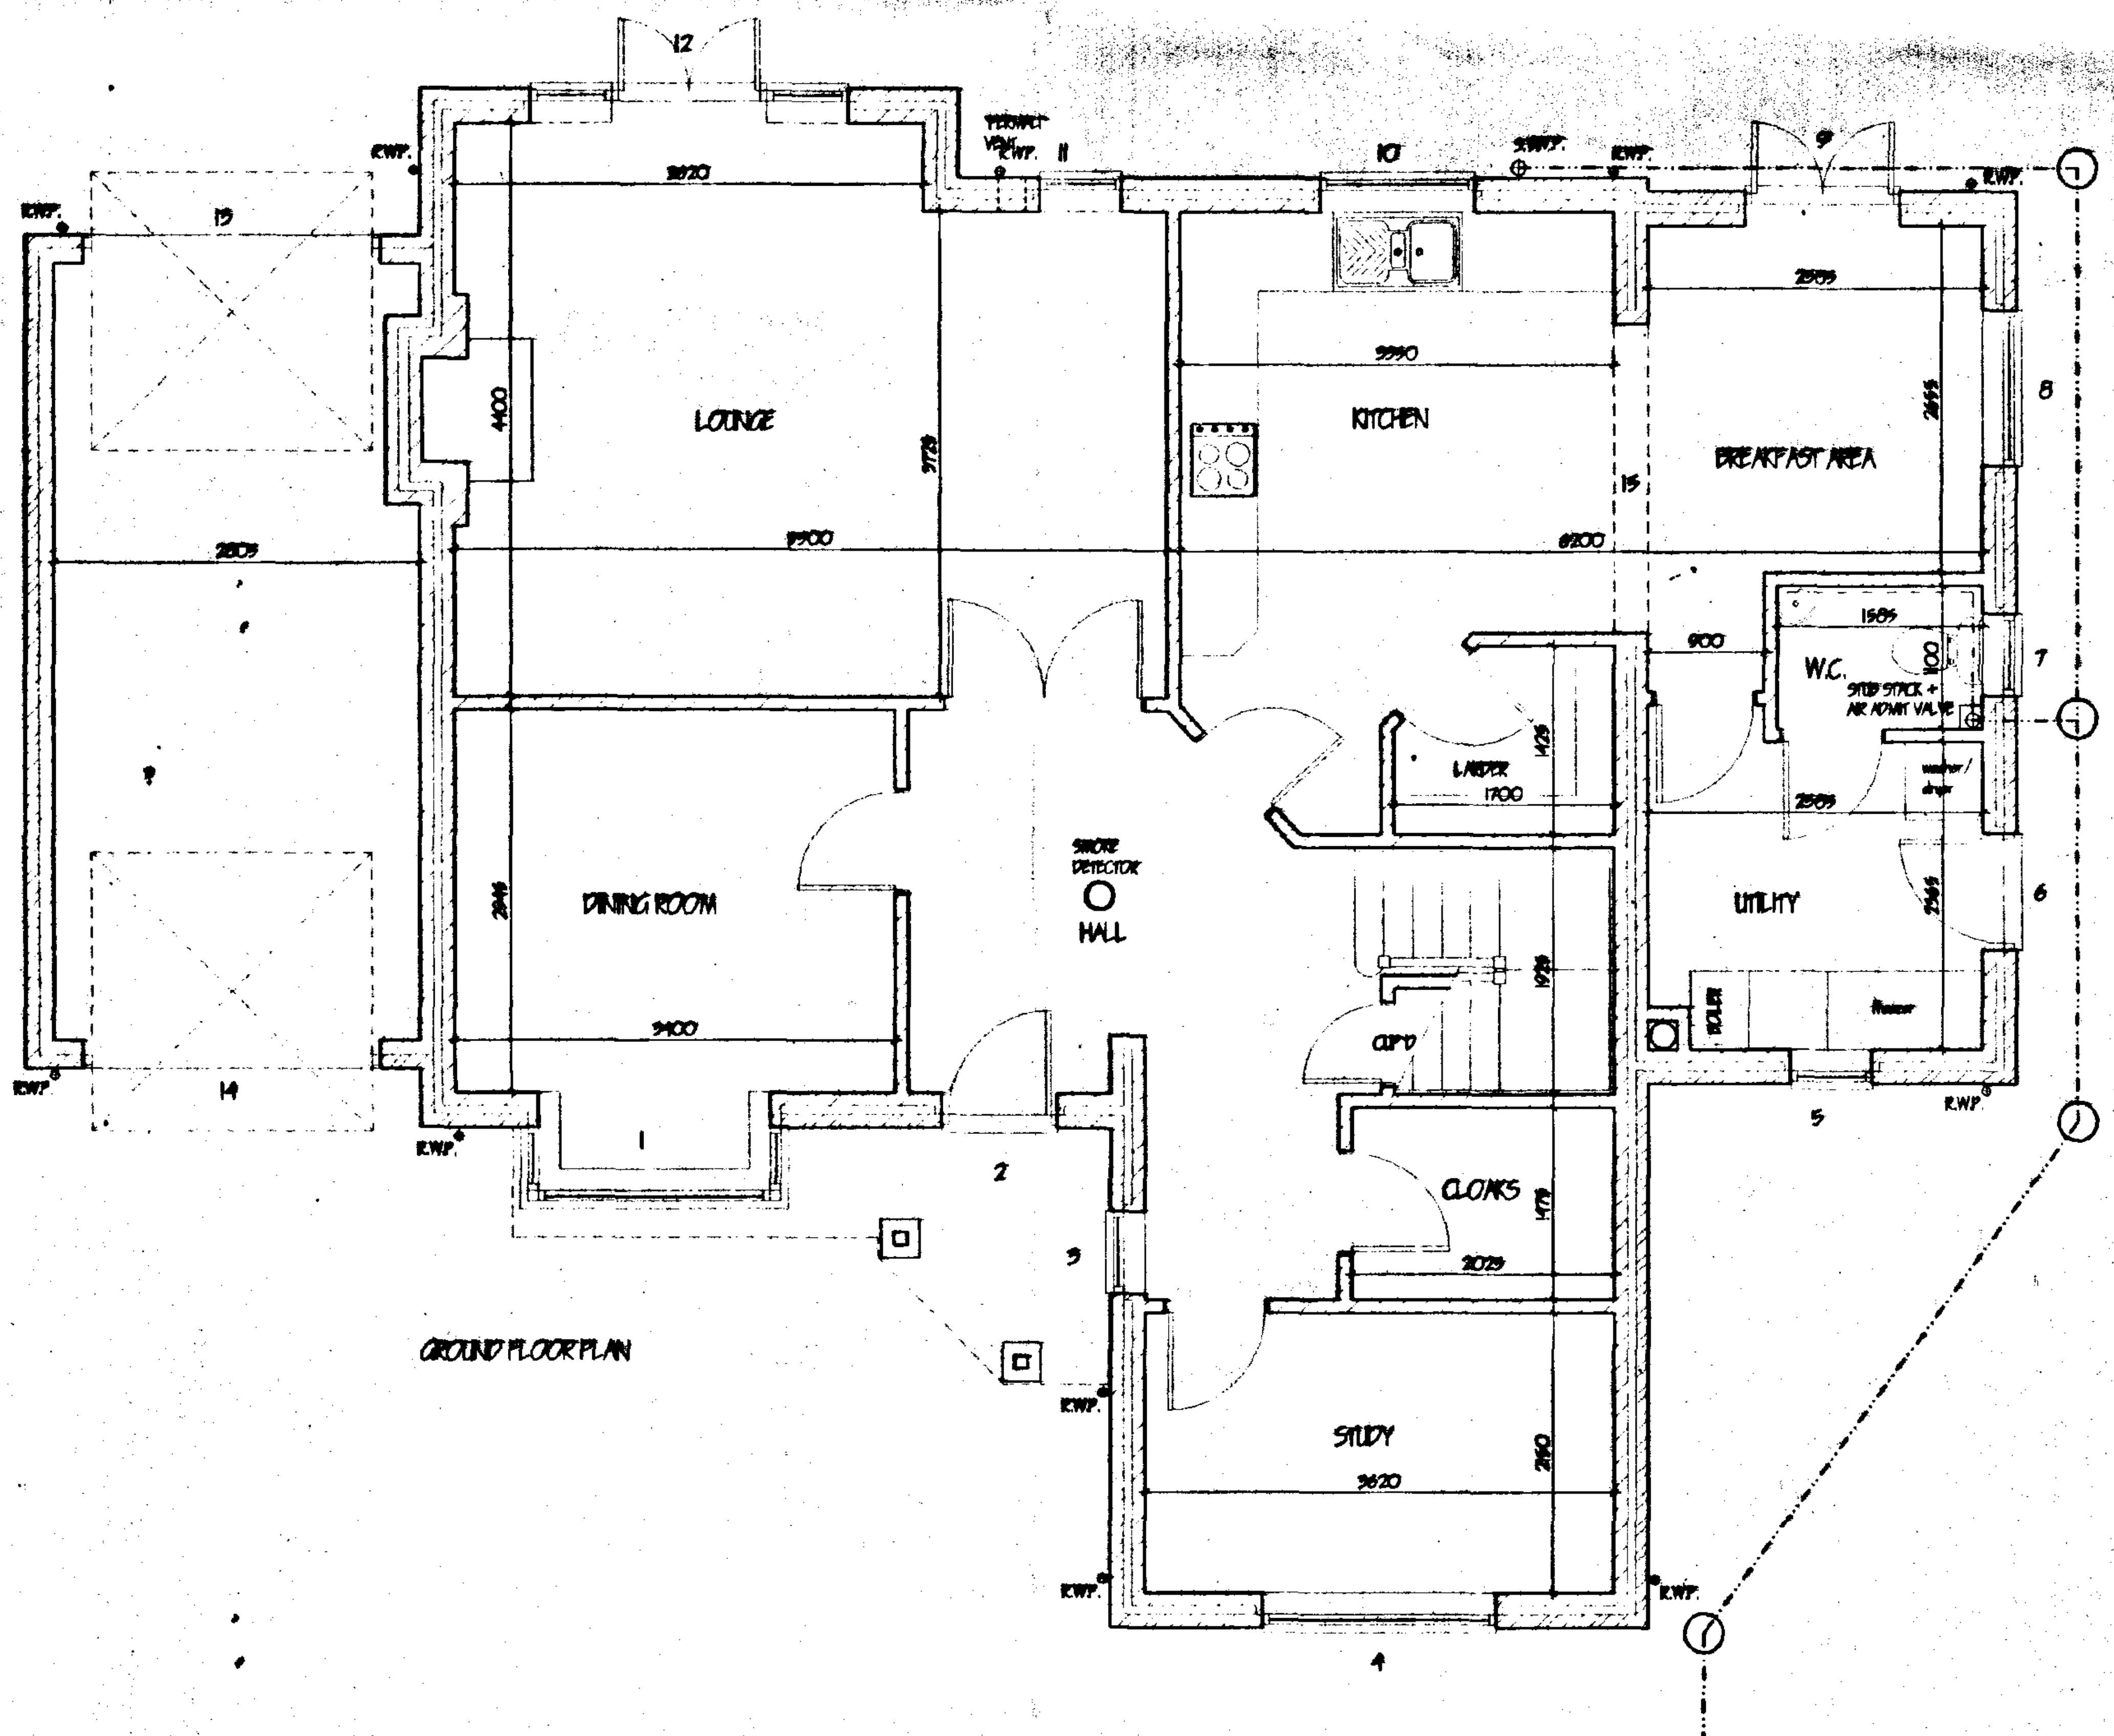

GROUND FLOOR PLAN

NORTH ELEVATION

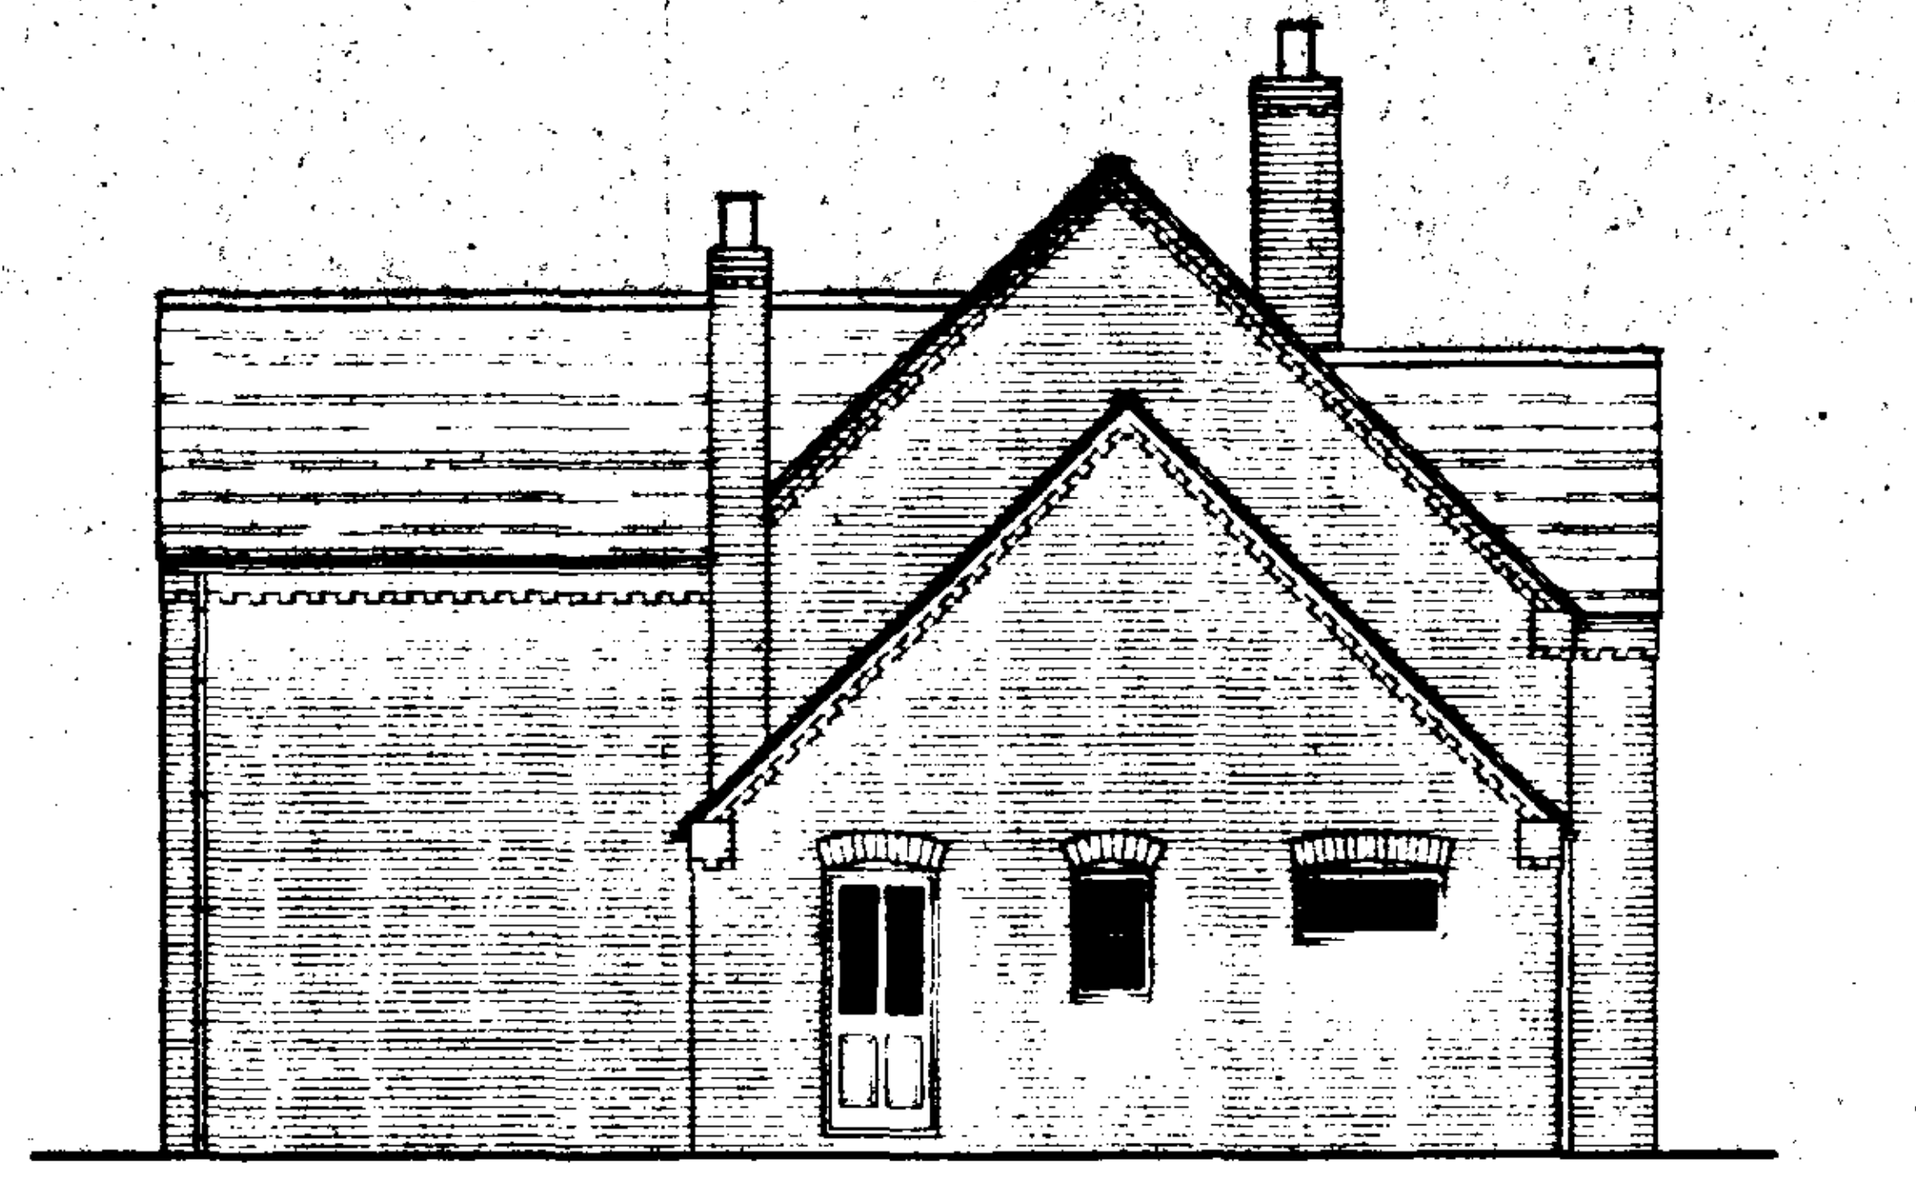

EAST ELEVATION

SOUTH ELEVATION

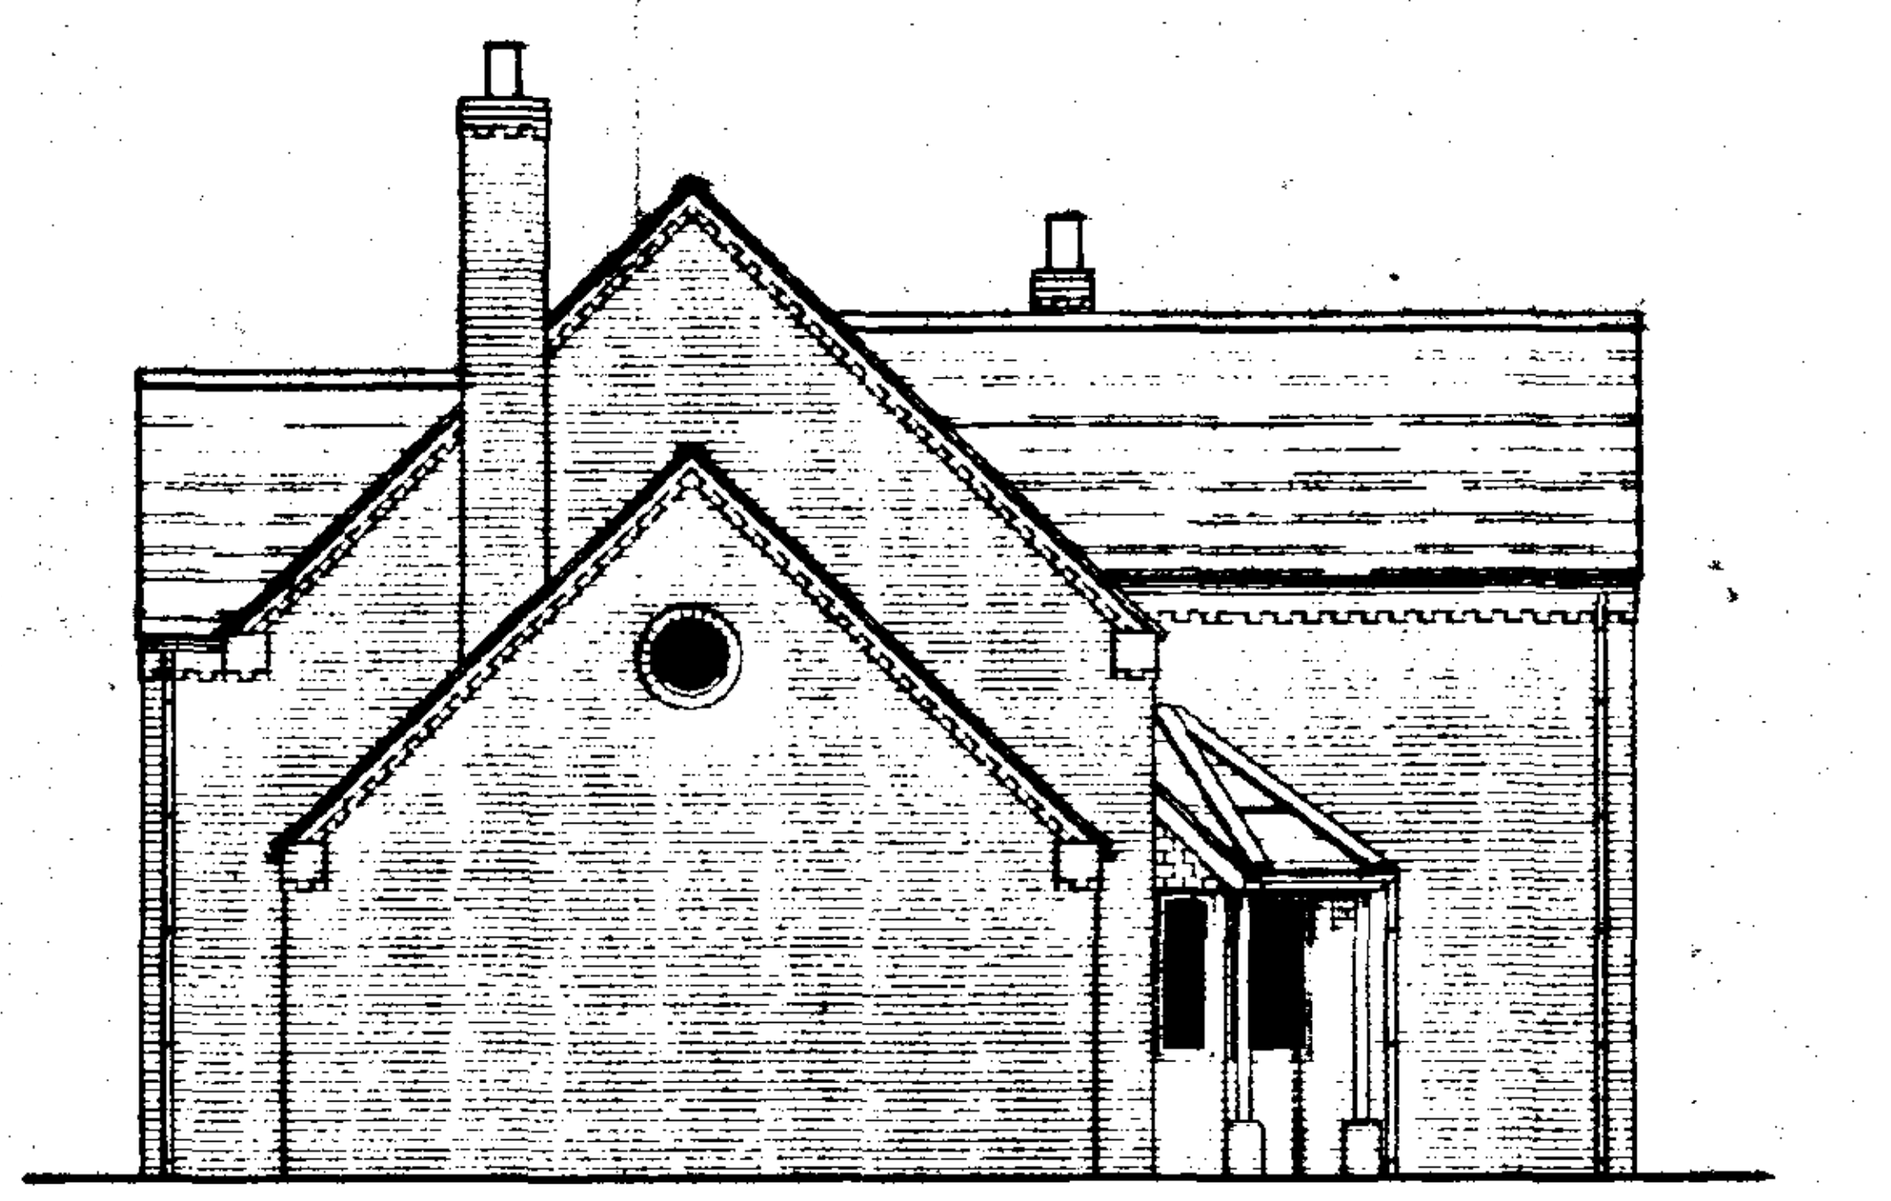

WEST ELEVATION

HOT WATER AND SPACE HEATING.
Solid fuel boiler to be on a min. 840mm square constructional hearth min 125mm thick. Flue to be of suitable diameter in relationship to boiler output. By "Selkirk" SC twin wall insulated Stainless Steel Chimney to B.S. 4543 and fitted to manufacturer's instructions. Base of stack to have non-combustible inspection plate and condensation collection vessel. Provide permanent ventilation to boiler of 550mm square per KW. by air brick in external wall. Provide timer switch and suitable thermostat to dwelling or fit thermostatic valves to all radiators. Hot water storage system to be thermostatically controlled with timer switches and to be vented. All hot water storage tanks and pipes to be insulated to B.R. L1. part 3.

SMOKE DETECTORS.
Provide mains operated self-contained smoke alarms to B.S. 5446: pt.1. in positions shown on plan.

GENERAL
All electrical installations to be in accordance with the latest I.E.E. Regulations.

GLAZING.
Double glaze property throughout (minimum 6mm air gap to all units) excluding garage. All glazing between f.f.l. and 800mm high and between f.f.l. and 1500mm high in doors and side lights to be safety glass to B.S. 6206. All windows/ doors to be draught sealed.

VENTILATION.
All windows to have opening lights to give the equivalent of 1/ 20th the floor area. Provide background ventilation to habitable rooms min. 8000mm sq permanent free air ventilation per room. To all other rooms provide min 4000 sq. All following rooms to have in addition to above Wall / Window mounted mechanical extractor fan. Kitchen to extract min. 60 litres per second. Utility rooms to extract min. 30 litres per second. Bathrooms to extract min. 15 litres per second which may be operated intermittently. W.C. to extract min. 6 litres per second with 15 minute overrun.

FOUL DRAINAGE
Inspection chamber construction to be "Osma" and installed in accordance with makers' instructions with the internal diameter related to the depth in accordance with B.S. 8301:1985. Foul drainage pipes to be 110mm dia. UPVC, to B.S. 4660:1983 flexibly jointed and laid to makers' instructions to a fall of 1:70 bed and surround with 100mm pea gravel: Where pipes pass under floors encase in 150mm pea gravel: Where pipes pass under drives surround in 150mm concrete with flexible joints to correspond with joints in pipework. Provide 65 x 100 prestressed concrete lintel bridging where pipes pass through walls, allow 50mm gap around pipe, opening masked both sides of wall with ridged sheet material: Soil and vent pipes to be 110mm dia. PVC to B.S. 4514: 1983 and to extend 900mm above window head terminating with PVC balloon. Waste pipes to be 40mm dia. PVC to B.S. 3943: 1979 complete with rodding eyes at every change of direction: Bath, basins and sink to have 75 deep seal traps: Shower to be raised on 150mm plinth with access plate to anti-syphon trap and 50mm waste.

SURFACE WATER DRAINAGE.
115mm dia. half round rainwater gutters to 69mm dia. rainwater pipes: 110mm dia. underground pipes flexibly joined to a fall of 1:70 pipes bedded and surrounded in pea gravel and discharge to 1.2m dia. soakaway min. 5.0m to edge from dwelling.

FLUE CONSTRUCTION.
225mm internal diameter to open fire & 150mm internal diameter to boiler clay flue liners to B.S. 1181: 1971 and to be laid socket uppermost: 100 face brickwork surround to flue and to extend min. 600mm above ridge line and terminate in corbelled out brickwork and clay pot: Weak mix. conc. infill around flue as work proceeds: Trim roof around flue, no timber within 40mm of flue: At roof / flue intersection provide code 4 lead flashing and 2 courses engineering bricks.

OPEN FIRE.
To be capable of burning smokeless fuel: Hearth to be constructed of non combustible material min. 125mm thick: To project from face of wall by min. 500mm and pass reveals by min. 150mm: All in accordance with approved document part J. (part C 1-25). Appliance to be in accordance with building regulations. Provide louvred permanent vent in ext. wall to give min. 50% of the appliance throat opening area positioned 150 above floor level. Provide 65 x 100 prestressed conc. lintel over chimney opening.

LINTELS.
All lintels to be manufactured by Messrs. I.G. and to be installed in accordance with makers' instructions, and to have min. end bearing of 150mm and at external positions to have cavity tray D.P.C. to CP. 121: Internal lintels to be I.G. 100 Box type. Lintels in garage to be underlined with 12.7 fireline board or receive 12mm render and skim. Provide Perp-end weep holes and stopends to cavity tray

LIMITATIONS.
This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning / Building Regulation approval.
The drawing must not be used as a contract document alone.
All dimensions shall be taken from site from actual work. Under no circumstances shall measurements be scaled from this drawing for construction or ordering purposes. All given dimensions shall be checked by the Builder / Contractor and will be his responsibility from commencement of site works.
The works will not be supervised or inspected on site by C.A.D. or any representative thereof. It is the client or their appointed agents responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract etc.

COPYRIGHT RESERVED.
Copies of this drawing must be made only with the written permission of Cooper Architectural Design.

STANDARDS.
All materials to be new unless otherwise stated and all components and materials etc. to be used fitted and installed etc. in strict accordance with manufacturers instruction and relevant Code of Practice.
Materials shall conform to appropriate British Standard Specification or BBA Certificate or European Code equivalent.

HEALTH & SAFETY.
The Employer / Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health & Safety legislation for Building Sites and Work Places.
The Employer / Client is advised that should the works need to comply with the Construction Design and Management Regulations an independent Planning Supervisor will be required.

SCOPE OF THE WORKS.
The works shall comprise of all that is shown on the drawing and details. Work that may not be specifically shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

CEILINGS.
200mm glassfibre insulation total thickness. 100mm between joists & 100mm over Joists. 12.7mm Gyproc plasterboard 3mm skim finish: Provide min. 38 x 38 noggins to all plasterboard edges. All joints to be taped and filled. Garage ceiling to be 12.7mm Gyproc Fireline board and Artex: Provide access trap to roof space: opening to be lined with 25 x 25 planted stops: Access panel to be 12mm ply with layer of 12.7mm Fireline board fixed to face. 100mm Jablite to top surface. Draught seal all round

STAIRCASE AND BALUSTRADE.
Construct staircase as follows: 875 o/ a strings 13No. risers of 200mm ex 25 x 225: 223 going ex 32 x 250: pitch 42deg. Min. head room 2.0m measured vertical above pitch line. All in accordance with B.S. 5395:1977. Staircase to have ex 58 x 50 shaped hardwood handrail min. 900 above pitch line. 100 x 100 softwood newel post. Gap between vertical balusters not to exceed 99mm. Handrail and balustrade to be capable of resisting the appropriate load specified in B.S. 6399: Pt. 1. Balustrade to be min. 900mm high.

revision	date	init.	revision details.

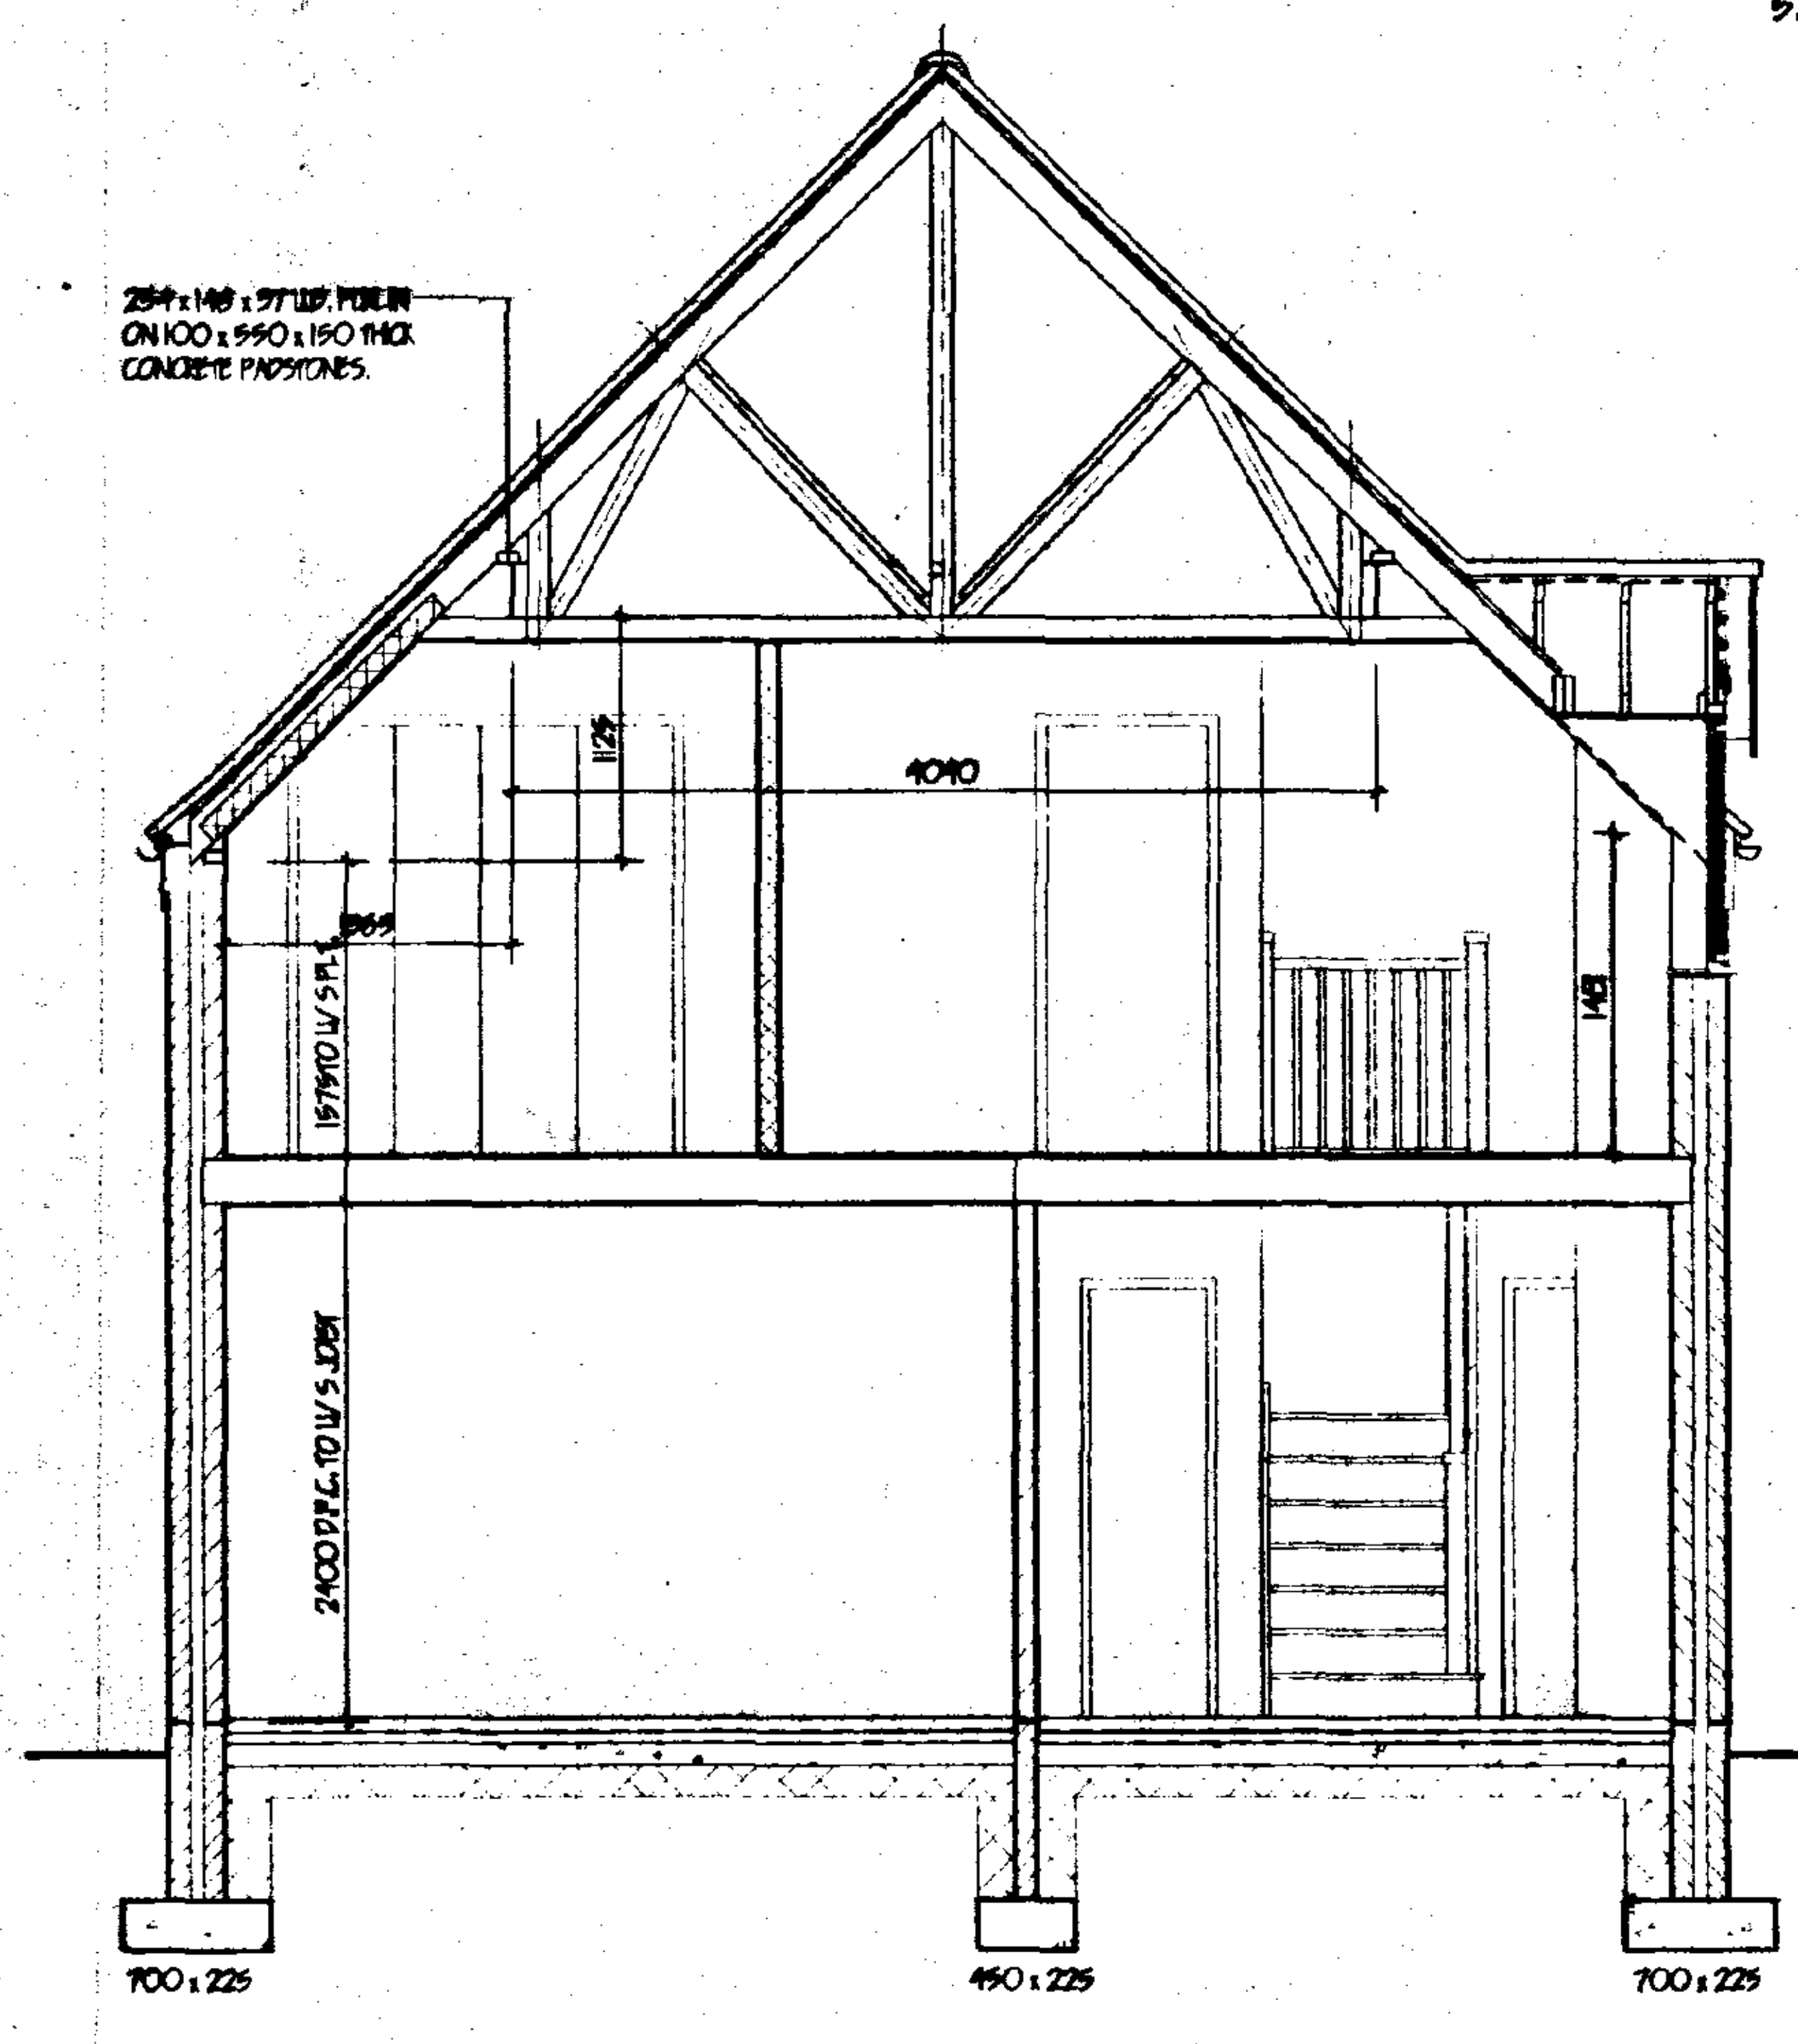

SECTION A - A

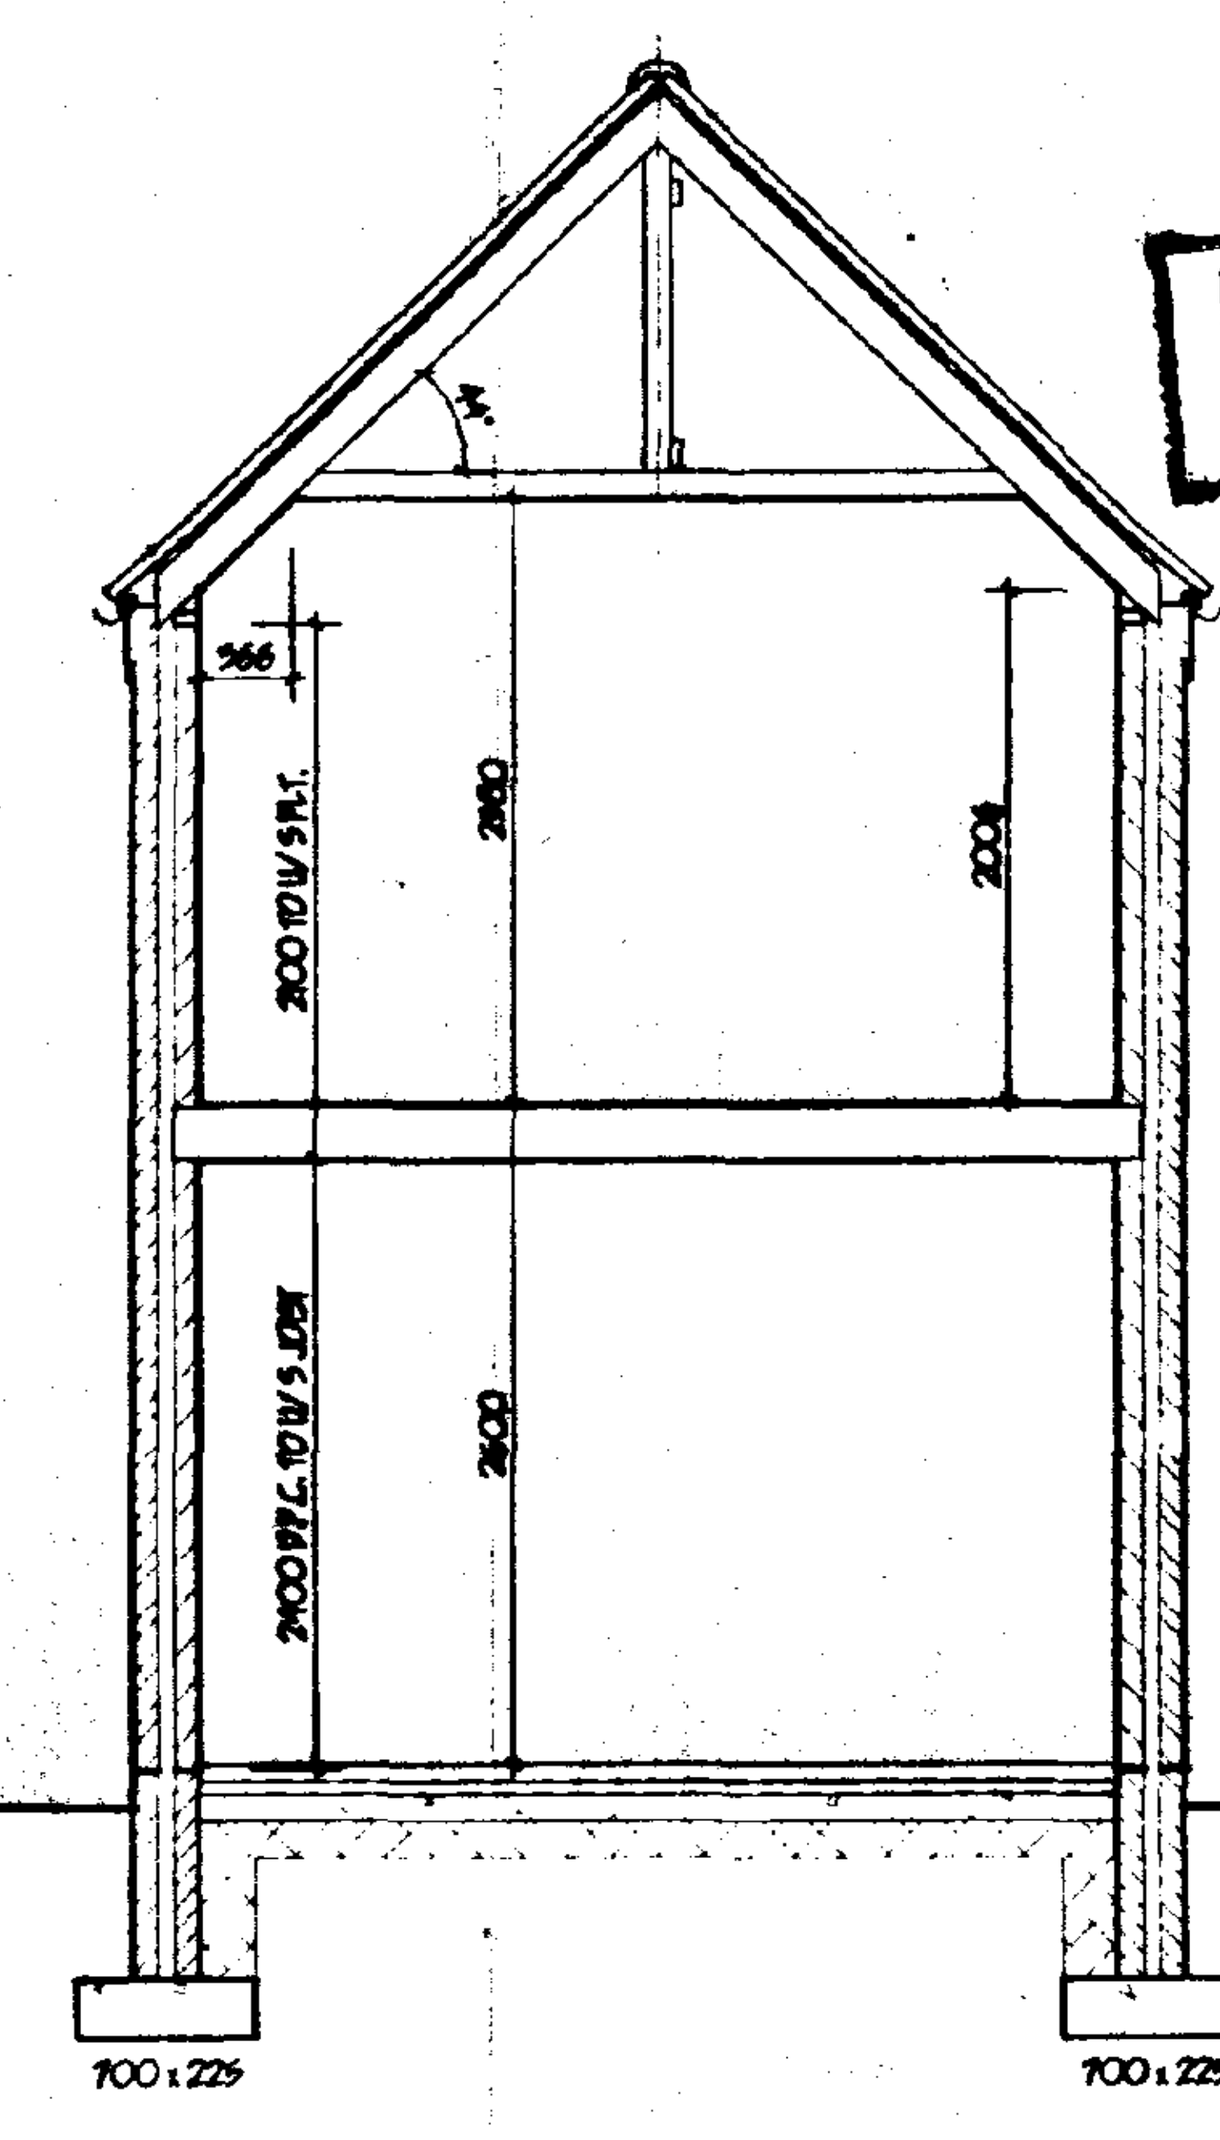

SECTION B - B

DETERMINED PLAN

COOPER ARCHITECTURAL DESIGN
BRONAVON, HOCKLESGATE, FLEET, SPALDING, LINC'S PE12 8LF
Tel/Fax : 01406 423782
Mobile : 0410 290652

Client.
MR & MR N. FULCHER

Project.
PROPOSED HOUSE & GARAGE
WASHWAY ROAD,
HOLBEACH,
SPALDING,
LINC'S

SOUTH HOLLAND DC
HOUSING & PLANNING
26 JAN 1999
Ref. 0066/99.

Drawing.
FLOOR PLANS / ELEVATIONS / SECTIONS

Scale	1:50 1:100	Drawing No.	9836:1
Date.	JAN. '99.	Drawn.	J.C.