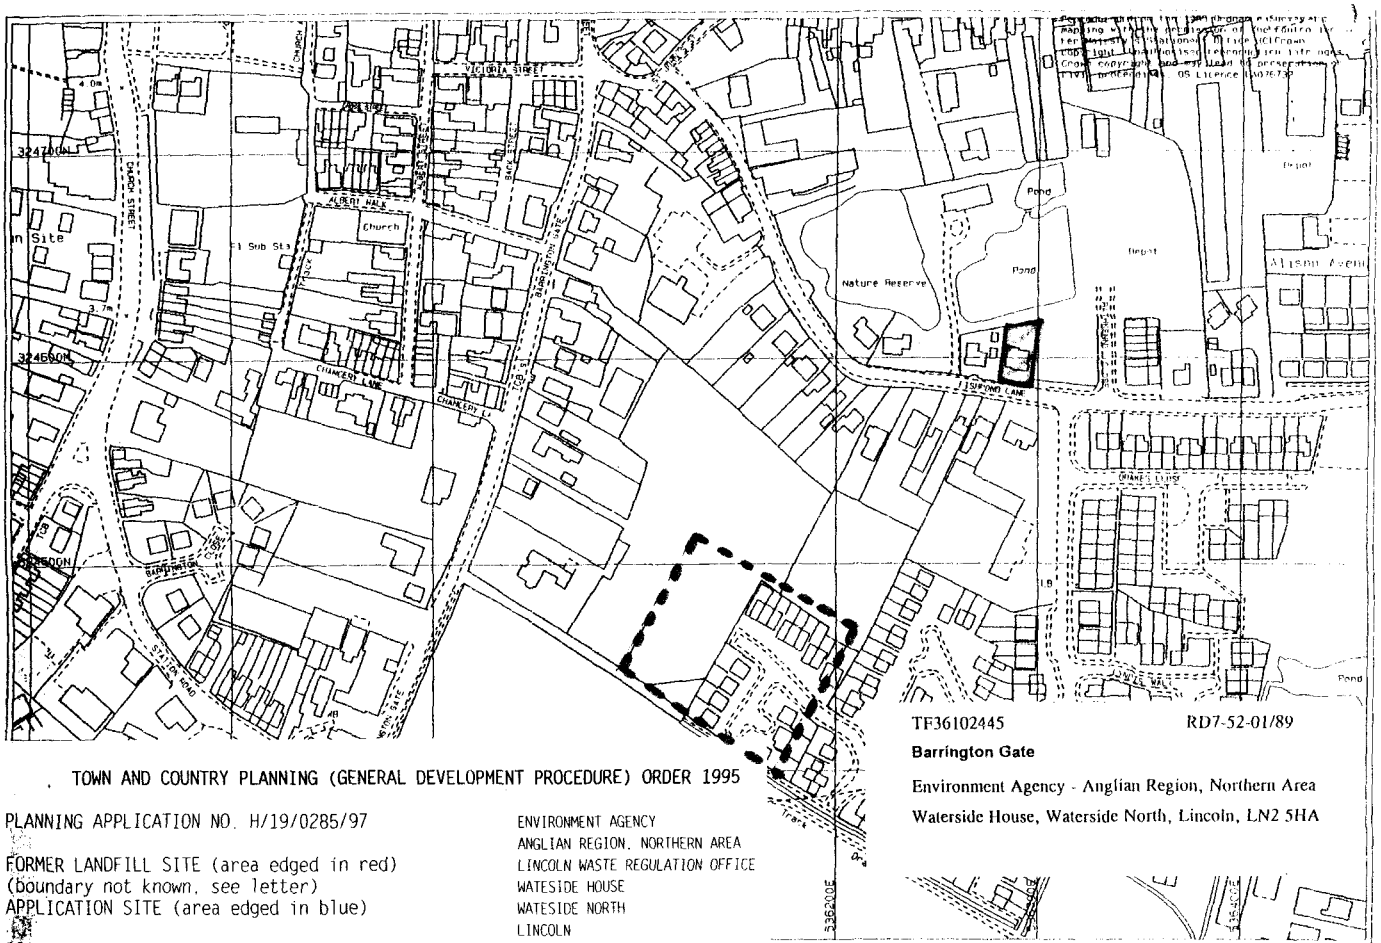



TF36102445 RD7-52-01/89

**Barrington Gate**

Environment Agency - Anglian Region, Northern Area
Waterside House, Waterside North, Lincoln, LN2 5HA

TOWN AND COUNTRY PLANNING (GENERAL DEVELOPMENT PROCEDURE) ORDER 1995

PLANNING APPLICATION NO. H/19/0285/97

FORMER LANDFILL SITE (area edged in red)
(boundary not known, see letter)
APPLICATION SITE (area edged in blue)


SCALE : 1:2500 REF: RD7-0308

ENVIRONMENT AGENCY
ANGLIAN REGION, NORTHERN AREA
LINCOLN WASTE REGULATION OFFICE
WATESIDE HOUSE
WATESIDE NORTH
LINCOLN
LN5 5HA
TEL 01522 895969


TF36 12 45

**CAVITY WALL CONSTRUCTION:**

**365mm cavity walling to consist: (BWK to M**
100mm facing external brickwork to B.S.3921:1974 for clay bricks and B.S.187:1978 for clacium silicate bricks.
65mm cavity: Build into cavity Rockwool cavity wall insulation Boarding in accord.
Makers instructions and agreement certificate M83/1087
100mm internal cavity skin of tarmac hemelite insulation blockwork.
Cavity walls to be tied together using galvanised iron or plastic twist ties spaced 900mm horizontally and 450mm vertically 300mm ctrs at unbonded cavity closures internal masonary walls of 100mm tarmac hemelite.
Mortar to B.R.E. digest No178 and CP 121 part 1 1973.
And as recommended by bwk manufacturer. Close cavities at eaves and provide Bituminous felt D.P.C.
Provide bit. felt D.P.C also to sills and jambs at closure. Provide thermal plasterboard to the int. jambs of all windows and doors, at the head under lintels and also under sills. Provide bituminous felt D.P.C. above all exposed lintels as cavity tray and stepped D.P.C cavity tray and code 4 lead flashing with a min 150mm upstand @ all roof/wall abutments.

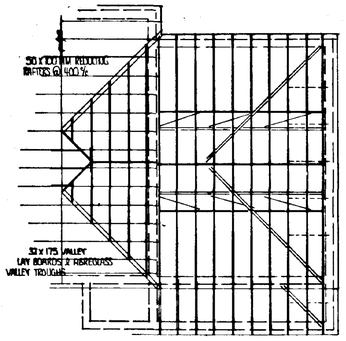


ROOF PLAN

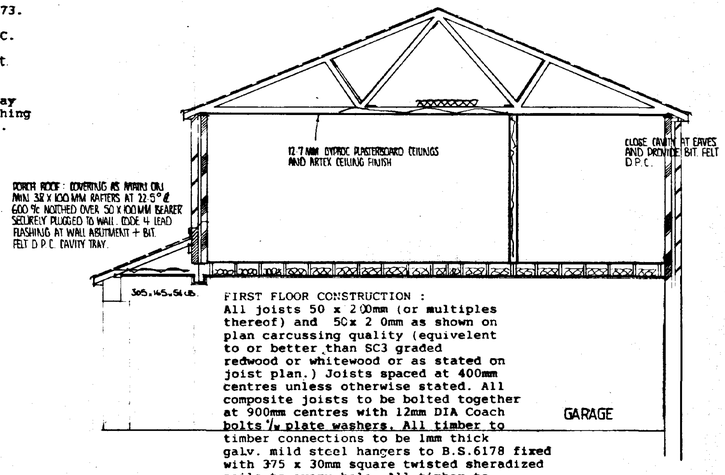


SECTION THRO'

FIRST FLOOR CONSTRUCTION :
All joists 50 x 200mm (or multiples thereof) and 50x 200mm as shown on plan carcussing quality (equivelent to or better than SC3 graded redwood or whitewood or as stated on joist plan.) Joists spaced at 400mm centres unless otherwise stated. All composite joists to be bolted together at 900mm centres with 12mm DIA Coach bolts ½w plate washers. All timber to timber connections to be 1mm thick galv. mild steel hangers to B.S.6178 fixed with 375 x 30mm square twisted sheradized nails to every hole. All timber to masonary connections to be 2.5mm thick galvanised M.S. Hangers to B.S.6178 top flange fully embedded and all holes nailed. Stud wall built on sole plate. Provide solid strutting at mid joist span. Provide 30 x 5mm once bent (900/100) galv.M.S. Lateral restraint straps to external walls where shown (at 2m max ½) fixed with 4N° 50mm & gauge CST. Screws or 5N°3.5 x 50mm galv. round wire nails 10 3N°joists min ½ solid blocking supports in between joists.
Finish: 18mm T&G. moisture resistant chipboard type C4 to B.S.5669

**ROOF COVERING:**
Concrete interlocking roof tiles on 38 x 25mm treated softwood battens, guage to suit tiling on B.S.747 type 1F untearable roofing felt or silimlar on cut/trussed rafters as applicable. Contractor is to determine tile fixing specification from manufacturers published literature with due consideration for site location, antisipated wind velocities and roof pitch.

**ROOF CONSTRUCTION:**


Wall plates generally 100 x 50 mm treated softwood (OR TO MATCH EXISTING)
with half lapped joints and fully bedded strapped down to support wall with 30 x 5mm GMS straps at Max 1.2M c/c
Cut rafters fully birdsmouthed over and twice nailed to all supports. Trussed rafter roof to be designed and manufactured by an approved manufacturer and fixed, together with min. 100 x 25mm sawn SW binders and bracing in accordance with B.S.5268 Part 111 1985 (and any subsequent amendment)
Trusses spaced at maximum 600mm centres and pitched at 22.5°; TO MATCH EXISTING TO BE CHECKED ON SITE BY TRUSS MANUFACTURER
Provide 30 x 5mm once bent (900/100) galv.M.S. lateral restraint straps to external walls at ceiling and rafter level where shown at max 2.0M fixed with 4N° 50mm B gauge CSK screws or 5N 3.5 x 50mm galv. round wire nails to 2N° trusses/ceiling joints minimum ½ solid blocking blocking support and edge packing.

**ROOFSPACE VENTILATION AND INSULATION:**


Provide eave to eave ventilation equivelent to 10,000mm²/m run. Use either ventilating soffit boards, continuous soffit ventilation strips or continuous over fascia ventilation system: Marley or sim. approved. Provide 100mm fibreglass insulation quilt inbetween ceiling ties and 100mm fibreglass insulation quilt over ceiling ties (total 200mm thickness). Ensure to maintain a minimum 25mm air space between roof insulation and roofing felt. Roof hatch insulated and to include compressible seal.

FASCIA, SOFFIT, BARGE BOARDS, R.W. GOODS TO MATCH EXISTING

CEILINGS : GARAGE : 1N° LAYER 15 MM GYPROC 'FIRELINE' PLASTERBOARD & ARTEX
100 MM FIBREGLASS INBETWEEN JOISTS.
SURROUND BEAMS WITH 2 N° LAYERS STAGGERED GYPROC FIRELINE
UTILITY : 1N° LAYER GYPROC 12.7 M/M P'BOARD AND ARTEX

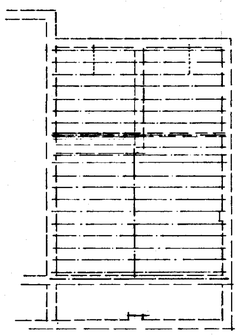

FLOOR JOIST PLAN

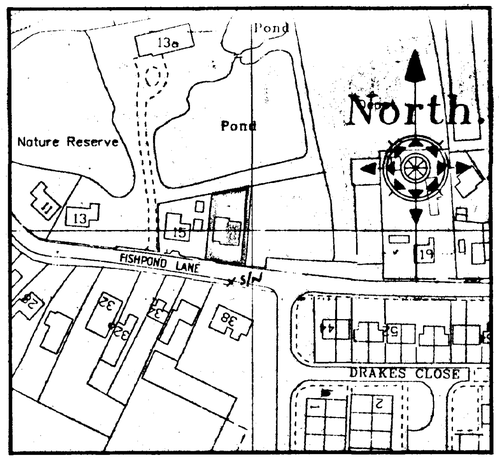



LOCATION PLAN 1:250

ROOF TILES TO MATCH EXISTING



PROPOSED FRONT ELEVATION

FACING BRICK TO MATCH EXISTING

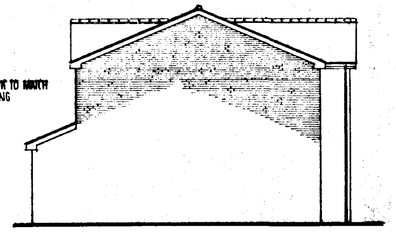

PROPOSED SIDE ELEVATION





EXISTING GROUND FLOOR





PROPOSED FIRST FLOOR EXTENSION




EXISTING FRONT ELEVATION

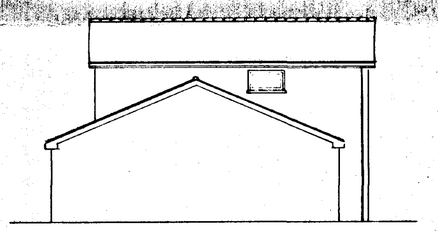

EXISTING SIDE ELEVATION

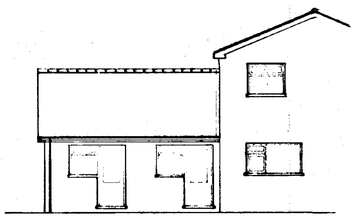

EXISTING REAR ELEVATION

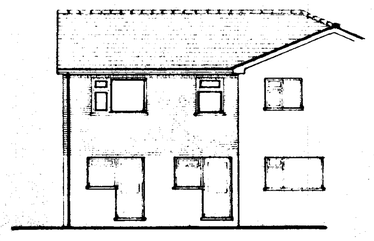

PROPOSED REAR ELEVATION

DETERMINED PLAN

SOUTH HOLLAND DC HOUSING & PLANNING
17 MAR 1997
Ref: 0285/97

| revision | date | init. | revision details. |
|---|---|---|---|
| | | | |

COOPER ARCHITECTURAL DESIGN
BROMHOLM, HIGHLEGATE
HOLBEACH, SPALDING, LINCS PE12 8LF
Tel/Fax : 01406 423788

Client.
MR .C. FEENEY

Project.
PROPOSED EXTENSION TO HOUSE
15a FISHPOND LANE, HOLBEACH,
SPALDING: LINCOLNSHIRE.

Drawing.
PLAN AS EXISTING / PROPOSED

| Scale | Drawing No. |
|---|---|
| 1:50 1:100 1:1250 | 9616-1 |
| Date. DEC 1996 | Drawn. J.C. |

Stud walls to consist of 35 x 89mm studs at 400mm c/c, both sides to be clad with 12.7mm plasterboard and skim. 100mm glassfibre infill between studs.

**LINTELS:**
Specified lintels are by I.G. Lintels LTD. Insulated as standard and installed with a min. 150mm end bearing. Lintels installed in strict accordance manufacturers recommendations incl. all necessary stop ends and 10mm weep holes at 675mm c/c above trays.

**VENTILATION:**
All window opening lights to have area to exceed 1/20TH from floor area.
All habitable rooms to have Trickle Ventilators in window/door heads giving ventilation equivelent to 8000mm²