

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Heating System
Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Insulated Pipes and Ducts
All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Wall Construction
275mm cavity walls to consist of:
100mm face brickwork (see site plan for details), 75mm cavity to be filled with Crown Dritherm full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved, 100mm internal skin of Tarmac Hemelite blockwork. Cavity walls tied together using galvanised iron or plastic twist ties spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish.

Habitable Room Trickle Ventilation
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm².

Roof Insulation
To roof spaces provide proprietary 200mm thick insulation laid as 100mm between joists and 100mm across joists. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150 mm above ground level. Weak mix infill to base of cavities to terminate 225 mm below lowest d.p.c. level.

Foundations
As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widened foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise.

Brickwork below d.p.c. to be F.L. quality

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

White UPVC double glazed windows to match existing. Opening vents to be minimum 1/20th of floor area.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible joined to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and nogging to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site.

Fascia
To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.







Ground Floor Construction
65mm sand/cement screed on proprietary 50mm thick floor insulation with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Bow window to match that of existing lounge bow window.


Remove existing side lounge window and increase opening down to floor level to form 900mm wide opening. Form arch under opening. Make good to disturbed areas.

Floor and ceiling levels to match existing.

External materials to match those of the existing garage.

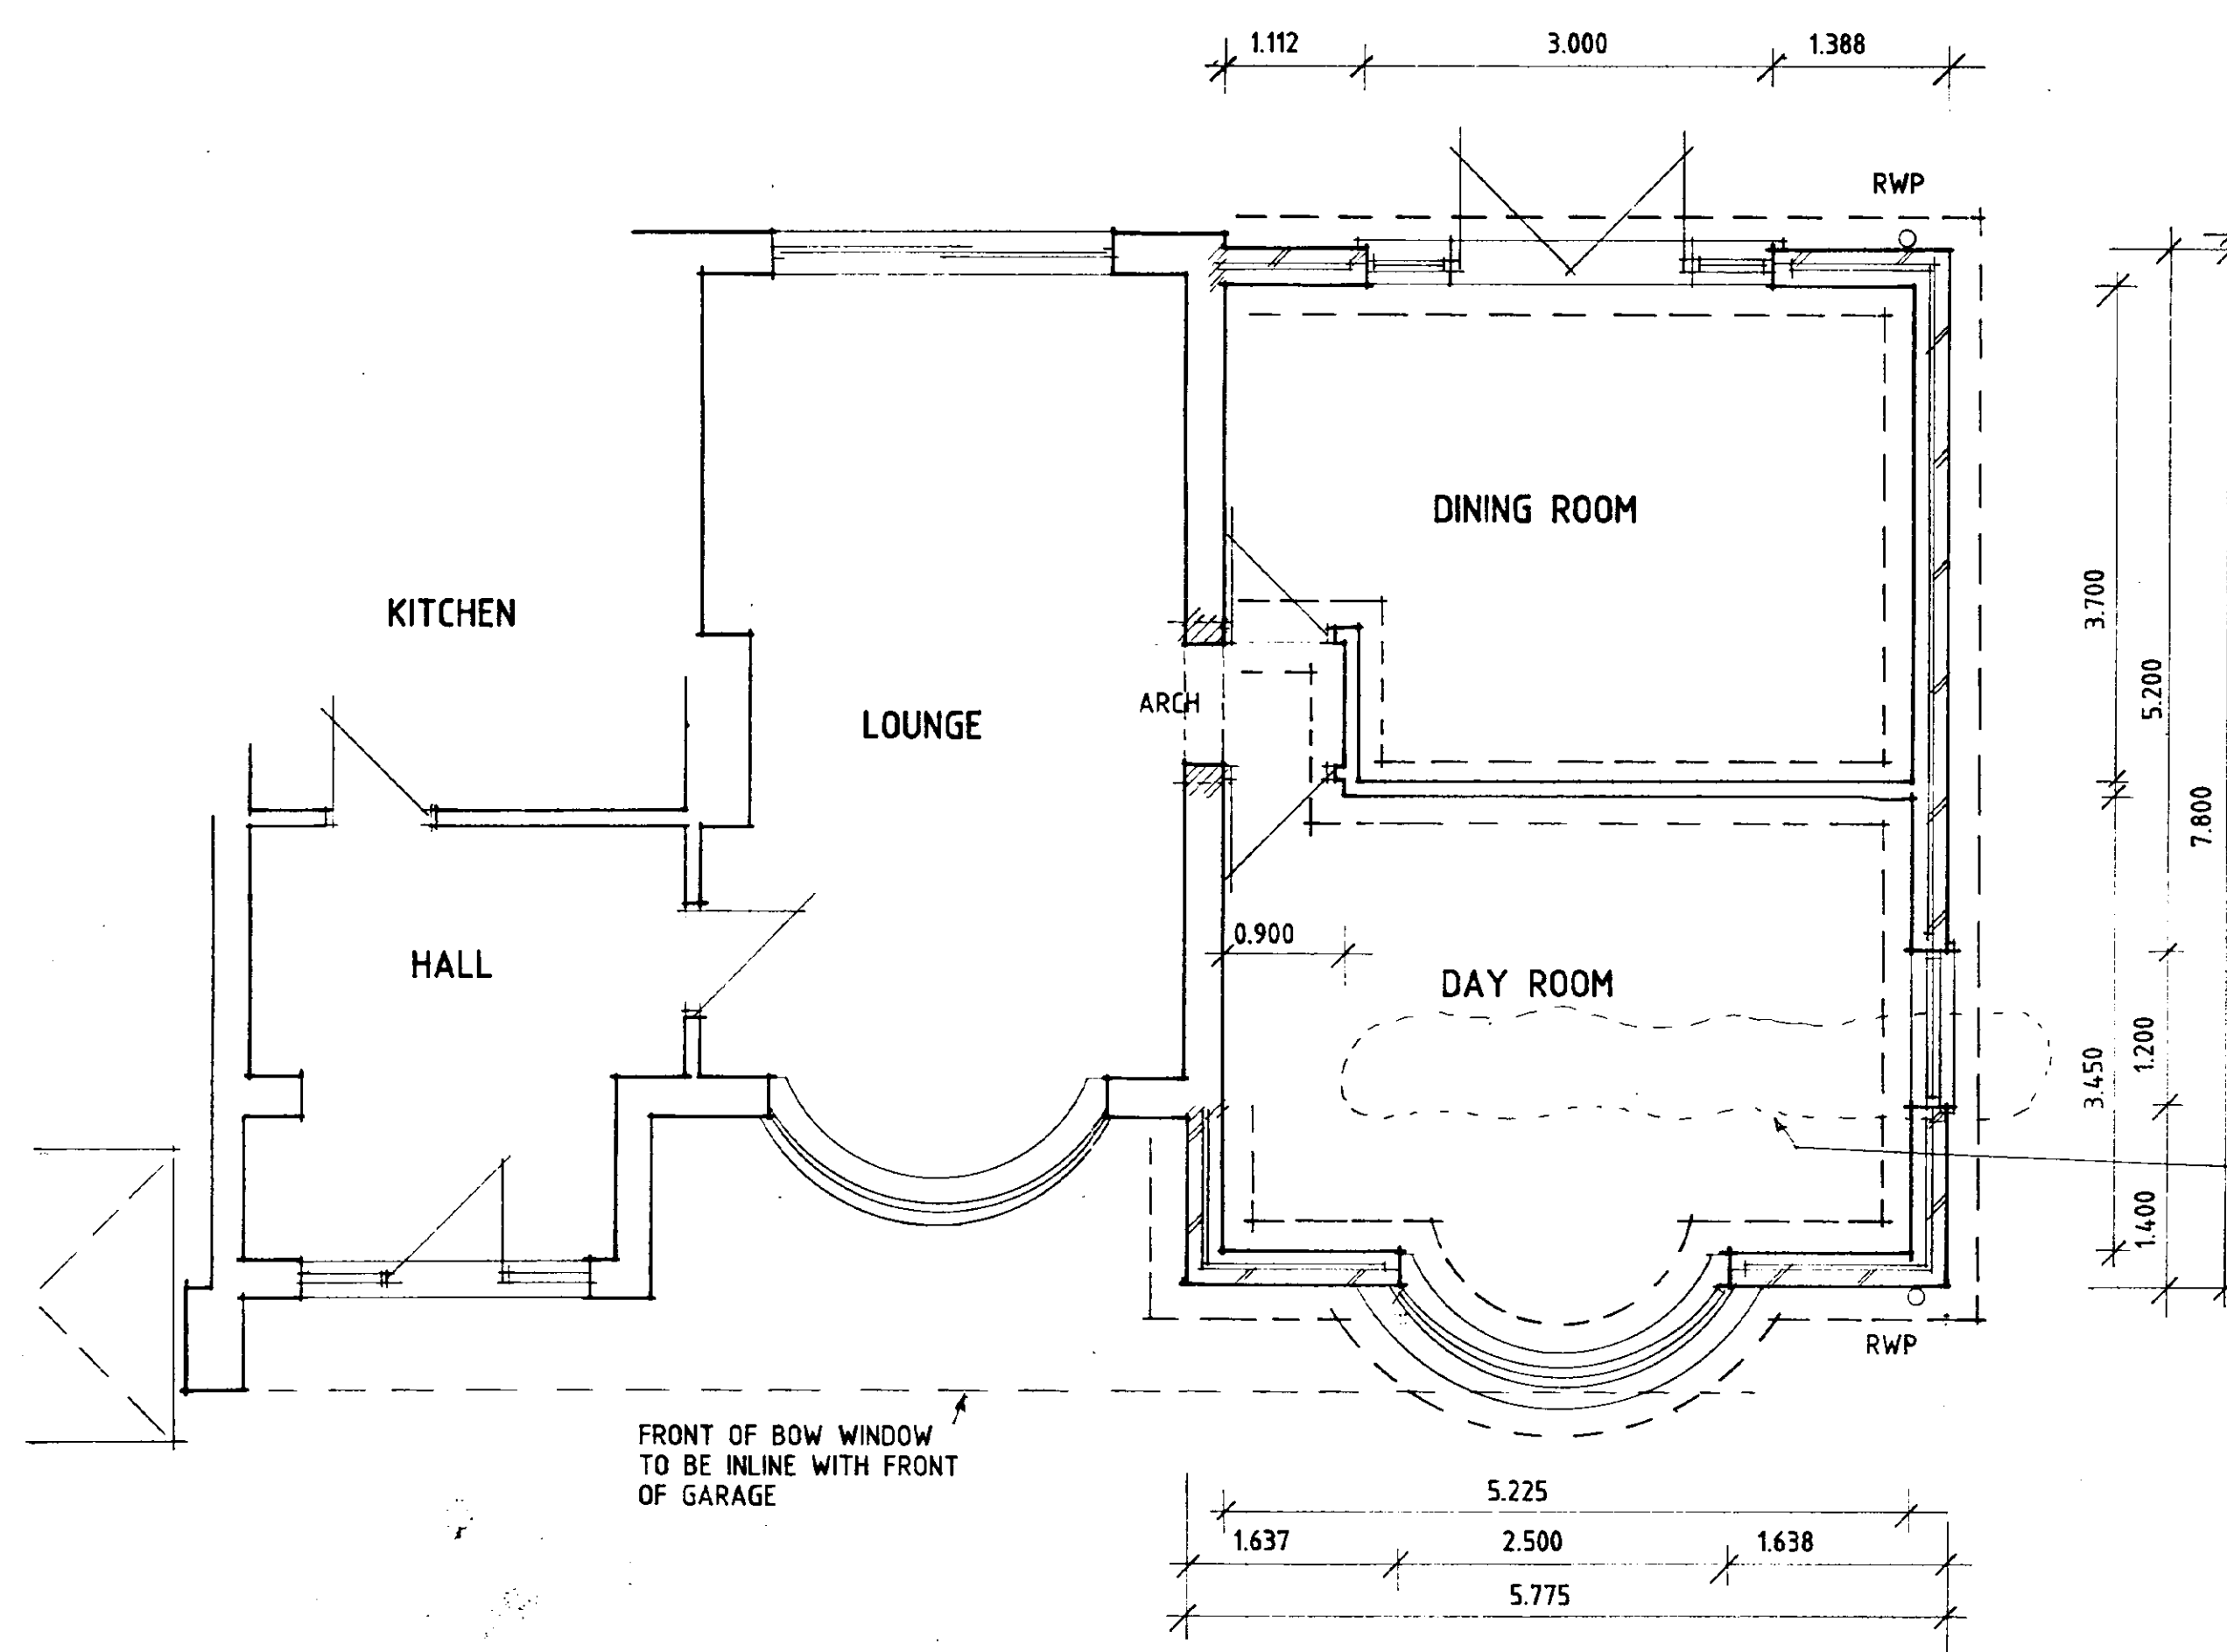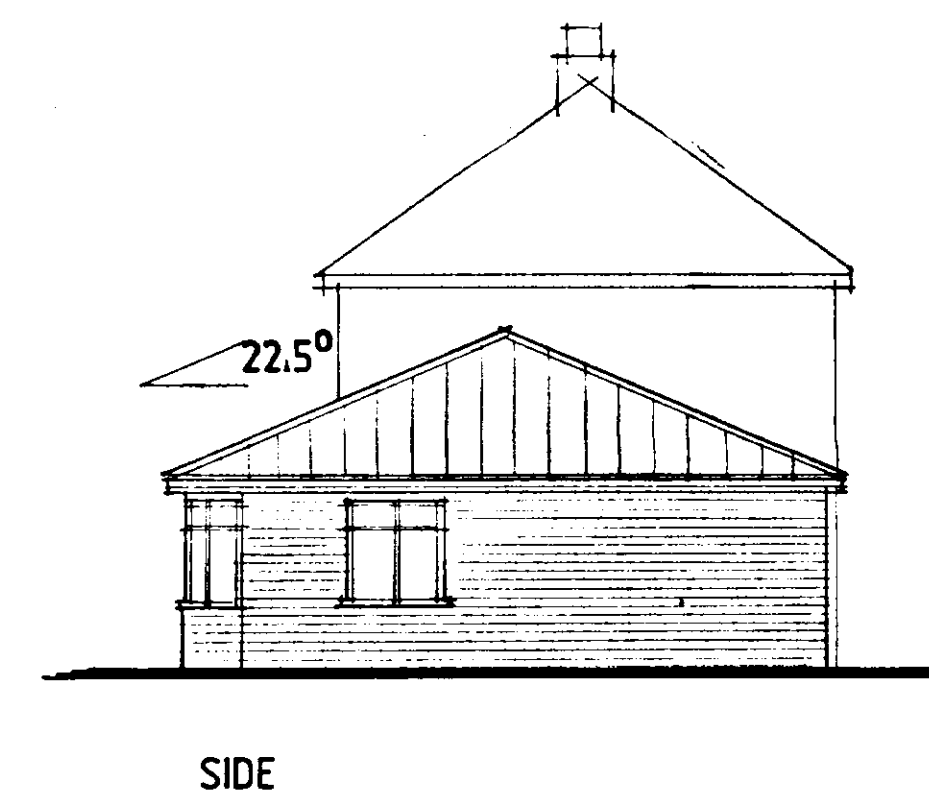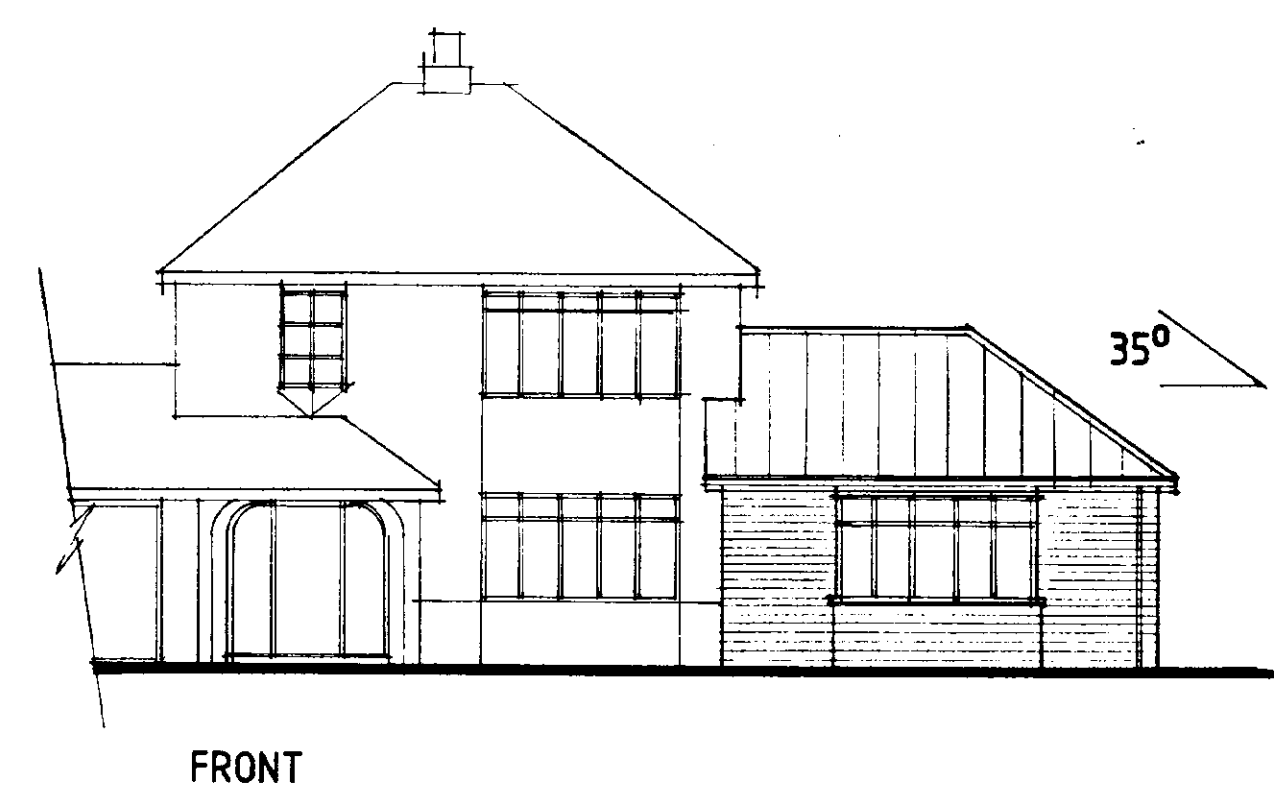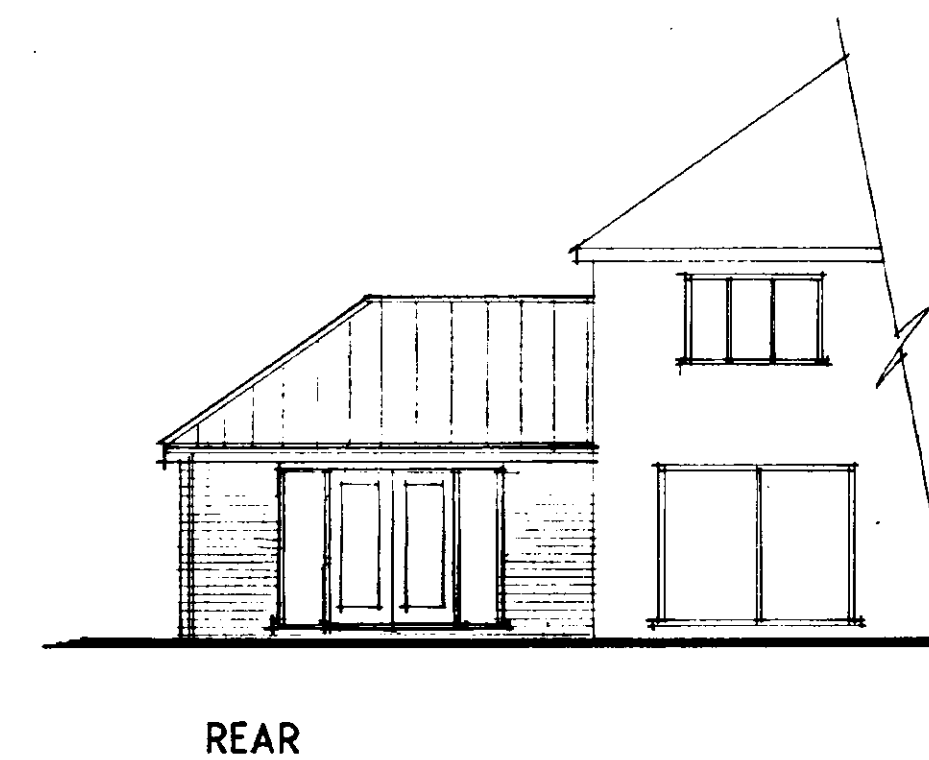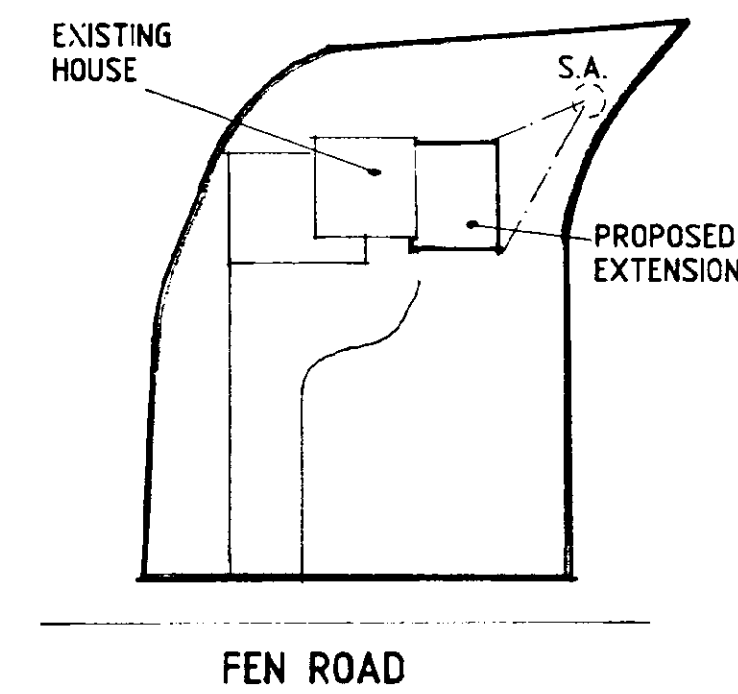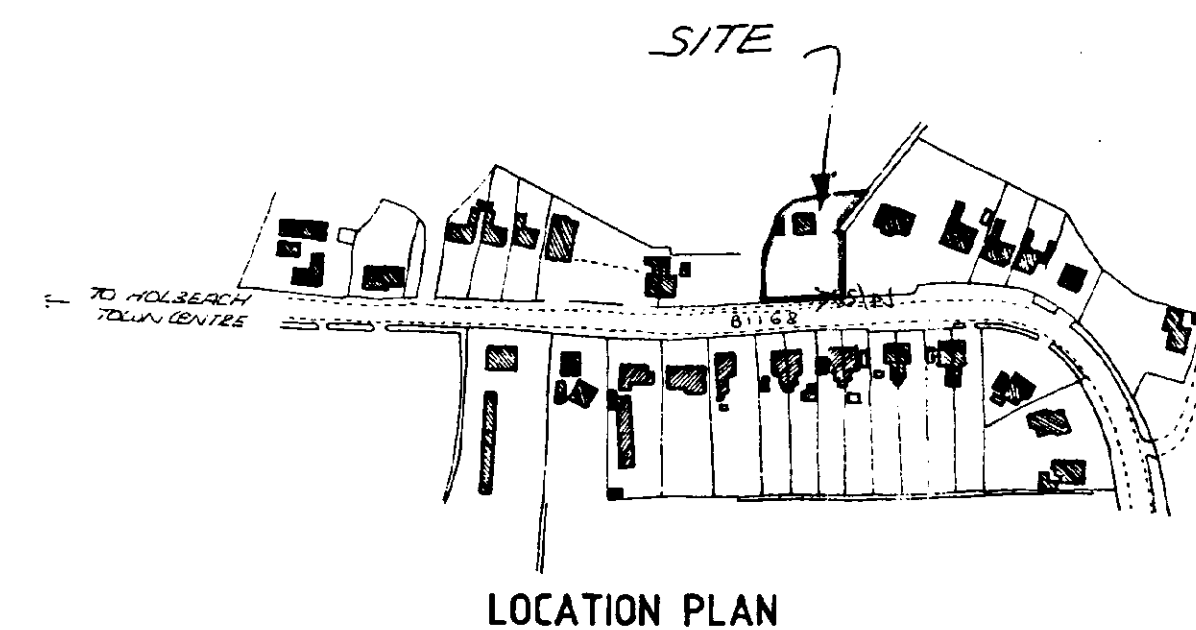

EXISTING CONIFER HEDGE TO BE REMOVED WHERE SHOWN DOTTED. FOUNDATIONS TO BE TAKEN DOWN BELOW TREE ROUTES AS NECESSARY

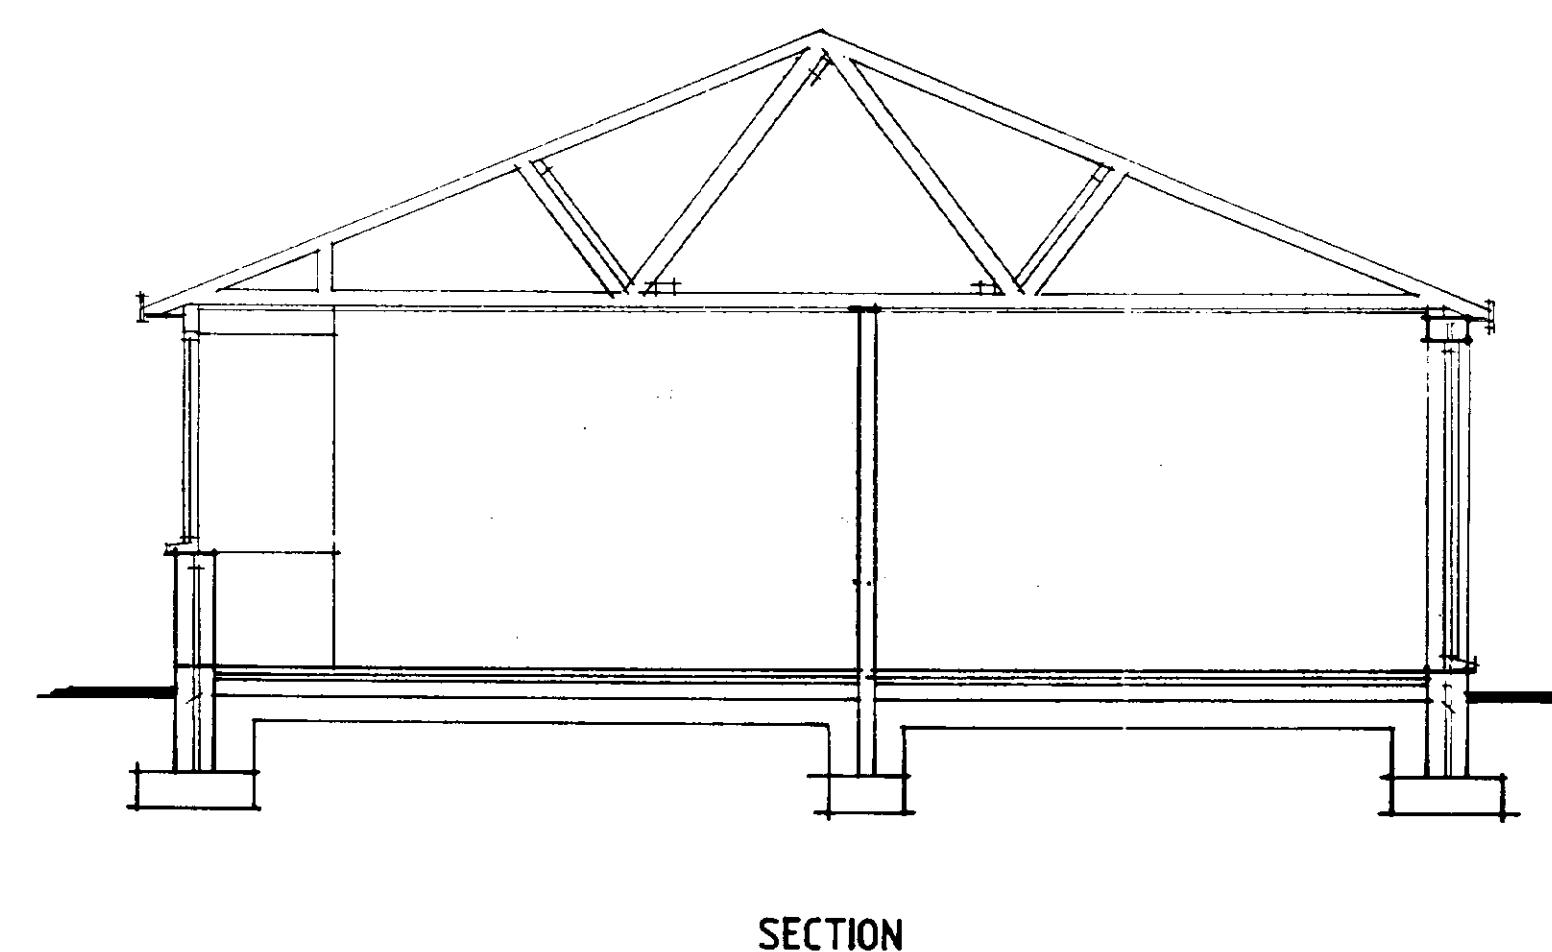

SOUTH HOLLAND DC
HOUSING & PLANNING
29 MAR 2000
Ref: 034460

DETERMINED
PLAN

DESIGN **Status**
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED EXTENSION TO
49 FEN ROAD, HOLBEACH FOR

MR. & MRS. D. GLUCKERT.

1:50 1:100 SD00-016/1
1:2500 1:500
MARCH-00 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490762