
Wire mesh supported synthetic media (EU4) pleated panel prefilter. Must be replaced every 3-4 weeks.

Activated carbon filter box 207 coconut sheel type carbon filter panels Dwell time is calculated 0,18 S. Carbon panels must be replaced every 8-12 months.


45JM / 16 / 4 / 5 / 32 -BT9 FlaktWoods kitchen extraction fan outlet side connected to the silencer. Noise level of the fan 52 dB(A) @ 4 meter distance without silencer.

DS251401 Silencer 450 mm long to reduce the noise level 7 to 10 dB (A)

Flexible canvass connection between duct and silencer.

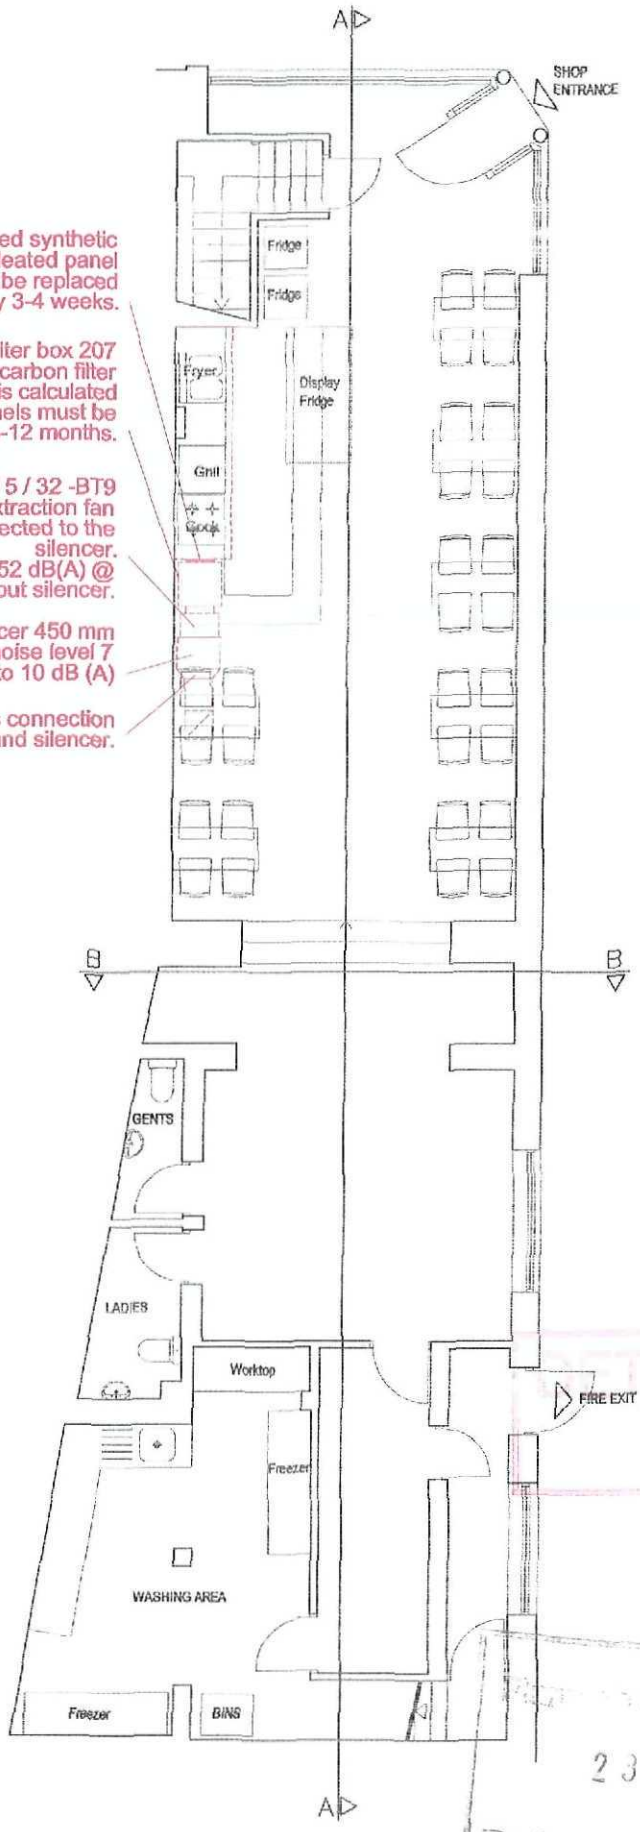

GROUND FLOOR PLAN

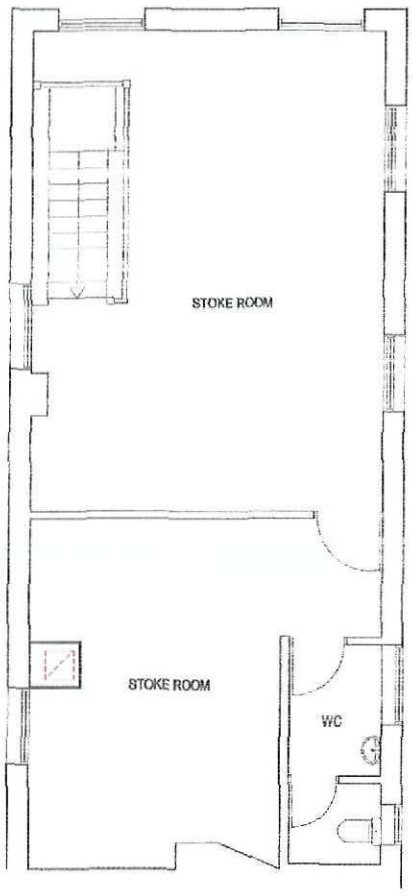

FIRST FLOOR PLAN

AMENDMENTS	
A	Extractor fan details revised 12/09
B	Extractor fan details revised 03/10
C	Extractor fan details revised 03/10
D	
E	
F	
G	
H	
J	
K	
L	
M	

ARCHIPEK
ARCHITECTURE + INTERIORS
86 STOKE NEWINGTON HIGH STREET
LONDON N16 6BL
T – 020 78930737
F – 020 72413565
E – [illegible]

CONTRACT
20 HIGH ST-2 ALBERT ST
HOLBEACH, SPALDING
LINCOLNSHIRE PE12 7DN

DRAWING
PROPOSED GROUND AND FIRST FLOOR PLANS


SCALE	DATE
1:100@A4	11/09
DRAWN BY: EM	CHECKED: OI

DRAWING No.
1003 / P / 1 C

DETERMINED PLAN
Development
23 MAR 2010
Ref: 0947-09




SIDE ELEVATION

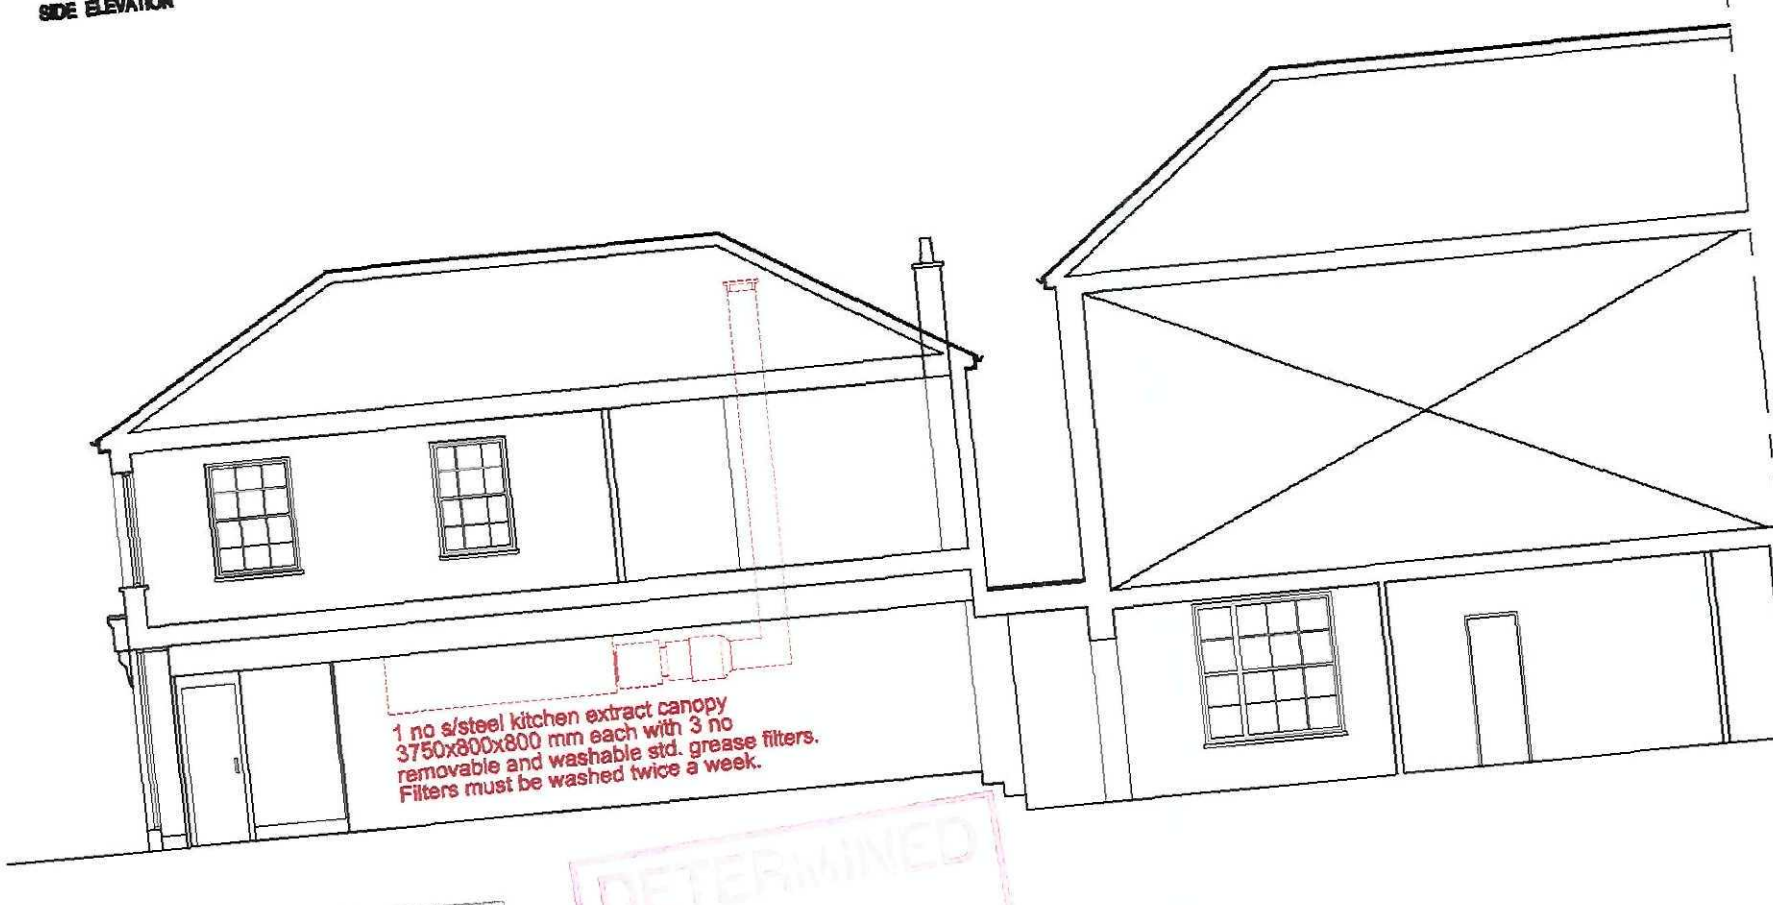

A-A SECTION

Planning & Development
23 MAR 2010
Ref: 947-09

DETERMINED
PLAN

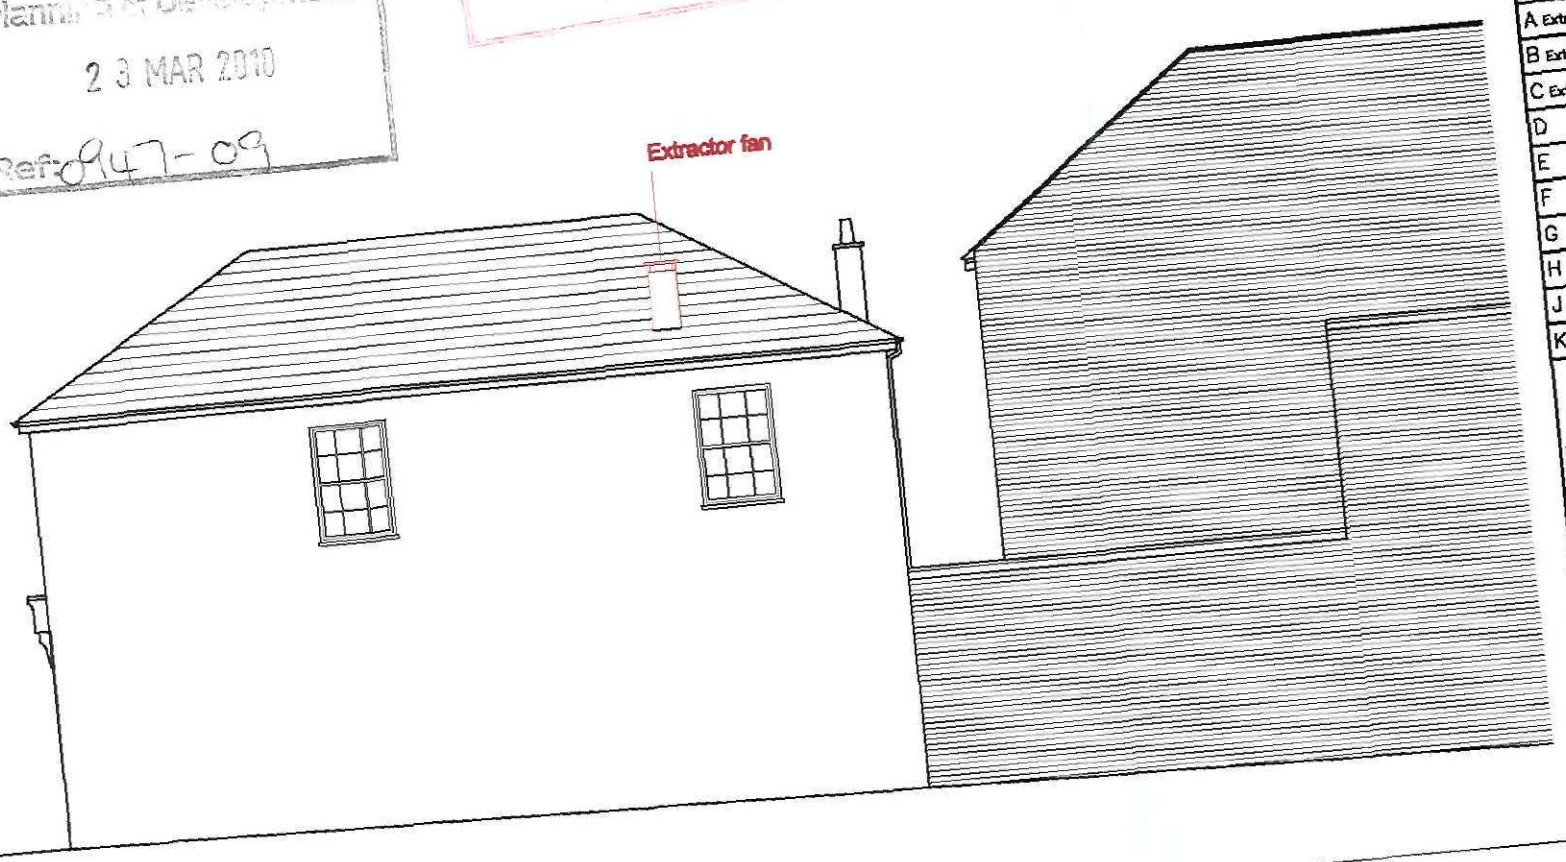

SIDE ELEVATION

AMENDMENTS
A Extractor fan
B Extractor fan
C Extractor fan
D
E
F
G
H
J
K

boundry