
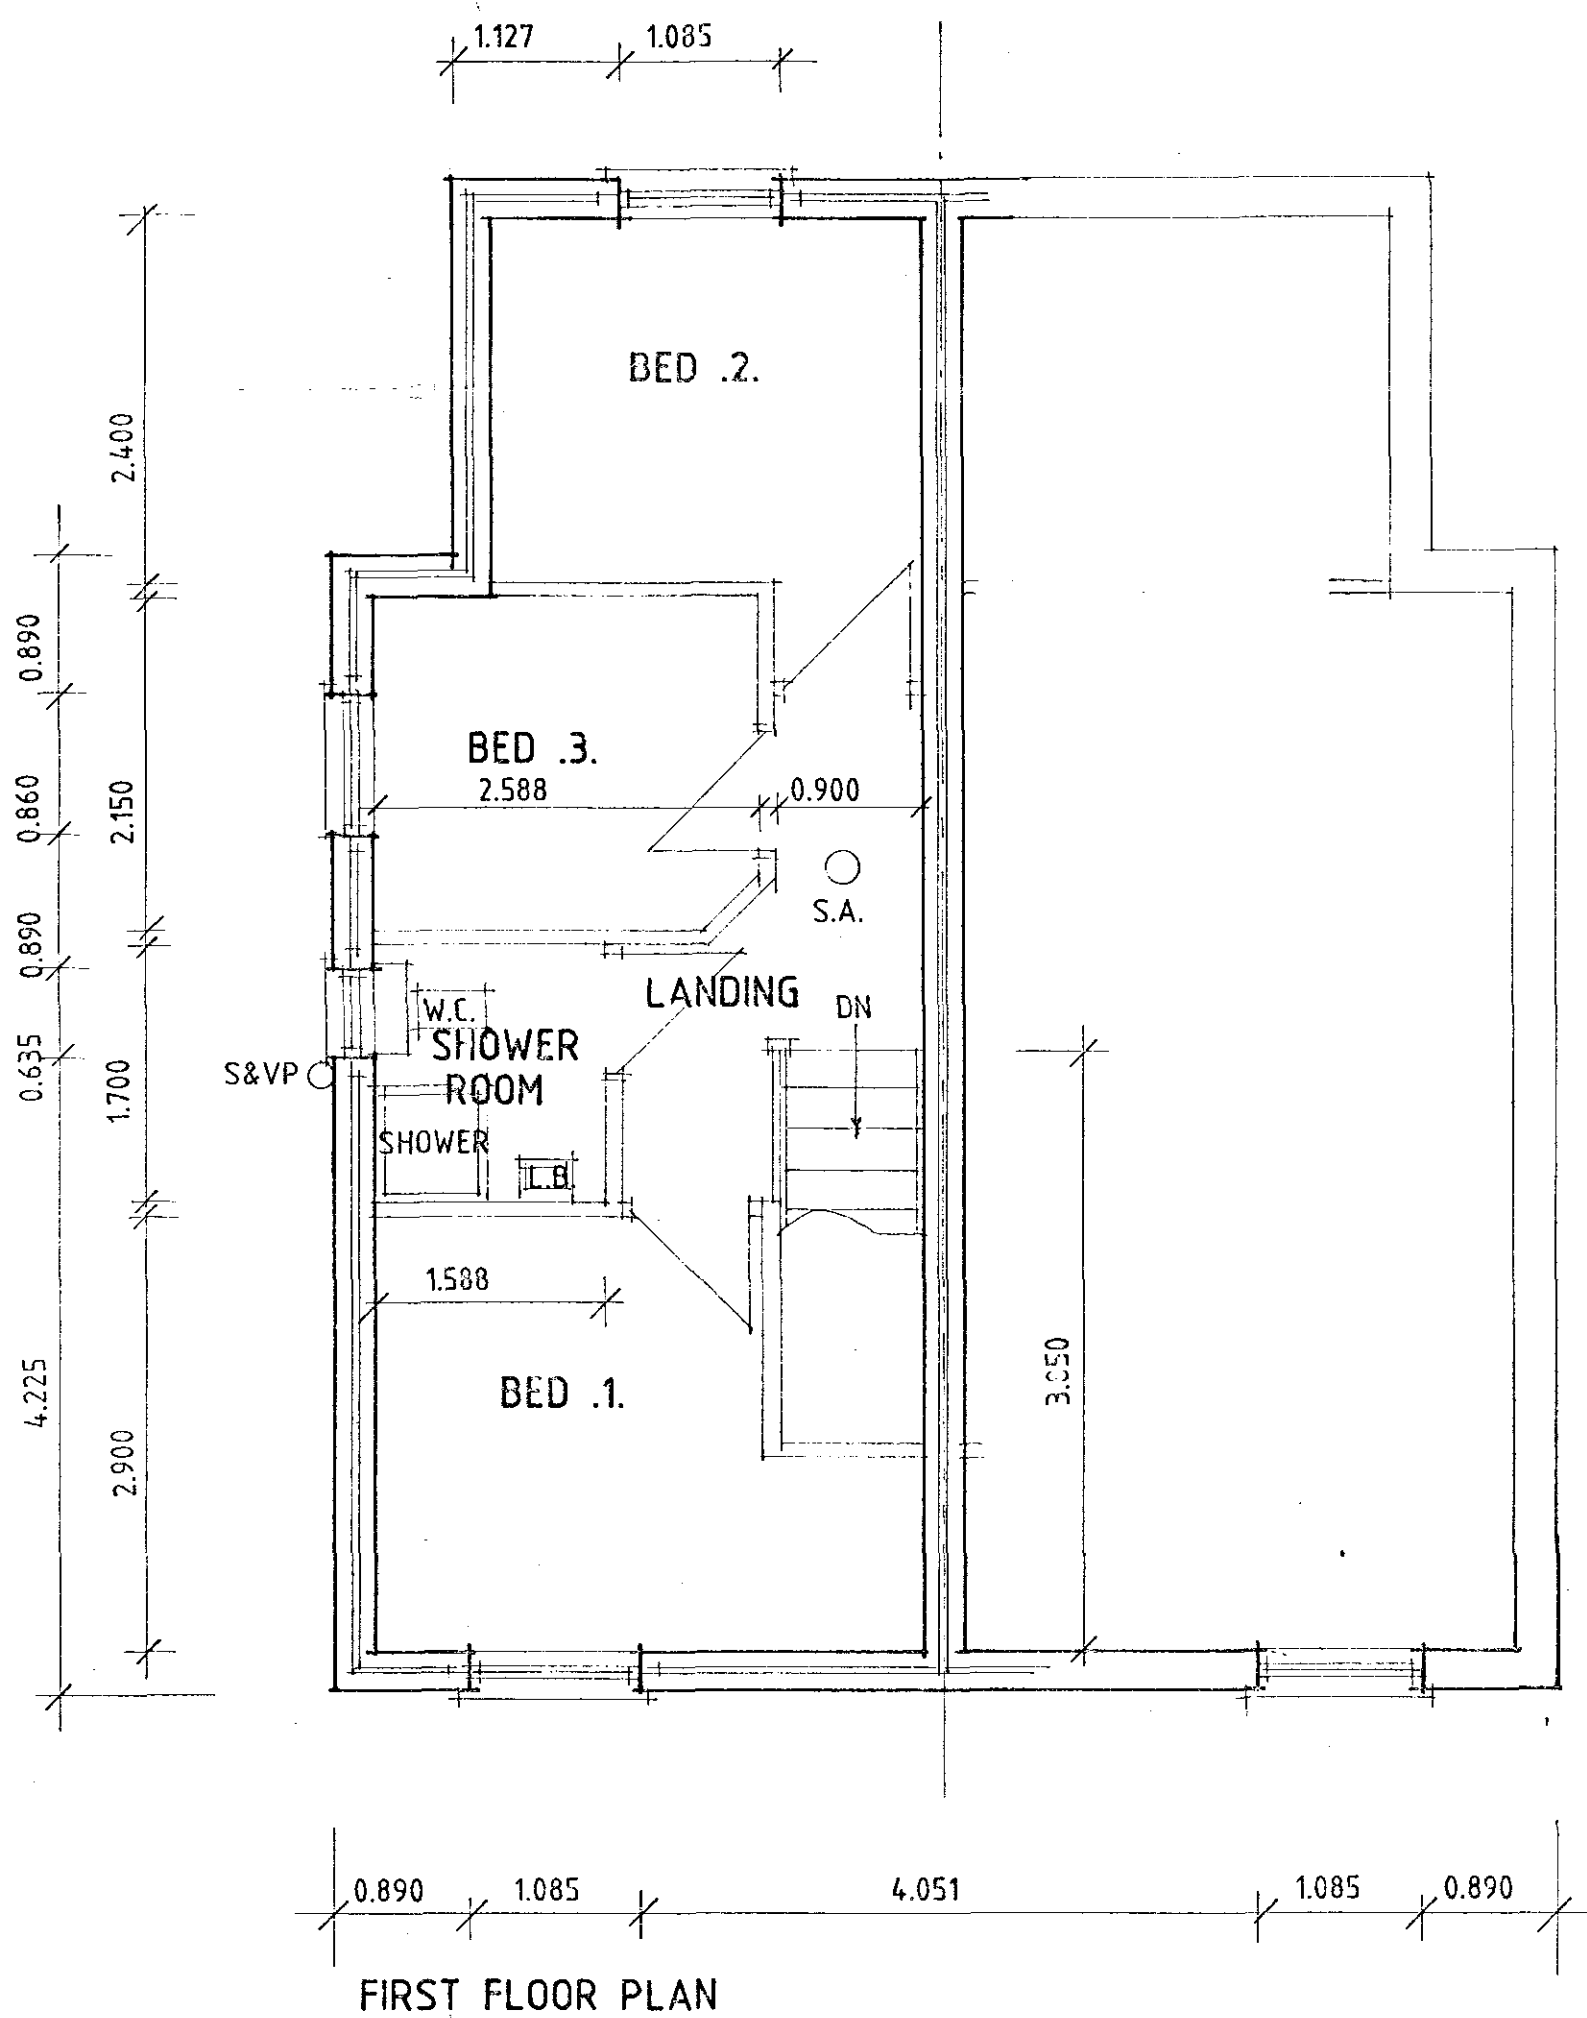


FRONT

SIDE

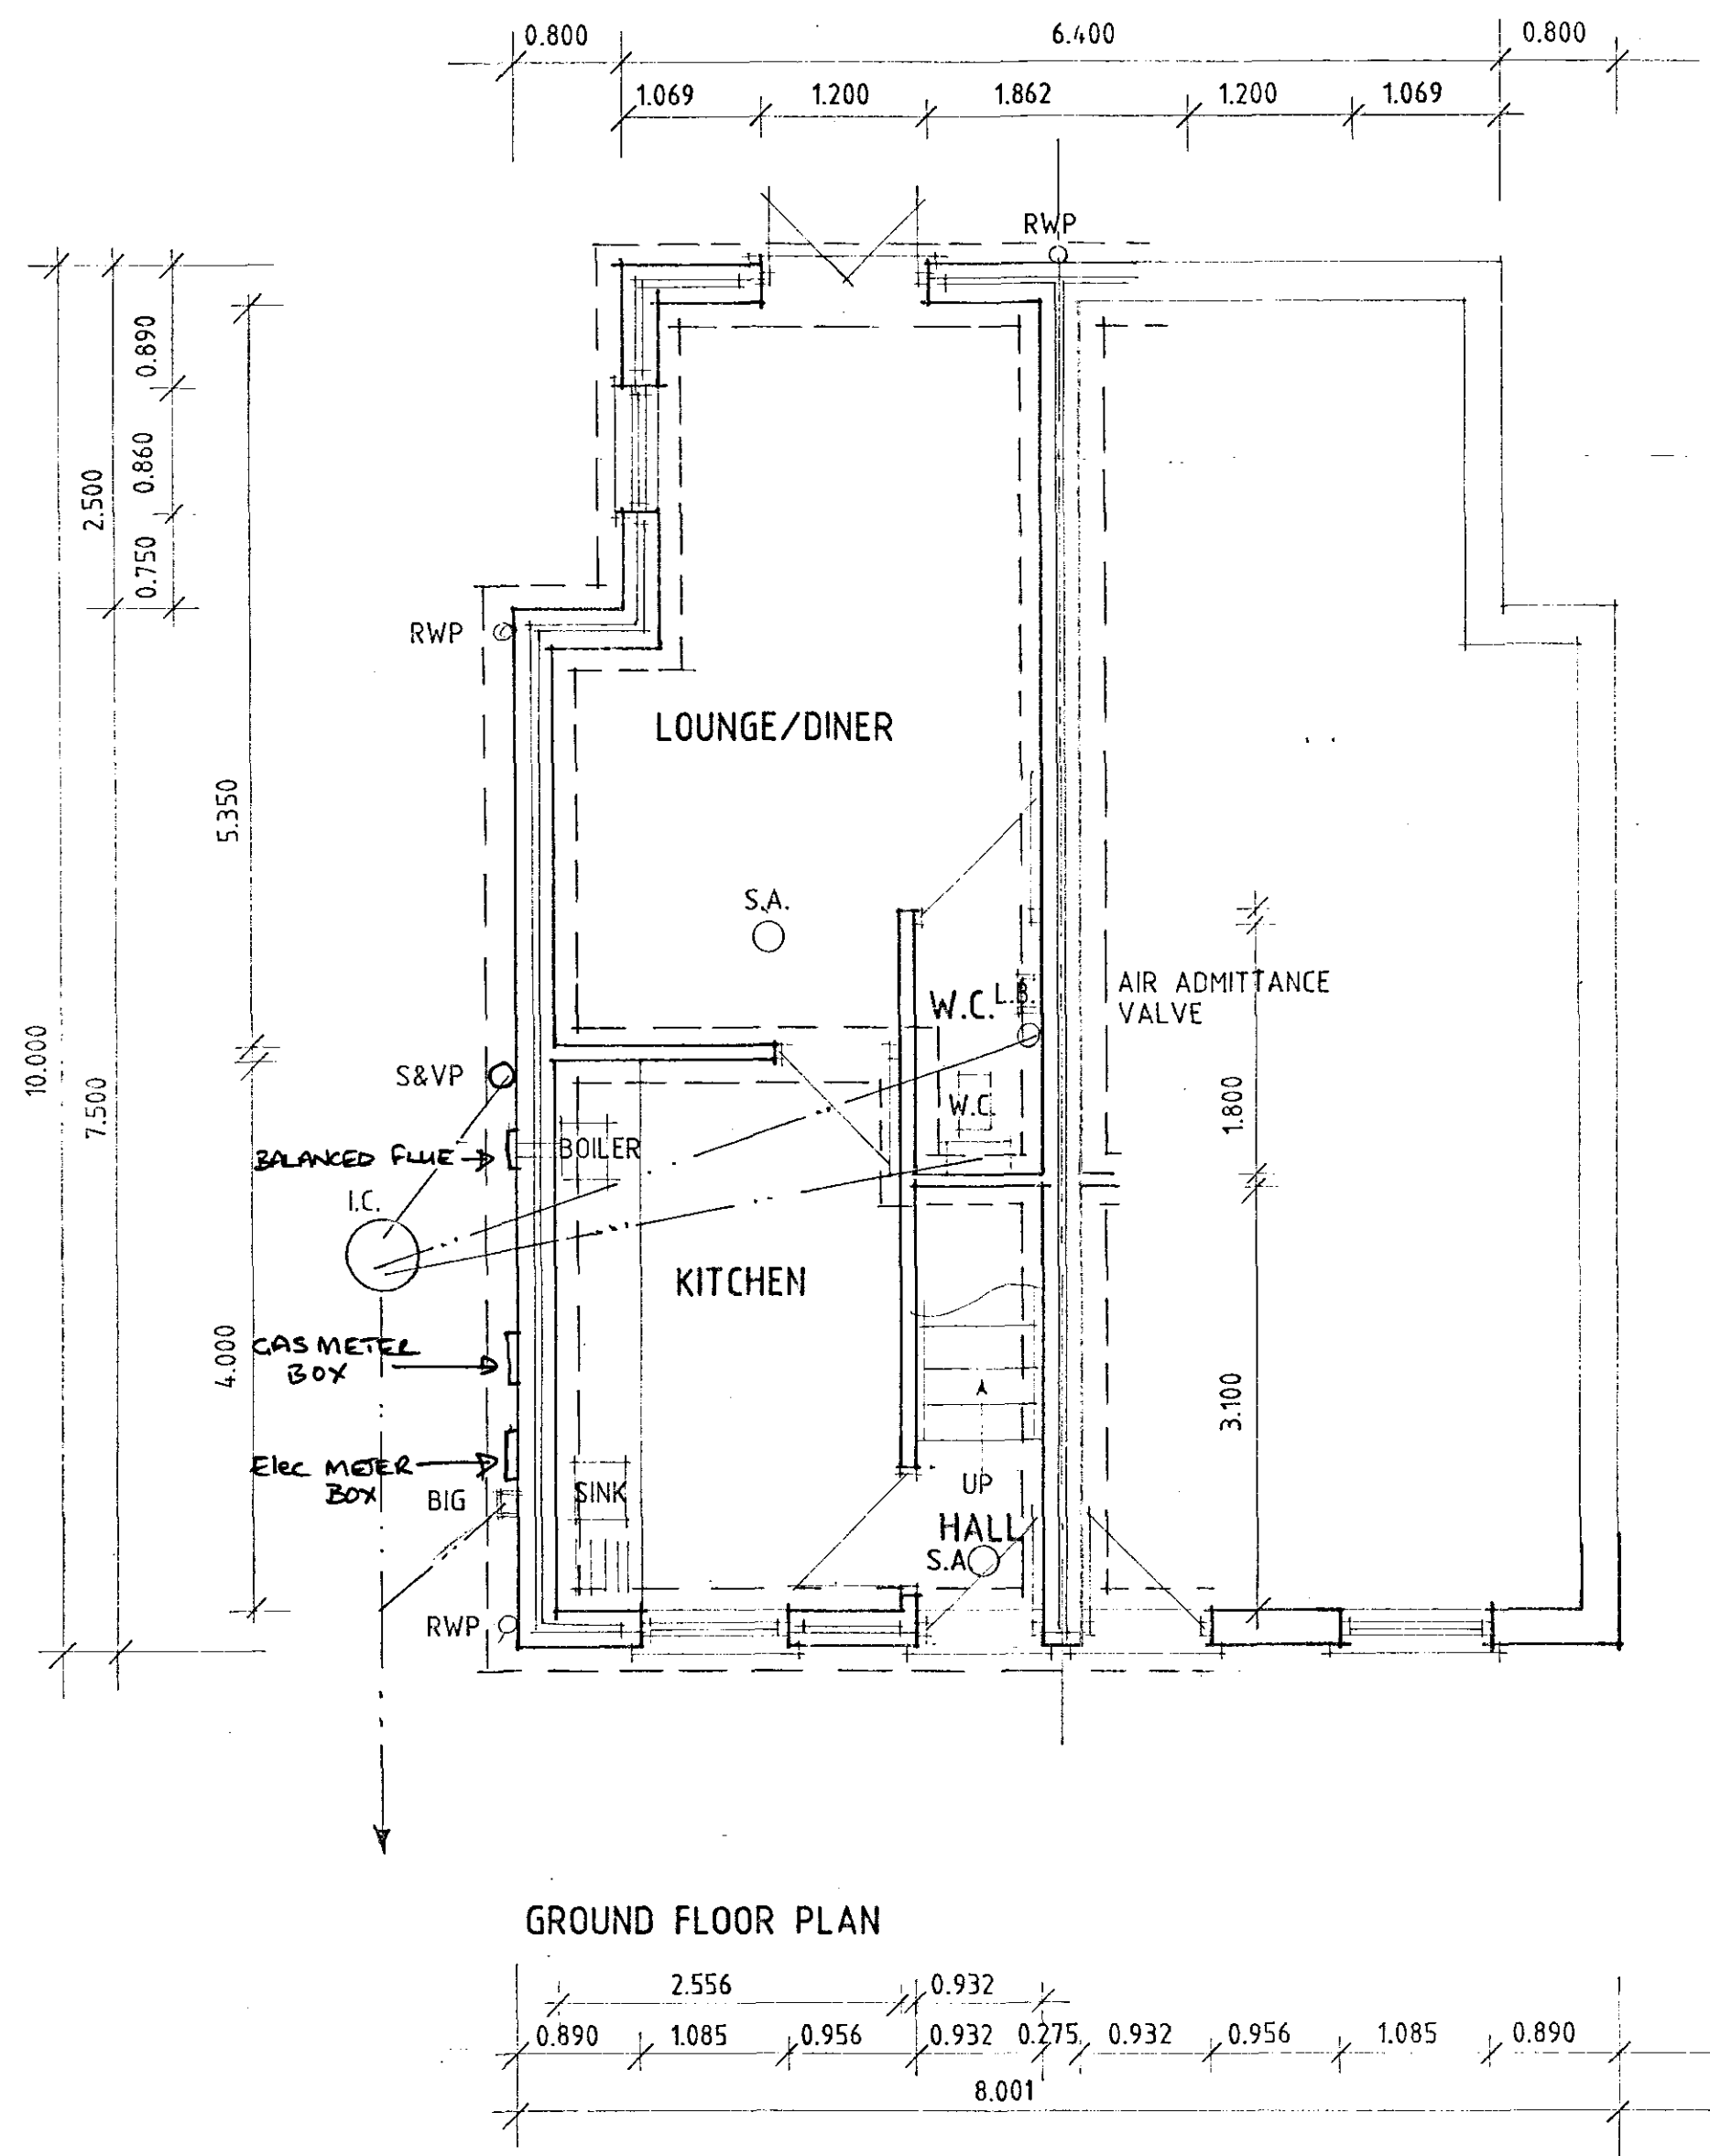

Foundations
As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be S11 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.I.D.C. chapter 4 when determining foundation depth.

I.G. Type 11/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Provide a firm level approach to front entrance of minimum width 900mm. Gradient of approach to be no steeper than 1:20. At entrance to building threshold to be maximum 15mm high.

External access door that serves as access to ground floor WC to have a minimum clear opening width of 775mm

Ensure minimum 900mm corridor width, access to ground floor WC with no obstructions (radiators, etc.) to corridor area adjacent doors

Sockets, light switches, TV points, doorbells to habitable rooms to be positioned between 450mm and 1200mm above floor level.

Provide area within main driveway of hard surfacing (block paving, tarmac or similar) of adequate size to enable wheelchair access from parked vehicle direct to main access of dwelling. Footpath minimum 900mm wide to be directly linked to hard surfacing driveway.

Minimum width of corridors and passageways for a range of doorway widths

Doorway clear opening width (mm)	Corridor/Passageway width (mm)
750 or wider	900 (when approached head-on)
750	1200 (When approached not head-on)
775	1050 (when approached not head-on)
800	900 (when approached not head-on)

Brickwork below d.p.c. to be F.L. quality

Outlets from balanced flue boilers to be at least 300mm from any openings.

All soakaways to be minimum 1m deep.

Provide cavity trays above in situ meter boxes.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Hot water cylinder to be minimum 115lt capacity.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Escape windows to be within 1.1m of floor.

All windows to give minimum 1/20th of floor area as ventilation and to be double glazed.

Glazing
All windows and doors to be double glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.85.

Inner Rooms
To have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Sill height not to exceed 1.1m.

Commissioning of Heating and HWS Systems
A competent person, i.e. the main contractor or sub-contractor shall supply a Certificate of Satisfactory Compliance with Building Regulations Part L. A copy of which shall be made available to both the client and the Building Control body.

A suitable set of operating and maintenance instructions are to be made available to the client to explain to the householders how to operate the systems so that they can perform efficiently and what routine maintenance is advisable for the purpose of the conservation of fuel and power.

Internal Lighting
Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Number of Rooms	Recommended min number of locations
1-3	1
4-6	2
7-9	3
10-12	4

Note: Hall stairs and landing count as one room (but may contain more than one fitting).

Excludes garages, lofts and outhouses.

External Lighting Fixed to the Building
External lights include lights in porches but not lights in garages and carports.

External lights should be made to enable effective control and/or the use of efficient lamps as follows:


- Automatically extinguish when there is enough daylight and when not required at night.
- Have sockets that can only be used with lamps having an efficiency greater than 40 lumens per circuit watt.

Sound Insulation to single Dwelling
The intermediate floor should be provided with 100mm thickness mineral wool between the joists. In addition internal stud walls should be suitably sound resisting to walls around bedrooms, WC and en-suites (unless the wall contains a door).

Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:-

- an electrical installation certificate issued under a competent person's scheme has been issued or
- an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so

B - B.R. ALTS - 3.8.05
A - DETAILS ADDED - 11.4.05

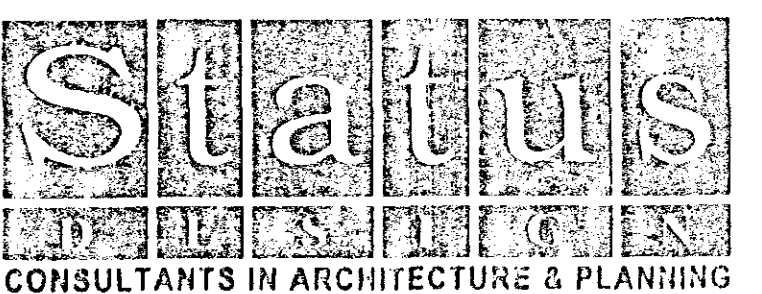

PROPOSED PAIR OF SEMI-DETACHED HOUSES AT ALBERT STREET, HOLBEACH FOR

MR. D. MOUNTAIN.

1:50 1:100 SD05-004/1

MARCH-05 B.GILHAM.

DETERM PLAN

2 Edinburgh Walk, Holbeach, Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702