




SOUTH WEST 1-100

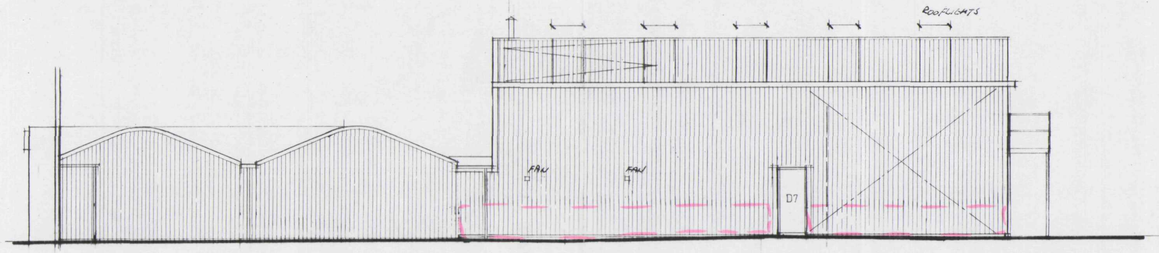

NORTH EAST 1-100

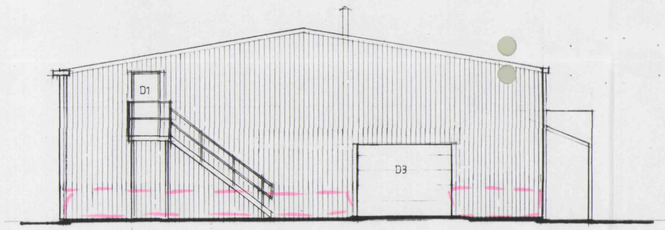

NORTH WEST 1-100

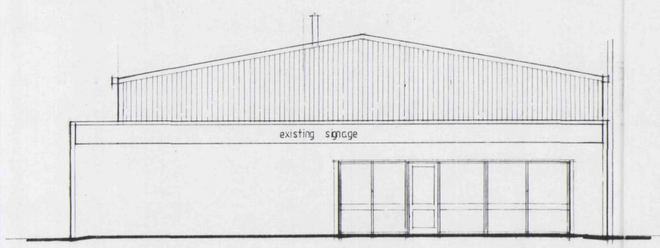

SOUTH EAST 1-100

FIRE PRECAUTIONS

- BREAK GLASS CALL POINT
- HEAT OR SMOKE DETECTOR


FIRE ALARM SYSTEM - TO BE IN ACCORDANCE WITH BS 5839 PT 1 2002 DESIGN TO BE BY ELECTRICAL CONTRACTOR CHECK WITH CLIENT TO SEE IF HE WANTS AMOUNT OF AUTO DETECTING EXTENDED

- EMERGENCY LIGHTING DESIGN TO BE BY ELECTRICAL CONTRACTOR & CONFORM TO BS 5266 PT1 1999. EMERGENCY LIGHTING TO ILLUMINATE ALL ESCAPE ROUTES, FIRE FIGHTING EQUIPMENT & FIRE SIGNAGE
- N1 GENERAL FIRE PRECAUTIONS NOTICE
- NS FIRE EXIT KEEP CLEAR SIGNAGE
- N6 FIRE DOOR KEEP SHUT SIGN
- E GRAPHIC FIRE EXIT SIGNAGE HEIGHT OF SYMBOLS IN mm. PROVIDE DIRECTIONAL ARROWS AS REQ'D

COMPLETE WITH SIGNAGE INDICATING USAGE OF EXTINGUISHERS & LOCATION OF.

- DP 3.5 DRY POWDER EXTINGUISHER SIZE IN KG
- CO2 3 CARBON DIOXIDE EXTINGUISHER SIZE IN KG
- W 9 WATER EXTINGUISHER SIZE IN LITRES

LAYOUT OF FIRE EXIT SIGNAGE & EMERGENCY LIGHTING TO TAKE INTO ACCOUNT RACKING LAYOUT/ LAYOUT OF STORES. PROVIDE ADDITIONAL FIXTURES AS REQ'D.
FIRE EXTINGUISHER PROVISION SHOWN INDICATIVE PROVISION TO BE BE ASSESSED BY SUPPLIER UPON OCCUPATION OF BUILDING.

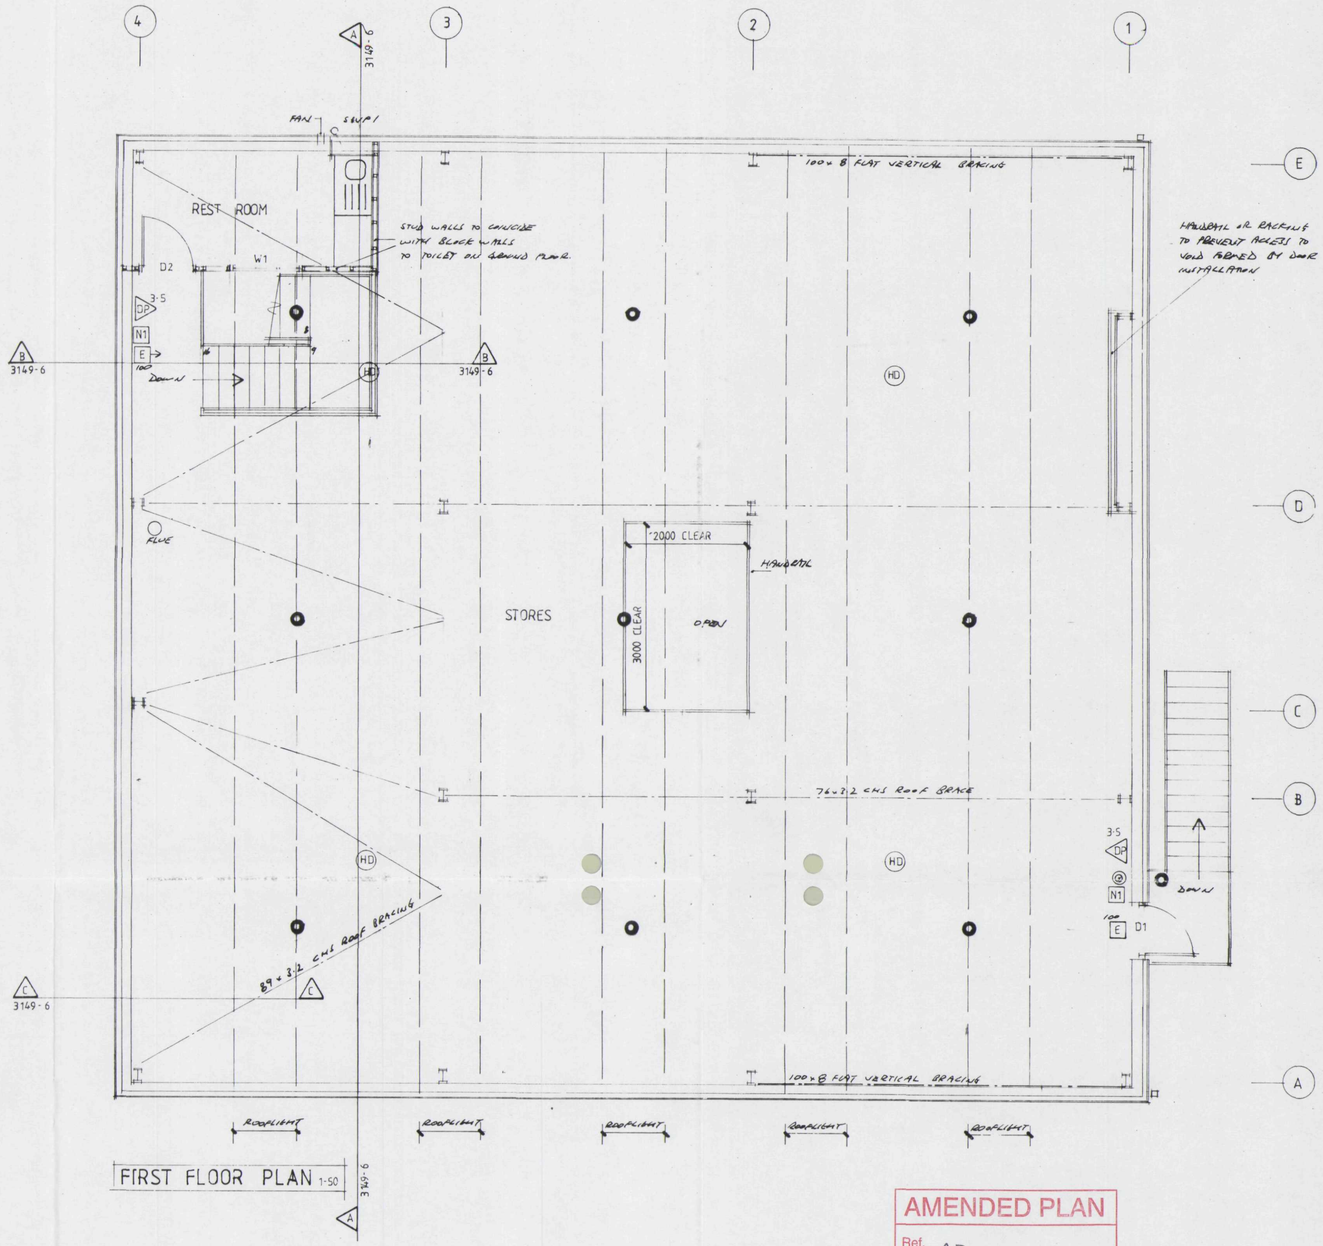

FIRST FLOOR PLAN 1-50

AMENDED PLAN
Ref. A3

SHDC
Planning & Development
09 JUL 2004
Ref: 1463/03

Contractor To Check All Dimensions On Site Before Work Commences.

Rev.	Date.	Init.	Revision Details.
A	17-7-4	RP	REMOVE W6, TEST D3 ALT PLANTER 6m x 1m
B	8-7-4	RP	LOAD DOWN TO PL & REMOVE FACE BRICK TO FLAT ROOF.

PODDINGTONS
Architectural Design Consultants
Unit 7, The Flaxmill, Flaxmill Lane, Pinchbeck,
Spalding, Lincs. PE11 3XQ.
Tel: 01775 720866 Fax: 01775 720877

Project.
TERRY RUDD MOTORCYCLES LTD.
FEN ROAD, HOLBEACH.
PROPOSED ALTERATIONS & EXTENSION

Drawing.
FIRST FLOOR PLAN & ELEVATIONS

Scale. 1-50 1-100
Drawing. No. 3149-5
Drawn.
Date. APRIL 2004
Rev. A B