General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other that that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practise. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m^2. Escape windows to be within 1.1m of floor.

Smoke detectors to be to BS5839/6:2004, Grade D, Category LD3.

For thermal bridging details refer to details: -

MC1-RE-01
MC1-WD- 03
MC1-WD-04
MC1-WD-05

Windows to achieve a 'U' value of 1.6 W/m^{2}K

Floor joists to be 200 x 50mm SC3 grade at 400mm centres.

Stairs to be Boulton & Paul Ref. SLB2W63N (handed) or similar approved.

Provide suitable outfall from sewage treatment plant to adjacent dyke, all to Environment Agency approval.

Existing access and drive to be re-used.

LANDSCAPING


EXISTING TREES TO REMAIN WHERE SHOW

PLANT NEW HAZLENUT HEDGE WHERE SHOWN

External Materials
Sandtoft double pantiles Dark Grey
Ibstock Ivanhoe Red Mix facing bricks.

External joinery to be white UPVC doors and windows, etc.

Heating
To be by 11kw low temperature floor-standing air/water heat pump c/w boost heater.
Ground floor to have under-floor wet heating system and first floor to have radiators.
On completion of works commissioning of heating system to be provided to the local authority by a competent person.

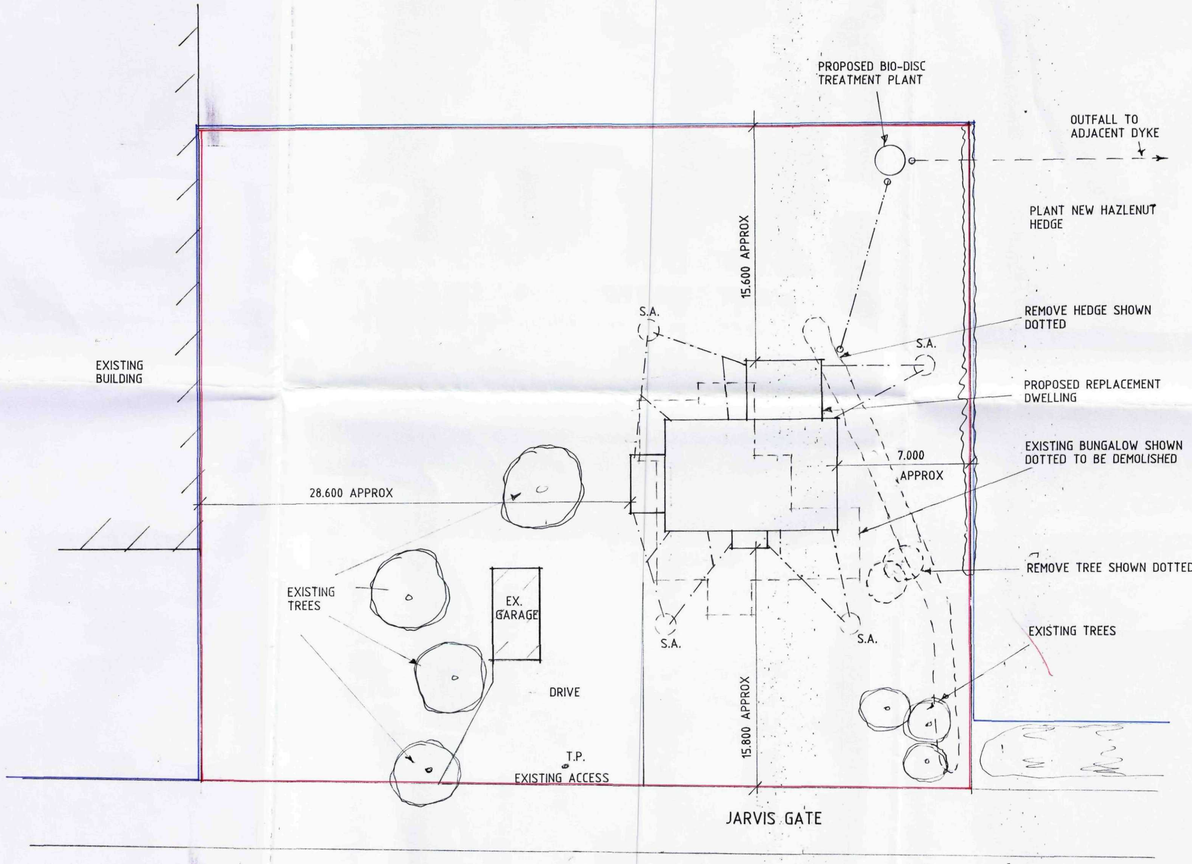

SITE PLAN

THIS DRG. TO BE READ IN CONJUNCTION WITH
SD11-017/1, SD11-017/4, SD11-017/5
THERMAL DETAILS - MC1-RE-01, MC1-WD-03, MC1-WD-04, MC1-WD-05
SRC STRUCTURAL REPORT REF - 25211

Sewage Treatment Plant
A suitable notice in regard to the package treatment work should be provided within the property, it is suggested that this is contained within a property log book. An example of the wording could be, 'The foul drainage from this property discharges to a package treatment works. Maintenance is required (insert *frequency) and should be carried out by the owner in* accordance with manufacturer's instructions. The owner is legally responsible to ensure that the system does not cause pollution, a health hazard or a nuisance'.

Hearths and Flues
A suitable notice in regard to the correct application and use of hearths and flues should be provided within the property. It is suggested that this is contained within a property log book. An example of the layout would be:

IMPORTANT SAFETY INFORMATION
(This information should be available at all times and not removed from the property)

Property address ..... (e.g.20 Main Street)
The hearth and chimney installed in the .....
(e.g. lounge) are suitable for ..... (e.g. decorative fuel effect gas fire.
Chimney liner .....(e.g. double skin stainless steel flexible 200mm diameter)
Suitable for condensing appliances .....(e.g. no)
Installed on .....(date)
Other information .....(designation of stainless steel liner T450 N2 S D 3)
Installer's name and address .....

Sound Insulation to single Dwelling
The intermediate floor should be provided with 100mm thickness mineral wool between the joists. In addition internal stud walls should be suitably sound resisting to walls around bedrooms, WC and en-suites (unless the wall contains a door).

Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:-
a) an electrical installation certificate issued under a competent person's scheme has been issued
or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

Stud Walls between Habitable Rooms
To have 15mm plasterboard finish to both sides of 50mm x 100mm studs with 100mm fibreglass between to reduce sound transmission

External Cavity Wall Lintels for 300mm Cavity Walls
IG type L1/S100 unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Internal Lintels
IG type Internal 100mm lintels to openings in 100mm internal walls unless stated otherwise.

Purge ventilation to windows
For a hinged or pivot window that opens 30° or more the height and width should be at least 1/20th of the floor area of the room.
For a hinged or pivot window that opens less than 30° the height and width should be at least 1/10th of the floor area.

Background Ventilation
Background ventilation is to be provided by trickle ventilators to the tops of windows. Use trickle vents offering 8000mm^2 per window head. Ventilation for whole extension to be 100,000mm^2

Roof Insulation to Sloping Ceiling
To ceiling slope provide 50mm Celotex GA4000 between rafters and 70mm Celotex CA4000 below rafters with joints taped to create VCL + air leakage barrier batten air space – low emissivity – 12.5mm Knauf wallboard, or similar approved. All to give 0.18W/m^{2}K.

External Wall Construction (300mm cavity)
100mm facing brickwork (see site plan for details)
100mm cavity with 45mm Celotex CW4000
100mm inner skin of Celcon standard blocks.
Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243:1978. Internal block walls to receive 10mm sand/cement render and skim. Robust details in accordance with T50, 2001

The flow rates for the mechanical extractor must be tested and results given to Local Authority Building Control to show that the extraction rate is the same as that specified in 'Approved Document F – Means of Ventilation', no later than 5 working days after the final test.

Provide wholesome or softened wholesome water to any wash basin in or adjacent to any room containing a sanitary convenience and any wash basin, bidet, fixed bath and shower in a bathroom.

Provide heated wholesome water or heated softened wholesome water to any wash basin or bidet in or adjacent to a room containing a sanitary convenience and any wash basins, bidet, fixed bath or shower in a bathroom and any sink that is provided in an area where food is prepared.

The hot water supply to any fixed bath is to be designed and installed with measures to ensure that the temperature of the water that can be delivered to the bath cannot exceed 48°C.

All glazing to meet the requirements of 'Approved Document N – Safety Glazing' in relation to impact, opening and cleaning.

Water calculations are to be supplied to South Holland District Council Building Control showing how the water usage will be limited to 125 litres/per person/per day.

Brickwork below d.p.c. to be F.L. quality

Outlets from balanced flue boilers to be at least 300mm from any openings.

All soakaways to be minimum 1m deep.

Provide cavity trays above in situ meter boxes.

Provide area for provision of solid waste storage (rubbish bins).

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Hot water cylinder to be minimum 115lt capacity.

Seal all openings and joints to perimeter walls.

SHDC
Planning & Development
02 AUG 2011
Ref: 0585-11

D - LANDSCAPING ALTS - 20.7.11
C - IMF. ADDED - 7.7.11
B - ALTS - 23.6.11
A - ALTS - 9.6.11

Status DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED REPLACEMENT DWELLING AT SUNNY HOLME, JARVIS GATE, SUTTON ST. JAMES FOR

MR. & MRS. R. HOWES.

SITE PLAN

1:200	SD11-017/3
JUNE-11	B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702