

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.


This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BHA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

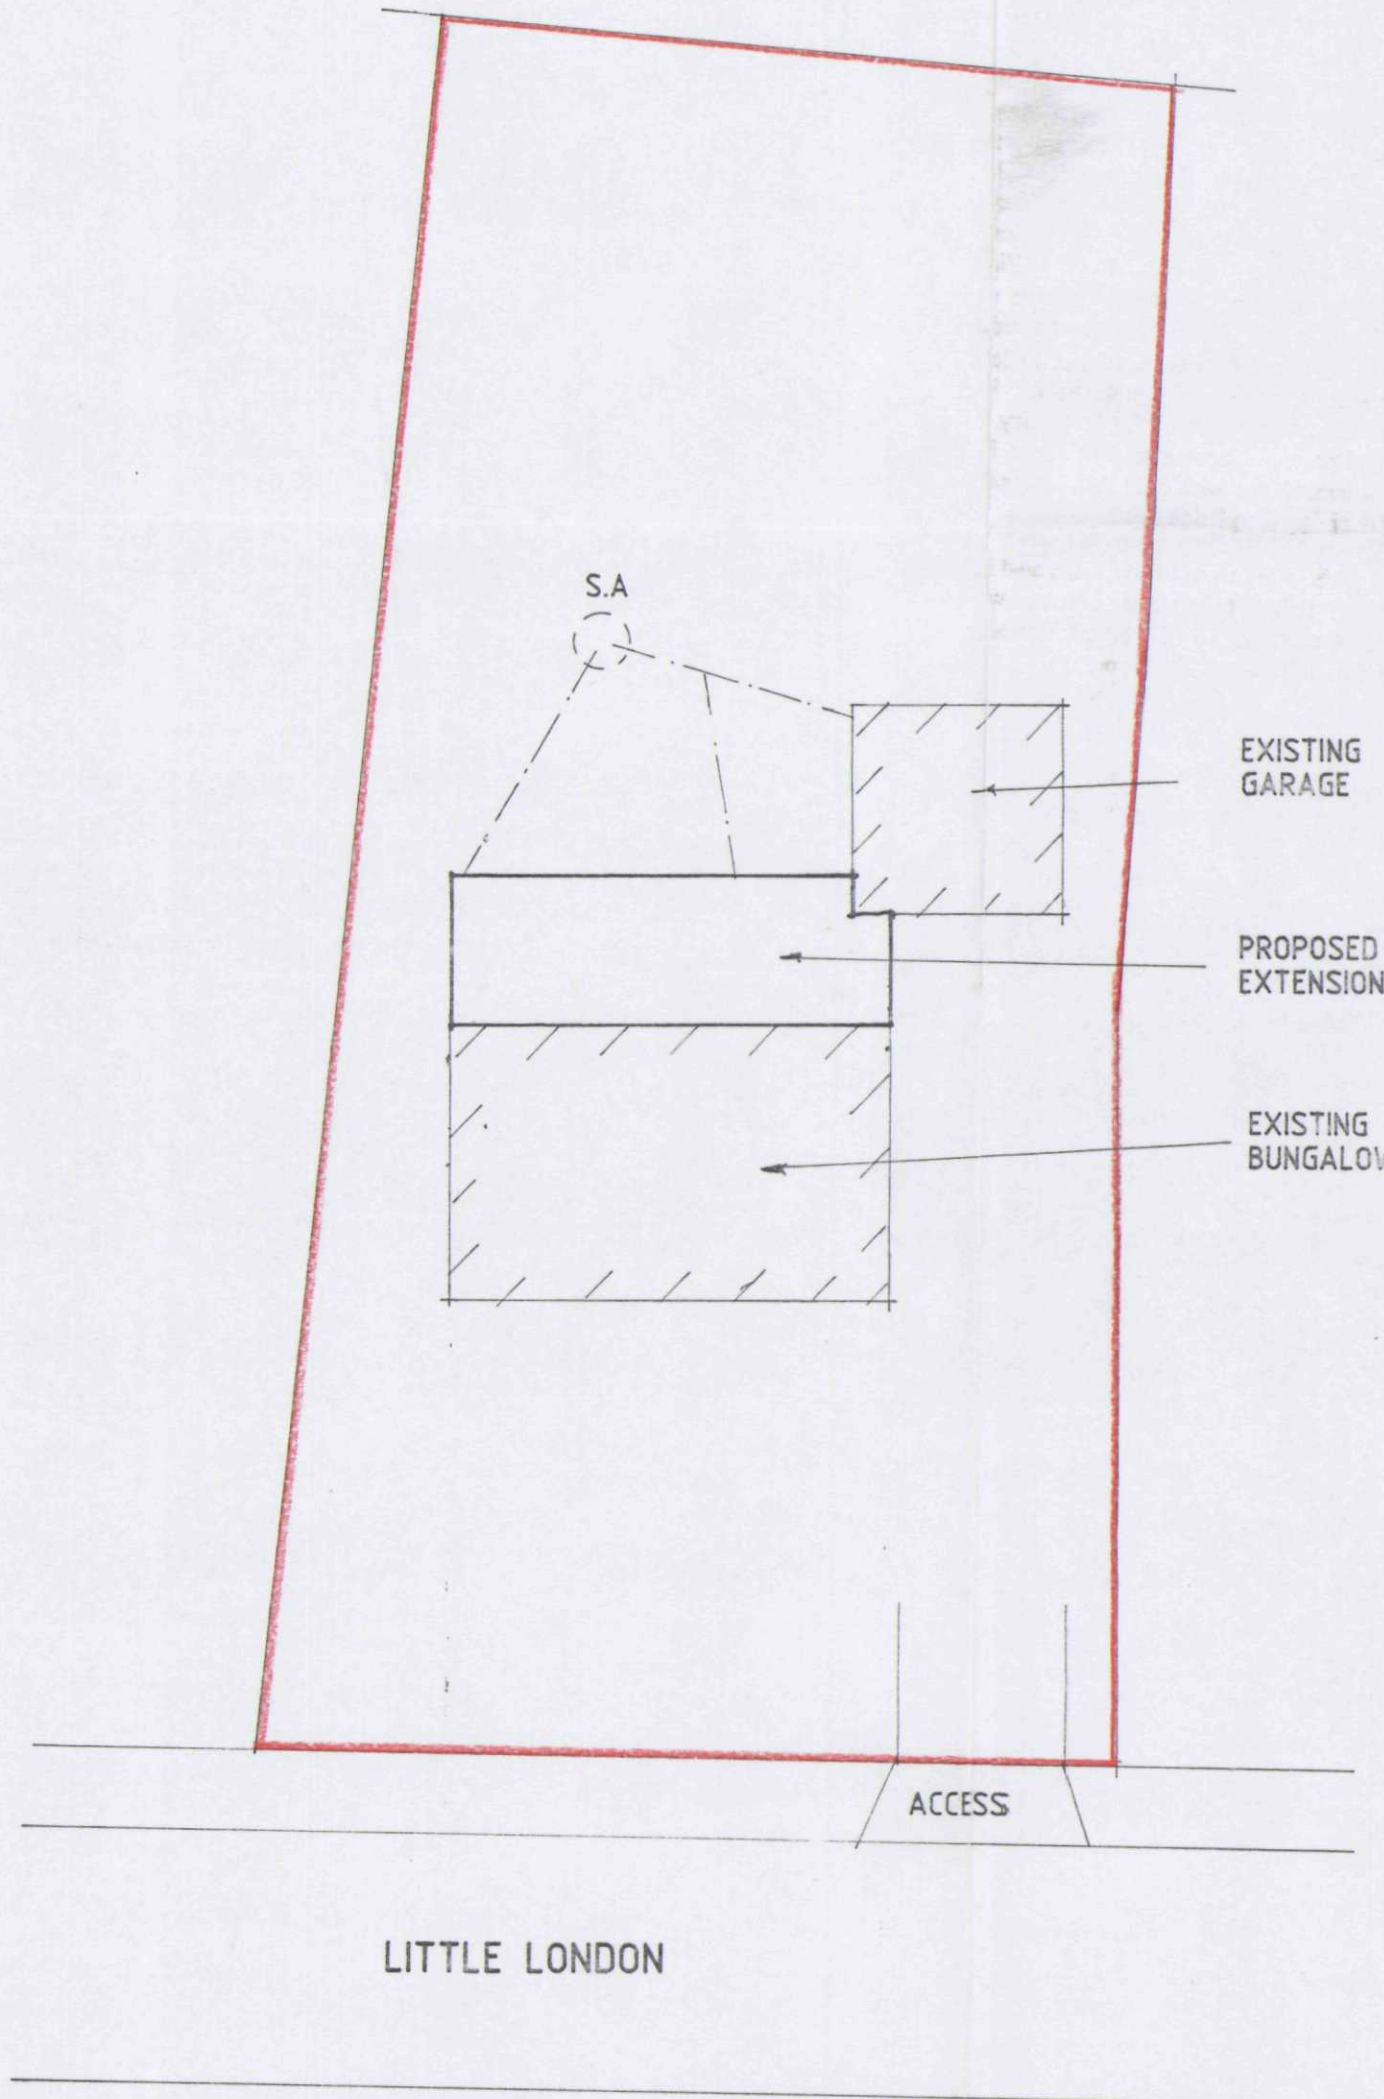

SITE PLAN

Remove existing rear conservatory to make way for new extension.

Remove pitched roof to existing garage.

Build on new flat roof extension in the manner shown.

Flat roof to continue over existing garage, but will not require insulation or ventilation to this area.

Flat roof joists over Lounge/Bathroom/Kitchen area to be 175mm x 50mm SC3 grade at 400mm centres.

Flat roof joists over garage to be 200mm x 50mm SC4 grade at 400mm centres.

Form opening in existing wall as shown in Lounge/diner. Support over with IG L6/50 lintel.

Remove existing bathroom window and extend opening down to floor to create doorway into new bathroom.

Existing front window to be removed and replaced with 2 no. smaller windows and central pier as shown. Add internal central stud partition to create 2 no bedrooms.

Form new opening in internal wall into bedroom 2. Support over with IG internal lintel.

Provide and install additional stud partitions and internal doors to complete hallway.

New flat roof to be dressed under existing pitched roof tiles to make completely watertight.

Connect foul drains to existing foul drains. Remove existing inspection chamber and grub up existing drains no longer required.

Brick up side door into garage to make way for extension.

Form opening into garage from new Kitchen. Support over with IG internal lintel. Door to be ½ hour fire resisting self-closing. To base of door provide 100mm threshold or step down into garage.

External materials to match those of existing bungalow.

Make good to all disturbed and affected areas.

Wall Construction

275mm cavity walls to consist of:
100mm face brickwork (see site plan for details),
75mm cavity to be filled with Crown Drithern full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved,
100mm internal skin of Celcon standard blocks or similar approved to give 0.35 U-value. Cavity walls tied together using galvanised iron or plastic twist ties spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

Kitchen/Utility/Bathroom/WC Trickle Ventilation

Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Utility Ventilation

Provide proprietary mechanical extract ventilation unit capable of extracting 30 lt./sec. System to offer intermittent operation.

Foul Water Drainage

Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document F) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Surface Water Drainage

To be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Ceilings

To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Flat Roof Construction (Warm Deck)

12.7mm white spar chippings bedded on bitumen on 3 no. layers built up felt (first layer asbestos based) on insulated roof deck comprising felt on Celotex Double R RG2080 85mm insulation on 12mm external grade plywood decking on 50mm to 0mm timber firrings securely spiked to treated timber joists (size stated on drawing). Provide 30 x 5mm mild steel anchor and lateral restraint straps to joists fixed to walls at maximum 1200mm c/c. Provide suitably sized fascia board. Form all necessary felt drips including tilting fillets and keep felt drips clear of fascia boarding. If flat roof intersects with pitched roof ensure flat roof felt laps under felt of pitched roof by a minimum of 600mm.

New/Old Walling

Where new walling meets old provide proprietary flexible wall starters.

Kitchen Ventilation

Provide proprietary mechanical extract ventilation unit capable of extracting 60 lt/sec. Alternatively provide proprietary cooker hood capable of extracting 30 lt/sec.

Bathroom/En-suite Ventilation

Provide proprietary mechanical extract ventilation unit capable of extracting 15 lt/sec. System to offer intermittent operation.

Heating System

Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Safety Glazing

Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection

Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Rainwater Goods

PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Habitable Room Trickle Ventilation

Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

Inspection Chamber Construction

Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

Ground Floor Construction

65mm sand/cement screed on proprietary 100 mm thick Jablite floor insulation or 60mm Celotex with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Lintels

All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Sub-structure Walling

100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Foundations

As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing

All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.85.

Brickwork below d.p.c. to be F.L. quality

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

**DETERMINED
PLAN**

SHDC
Planning & Development
07 JUN 2004
Ref: 0750104

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED EXTENSION TO
109 LITTLE LONDON,
LONG SUTTON FOR

MR. M. PITFIELD.

1:200 SD04-048/2
MAY-04 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702

