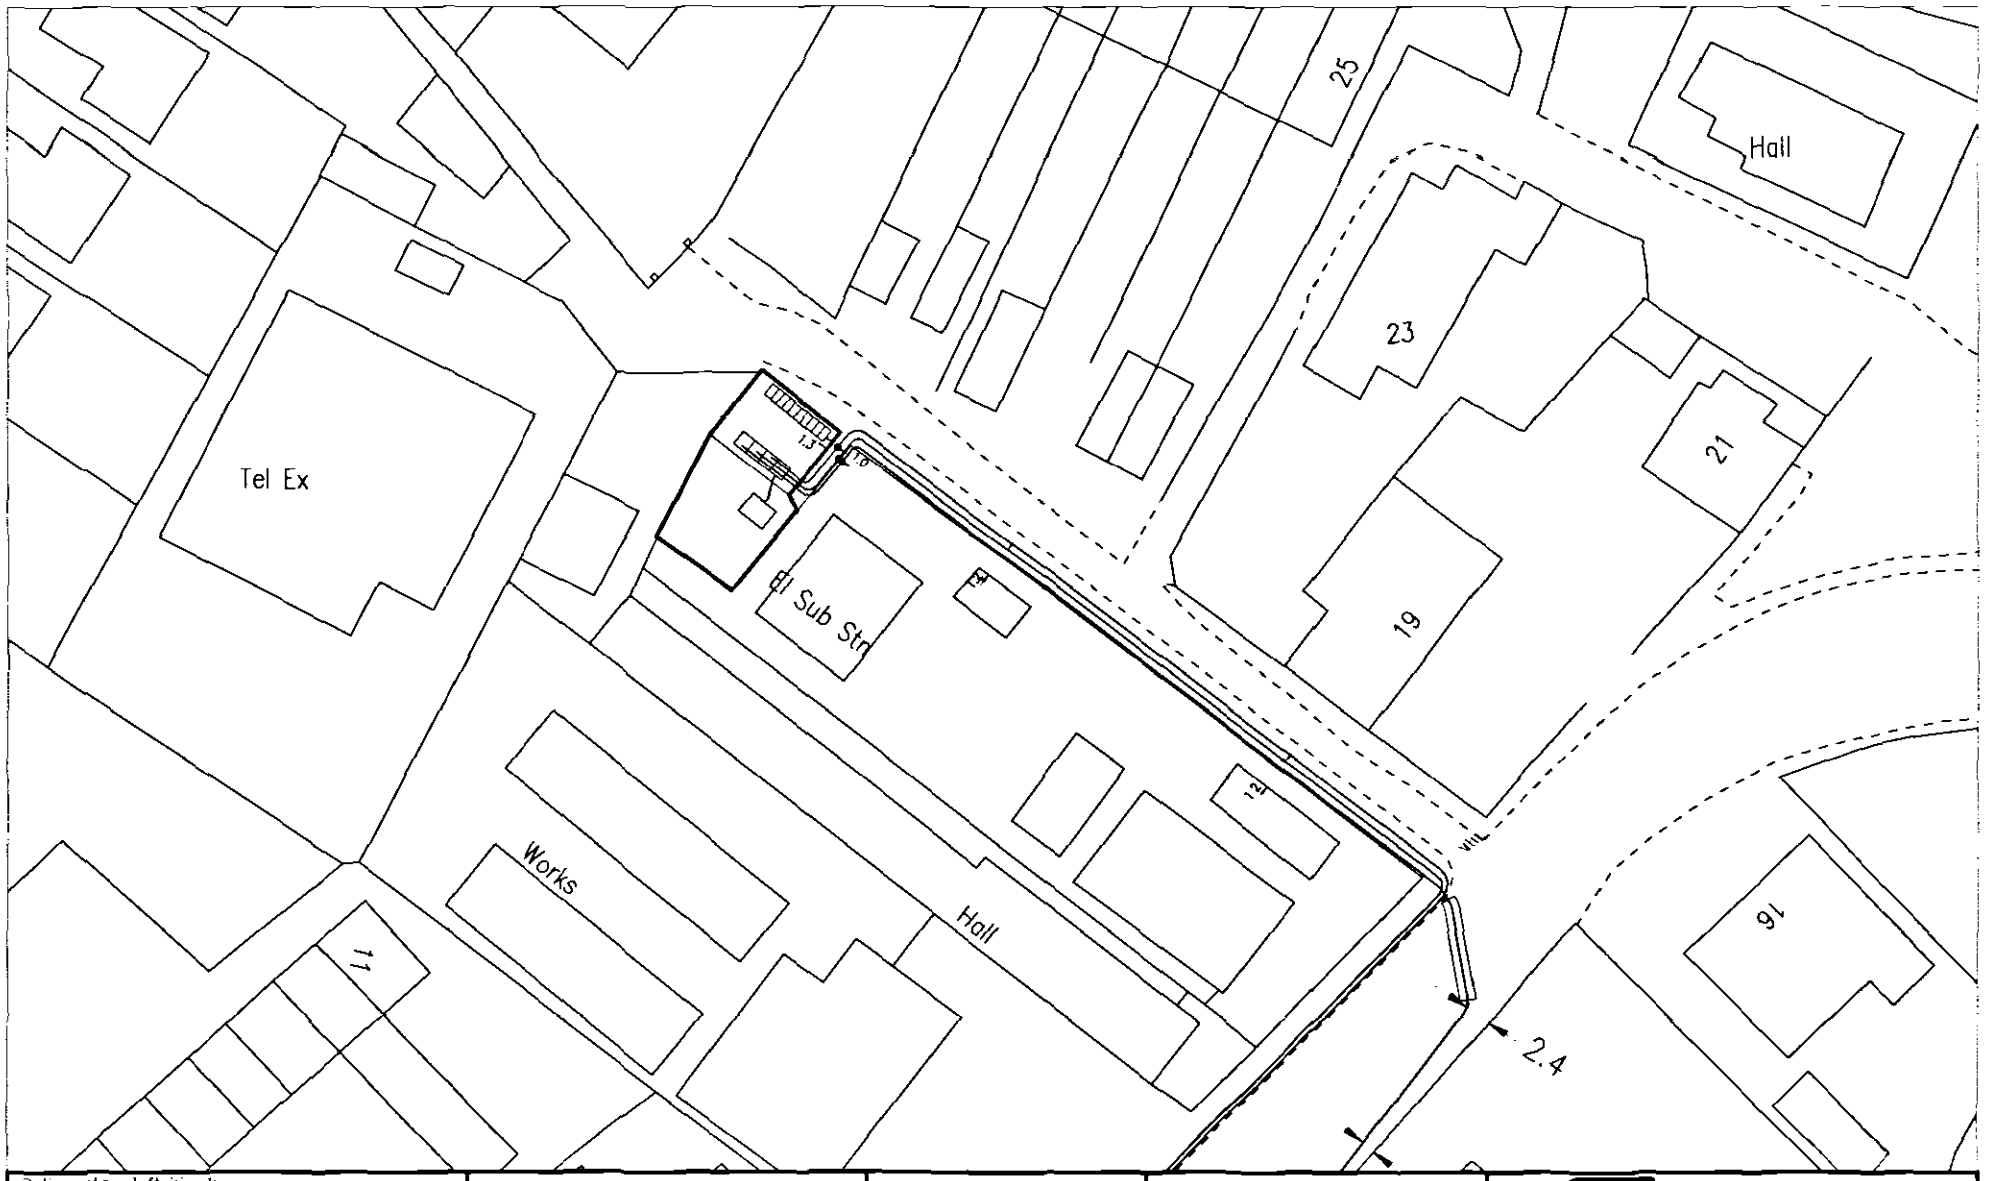


Deliberately left Blank

Scale 1:500 /11kV, 33kV, 25kV, 132kV

TF43252312 (543252,323127)

Sheet 2 of 2

Marie Johnson

23/09/2003

IMPORTANT NOTICE. Owing to the scale of this plan apparatus positions are approximate only and few service connections are shown. Exact locations of all cables including service cables should be verified by cable locator and careful use of hand tools. The cost of rectifying any damage will be charged. Further advice, if required may be obtained by calling 0800 0863080. Work must be carried out in accordance with all current Health and Safety Regulations. Guidance notes are available from The Health and Safety Executive.

ACCIDENTAL DAMAGE MUST BE REPORTED TO 0800 0568090 IMMEDIATELY – *MEANWHILE KEEP WELL CLEAR!*

This plan is based upon the ordnance survey map by East Midlands Electricity Distribution plc with the sanction of the Controller of H.M. Stationery Office. Crown Copyright Reserved. Subject to any specific exceptions this copy must not be copied without the prior permission of the copyright owner. Any information provided by East Midlands Electricity Distribution plc is copyright and may not be reproduced in any form without the written permission of East Midlands Electricity Distribution plc.

For further drawings contact
QC Data, PO Box 6540
Nottingham, NG8 3PT.
0115 901 4711

Additional Information
Cruf. 44406
Your ref. H11/0939-03

East Midlands Electricity

Overhead Line
Duct
Underground Cable
Cable joint
Substation
LV Distribution Boxes
W.L. – Wall Line
H.L. – Hedge Line
F.L. – Fence Line
C.L. – Centre Line
B.L. – Bollard Line