

Existing building to be converted to flats in the manner shown.

Brick up openings in existing walls, as shown.

Form openings for new external doors and windows, as shown; support over openings with IG Box 200 and Box 100 lintels.

Form new second floor, all in accordance with SRC structural calculations Reference 13607/1 to 24.

All new separating walls between flats to be to robust Detail E-WT-1.

Separating floors between flats to be to Robust Detail E-FT-1.

Provide half-hour fire protection between floors and dividing walls between flats.

Provide suitable fire-stopping between walls and floor.

Proposed new common stairs to have maximum rise of 150 mm and minimum going of 280mm

All first and second floor internal doors off habitable rooms to be ½ hour fire-resisting, self-closing type.

Connect foul drains to foul sewer in London Road, all to Anglian Water requirements.

Make good to all disturbed and affected areas.

Private Stairs
Stairwell formed by timber trimmers and load bearing walls (see plan). Provide timber balustrading to open side of stairs 900mm above pitch line and 1000mm high to stairwell opening to act as guarding and to be capable of resisting a horizontal force of 0.36 kNm. Balustrading to be vertical type, not horizontal or ranch style. No parts of stairs to have any gaps greater than 29mm. Provide timber handrail to top of balustrading or independently 900mm above pitch line. Ensure minimum headroom above pitch line is 2000mm. Total rise: See plan. Maximum rise: 220mm. Minimum going: 220mm. Maximum pitch: 42°. Read in conjunction with Approved Document K.

Insulated Pipes and Ducts
All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Roof/Wall Abutments
Provide Code 4 lead flashings and lap over roof covering. Dress up wall a minimum of 150mm (stepped on pitched abutments) and provide d.p.c. cavity tray to make completely watertight.

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Roof Ventilation to Sloping Ceiling
At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.

Kitchen Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 60 l/sec. Alternatively provide proprietary cooker hood capable of extracting 30 l/sec.

Bathroom/En-suite Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 15 l/sec. System to offer intermittent operation.

Hot Water Storage
Provide system approved by BBA and installed by BBA approved installer. System to be vented and insulated in accordance with BS5615 1985. Provide thermostatic control.

Heating System
Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Insulated Pipes and Ducts
All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5839 Part 6, 2006 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Habitable Room Trickle Ventilation
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

Kitchen/Utility/Bathroom/WC Trickle Ventilation
Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U-value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Roof Insulation to Sloping Ceiling
To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

Foul Water Drainage
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

Inspection Chamber Construction
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

First Floor Walling
Provide 50 x 75mm timber vertical studs at 400mm c/c to be constructed of 50 x 75mm timber head and sole plates. Provide 12.5mm Gyproc plasterboard of 10kg/m² density and skim finish to both sides. Provide to airspace proprietary acoustic insulation. Timber stud partitions running parallel to joist direction to be built off 2 no. floor joists fixed together. Provide 1 no. joist either end of stud partition joist beam to fix flooring.

Second Floor Construction
19mm flooring grade moisture resistant decking on timber joists as stated on plan. To external walls joists to be supported on joist hangers (not built into wall). Provide 30mm x 5mm mild steel restraint straps to joists running parallel with wall securely fixed to walls and to span minimum 3 no. joists at maximum 1200mm c/c. At strap positions provide pack and noggin to joists. Solid strutting to be installed mid-span where span of joists between 2.5m and 4.5m. For spans in excess of 4.5m position of struts at 1/3rd span. Double up floor joists locally under bath feet and hot water cylinder where applicable. All doubled up joists to be bolted together at 600mm centres. Provide 75mm fibreglass insulation between floor joists.

Fascia and Bargeboards
To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Header Tank Support
Water tank in roof space to be supported on bearers to spread the load to BS5268 Part 3 1985.

Boiler to Rear Unit
Provide balanced flue condensing type gas boiler of required rating in position indicated on drawing to be either a wall hung type or free standing on 125mm high concrete hearth above oversite. Boiler outlet to have protective guard cover and to be a minimum 300mm from any opening into the building which is wholly or partially above the terminal. Read in conjunction with Approved Document J1/2/3. At completion of works commissioning of heating system to be provided to the local authority Building Control by a competent Corgi registered person. Boiler to have a Sedbuk rating of 86%.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Ground Floor Construction
65mm sand/cement screed on 100mm Celotex insulation with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

I.G. Type L1/S85 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Foundations
As indicated on plan, provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be S13 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

Provide a firm level approach to front entrance of minimum width 900mm. Gradient of approach to be no steeper than 1:20. At entrance to building threshold to be maximum 15mm high.

External access door that serves as access to ground floor WC to have a minimum clear opening width of 775mm.

Ensure minimum 900mm corridor width, access to ground floor WC with no obstructions (radiators, etc.) to corridor area adjacent doors

Sockets, light switches, TV points, doorbells to habitable rooms to be positioned between 450mm and 1200mm above floor level.

Provide area within main driveway of hard surfacing (block paving, tarmac or similar) of adequate size to enable wheelchair access from parked vehicle direct to main access of dwelling. Footpath minimum 900mm wide to be directly linked to hard surfacing driveway.

Minimum width of corridors and passageways for a range of doorway widths

Doorway clear opening width (mm)	Corridor/Passageway width (mm)
750 or wider	900 (when approached head-on)
720	1200 (When approached not head-on)
775	1000 (when approached not head-on)
800	900 (when approached not head-on)

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Commissioning of Heating and HWS Systems
A competent person, i.e. the main contractor or sub-contractor shall supply a Certificate of Satisfactory Compliance with Building Regulations Part L. A copy of which shall be made available to both the client and the Building Control body.

A suitable set of operating and maintenance instructions are to be made available to the client to explain to the householders how to operate the systems so that they can perform efficiently and what routine maintenance is advisable for the purpose of the conservation of fuel and power.

Internal Lighting
Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Provide energy efficient lights of one per 25m² of floor area or one per four fittings whichever is the largest.

Excludes garages, lofts and outhouses.

External Lighting Fixed to the Building
External lights include lights in porches but not lights in garages and carports.

External lights should be made to enable effective control and/or the use of efficient lamps as follows:

- Automatically extinguish when there is enough daylight and when not required at night.
- Have sockets that can only be used with lamps having an efficiency greater than 40 lumens per circuit watt.

Dry Lining
Dry line existing solid external walls with Celotex TUFF-R™ Zero GA3000Z system internally all in accordance with manufacturers specification.

Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either-
a) an electrical installation certificate issued under a competent person's scheme has been issued or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

Stud Walls between Habitable Rooms
To have 15mm plasterboard finish to both sides of 50mm x 100mm studs with 100mm fibreglass between to reduce sound transmission
Emergency Lighting
Provide and install emergency lighting all to BS5266:Part 1:1999.

Fire Detection/Alarm System
Provide and install fire detector and alarm system all to BS5839:Part 1:2002.

Wall Construction 285mm Cavity
285mm cavity walls to consist of -
100mm face brickwork (see site plan for details),
85mm cavity to be filled with Crown Dritherm 32,
100mm internal skin of Tarmac Durox Supabloc or similar approved to give 0.29 U value.
Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

Brickwork below d.p.c. to be F.L. quality

Outlets from balanced flue boilers to be at least 300mm from any openings.

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Hot water cylinder to be minimum 115lt capacity.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Escape windows to be within 1.1m of floor.

All new drains under building to be encased in 150mm concrete.

Gas central heating to flats 3, 4 & 6.


Electric storage heaters to flats 1, 2, 5 and 6.

External door and all internal surfaces to Bin Store to be 1-hour fire protected. Provide mechanical ventilation to Bin Store, ducted at high level to external air to give continuous trickle ventilation.

All internal party walls to be sound tested.

Foul drainage to be connected to foul sewer in London Road; drains to be laid to suitable depths to suit foul sewer.

All doors and windows at ground floor level facing into passage to give ½-hour fire protection; windows to non-openable. All rooms using these windows and doors to have mechanical ventilation, ducted at high level to give 4 no. air changes per hour.

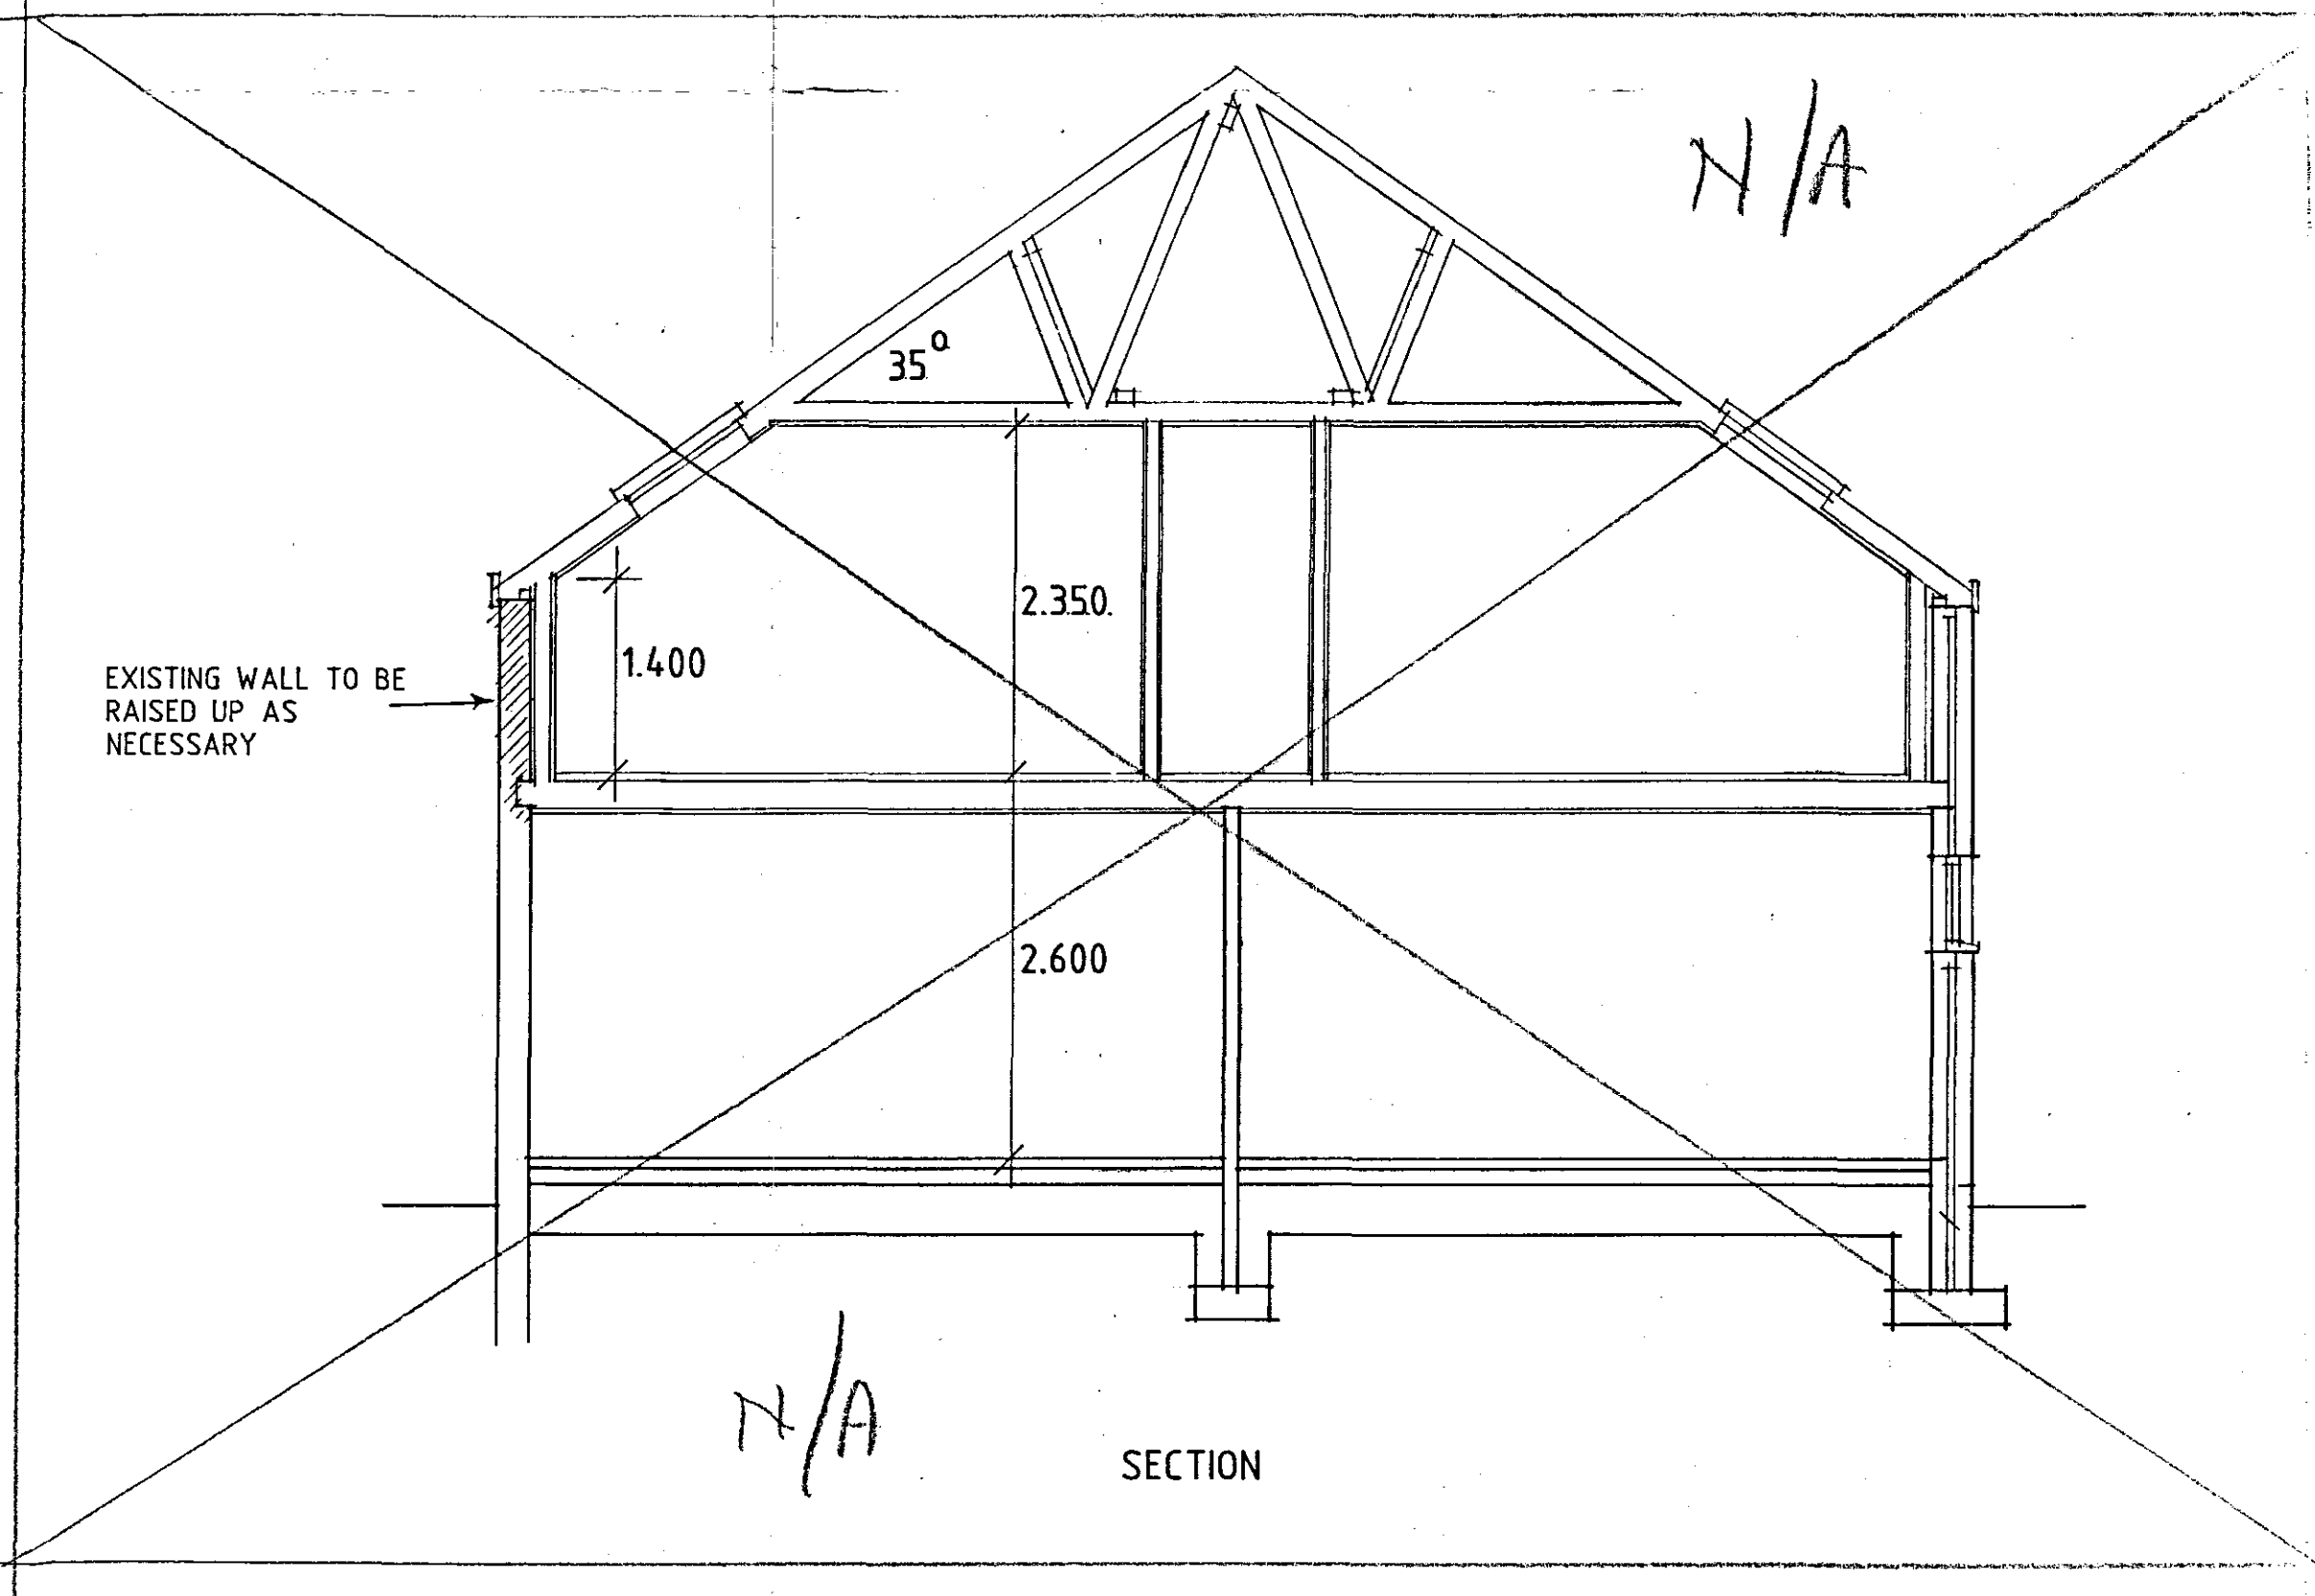

DETERMINED PLAN

A - ALTS - 22.8.07

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED CONVERSION OF
ANTIQUE CENTRE TO FLATS
AT THE CHAPEL EMPORIUM,
LONDON ROAD, LONG SUTTON
FOR

MR. J. FARROW.

SECTION

1:50 SD07-005/7

JUNE-07 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702

