

**FLOOD RISK ASSESSMENT
FOR PROPOSED
RESIDENTIAL DEVELOPMENT
OFF CHURCH LANE,
LUTTON, SPALDING, Lincs.**

FINAL REPORT

GEOFF BEEL CONSULTANCY

DECEMBER 2015

GCB/MERCHANT

DISCLAIMER

This document has been prepared solely as a Flood Risk Assessment in support of a planning application for proposed Residential Development at land off Church Lane, Lutton, Spalding, Lincs. "Geoff Beel Consultancy" accepts no responsibility or liability whatsoever for any use made of this document other than by the client "Mr & Mrs T Baker" for the purposes it was originally commissioned and prepared. All comments and opinions made are based upon information available to "Geoff Beel Consultancy" during the necessary investigative process, and the conclusions and recommendations could therefore, differ in the event of material subsequently being found erroneous, incomplete or misleading. "Geoff Beel Consultancy" therefore, accepts no liability should this prove to be the case.

CONTENTS

- 1.0 INTRODUCTION
- 2.0 LOCATION
- 3.0 THE SITE AND SEQUENTIAL TEST
- 4.0 EXISTING FLOOD ALLEVIATION MEASURES
- 5.0 POTENTIAL SOURCE OF FLOODING
- 6.0 EXTENT OF KNOWN FLOODING
- 7.0 PROBABILITIES AND TRENDS OF FLOODING
- 8.0 IMPACTS OF FLOODING
- 9.0 RESIDUAL RISKS – EXTREME EVENTS
- 10.0 CONCLUSIONS AND RECOMMENDATIONS

- Fig 1 - Location Plan & Site Layout Plan –
G R Merchant drg. no. 2857-15-01C
- Fig 2 - Floor Plans –
G R Merchant drg. no. 2857-15-02C
- Fig 3 - Second Floor Plan & Elevations –
G R Merchant drg. no. 2857-15-03B
- Fig 4 - Proposed Garages Floor Plans & Elevations –
G R Merchant drg. no. 2857-15-04B
- Fig 5 - Environment Agency Flood Zone Map
- Fig 6 - South Holland District Council Strategic Flood Risk
Assessment Flood Zone Map – Residual Depth (2115)
- Fig 7 - Environment Agency Tidal Hazard Mapping –
Depth, Hazard & Velocity for 1 in 200 year & 1 in 1000 year
events (2115) – CCN/2013/35491
- Fig 8 - South Holland Internal Drainage Board District Plan

1.0 INTRODUCTION

1.1 A full planning application is to be made by G R Merchant Ltd for proposed residential development on behalf of Mr & Mrs T Baker off Church Lane, Lutton, Spalding, Lincs.

1.2 A Flood Risk Assessment is required before the permitted development may commence and meet the requirements and general conditions contained in Paragraph 9 of the Technical Guide to the National Planning Policy Framework (NPPF) for approval by the Environment Agency.

The site, as situated, is located within a defended Flood Zone 3, of the Environment Agency's Flood Zone Maps. The latest Agency Flood Maps have been created as a tool to raise awareness of flood risk with the public and our partner organisations, such as Local Authorities, Emergency Services and Drainage Authorities. The Maps do not take into account any flood defences.

The site is also shown in Flood Zone 1 of the South Holland District Council's Strategic Flood Risk Assessment Maps (2115).

The site is also located in the South Holland IDB drainage district.

1.3 Geoff Beel Consultancy was appointed on 15th December 2015 to undertake a Flood Risk Assessment.

2.0 LOCATION

2.1 The development site is located west of Lutton Bank at land off Church Lane, Lutton. The National Grid Reference of the central point of the development is TF 43252562.

2.2 The position and extent of the site is shown on Fig 1 – Location Plan & Site Layout Plan at the end of the document.

2.3 The site, located within the South Holland Internal Drainage Board district is shown within Flood Zone 3 as detailed on the Environment Agency Flood Zone Maps and in Flood Zone 1 of the Council's Strategic Flood Risk Assessment Map (2115) as defended by the Internal Drainage Board system and the Lutton Bank secondary defence with a crest level of 5.7m aOD.

3.0 THE SITE AND SEQUENTIAL TEST

3.1 The site is existing agricultural buildings to be demolished with grass paddock.

3.2 The area of development is approximately 0.10 hectare.

3.3 The proposed site layout consists the construction of a 3 storey dwelling with detached garages.

- 3.4 The Sequential Test and Exception Test will require to be applied by the Local Planning Authority but the development may be permitted as the site is protected against both the 1 in 200 year return period tidal event and the 1 in 100 year return period fluvial event and located in Flood Zone 1 of the Council's Strategic Flood Risk Assessment Map (2115).

4.0 EXISTING FLOOD ALLEVIATION MEASURES

- 4.1 The site is within a defended floodplain, as defined in Appendix 1 of the Environment Agency's 'Policy for the Protection of Floodplains' and is considered to be passive until such time as a flood greater than that for which the defences were designed occurs. The likelihood of flooding due to overtopping or failure of a flood defence embankment is considered to be small.

The South Holland Internal Drainage Board is protected by a combination of the River Welland tidal defences downstream of Spalding, the River Welland fluvial embankments as well as the River Nene tidal defences downstream of Foul Anchor.

- 4.2 The site and the surrounding land drains by gravity to a Board drain west of the site and hence the Lutton Leam and Lutton Leam Outfall to the tidal River Nene downstream of the West Lighthouse.
- 4.3 The existing standard of drainage for the South Holland Internal Drainage Board is 1 in 50 years return period, compatible with the Department of the Environment, Food and Rural Affairs target level of service for rural drainage and flood defence works. Freeboard of 900mm is provided to the lowest land levels.
- 4.4 Current maintenance standards within the South Holland Internal Drainage Board and of the Environment Agency defences are generally very good.

During the operation and maintenance of its pumping stations, associated structures and channel systems, particularly those that could affect property, the Board seeks to maintain a general standard capable of providing flood protection to its district. A routine maintenance programme is in place to ensure that the Board's assets are commensurate with the standard of protection that is sought. However, bank slips, blocked culverts etc may occur from time to time and these matters are usually dealt with promptly.

5.0 POTENTIAL SOURCES OF FLOODING

5.1 Three potential sources of flooding have been identified as a result of this assessment:

- a) local blockages to IDB main drain system.
- b) storm return period of 1 in 50 years being exceeded
- c) overtopping and breaching of defences of the tidal River Nene

5.2 The probability of flooding from source a) is low due to the maintenance standards already achieved and managed by the IDB.

The probability of flooding from b) is also low due to the South Holland IDB main drain design standard incorporating a minimum 900mm freeboard to the lowest land level which provides adequate storage in events greater than 1 in 50 years.

Previous historic rainfall events of 1968 and 1978, estimated to be greater than 1 in 100 year events, caused no flooding to any residential properties at the time and the Boards policy is to provide a standard of drainage which satisfies NPPF requirements of a 1 in 100 year return period for fluvial protection inclusive of the effects of climate change and developments to the arterial system enables a flexible approach to be adopted and meet the criteria for “sustainable urban drainage”.

5.3 The flood embankments to the fluvial River Welland provide a 1 in 100 year return period level of protection in combination with the Crowland and Cowbit Washes. The flood embankments to the tidal River Welland and tidal River Nene provide a 1 in 200 year return period level of protection.

5.4 Soakaway drainage to BRE365 design requirements and Building Regulation approval will be installed.

5.5 More recent Tidal Hazard Mapping produced by the Environment Agency is shown in Fig 7 of this assessment.

The site is shown to be flooded to a depth of between 0.25 – 0.50m if a breach occurred to the River Nene tidal defences and the Lutton Bank also breached and it is necessary to mitigate against this remote risk.

Finished floor level has been raised 0.50m above existing ground floor level with flood resilient construction 300mm above finished floor level.

5.6 The developer should ensure that the eventual occupiers of the dwelling are sufficiently aware of the risk of flooding and the standard of the existing defences. The Environment Agency provides a Flood Warnings Service which includes Flood Warning Codes and uses direct warning methods where the risks and impacts of flooding are high. Indirect warnings are provided to all flood risk areas, even those a low risk of flooding. The main method is media broadcasts via local radio and also by television.

In addition to direct and indirect flood warnings, the Environment Agency operates a 24 hour a day Floodline Service providing advice and information on flooding by contacting 0845 988 1188 and the occupiers of the dwelling holding should register with the Floodline Direct Warnings Service to receive any future flood warnings.

6.0 EXTENT OF KNOWN FLOODING

- 6.1 During the preparation of this assessment, no evidence was discovered of the site being flooded or of any adjoining properties.

7.0 PROBABILITIES AND TRENDS OF FLOODING

- 7.1 The probability of this development flooding from localised drainage systems is very low.
- 7.2 The probability of the site flooding with water from any South Holland IDB main drain is less than 1% because of the standards of the existing flood defence systems, storage within existing drainage channels and the location of the site.
- 7.3 The probability of the site flooding with fluvial waters from any main river system is less than 1% because of the standards of the existing flood defences and the location of the site.
- 7.4 If under very extreme events, levels of floodwater from the South Holland IDB main drains or arterial systems rose to such an extent that the site was affected, the situation would not be sudden. It is very probable that sufficient time would be available to take precautionary actions to limit the extent and potential impact of flooding.
- 7.5 The water levels in the drainage channels will tend to rise as a result of the impacts of climate change. However the existing systems and defences together with the proposed floor levels 0.50m above existing ground level with flood resilient construction up to 300mm above finished floor level will be appropriate for the design life of the development (i.e. 100 years).

8.0 IMPACTS OF FLOODING

- 8.1 No significant impacts of flooding are anticipated.
- 8.2 Floor levels of the development will be at 0.50m above existing ground level with flood resilient construction up to 300mm above finished floor level which will offer protection against impacts arising from any extreme short duration, localised events.
- 8.3 The general location of the site within the catchment is such that if flooding occurred from any of the South Holland IDB main drain systems, then probably 2 to 3 days warning time would be available.

- 8.4 No displacement of water from the site will affect any adjoining properties. It is intended to provide soakaway drainage to BRE365 design requirement and Building Regulations approval.
- 8.5 Safe and dry access/egress is available to the site from Puddingpoke Lane off Lutton Bank with carriageway level at 5.70m aOD in a southerly direction to Long Sutton.

9.0 RESIDUAL RISK – EXTREME EVENTS

- 9.1 The residual risk from extreme events is very low on this site, because of its location, within the South Holland IDB area and its location 5.00kms from the Wash and River Nene tidal defences.
- 9.2 The site is within Flood Zone 1 according to NPPF classification with a very low risk of flooding due to the current standards of drainage and flood defence and land levels. The site is not located within a Functional Flood Plain of any 'main river' or 'main drain'. The Environment Agency Flood Zone Maps have been produced irrespective of existing flood defences and standards of protection.
- 9.3 South Holland District Council in conjunction with the Environment Agency and the local IDB's within the Council area have carried out a Strategic Flood Risk Assessment of the whole District by appointed Consulting Engineers.

The Strategic Flood Risk Assessment has produced more definitive Flood Risk Maps than those published by the Environment Agency and at the same time has analysed flood return periods of all tidal and fluvial defences for years 2002 and 2115 to account for the effects of climate change.


Breach scenarios of embankments failing and/or being overtopped have also been carried out to establish Flood Risk Zones.

- 9.4 As a result of the Strategic Flood Risk Assessment; the South Holland Main Drain and associated IDB main drains have been determined as providing protection against a 1 in 100 year return period event both in years 2002 and 2115.
- 9.5 The development site has been identified outside of any Flood Risk Zone from the South Holland Main Drain and associated IDB main drain or the River Nene.


10.0 CONCLUSIONS AND RECOMMENDATIONS

10.1 As a result of the assessment, the following conclusions have been reached:-

- The proposed development is not in a Functional Floodplain. It is located in the Passive Floodplain protected by The Wash and River Nene tidal defences to a 1 in 200 year return period, (0.5%)
- The site is in Flood Zone 1 with the actual risk of site flooding from any Environment Agency river system being very low (less than 0.5%). The site has been identified in Flood Zone 1 of the South Holland District Council's Strategic Flood Risk Assessment Maps.
- Although the site is located within an Internal Drainage District with a minimum standard of drainage of 1 in 50 years, this accords with Defra guidelines for rural development. Freeboard to design water level of 900mm to lowest land level is available for events greater than 1 in 50 years providing further storage within the drainage channels.
- On site rainwater from the development will be discharged via soakaways to BRE 365 design requirement and Building Regulations approval.
- Finished floor level of the dwelling has been raised 0.50m above existing ground level with flood resilient construction up to 300mm above finished floor level.





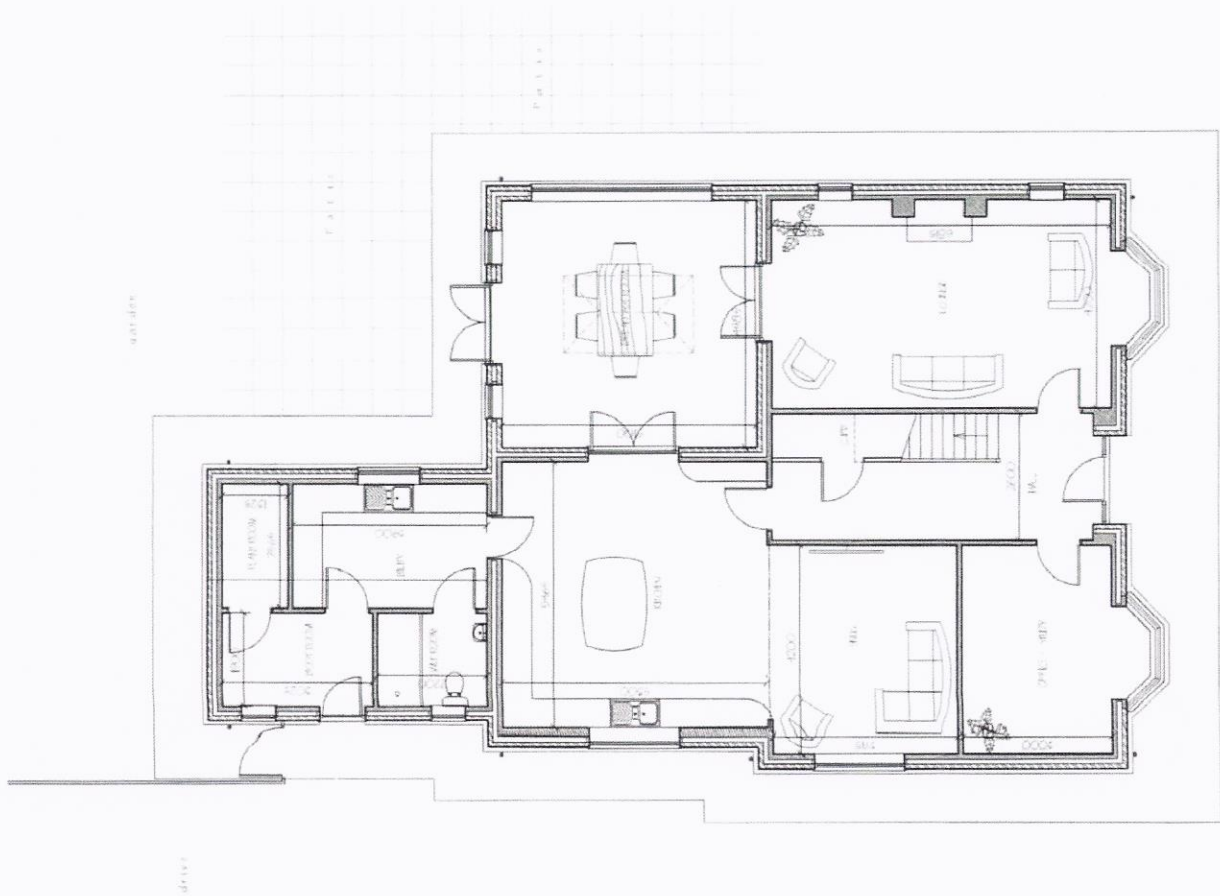


SECOND FLOOR PLAN

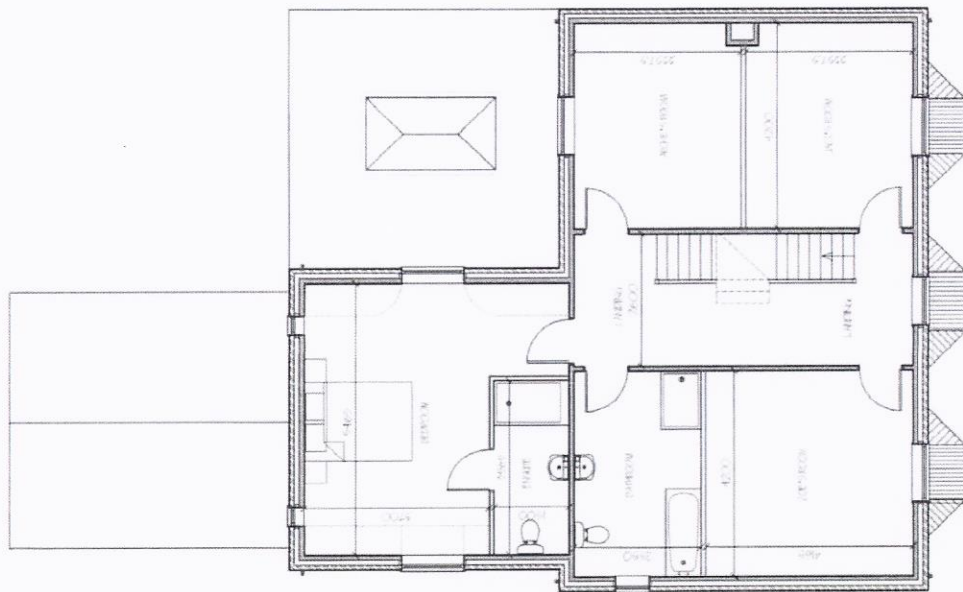


FIRST FLOOR PLAN


G. R. MERCHANT LTD. 1890 AINSIE FMSO ARCHITECTURAL, STRUCTURAL AND MECHANICAL CONSULTANTS 4 Virginia Avenue 18A Park Road, Herts 2 79L Tel 01438 500800 Fax 01438 500800 E-mail: g.r.merchant@btinternet.com		Project 1890 AINSIE FMSO Date 18.11.01 Drawn 18.11.01 Checked 18.11.01 Scale 1/4" = 1'-0"
DO NOT SCALE FROM THIS DRAWING		Date 18.11.01 Scale 1/4" = 1'-0"

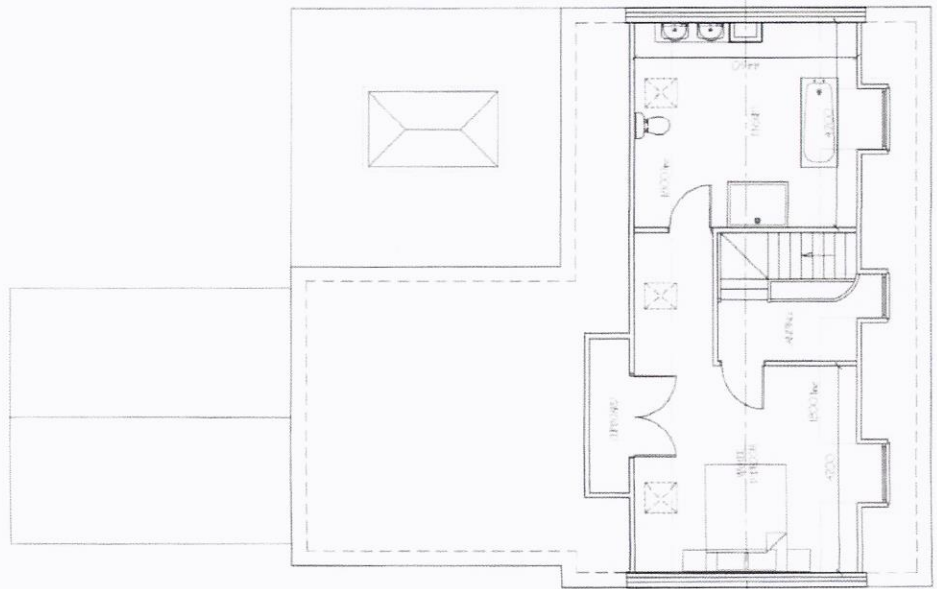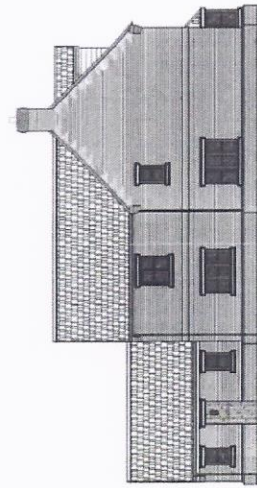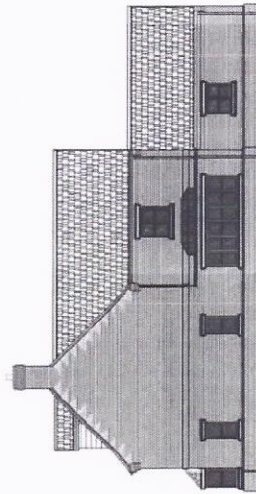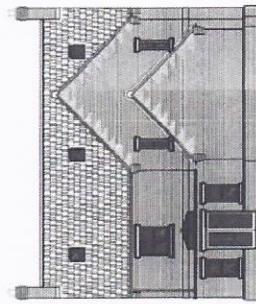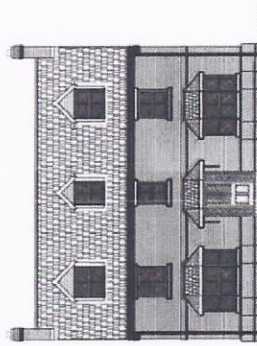


147	148	149	150	151	152	153	154	155	156	157	158	159	160	161	162	163	164	165	166	167	168	169	170	171	172	173	174	175	176	177	178	179	180	181	182	183	184	185	186	187	188	189	190	191	192	193	194	195	196	197	198	199	200	201	202	203	204	205	206	207	208	209	210	211	212	213	214	215	216	217	218	219	220	221	222	223	224	225	226	227	228	229	230	231	232	233	234	235	236	237	238	239	240	241	242	243	244	245	246	247	248	249	250	251	252	253	254	255	256	257	258	259	260	261	262	263	264	265	266	267	268	269	270	271	272	273	274	275	276	277	278	279	280	281	282	283	284	285	286	287	288	289	290	291	292	293	294	295	296	297	298	299	300	301	302	303	304	305	306	307	308	309	310	311	312	313	314	315	316	317	318	319	320	321	322	323	324	325	326	327	328	329	330	331	332	333	334	335	336	337	338	339	340	341	342	343	344	345	346	347	348	349	350	351	352	353	354	355	356	357	358	359	360	361	362	363	364	365	366	367	368	369	370	371	372	373	374	375	376	377	378	379	380	381	382	383	384	385	386	387	388	389	390	391	392	393	394	395	396	397	398	399	400	401	402	403	404	405	406	407	408	409	410	411	412	413	414	415	416	417	418	419	420	421	422	423	424	425	426	427	428	429	430	431	432	433	434	435	436	437	438	439	440	441	442	443	444	445	446	447	448	449	450	451	452	453	454	455	456	457	458	459	460	461	462	463	464	465	466	467	468	469	470	471	472	473	474	475	476	477	478	479	480	481	482	483	484	485	486	487	488	489	490	491	492	493	494	495	496	497	498	499	500	501	502	503	504	505	506	507	508	509	510	511	512	513	514	515	516	517	518	519	520	521	522	523	524	525	526	527	528	529	530	531	532	533	534	535	536	537	538	539	540	541	542	543	544	545	546	547	548	549	550	551	552	553	554	555	556	557	558	559	560	561	562	563	564	565	566	567	568	569	570	571	572	573	574	575	576	577	578	579	580	581	582	583	584	585	586	587	588	589	590	591	592	593	594	595	596	597	598	599	600																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
147		148		149		150		151		152		153		154		155		156		157		158		159		160		161		162		163		164		165		166		167		168		169		170		171		172		173		174		175		176		177		178		179		180		181		182		183		184		185		186		187		188		189		190		191		192		193		194		195		196		197		198		199		200		201		202		203		204		205		206		207		208		209		210		211		212		213		214		215		216		217		218		219		220		221		222		223		224		225		226		227		228		229		230		231		232		233		234		235		236		237		238		239		240		241		242		243		244		245		246		247		248		249		250		251		252		253		254		255		256		257		258		259		260		261		262		263		264		265		266		267		268		269		270		271		272		273		274		275		276		277		278		279		280		281		282		283		284		285		286		287		288		289		290		291		292		293		294		295		296		297		298		299		300		301		302		303		304		305		306		307		308		309		310		311		312		313		314		315		316		317		318		319		320		321		322		323		324		325		326		327		328		329		330		331		332		333		334		335		336		337		338		339		340		341		342		343		344		345		346		347		348		349		350		351		352		353		354		355		356		357		358		359		360		361		362		363		364		365		366		367		368		369		370		371		372		373		374		375		376		377		378		379		380		381		382		383		384		385		386		387		388		389		390		391		392		393		394		395		396		397		398		399		400		401		402		403		404		405		406		407		408		409		410		411		412		413		414		415		416		417		418		419		420		421		422		423		424		425		426		427		428		429		430		431		432		433		434		435		436		437		438		439		440		441		442		443		444		445		446		447		448		449		450		451		452		453		454		455		456		457		458		459		460		461		462		463		464		465		466		467		468		469		470		471		472		473		474		475		476		477		478		479		480		481		482		483		484		485		486		487		488		489		490		491		492		493		494		495		496		497		498		499		500		501		502		503		504		505		506		507		508		509		510		511		512		513		514		515		516		517		518		519		520		521		522		523		524		525		526		527		528		529		530		531		532		533		534		535		536		537		538		539		540		541		542		543		544		545		546		547		548		549		550		551		552		553		554		555		556		557		558		559		560		561		562		563		564		565		566		567		568		569		570		571		572		573		574		575		576		577		578		579		580		581		582		583		584		585		586		587		588		589		590		591		592		593		594		595		596		597		598		599		600	
147		148		149		150		151		152		153		154		155		156		157		158		159		160		161		162		163		164		165		166		167		168		169		170		171		172		173		174		175		176		177		178		179		180		181		182		183		184		185		186		187		188		189		190		191		192		193		194		195		196		197		198		199		200		201		202		203		204		205		206		207		208		209		210		211		212		213		214		215		216		217		218		219		220		221		222		223		224		225		226		227		228		229		230		231		232		233		234		235		236		237		238		239		240		241		242		243		244		245		246		247		248		249		250		251		252		253		254		255		256		257		258		259		260		261		262		263		264		265		266		267		268		269		270		271		272		273		274		275		276		277		278		279		280		281		282		283		284		285		286		287		288		289		290		291		292		293		294		295		296		297		298		299		300		301		302		303		304		305		306		307		308		309		310		311		312		313		314		315		316		317		318		319		320		321		322		323		324		325		326		327		328		329		330		331		332		333		334		335		336		337		338		339		340		341		342		343		344		345		346		347		348		349		350		351		352		353		354		355		356		357		358		359		360		361		362		363		364		365		366		367		368		369		370		371		372		373		374		375		376		377		378		379		380		381		382		383		384		385		386		387		388		389		390		391		392		393		394		395		396		397		398		399		400		401		402		403		404		405		406		407		408		409		410		411		412		413		414		415		416		417		418		419		420		421		422		423		424		425		426		427		428		429		430		431		432		433		434		435		436		437		438		439		440		441		442		443		444		445		446		447		448		449		450		451		452		453		454		455		456		457		458		459		460		461		462		463		464		465		466		467		468		469		470		471		472		473		474		475		476		477		478		479		480		481		482		483		484		485		486		4																																																																																																																																																																																																																																			




FRONT ELEVATION




SIDE ELEVATION




REAR ELEVATION



FRONT ELEVATION

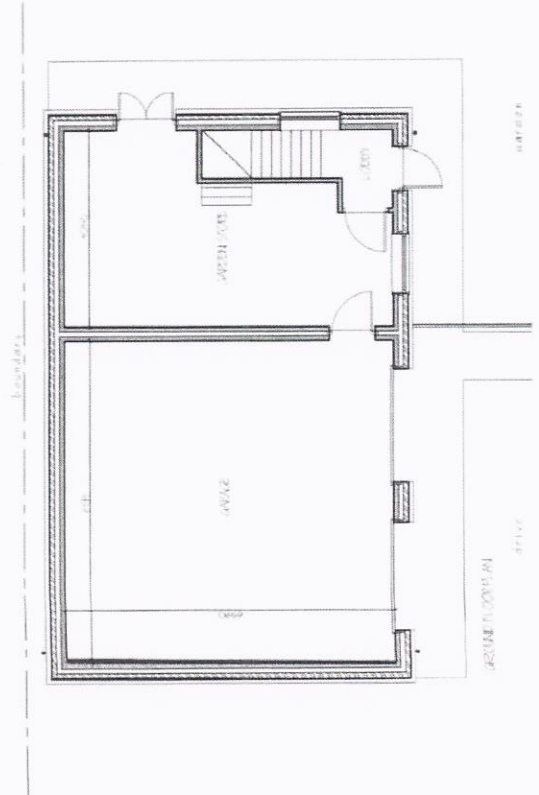

FIRST FLOOR

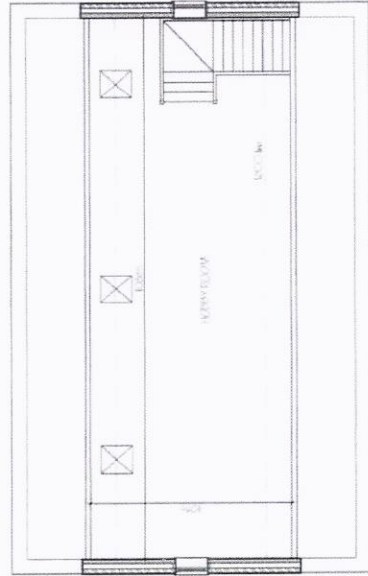

SECOND FLOOR

G. R. MERCHANT LTD. LONG ARCADE FWD ARCHITECTURAL, STRUCTURAL AND LAND DRAINAGE CONSULTANTS 12A Wellington Street Sandhurst, Bucks. PG 13 7BE Phone 01494 432744 E-mail: grm@grmarchitect.co.uk		Project: WINDMILL HOUSE Location: WINDMILL HOUSE Date: 10/01/01 Drawing No: 1001 Drawing Title: WINDMILL HOUSE Drawing No: 1001 Drawing Title: WINDMILL HOUSE
--	--	--



Enter a postcode or place name:

Other topics for this area...

Lutton, Lincolnshire

Flood Map for Planning (Rivers and Sea)

Flood Map for Planning (Rivers and Sea)

Map legend

Luton, Lincolnshire at scale 1:10,000

Other maps	Data search	Text only version
------------	-------------	-------------------

Click on the map to see what Flood Zone (National Planning Policy Guidance definitions) the proposed development is in.

- ☒ Flood Map for Planning (Rivers and Sea)

Flood Zone 3

 Flood defences
(Not all may be sited in the same way)


 Are as benefiting from flood defences (Not all may be shown*)



☒ Main River Line

Main River Line

☒ Other national environmental organisations

Natural Resources Wales
Area of responsibility

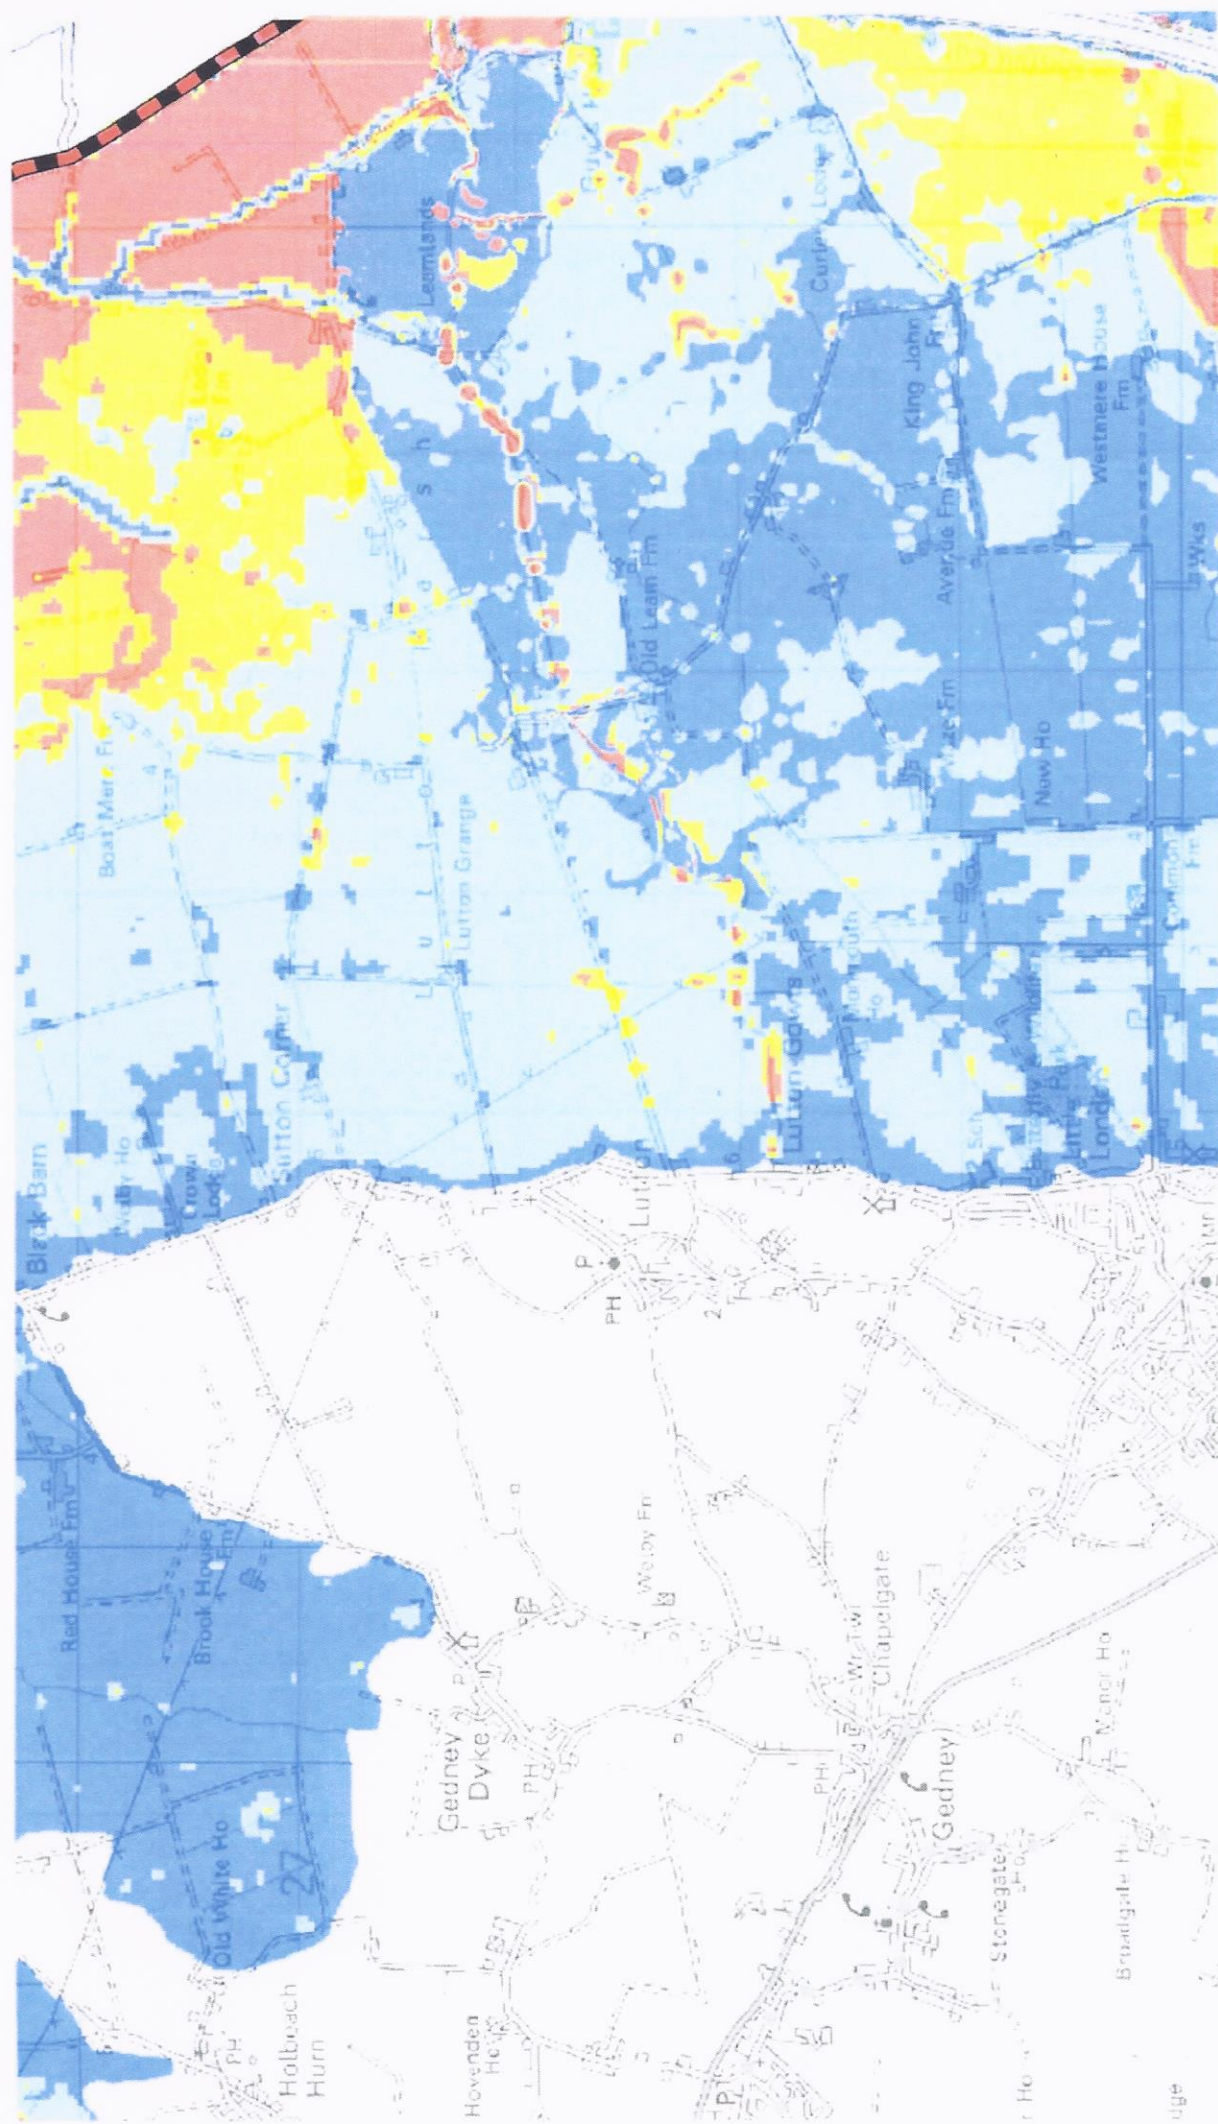

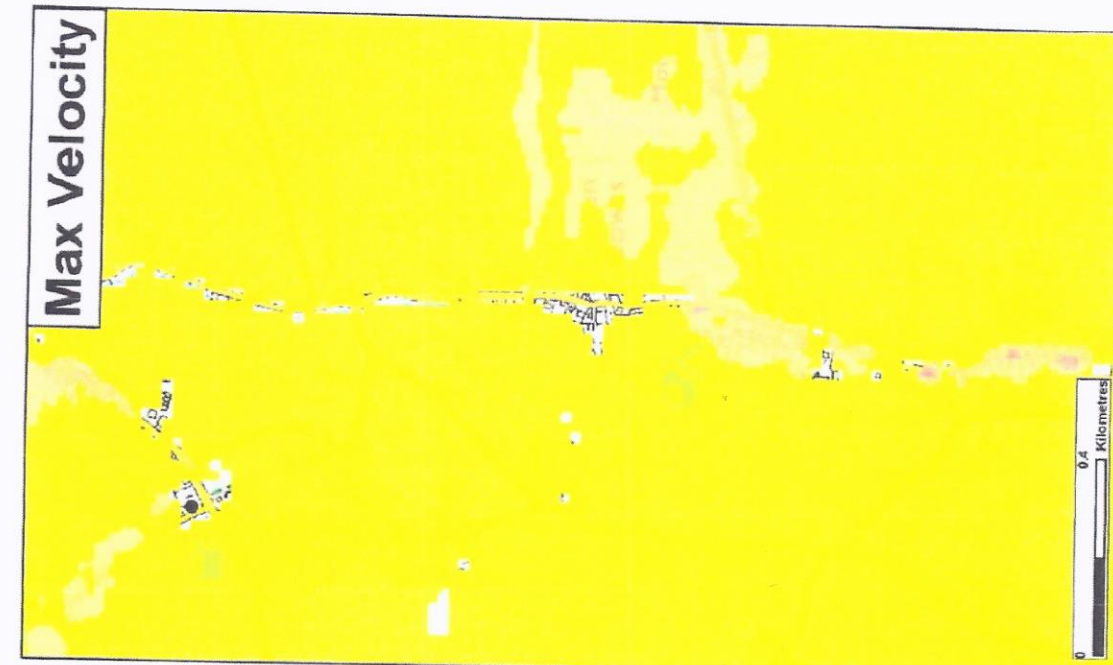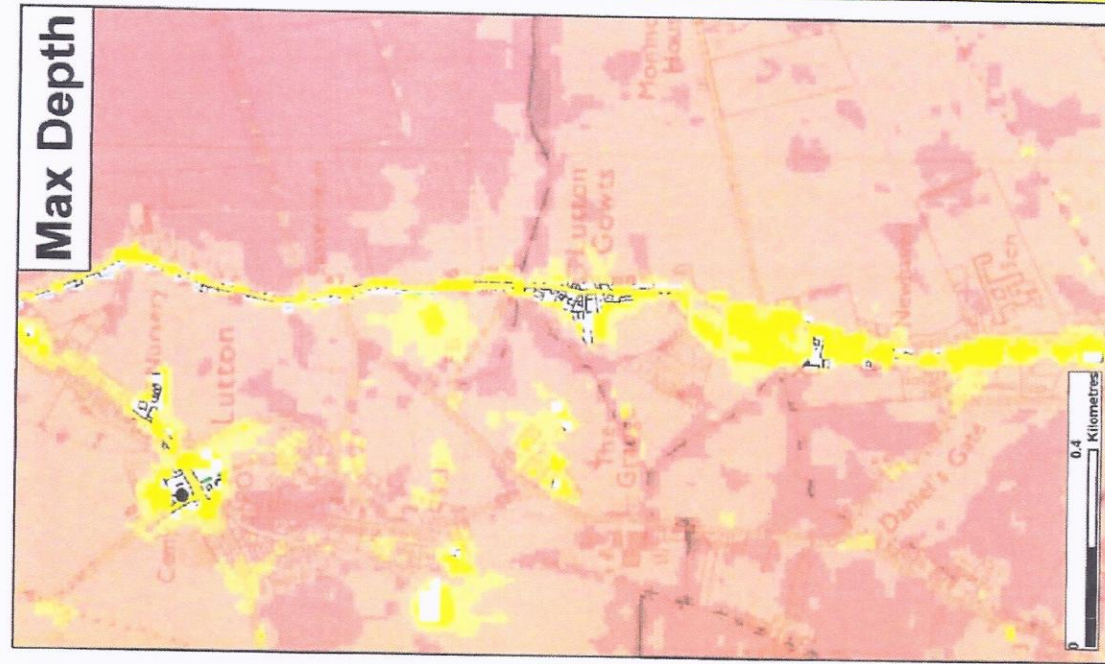

★ Modelled Breach Locations - see also the accompanying plan "Location of Modelled Breaches"			
Max Hazard (Flood Risk to People: FD3320)	Max Depth (m)	Max Velocity (m/s)	Scenario Annual Chance
Less than 0.75 (Low Hazard)	0 - 0.25	0 - 0.3	2115
Between 0.75 and 1.25 (Danger for Some)	0.25 - 0.50	0.3 - 1.0	
Between 1.25 and 2.0 (Danger for Most)	0.50 - 1.0	1.0 - 1.5	
Greater than 2.0 (Danger for All)	1.0 - 2.0	1.5 - 2.5	
	2.0 +	2.5 +	
Date Printed	Scenario year	Scenario Annual Chance	0.5% (1 in 200)
November 2013	2115		

This map shows the level of flood hazard to people (called a hazard rating) if our flood defences are breached at certain locations, for a range of scenarios. The hazard rating depends on the depth and velocity of flood/water, and maximum values of these are also mapped.

The map is based on computer modelling of simulated breaches at specific locations. Each breach has been modelled individually and the results combined to create this map. Multiple breaches, other combinations of breaches, different sized tidal surges or flood flows may all give different results.



The map only considers the consequences of a breach, it does not make any assumption about the likelihood of a breach occurring. The likelihood of a breach occurring will depend on a number of different factors, including the construction and condition of the defences in the area. A breach is less likely where defences are of a good standard, but a risk of breaching remains.

General Enquiries No. 03706 506 506. Weekday Daytime calls cost 5p plus up to 6p per minute from BT. Weekend Unlimited. Mobile and other providers' charges may vary.

Northern Area Tidal Breach Hazard Mapping

Map Centred on TF 43633 24805

This map is reproduced by permission of Ordnance Survey on behalf of The Controller of Her Majesty's Stationery Office. Crown copyright. All rights reserved. Environment Agency 10002380. 2011. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings.

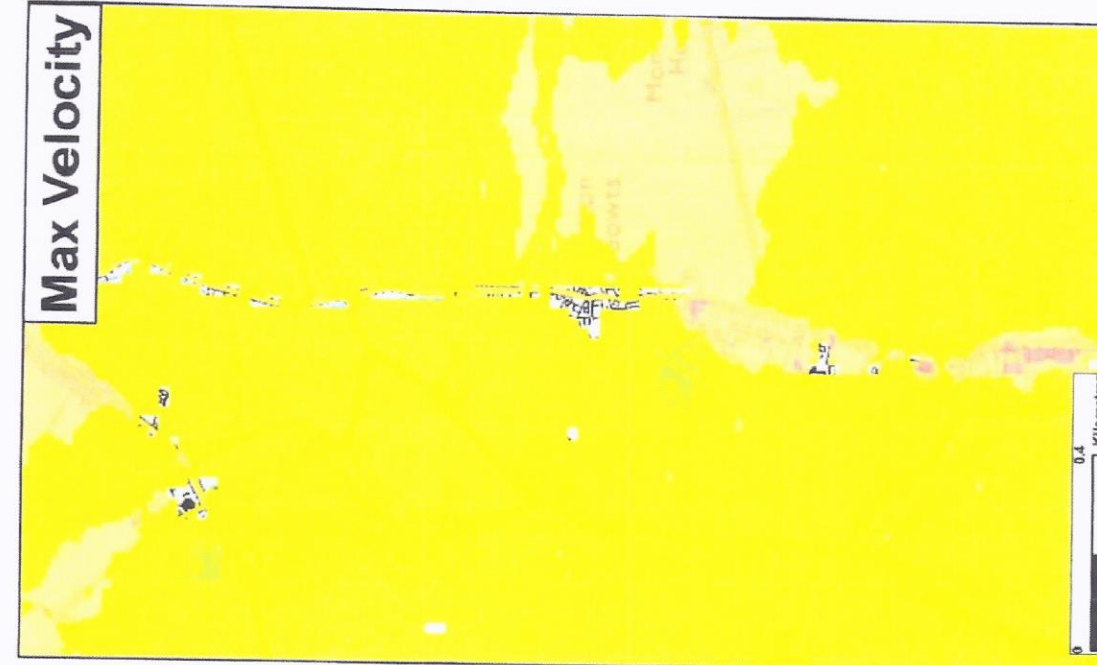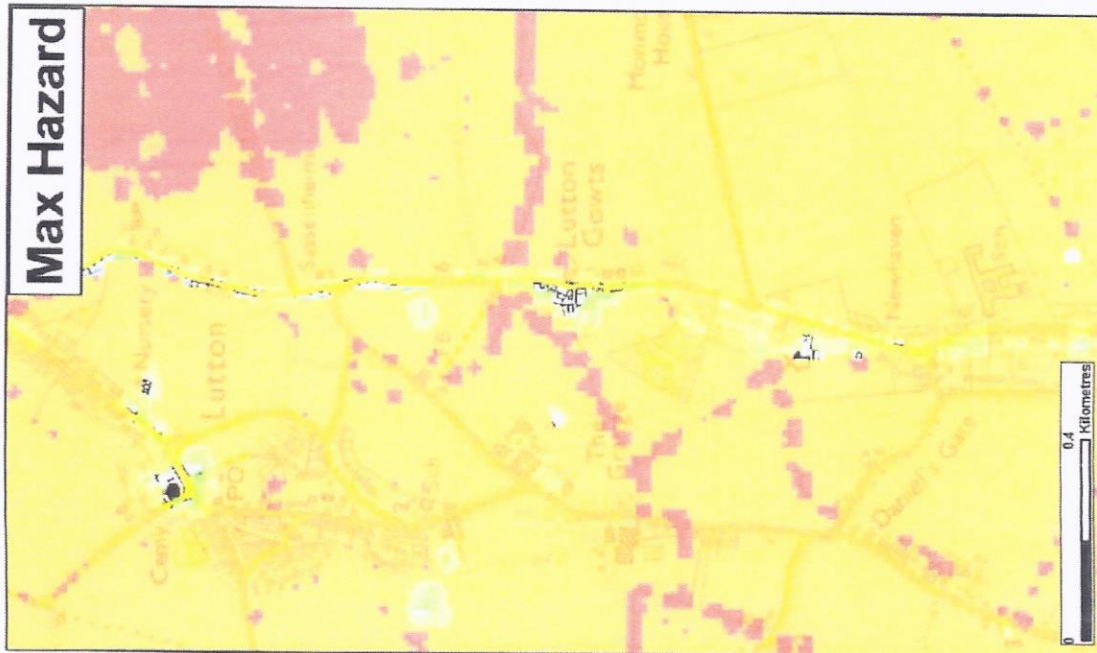

★ Modelled Breach Locations - see also the accompanying plan "Location of Modelled Breaches"			
Max Hazard (Flood Risk to People - F03320) Less than 0.75 (Low Hazard) Between 0.75 and 1.25 (Danger for Some) Between 1.25 and 2.0 (Danger for Most) Greater than 2.0 (Danger for All)	Max Depth (m) 0 - 0.25 0.25 - 0.50 0.50 - 1.0 1.0 - 2.0 2.0 +	Max Velocity (m/s) 0 - 0.3 0.3 - 1.0 1.0 - 1.5 1.5 - 2.5 2.5 +	Scenario Annual Chance 2115 0.1% (1 in 1000)
Date Printed November 2013	Scenario year 2115		

This map shows the level of flood hazard to people (called a hazard rating) if our flood defences are breached at certain locations, for a range of scenarios. The hazard rating depends on the depth and velocity of floodwater, and maximum values of these are also mapped.

The map is based on computer modelling of simulated breaches at specific locations. Each breach has been modelled individually and the results combined to create this map. Multiple breaches, other combinations of breaches, different sized tidal surges or flood flows may all give different results.

The map only considers the consequences of a breach, it does not make any assumption about the likelihood of a breach occurring. The likelihood of a breach occurring will depend on a number of different factors, including the construction and condition of the defences in the area. A breach is less likely where defences are of a good standard, but a risk of breaching remains.

General Enquiries No. 03708 506 506. Weekday Daytime calls cost 5p plus up to 6p per minute from BT Weekend Unlimited. Mobile and other providers' charges may vary.

Northern Area Tidal Breach Hazard Mapping

Map Centred on TF 43633 24805

This map is reproduced by permission of Ordnance Survey on behalf of The Controller of Her Majesty's Stationary Office. Crown copyright. All rights reserved. Ordnance Survey consent is given for individual users to make copies of this map for private use only. It is not to be used for promotional or other purposes.

