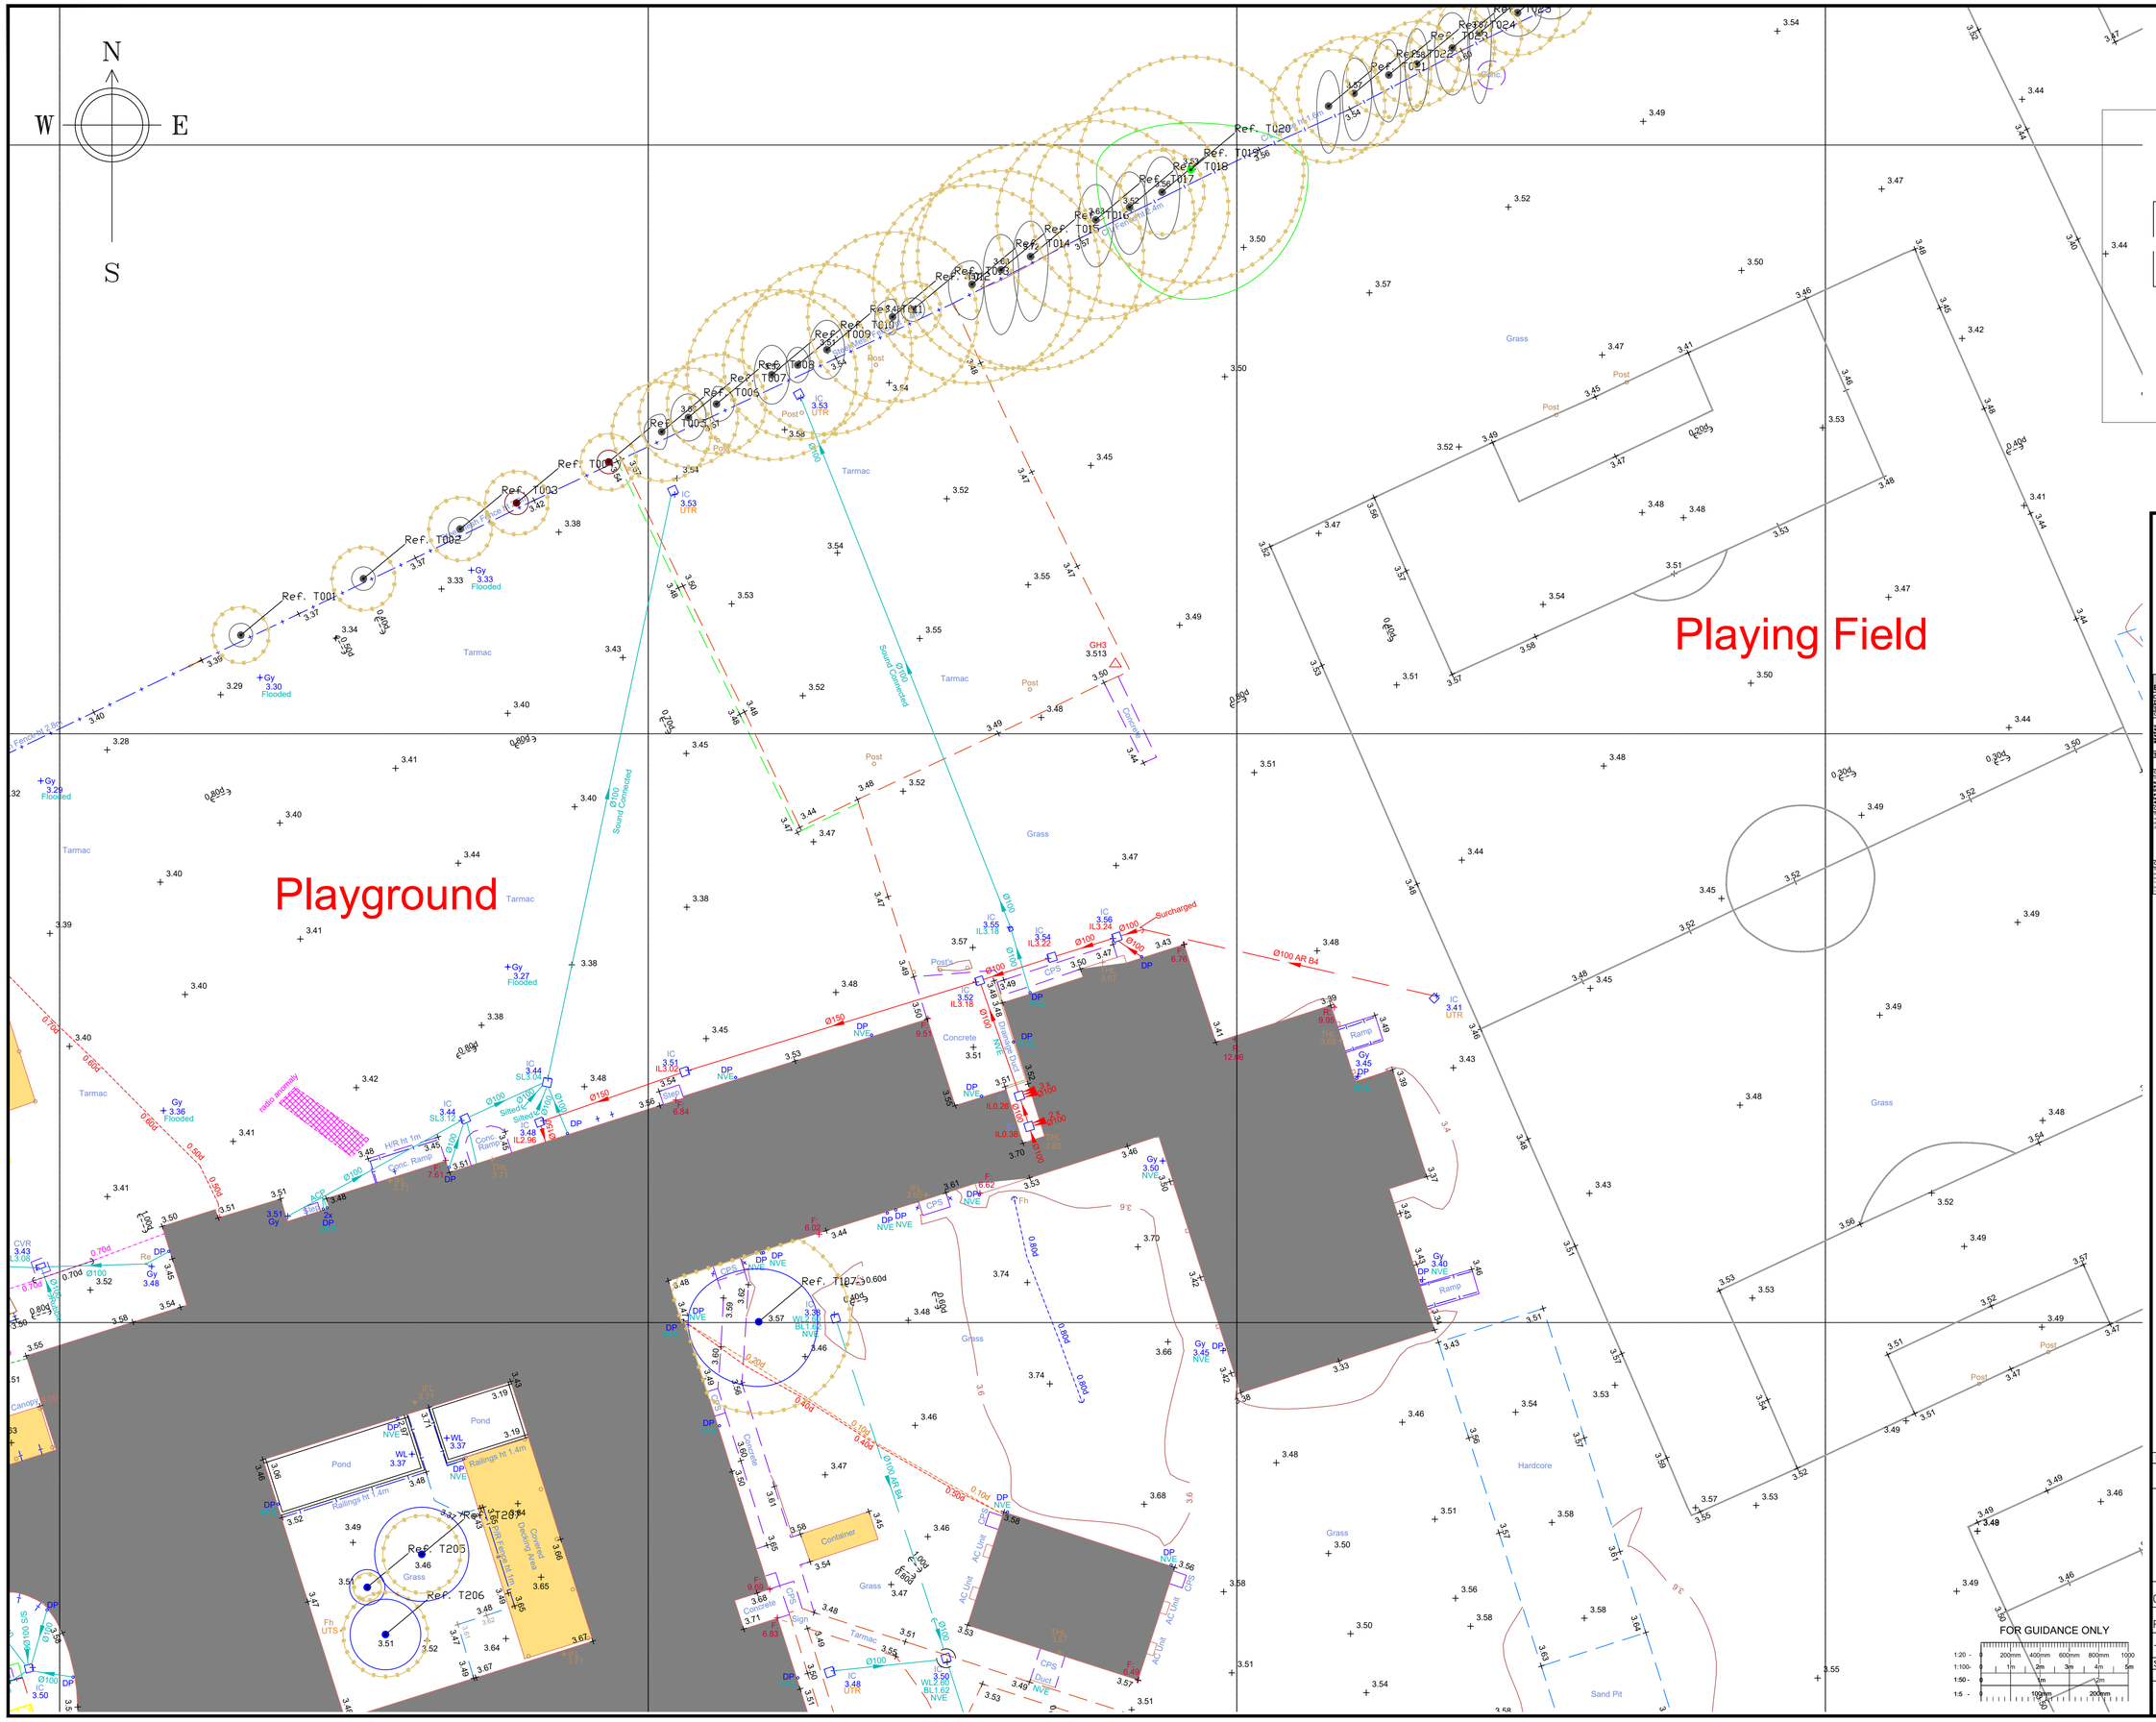

A1

This drawing has been prepared in accordance with BS 5837:2012.

This drawing is intended to be printed and used in colour only, and for no purpose other than the consideration of trees in accordance with BS 5837.

BS5837:2012 Cascade chart for tree quality assessment			
Category & Definition	Criteria (including subcategories where appropriate)		Identification on plan
Trees unsuitable for retention			
Category U			Red (on plan) RGB 187,0,0
Trees to be considered for retention			
	1. Mainly arboricultural qualities	2. Mainly landscape qualities	3. Mainly cultural values, including conservation
Category A			
Trees of high quality with an estimated remaining life expectancy of at least 40 years			Light Green RGB 0,255,0
Category B			
Trees of moderate quality with an estimated remaining life expectancy of at least 20 years			Blue RGB 0,0,255
Category C			
Trees of low quality with an estimated remaining life expectancy of at least 10 years, or young trees with a stem diameter below 150 mm			Grey RGB 191,191,191

KEY

- Root Protection Area (RPA)
- Tree Stem
- T1 Tree No.

Rev	Details	Date	Checked By

Drawing Number AEL-18654-TCP-5

APEX ENVIRONMENTAL

Apex Environmental Ltd
3 Lawrence Way, Lichfield, WS13 6RD
TEL. 0121 249 1255 e-mail: info@acd-treeconsultants.co.uk web: www.acd-treeconsultants.co.uk

Client Bowmer + Kirkland Limited

Project University Academy, Long Sutton

Title Tree Constraints Plan

Scale	Date	Drawn	Checked	Drawing No.	Rev
1:250	04/03/2024	RJH			B

THIS DRAWING IS CONFIDENTIAL AND MUST NOT BE REPRODUCED WITHOUT THE CONSENT OF APEX ENVIRONMENTAL LTD