Build on extensions in the manner shown.

Floor level, fascia line & roof pitch all to match existing.

Form opening between lounge & dining are as shown central of lounge. Support over with 1.G.L.I/S lintel or similar approved.

Existing bed 3 front window/to be blocked up as shown.

Build in new side window to proposed bed 2 as shown. Support over with 1.G.L.I/S lintel or similar approved.

Existing foul drains under proposed extension to be exposed & surrounded and surround in 150mm of concrete.

Make good to all disturbed and affected areas.

Provide box lintel over proposed hall at junction of flat roof & pitched roof to supply support.

Remove existing wall between kitchen and dining area as shown.

Roof/Wall Abutments
Provide Code 4 lead flashings and lap over roof covering. Dress up wall a minimum of 150mm (stepped on pitched abutments) and provide d.p.c. cavity tray to make completely watertight.

Flat Roof Construction (Cold Roof)
12.7mm white spar chippings bedded on bitumen on 3no. layers built up felt (first layer asbestos based) on 12mm external grade plywood decking on 50mm to 0mm timber firrings securely spiked to treated timber joists (size stated on drawings). Provide 30 x 5mm mild steel anchor and lateral restraint straps to joists fixed to walls at maximum 1200mm c/c. Extend joists past wall and provide suitably sized fascia board, complete with soffit board. Provide proprietary ventilation to soffit to offer equal to a 25mm continuous gap along eaves. Lay between joists proprietary 150mm thick insulation maintaining a 50mm air gap between insulation and plywood. Form all necessary felt drips including tilting fillets and keep felt drips clear of fascia boarding. If flat roof intersects with pitched roof ensure flat roof felt laps under felt of pitched roof by a minimum of 600mm.

Flat roof joists to be 100 x 50 SC3 grade at 400 centres.

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Valleys
Use proprietary fibreglass valleys or provide Code 4 lead to valleys to make completely watertight.

Kitchen Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 60l/sec. Alternatively provide proprietary cooker hood capable of extracting 300l/sec.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 500mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5839 Part 6, 2006 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half-round gutters and 68mm diameter downpipes.

Habitable Room Trickle Ventilation
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible joined to felt 1/70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening in eaves level to be L1/E lintels by I.G. or similar approved.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Foundations
As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be S15 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with Pilkington 'K' glass or similar approved, to achieve either WER Band C or a 'U' value of 1.6W/m²K.

Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:-
a) an electrical installation certificate issued under a competent person's scheme has been issued
or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

Protection to Underground Pipes
Where pipes are set under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

Roof Construction
Roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 23 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall in verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete gallstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 4I.T.P.A. with timber support members to span 4 no. trusses.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Ground Floor Construction
65mm sand/cement screed on 100mm Celotex insulation with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to tap floor d.p.m. by a minimum of 50mm.

External Cavity Wall Lintels for 300mm Cavity Walls
IG type L1/S100 unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Internal Lintels
IG type Internal 100mm lintels to openings in 100mm internal walls unless stated otherwise.

Purge ventilation to windows
For a hinged or pivot window that opens 30° or more the height and width should be at least 1/20th of the floor area of the room.
For a hinged or pivot window that opens less than 30° the height and width should be at least 1/10th of the floor area.

Background Ventilation
Background ventilation is to be provided by trickle ventilators to the tops of windows. Use trickle vents offering 8000mm² per window head. Ventilation for whole extension to be 50,000mm²

External Wall Construction (300mm cavity)
100mm facing brickwork (see site plan for details)
100mm Cavity with ISOVER, HI-CAV 52 insulation
100mm inner skin of tarmac Hemalite blocks
Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243;1978. Internal block walls to receive 10mm sand/cement render and skim. Robust details in accordance is T50,2001

At junction of new roof to existing house wall provide proprietary ventilation system to give 10mm continuous gaps and to be lead flashed to be completely watertigh.

Brickwork below d.p.c. to be F.L. quality

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

Smoke detectors to be to BS5839/6:2004, Grade D, Category LD3.

Existing kitchen French doors to be removed and opening to be bricked up.

Existing foul drains where under proposed extension to be exposed and encased in 150mm concrete.

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Status Design Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundations work is undertaken.

Please note this drawing is not a conveyance drawing

Proposed ensuite soakaways to be maintained by the owner for the life duration of the property.

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document also. The works will not be supervised or inspected by Status Design unless specifically instructed to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc


All materials to be new unless stated otherwise and all components and accessories, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 2015 (CDM) and Health and Safety at Work etc. Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.


The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred to necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.


It is the property/landowner's responsibility to be aware of the Party Wall, etc. Act 1996 when building or carrying out alterations in close proximity to adjoining neighbour's boundaries.

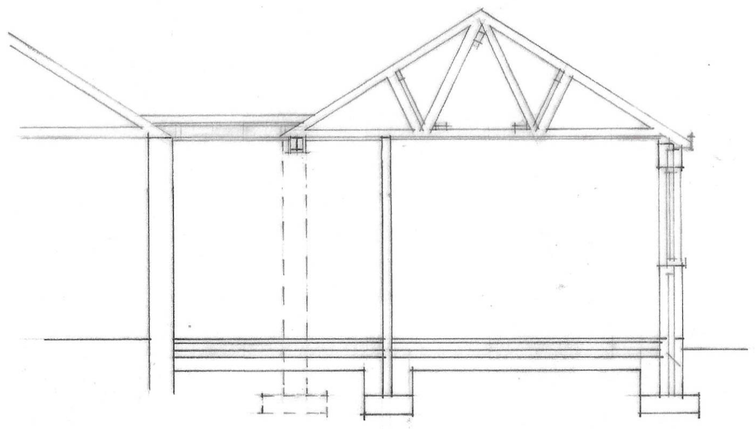

SECTION A-A

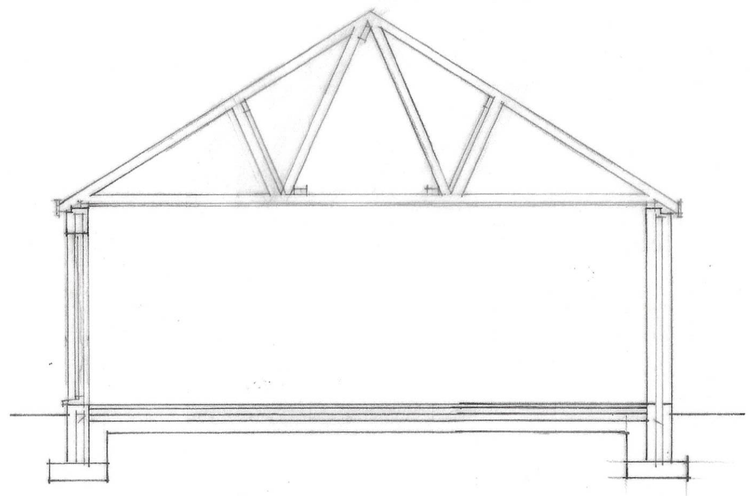

SECTION B-B

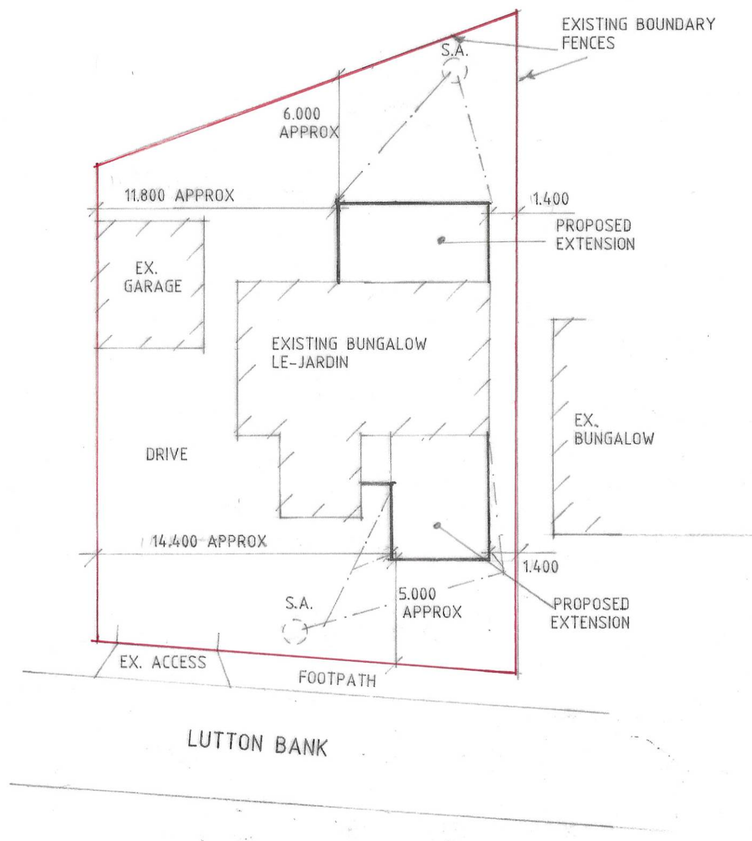

THIS DRG. TO BE READ IN CONJUNCTION WITH SD21-041/1, SD21-041/2

A - ALTS - 25.2.22

Status DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED EXTENSIONS AT LE-JARDIN, LUTTON BANK, LUTTON FOR

MR. R. DAY.

SECTIONS/SITE PLAN

1:50 1:200	SD21-041/3
JAN-22	B.GILHAM.

7 Edinburgh Walk, Holbeach, Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702