General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other that that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.


This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practise. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.


The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

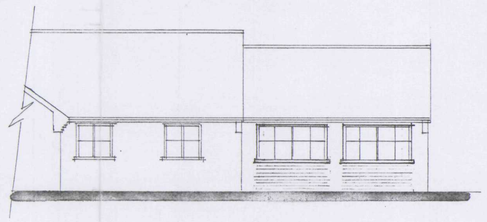

SIDE ELEVATION

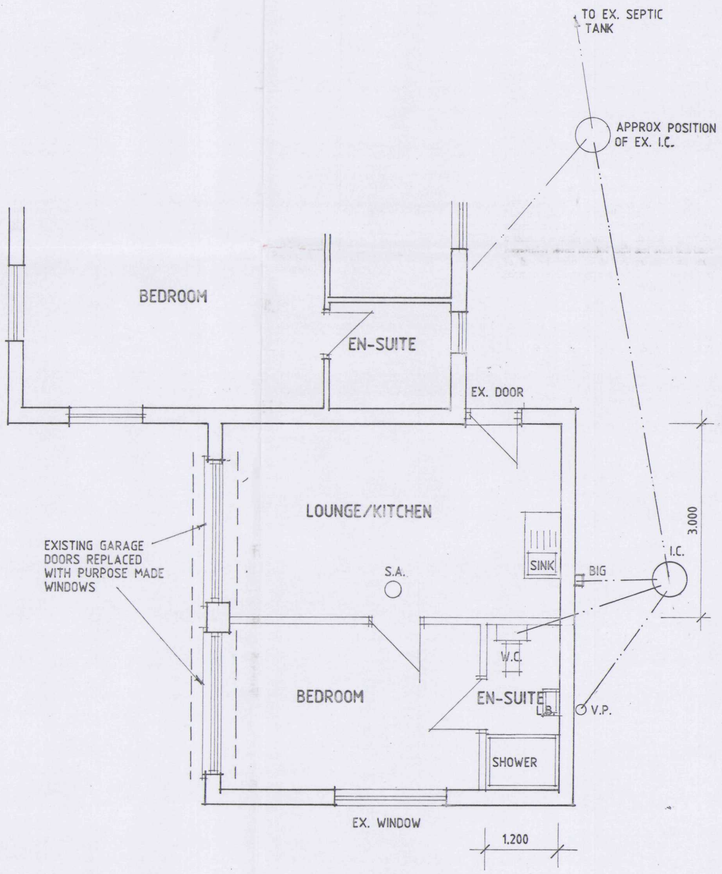

FLOOR PLAN

Existing double garage to be converted to create a self-contained one-bed annexe.

Existing floor to be levelled up as necessary and treated with 2 no. coats of Synthaprufe waterproofer. Floor then to be covered with 60mm Celotex insulation and 19mm Weyroc floor grade moisture-resistant decking.

Provide 100mm stud partitions in positions shown with internal doors to create room separation.

Foul drains to be connected to existing foul drainage system as shown. Check depth of existing drainage system for adequacy. If found to be inadequate connect foul drains direct to existing septic tank.

Ensure existing roof has suitable eaves ventilation equivalent to a 10mm continuous gap along eaves.

Kitchen Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 60 lt/sec. Alternatively provide proprietary cooker hood capable of extracting 30 lt/sec.

Bathroom/En-suite Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 15 lt/sec. System to offer intermittent operation.

Heating System
Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Habitable Room Trickle Ventilation
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

Kitchen/Utility/Bathroom/WC Trickle Ventilation
Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.25 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Foul Water Drainage
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Protection to Underground Pipes
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab concrete.


Inspection Chamber Construction
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

Existing garage doors to be removed and cavity wall to be built up to sill of new purpose-made double-glazed windows to fit existing opening width.

Facing bricks to match those of existing building.

Wall Construction
275mm cavity walls to consist of:
100mm face brickwork (see site plan for details), 75mm cavity to be filled with Crown Dritherm full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved, 100mm internal skin of Celcon standard blocks or similar approved to give 0.35 U/value. Cavity walls tied together using galvanised iron or plastic twist ties spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

Foundations
As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

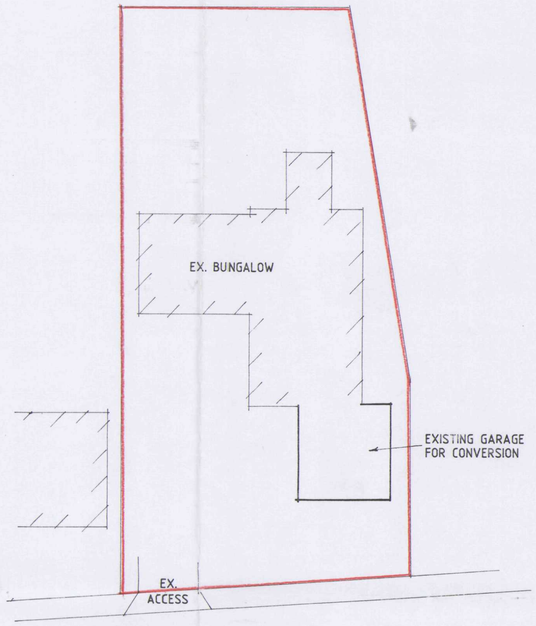

SITE PLAN

DETERMINED PLAN

SHDC Planning & Development
19 OCT 2004
Ref: 1402/04

A - MINOR ALTS - 16.10.04

Status DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED CONVERSION OF EXISTING DOUBLE GARAGE TO SELF CONTAINED ANNEXE AT 45 LIME WALK, LONG SUTTON FOR

MR. & MRS. ASHTON.

1:50 1:100 | SD04-093/1
1:200 |
OCT-04 | B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702