



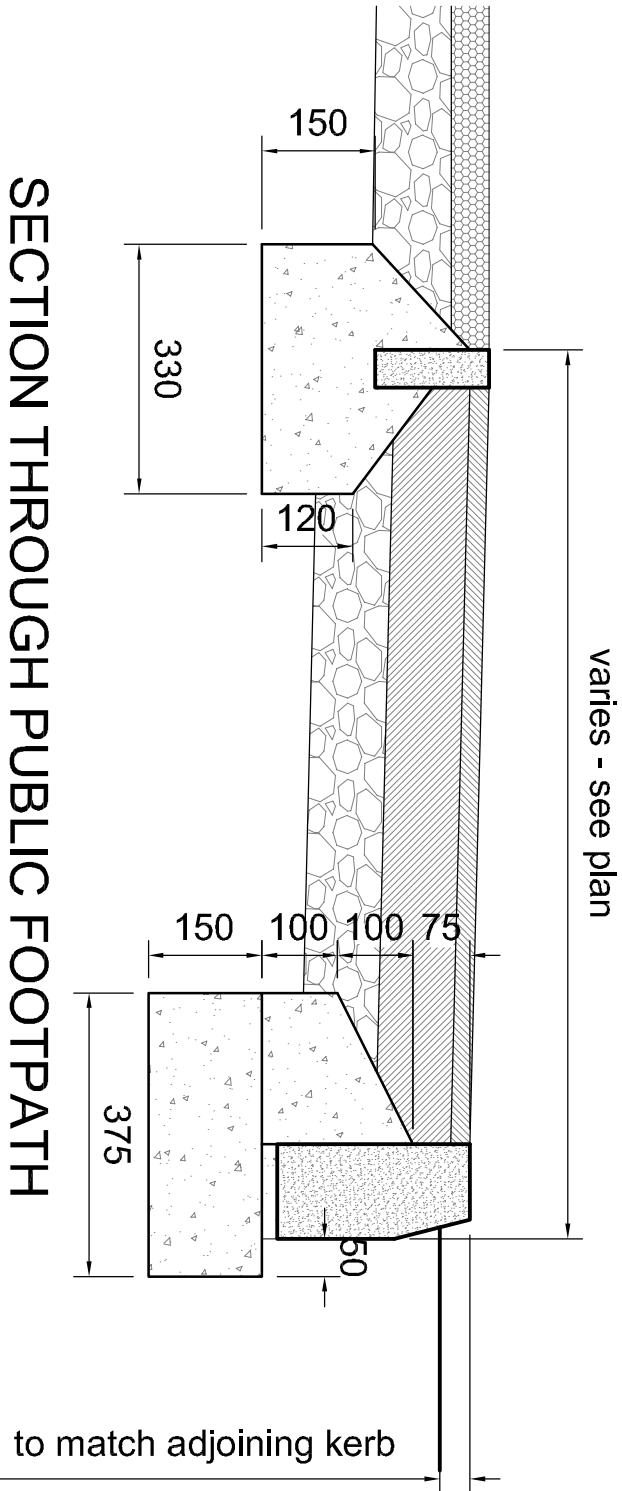

FOOTPATH SPECIFICATION - TO LCC REQUIREMENTS


- *100mm of Type 1 sub-base to Clause 1.2
- *100mm of 20mm size Dense, 70/100 or 100/150 Binder Course (AC 20 dense bin rec) to Clause 9.1 compacted to a void content within the range 2%-10%.
- *25mm of firm size Dense 70/100 or 100/150 Surface Course (AC 6 dense surf) to Clause 9.4 compacted to a void content within the range 2%-10%.
- *The Surface Course must be bonded to the Binder Course.
- *Crossfall to be 1:30 towards carriageway
- *Precast concrete Kerbs and edgings to be to BS EN 1340:2003
- *Concrete bed and backing to grade ST3 to clause 12.1
- *Prepared formation to be sprayed with an approved weedkiller

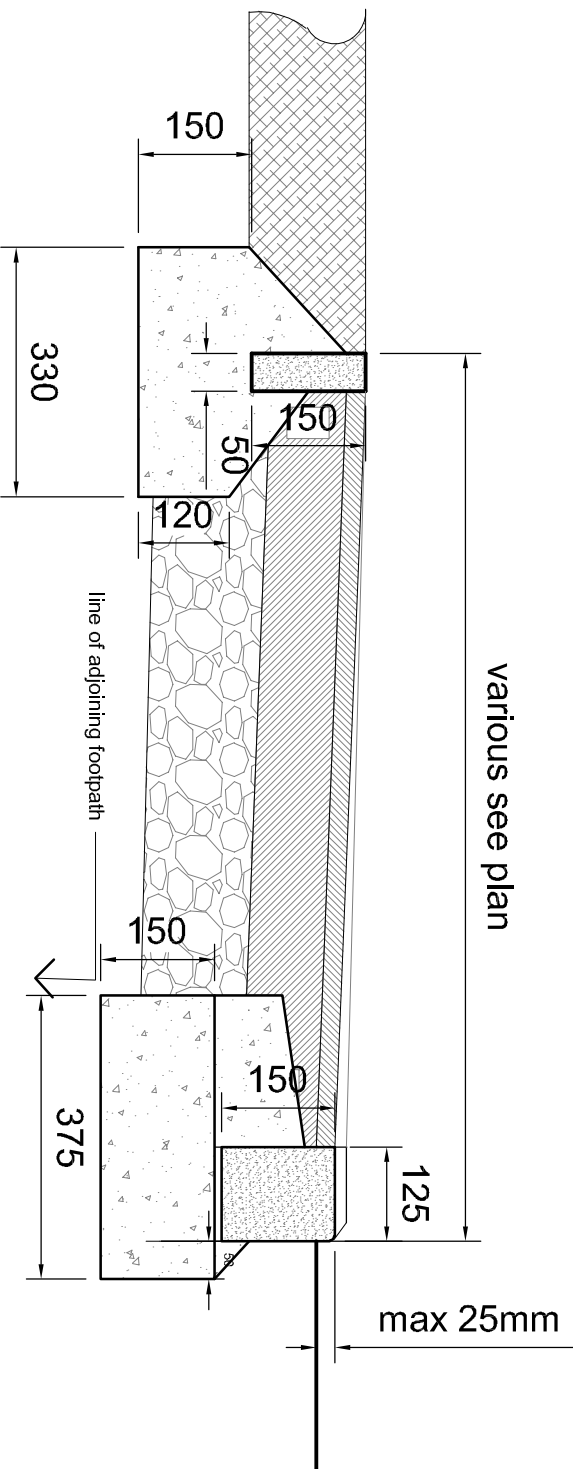

SECTION THROUGH CROSSOVER

1.6 VEHICLE ACCESS CROSSINGS

- 1.6.1 Light Duty (Domestic) crossings
- 1.6.1.1 150mm of Type 1 sub-base to Clause 1.2. (NB where the CBR value of the sub-grade is below 1.5% an approved geosynthetic layer to Clause 6.7 will be required to be placed on the sub-grade). On certain sites the depth of topsoil may exceed 275mm. On such sites topsoil containing organic matter, roots, etc. shall be removed and replaced with Type 1 sub-base in accordance with Clause 1.2.
- 1.6.1.2 100mm of AC20 Dense Bin Rec Binder Course 40/60 or 100/150open to Clause 9.1 compacted to a void content within the range 2%-10%.
- 1.6.1.3 25mm of AC6 Dense Surf Surface Course to Clause 9.4 compacted to a void content within the range 2%-10%.
- 1.6.1.4 The joint between the access crossing and the carriageway shall be formed with 125mm x 150mm precast concrete kerbs on a 150mm x 380mm base of ST4 (20N/mm²) concrete (approximately 1 cement: 2 sand: 4 aggregate by volume mix). A 125mm x 150mm x 225mm taper kerb will be required on each side of the crossing along the carriageway edge.
- 1.6.1.5 The highway boundary shall be delineated across the access crossing with 50mm x 150mm square cut precast concrete edging on a 75mm x 330mm base of ST4 (20N/mm²) concrete.

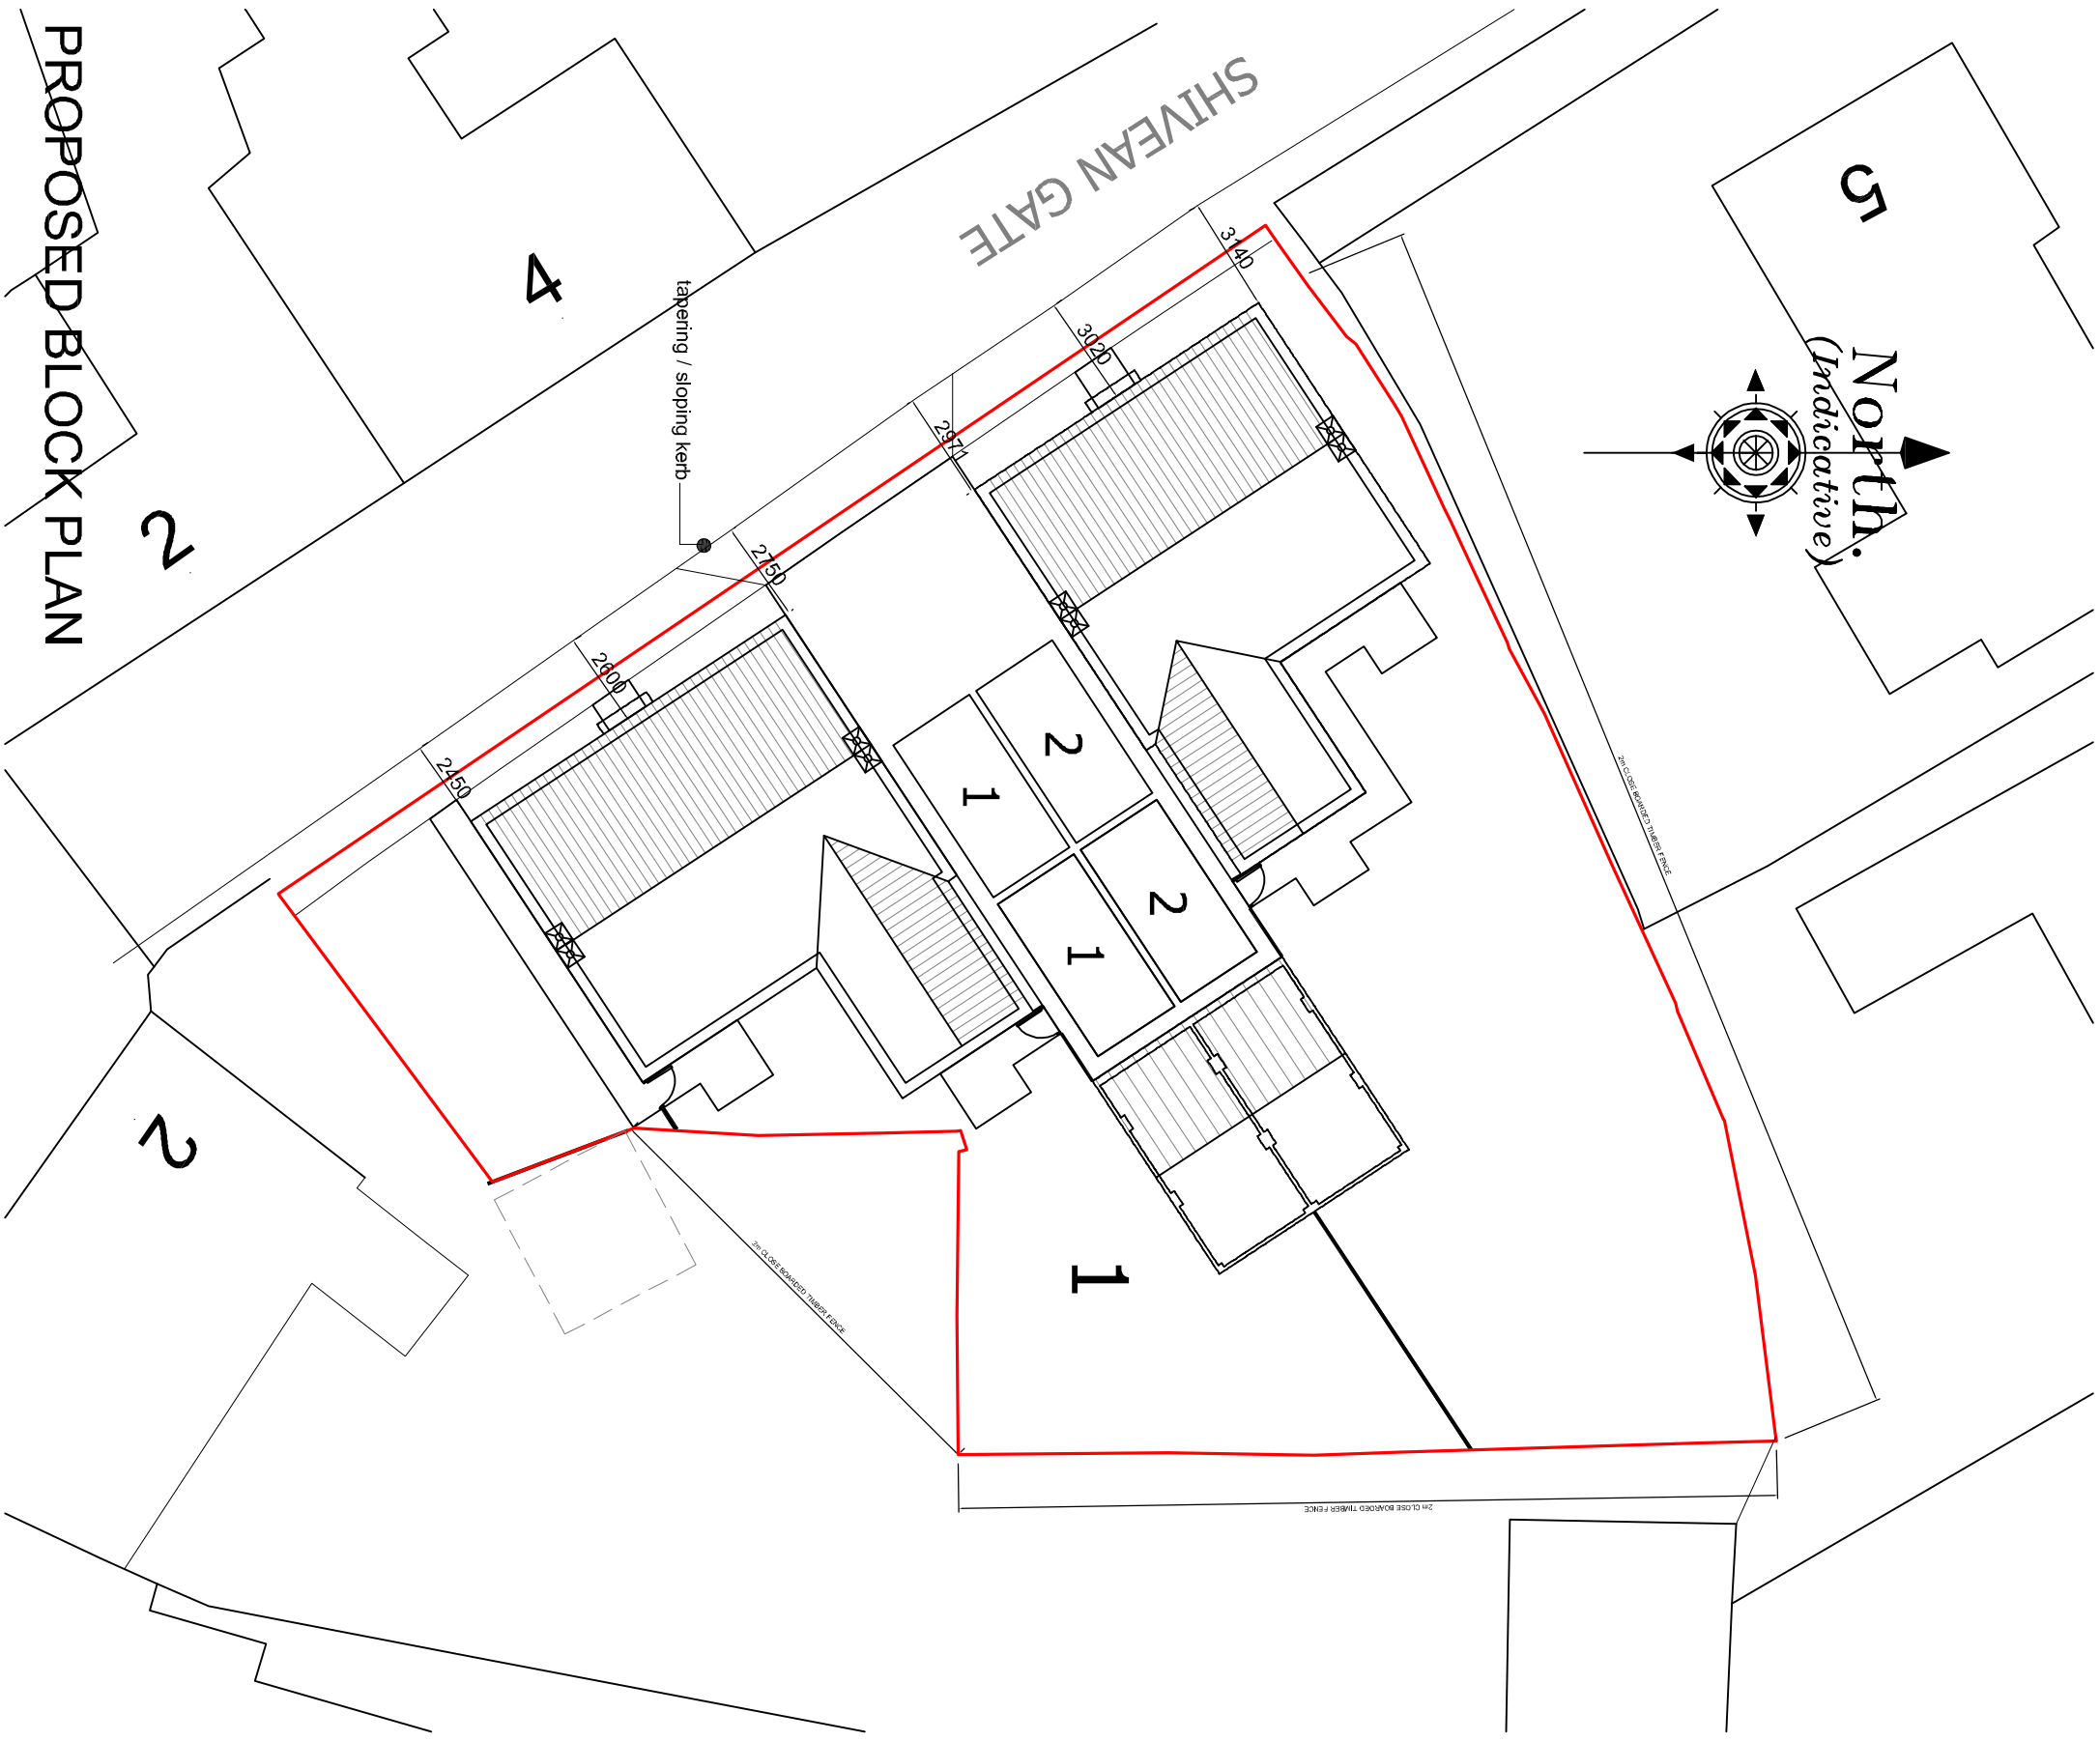

PROPOSED BLOCK PLAN

Revision	Date	Drawn	Description
----------	------	-------	-------------

Client Tawny Homes

Project Erection of 2 Dwellings - 3 Shivean Gate, Moulton Spalding

Drawing Condition Compliance - Condition 15

Scale 1:10, 1:200 @ A2 Drawn AWM Checked TAC Date 26/04/2024

Drawing No.

22/613/PA/002



Trevor A Clay RIBA Ltd, 14 Old Fendike Road, Weston Hills, Spalding, Lincs. PE126DD
01406 380027 trevor@tacarchitects.co.uk www.tacarchitects.co.uk