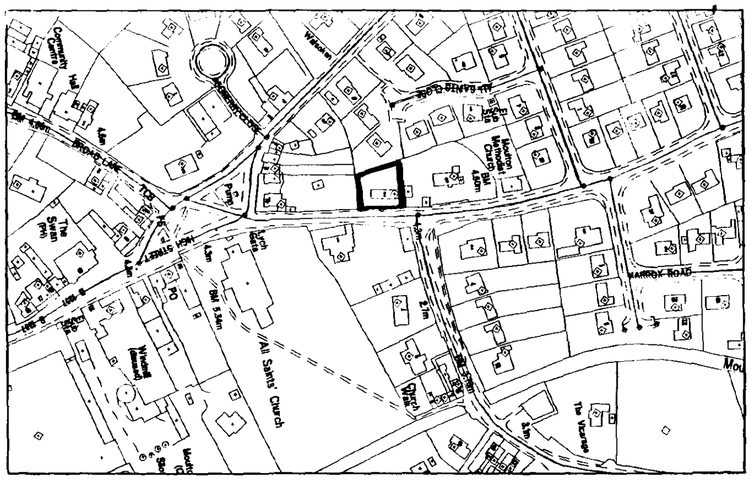
REMOVE EXISTING TIMBER FENCING AND PUT ASIDE EXISTING METAL GATE FOR RE-USE
EXCAVATE FOR FOUNDATIONS 750 MM BELOW GROUND LEVEL (1·0 M IN CLAY)
AND PROVIDE 500 MM WIDE X MIN 225 MM CONCRETE STRIP FOUNDATIONS
CARE MUST BE TAKEN TO AVOID ANY SERVICES DURING EXCAVATION AND ENSURE FOOTINGS
BASE IS BELOW ANY EXISTING FOUL OR S.W. DRAINS INVERT. PROVIDE 50 MM GAP AROUND ANY PIPE
TO BE FILLED WITH COMPRESSIBLE MATERIAL AND LINTEL OVER.
SUB-STRUCTURE WALLING IN CLASS 'A' CONCRETE BLOCKWORK IN 1:3 CEMENT/SAND MORTAR
PROVIDE D.P.C. TO WALLS 150 MM ABOVE GROUND LEVEL
WALLING IN 225 MM THICKNESS RECLAIMED FACING BRICKWORK IN ENGLISH BOND (1:2:9 MORTAR)
(ALTERNATING COURSES OF HEADERS AND STRETCHERS) TO TERMINATE 1·8 M HIGH IN BLK ON EDGE
COPING ON 2 COURSE PLAIN TILE CREASING


Community Hall
Warden
ALL SAINTS CLOSE
Pump
Mission Church
Sch
Sch
Sch