




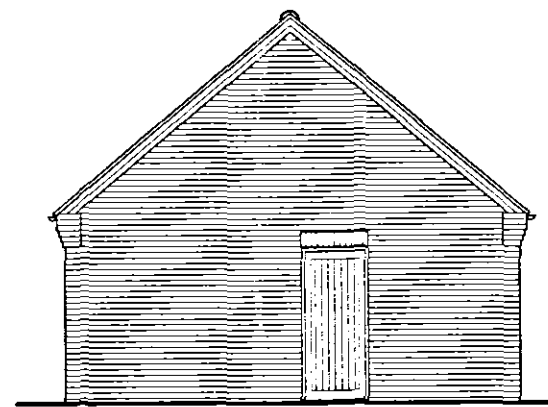


SIDE ELEVATION

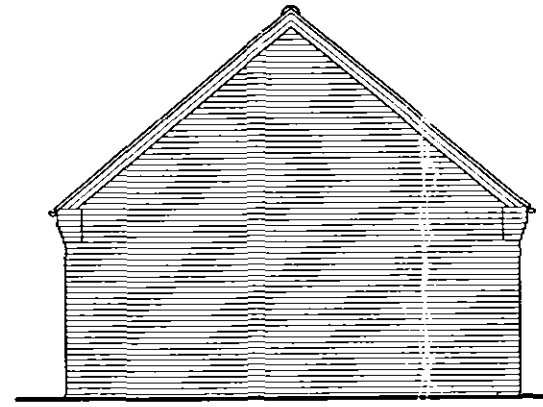

SIDE ELEVATION

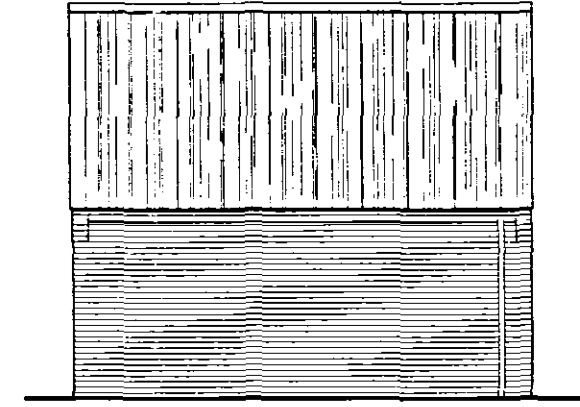

REAR ELEVATION

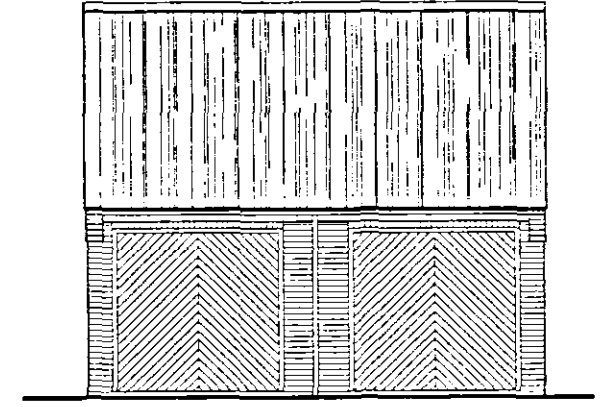

FRONT ELEVATION

PITCHED ROOF CONSTRUCTION.
Interlocking concrete roof tiles to match existing to B.S. 475 part 2:1971, on 25 x 38 softwood treated battens on underfelt to B.S. 747 (type IF) and in all cases to be lapped by 150mm both vertically and horizontally. Tiles to be laid with min. headlap of 75mm and to be fixed in accordance with regard to wind speed, roof pitch and exposure category as detailed in CP3 chapter V part 2:1972. Twinplate specialist made prefabricated roof trusses to comply with B.S. 5268 part 3:1985. TRUSS CALC'S TO BE SUBMITTED TO L/A MIN. 28 DAYS PRIOR TO ERECTION. Trusses to be at 600c/c to a pitch of 35 deg. CHECK ON SITE. 38 x 100 ridge node binder. 38 x 100 ceiling binder. All trusses to be strapped to wall plate by 50 x 5 galvanised metal straps acting as anchor and lateral restraint straps at max. 1.5m c/c. Note: provide solid bracing beneath straps. 50 x 100 wall plate bedded on sand and cement. 25 x 175 fascia boards. 6mm ext. grade plywood soffit complete with 10mm wide continuous air gap and fly proof screen. All

WALLING.
Face brickwork to B.S. 3921:1974 for clay bricks and B.S. 187:1978 for calcium silicate bricks. 100mm Tarmac Hemelite insulation block to form 215mm wall

SUB STRUCTURE WALLING.
2 x 100mm dense concrete blocks to B.S. 6075 pt.1:1981. DPC to external wall positioned in accordance with CP 102 min. 150 above finished ground level. Brickwork below d.p.c. to be F.L. quality.


GROUND FLOOR CONSTRUCTION.
Strip all vegetable soil and lay floor as follows: 100mm 514 mix concrete oversite on 1200q polythene D.P.M. lapped continuous with D.P.C. by min. 100mm. 150 bladed and consolidated hardcore

FOUNDATIONS.
Under walls as shown provide strip concrete foundations as follows: Under 215 walls provide 225 x 600 all 514 mix to B.S. 5528:1990
All foundations taken down to bear on load bearing strata min. depth of 600 to top of foundations: should shrinkable soil conditions be found on site then foundations shall be taken down to a depth of 1 metre below ground level.


SURFACE WATER DRAINAGE.
115 dia. half round rainwater gutters to 65 dia. rainwater pipes 82.4 dia. underground pipes flexibly joined to a fall of 1:70 pipes bedded and surrounded in pea gravel and discharge to 1.2m dia. soakaway min. 5.0m from dwelling.

LINTELS.
All lintels to be manufactured by Messrs. I.G. and to be installed in accordance with makers' instructions, and to have min. end bearing of 150mm and at external positions to have cavity tray D.P.C. to CP. 121. Lintels in garage to be underlined with 12.7 fibre board or receive 12mm render and skim.

STANDARDS.
All materials to be new unless otherwise stated and all components and materials etc. to be used fitted and installed etc. in strict accordance with manufacturers instruction and relevant Code of Practice. Materials shall conform to appropriate British Standard Specification or BBA Certificate or European Code equivalent.

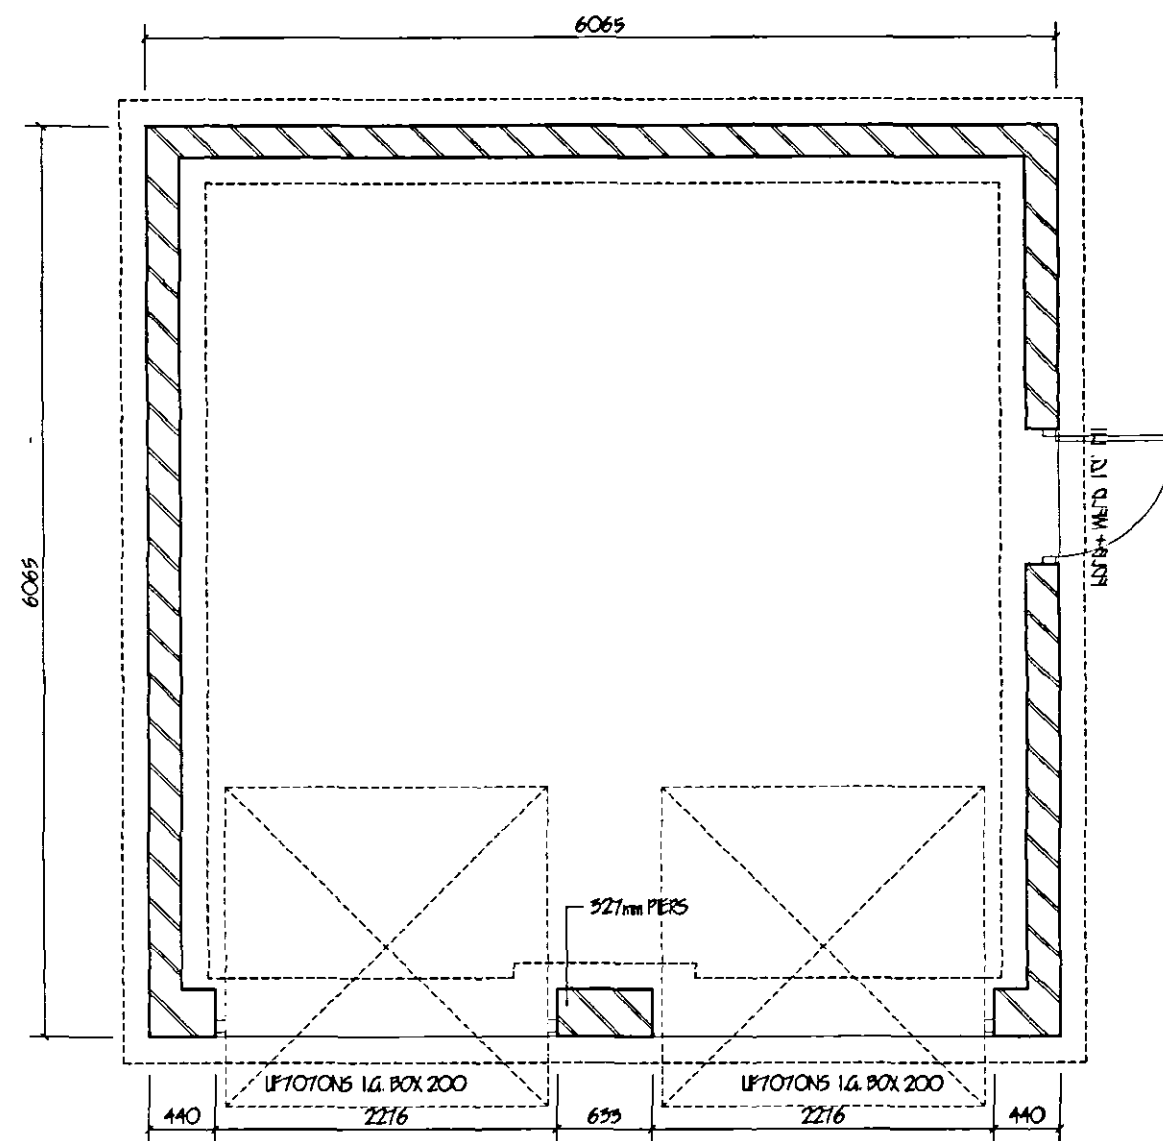

FLOOR PLAN

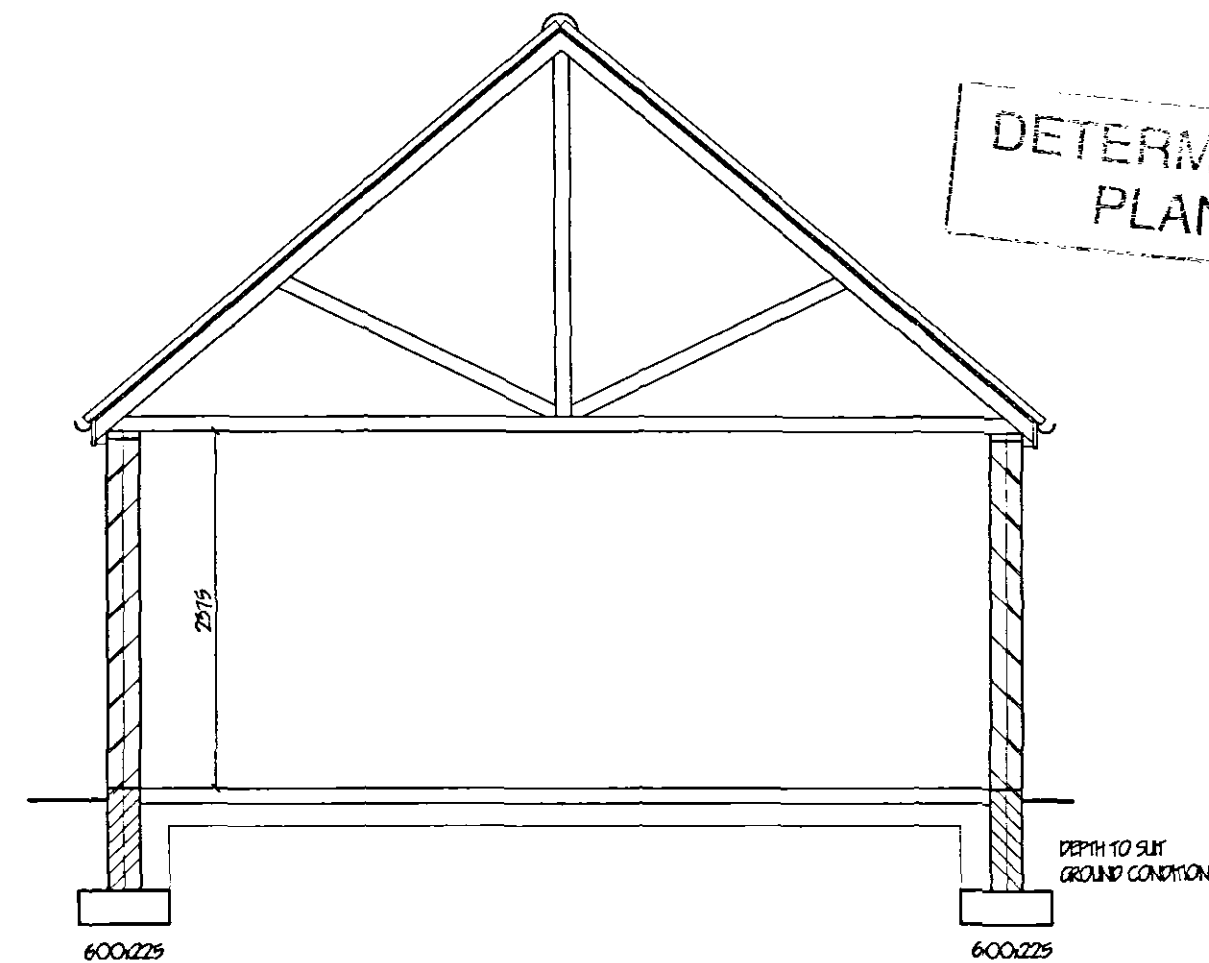

SECTION

PLOT 1

ref.	revision	date

G. R. MERCHANT
I.ENG AMICE FIWO
**ARCHITECTURAL, STRUCTURAL
AND LAND DRAINAGE
CONSULTANTS**
Unit 4, Wrights Mews
12A Park Road, Holbeach,
Spalding, Lincs. PE12 7BX
Tel: 01406 490900
Fax: 01406 425744
E-Mail: G. R. Merchant @ Merchant. FS.
Co. UK

Project
DOUBLE GARAGE
Rear of 30 SEAS END ROAD,
MOLLTON-SEAS-END,
SPALDING, Lincs.

Client
S&S DEVELOPMENTS LTD

Drawing
FLOOR PLANS / ELEVATIONS / SECTION

Job Ref.
1439/06

Drawing No.
07.

Date
APRIL '06.

Drawn
G.R.M.

Scales
1:50 1:100

DO NOT SCALE FROM THIS DRAWING
This drawing is copyright and may not be altered, copied, photographed or used for any other purpose other than that for which it is issued.
The General Contractor is to check all dimensions on site and report any discrepancies to the Architect.
All details shown on this drawing including foundations are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions which may be discovered during construction unless reported to the Architect so that design amendments may be considered. Site and surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

1533/06