




© Crown Copyright 2009. All rights reserved. Licence number 100020449. Plotted Scale - 1:1250

SHDC
Planning & Development
12 JAN 2010
Ref: 0024-10

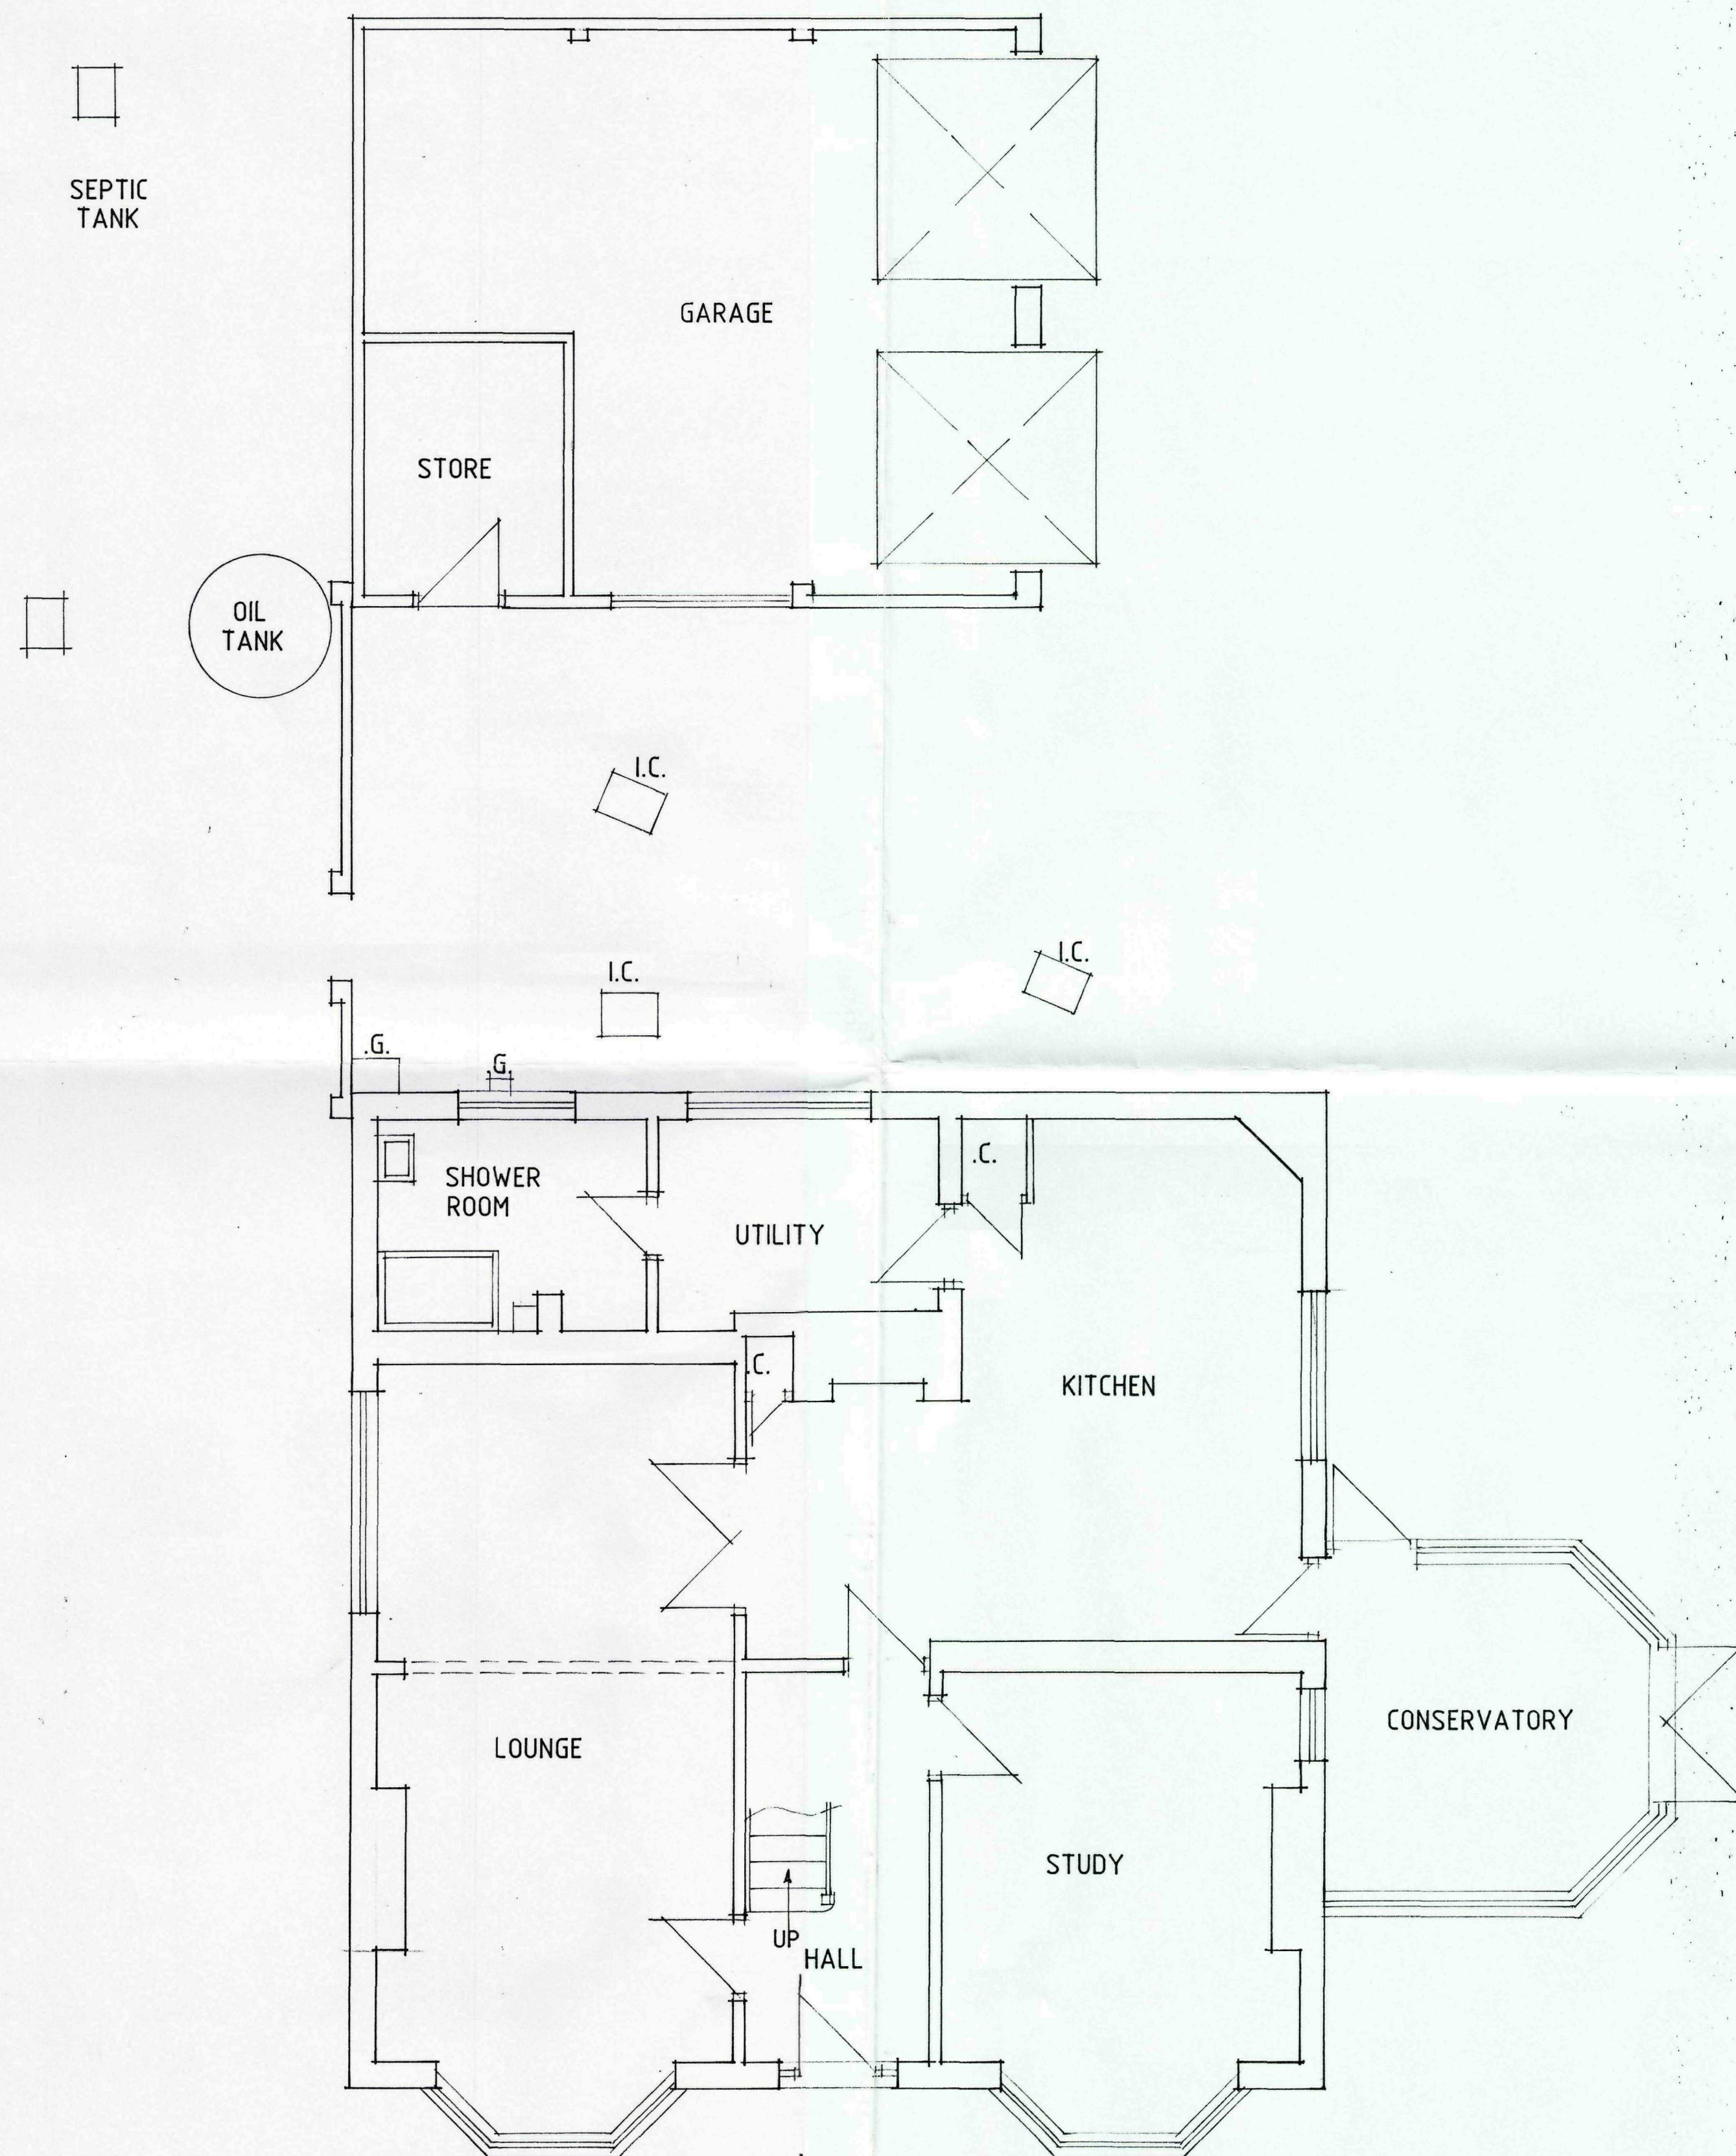


GROUND FLOOR PLAN




FRONT




SIDE

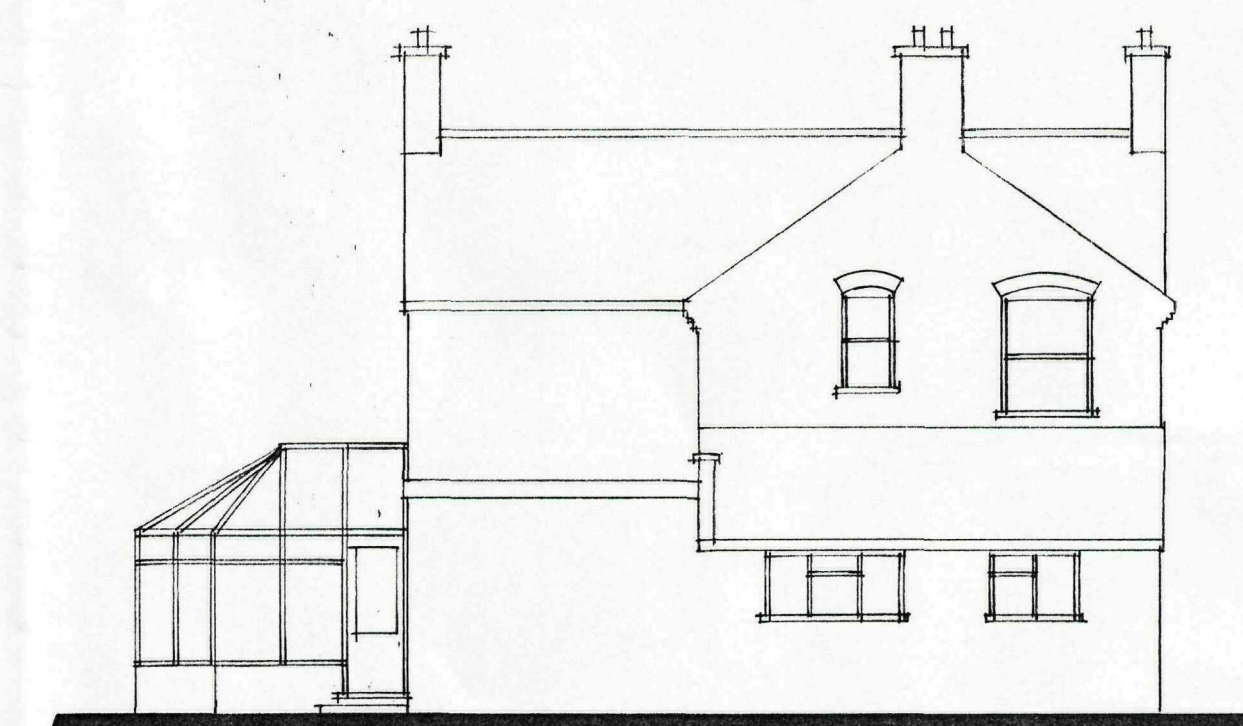

REAR

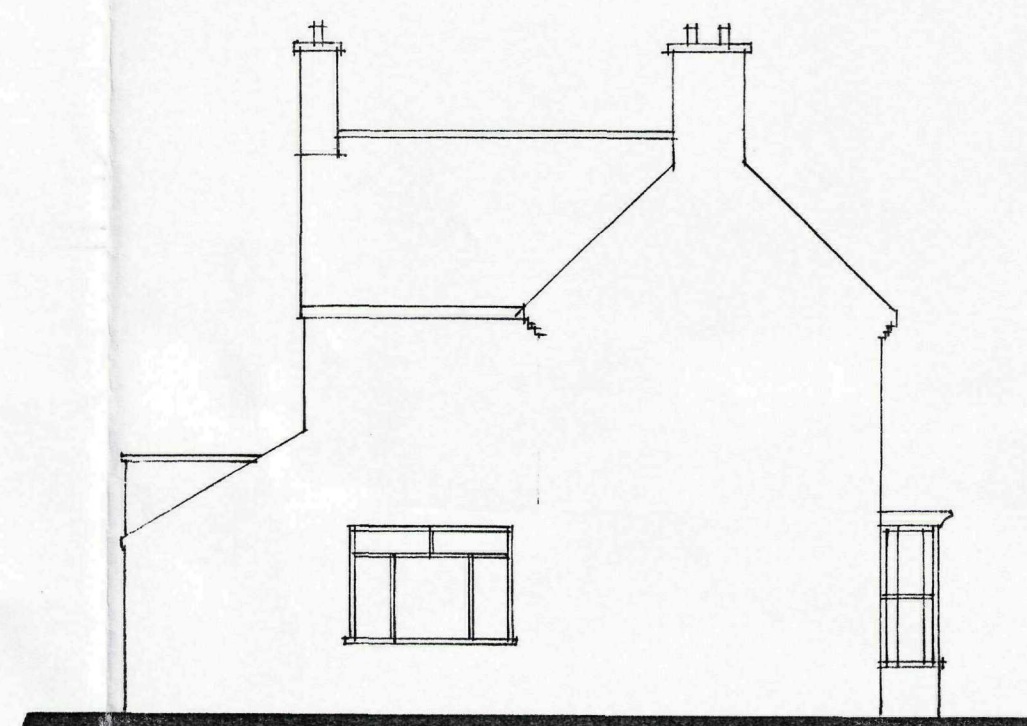

SIDE

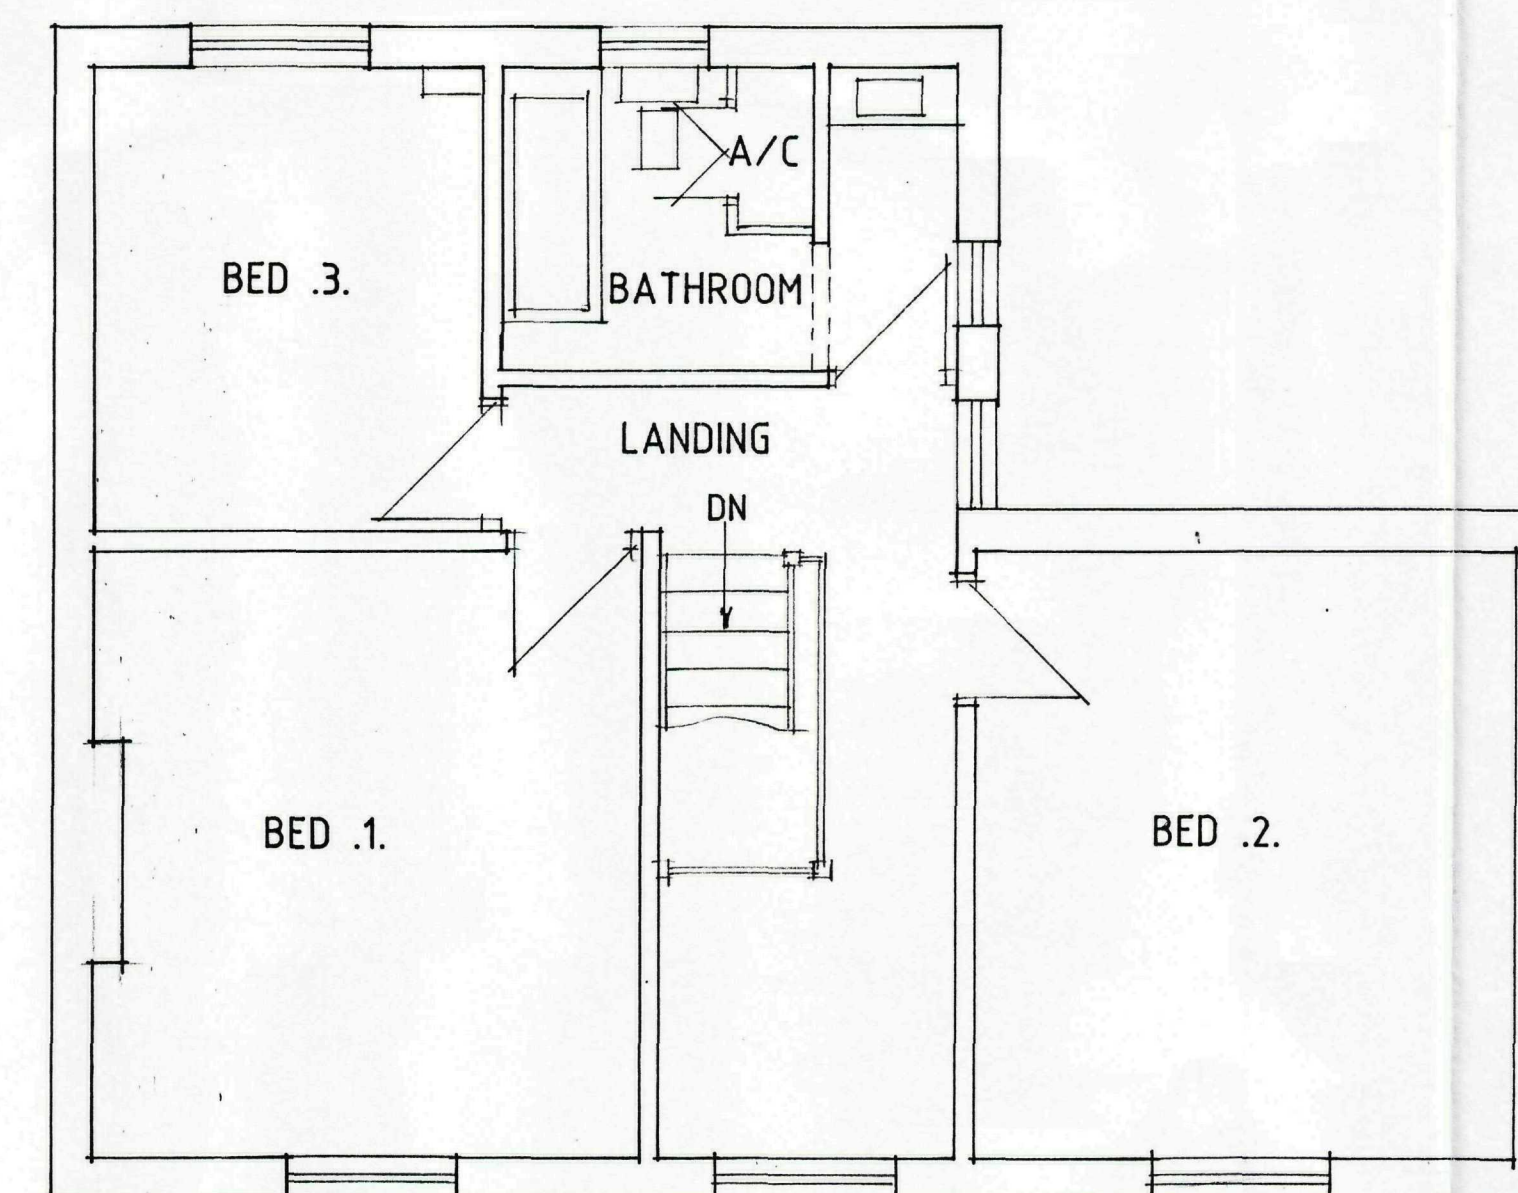

FIRST FLOOR PLAN

SHDC
Planning & Development
12 JAN 2010
Ref: 0024-10

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED ALTERATIONS,
EXTENSION & NEW GARAGE
AT WEMBLEY HOUSE,
DOZENS BANK, WEST
PINCHBECK FOR


MR. & MRS. S. ALLARD.


PLAN AS EXISTING

1:50 1:100 SD09-029/1

AUG-09 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702



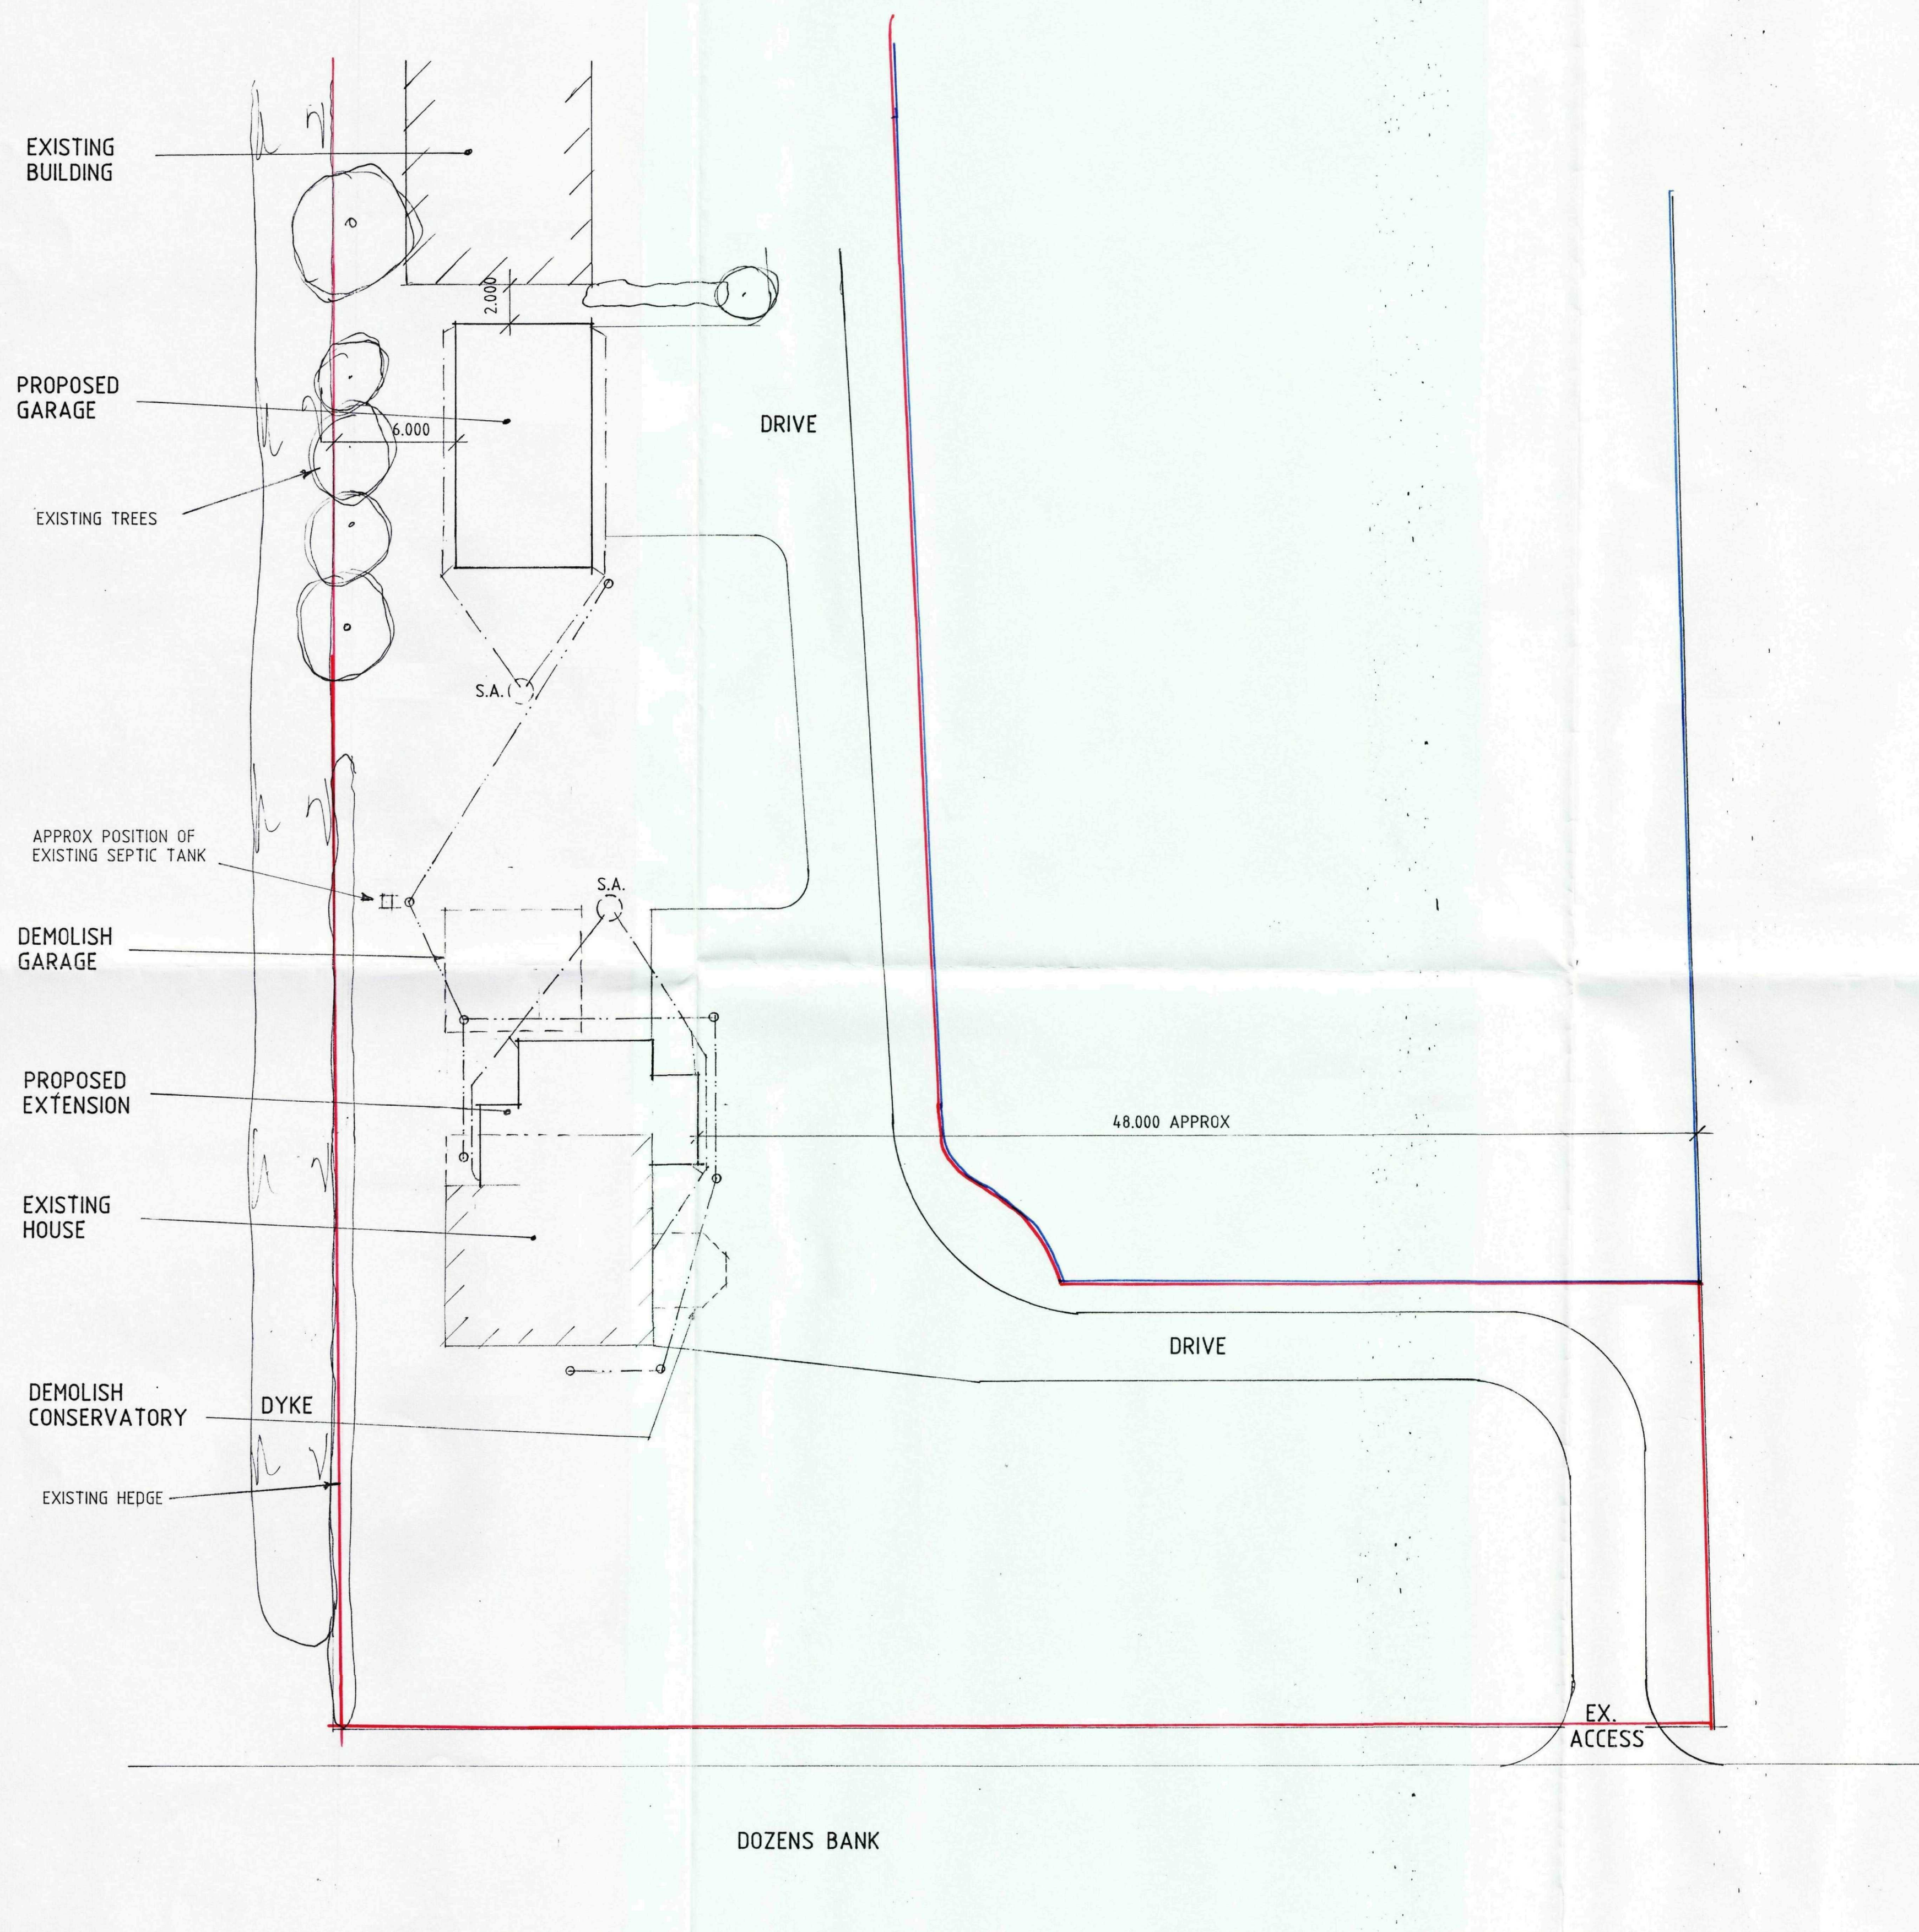

SITE PLAN

THIS DRG. TO BE READ IN CONJUNCTION WITH
SD09-029/1, SD09-029/9, SD09-029/10, SD09-029/11, SD09-029/12
THERMAL DETAILS MC1-RE-01, MC1-WD-03, MC1-WD-04, MC1-WD-05.
SRC LETTER DATED 5.10.09 REF 30909 & SCHEDULES 30909/SK, 30909/BH1 & 30909/BH2

D - IMF. ADDED - 16.12.09
C - DESIGN ALTS - 30.11.09
B - ALTS - 9.11.09
A - IMF. ADDED - 12.10.09

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

SHDC
Planning & Development
12 JAN 2010
Ref: 0024-10

PROPOSED ALTERATIONS,
EXTENSION & NEW GARAGE
AT WEMBLEY HOUSE,
DOZENS BANK, WEST
PINCHBECK FOR



MR. & MRS. S. ALLARD.

SITE PLAN

1:200 SD09-029/3
AUG-09 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702



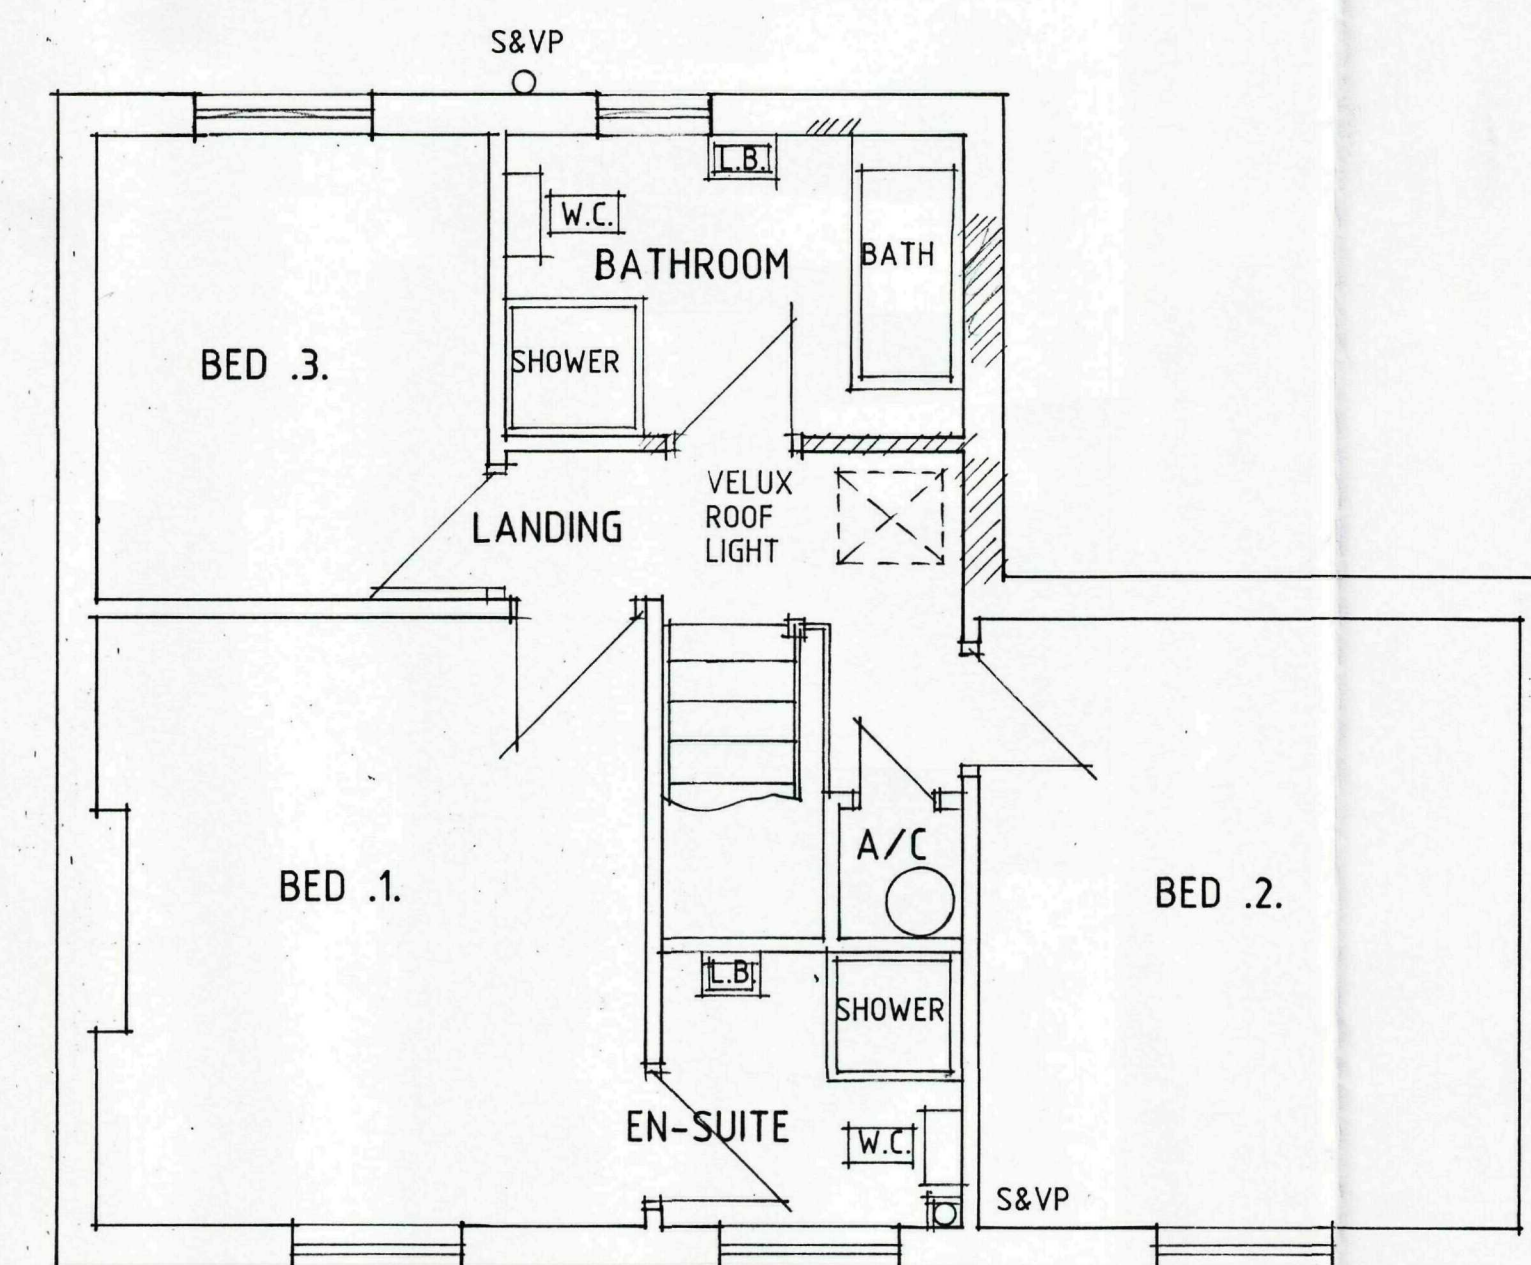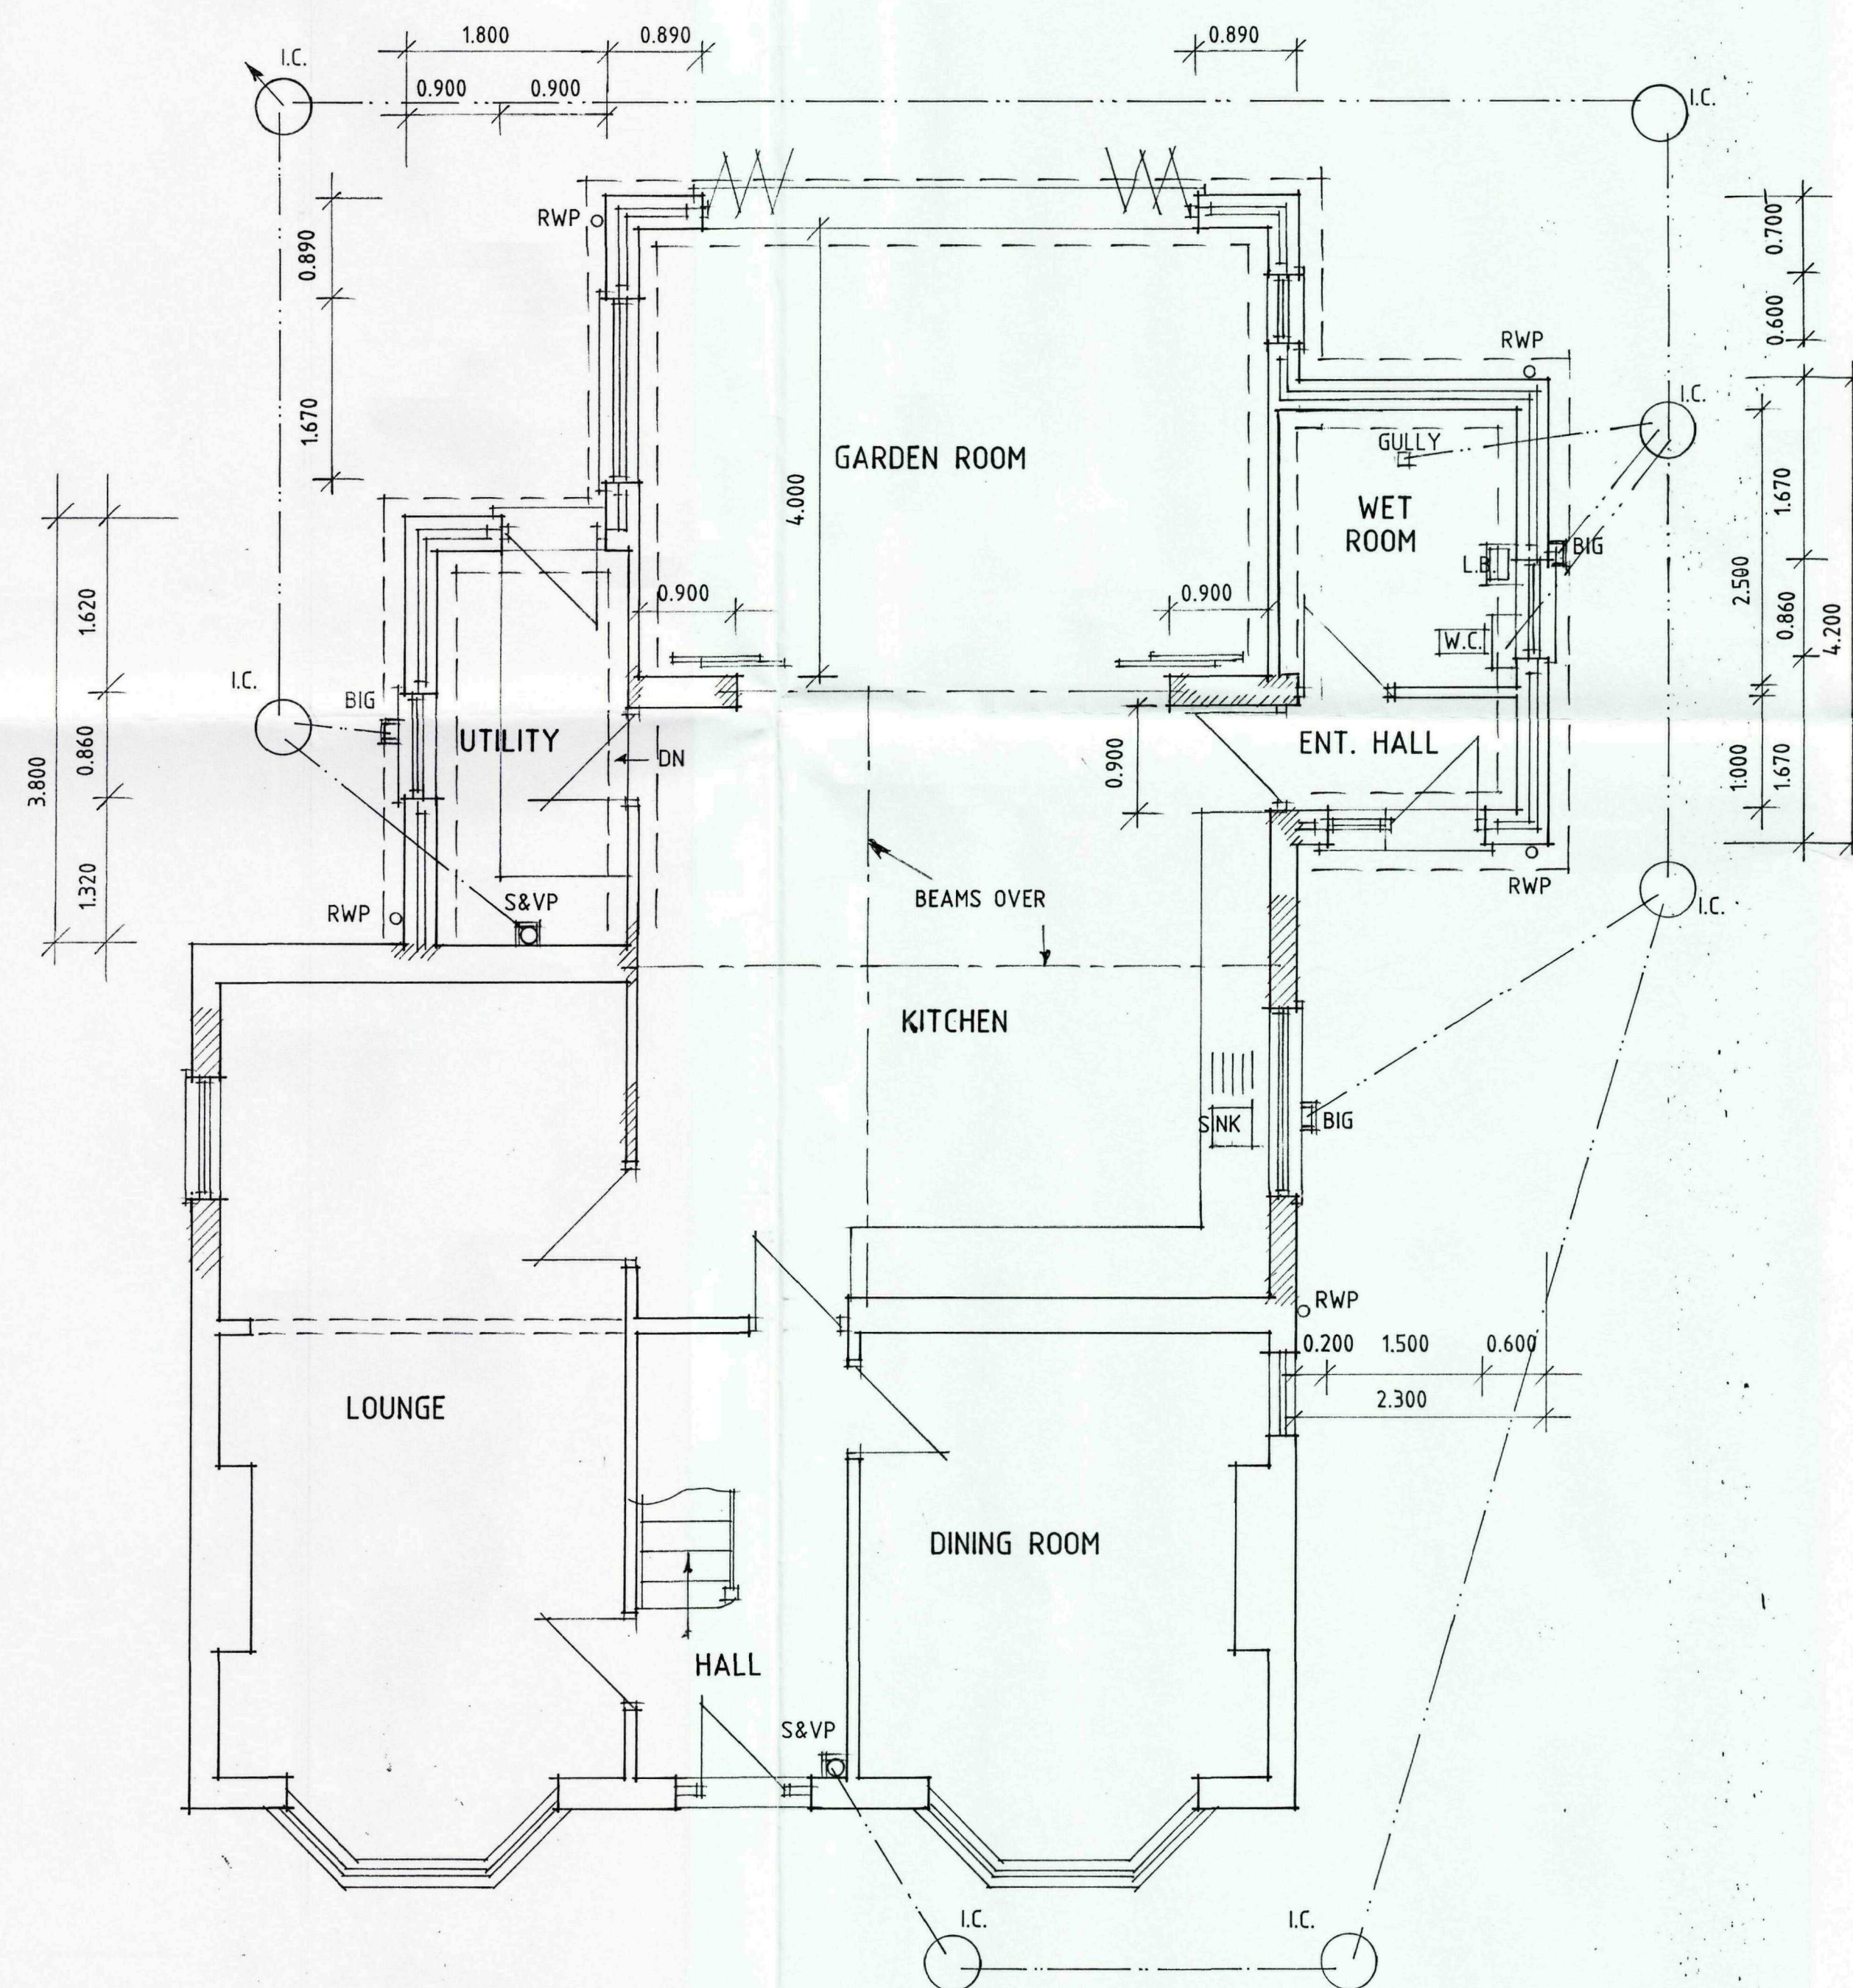

SHDC
Planning & Development
12 JAN 2010
Ref: 0024-10

A- IMF. ADDED - 9.12.09

Status
D E S I G N
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED ALTERATIONS,
EXTENSION & NEW GARAGE
AT WEMBLEY HOUSE,
DOZENS BANK, WEST
PINCHBECK FOR

MR. & MRS. S. ALLARD.

PLAN AS PROPOSED

1:50 SD09-029/9

NOV-09 | B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702






FRONT



SIDE



REAR

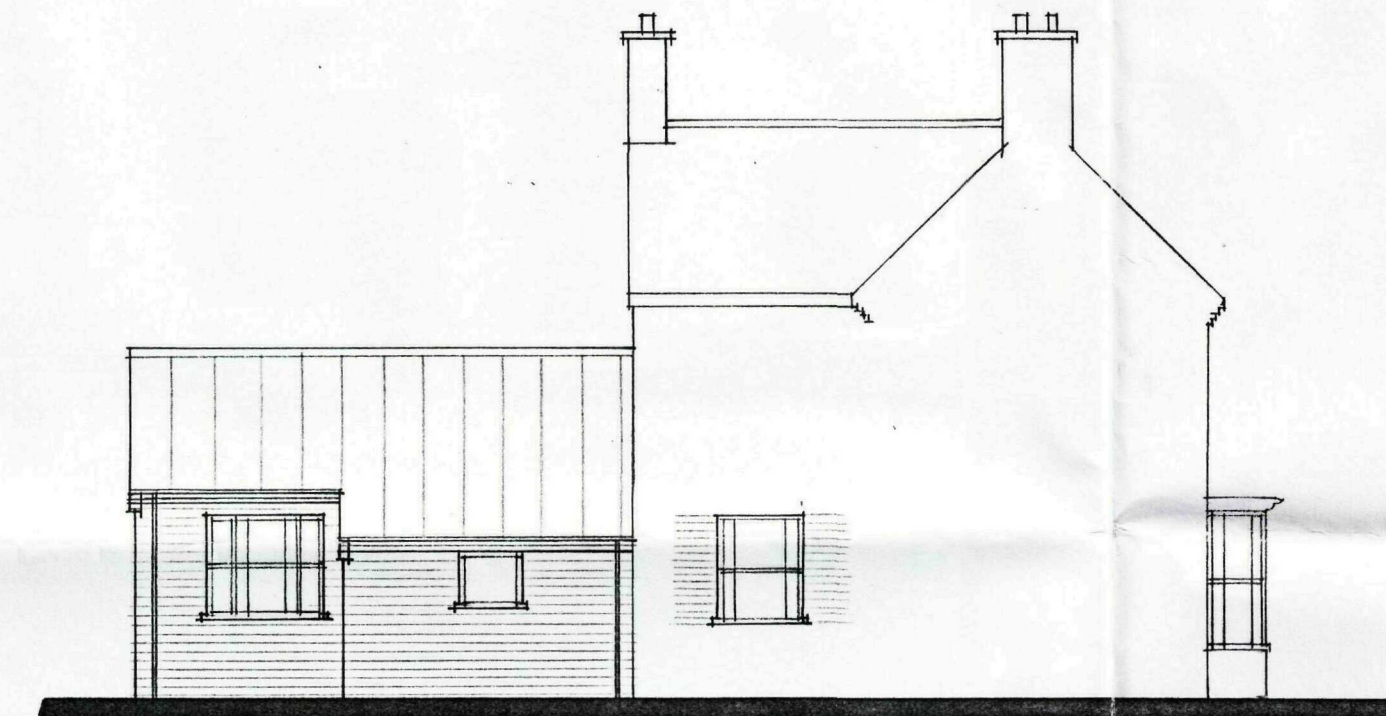

SIDE

A - IMF. ADDED - 14.12.09

SHDC
Planning & Development
12 JAN 2010
Ref: 0024-10

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED ALTERATIONS,
EXTENSION & NEW GARAGE
AT WEMBLEY HOUSE,
DOZENS BANK, WEST
PINCHBECK FOR

MR. & MRS. S. ALLARD.

ELEVATIONS AS PROPOSED

1:100 SD09-029/10
NOV-09 B.GILHAM,

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702



Roof Insulation to Sloping Ceiling
To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

First Floor Walling
Provide 50 x 75mm timber vertical studs at 400mm c/c to be constructed of 50 x 75mm timber head and sole plates. Provide 12.5mm Gyproc plasterboard of 10kg/m² density and skim finish to both sides. Provide to airspace proprietary acoustic insulation. Timber stud partitions running parallel to joist direction to be built off 2 no. floor joists fixed together. Provide 1 no. joist either end of stud partition joist beam to fix flooring.

Integral Garage
Internal door between dwelling and garage (where applicable) to have 100mm step down into garage and door to be ½ hour fire-resisting self-closing type. Ceiling between garage and domestic room above (where applicable) to be ½ hour fire-resisting.


Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:
a) an electrical installation certificate issued under a competent person's scheme has been issued or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

Brickwork below d.p.c. to be F.L. quality


All soakaways to be minimum 1m deep.




FRONT

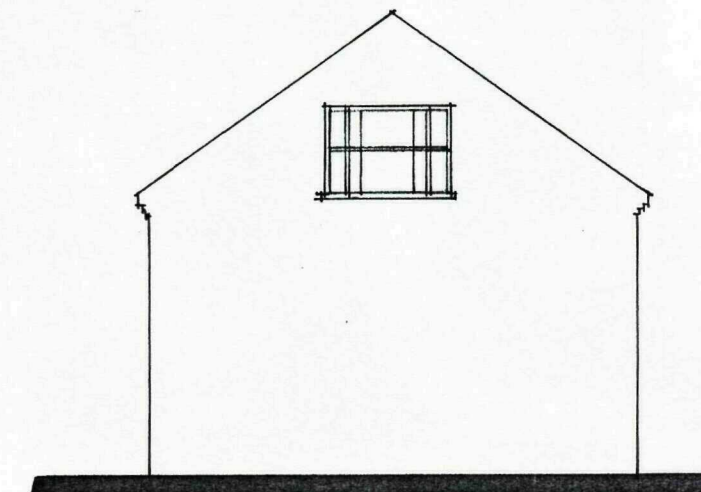

REAR

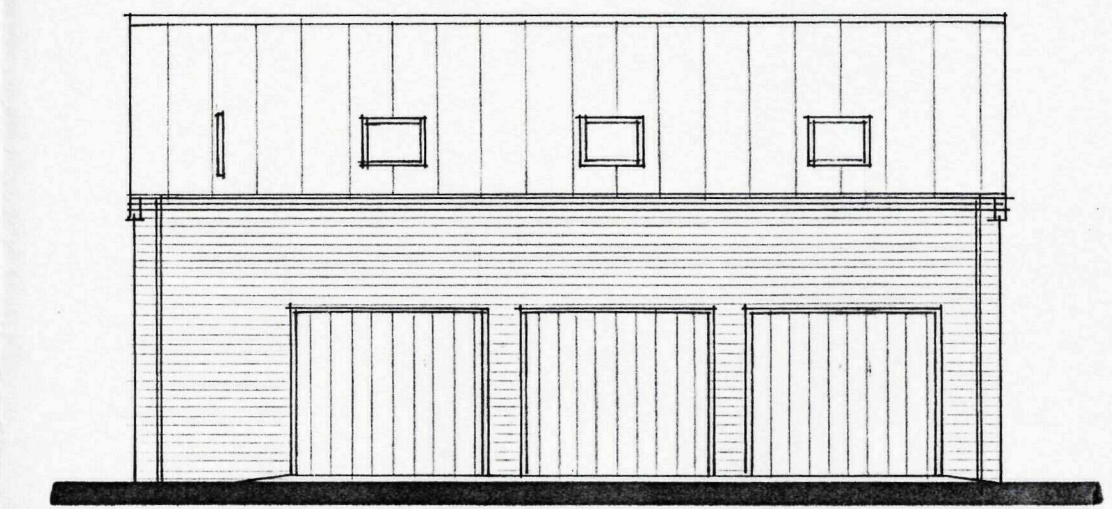

SIDE

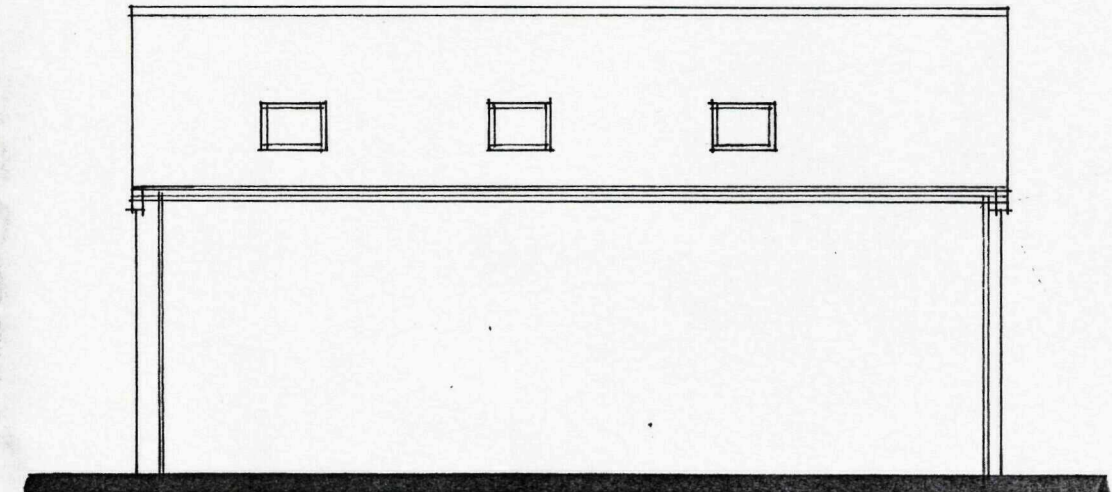

SIDE

GARAGE

Build new garage in position shown.

Facing bricks to match house with slate roof.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible joined to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Ceilings

To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggin to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Fascia and Bargeboards
To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Garage Floor Construction
100mm concrete oversite on 1200 gauge polythene d.p.m. on minimum 150mm, maximum 600mm well blinded and compacted hardcore. If garage is integral to house finished floor level to be 100mm below that of house. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Floor to entrance to be as extension floor.

Garage Cavity Walls
275mm cavity walls of 100mm facing bricks, 75mm cavity and 100mm internal block skin. Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243, 1978.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Lintels

All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor.

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Foundations

As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Private Stairs


Stairwell formed by timber trimmers and load bearing walls (see plan). Provide timber balustrading to open side of stairs 900mm above pitch line and 1000mm high to stairwell opening to act as guarding and to be capable of resisting a horizontal force of 0.36 kN/m. Balustrading to be vertical type, not horizontal or ranch style. No parts of stairs to have any gaps greater than 99mm. Provide timber handrail to top of balustrading or independently 900mm above pitch line. Ensure minimum headroom above pitch line is 2000mm. Total rise: See plan. Maximum rise: 220mm. Minimum going: 220mm. Maximum pitch: 42°. Read in conjunction with Approved Document K.

Roof Ventilation to Sloping Ceiling

At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.



A - IMF. ADDED - 14.12.09

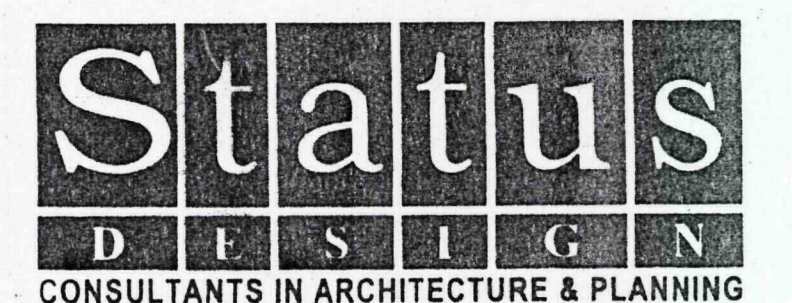

PROPOSED ALTERATIONS,
EXTENSION & NEW GARAGE
AT WEMBLEY HOUSE,
DOZENS BANK, WEST
PINCHBECK FOR




MR. & MRS. S. ALLARD.

TRIPLE GARAGE

1:50 1:100 SD09-029/11

NOV-09 B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702

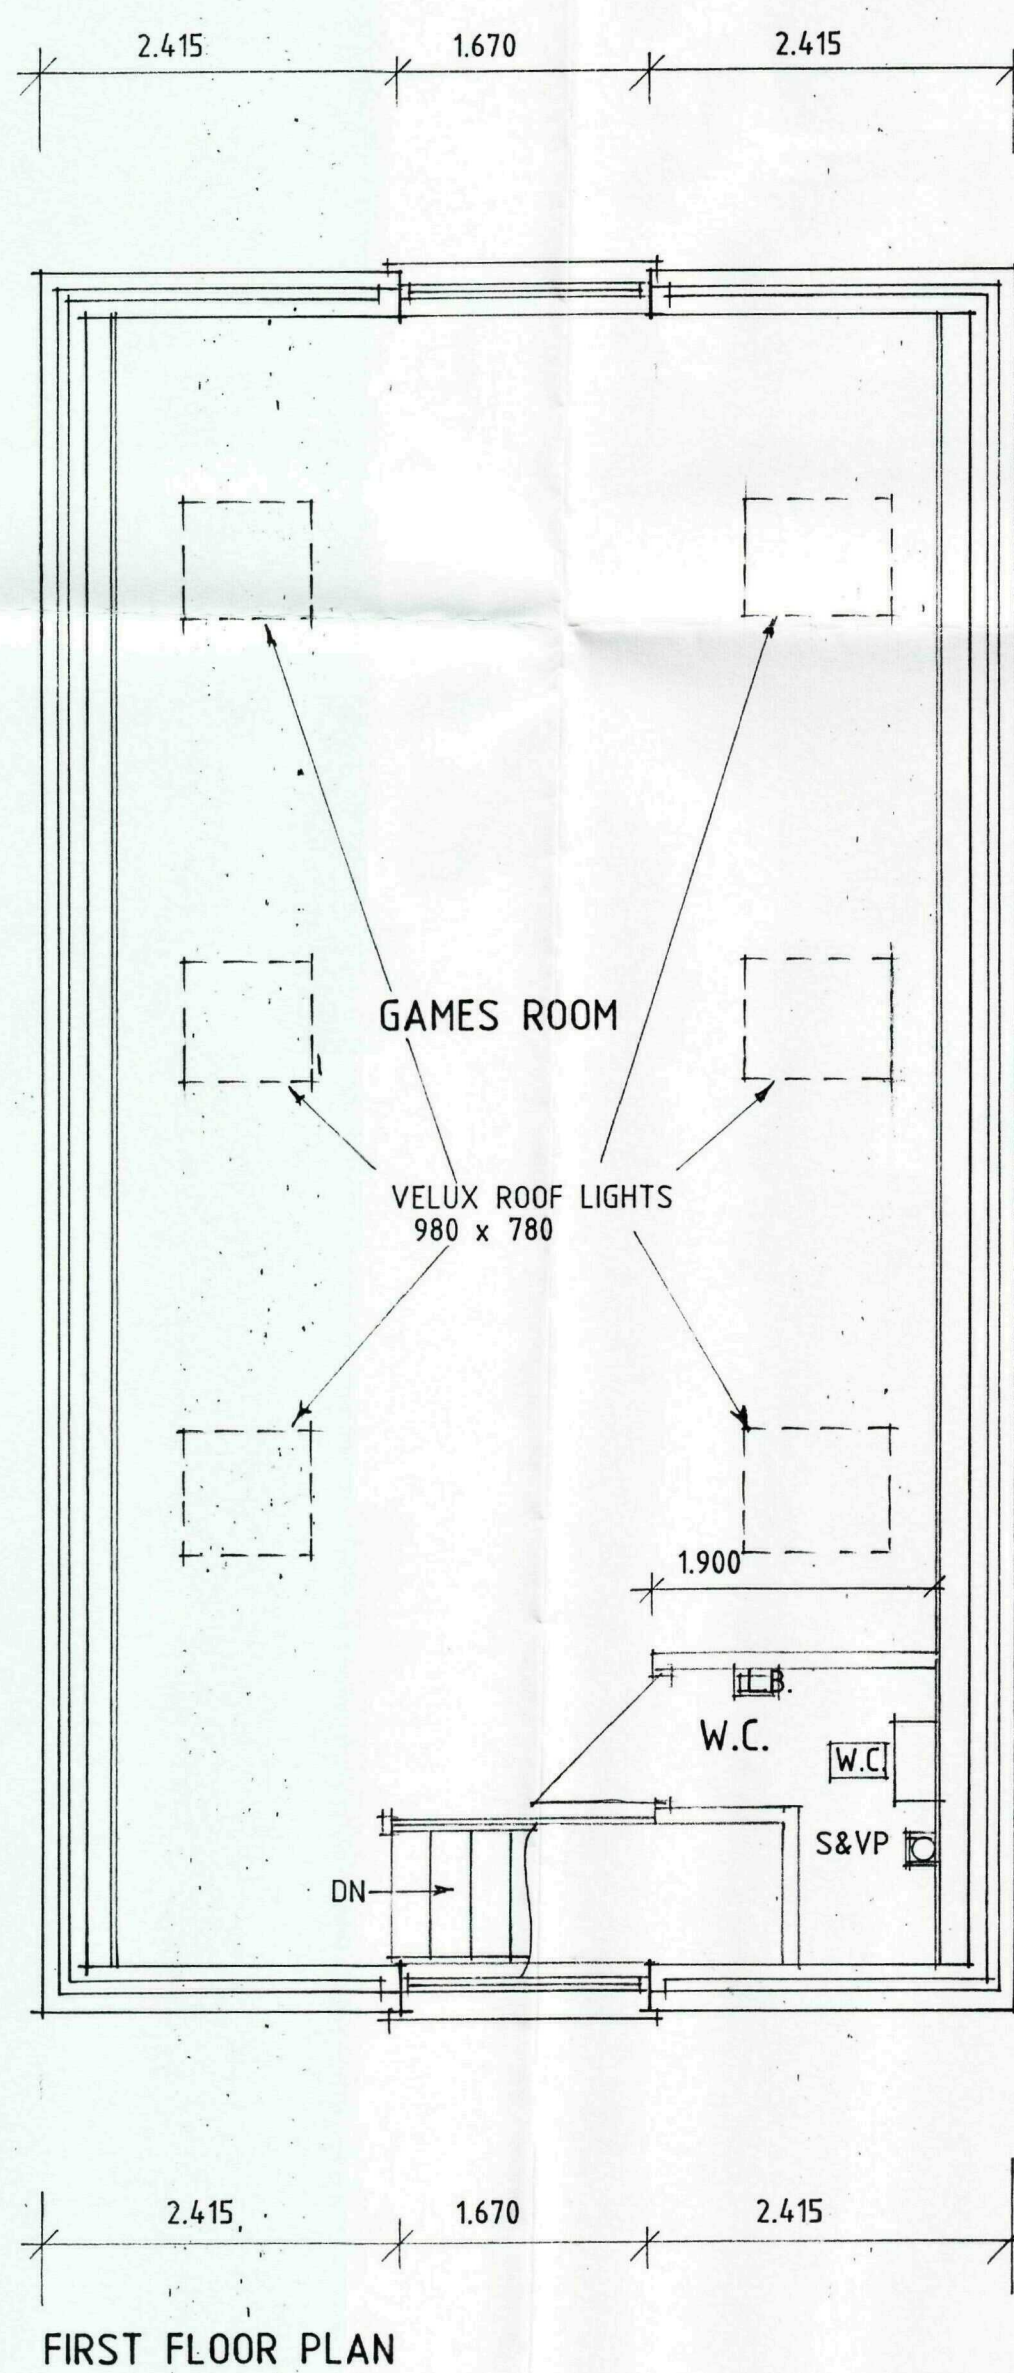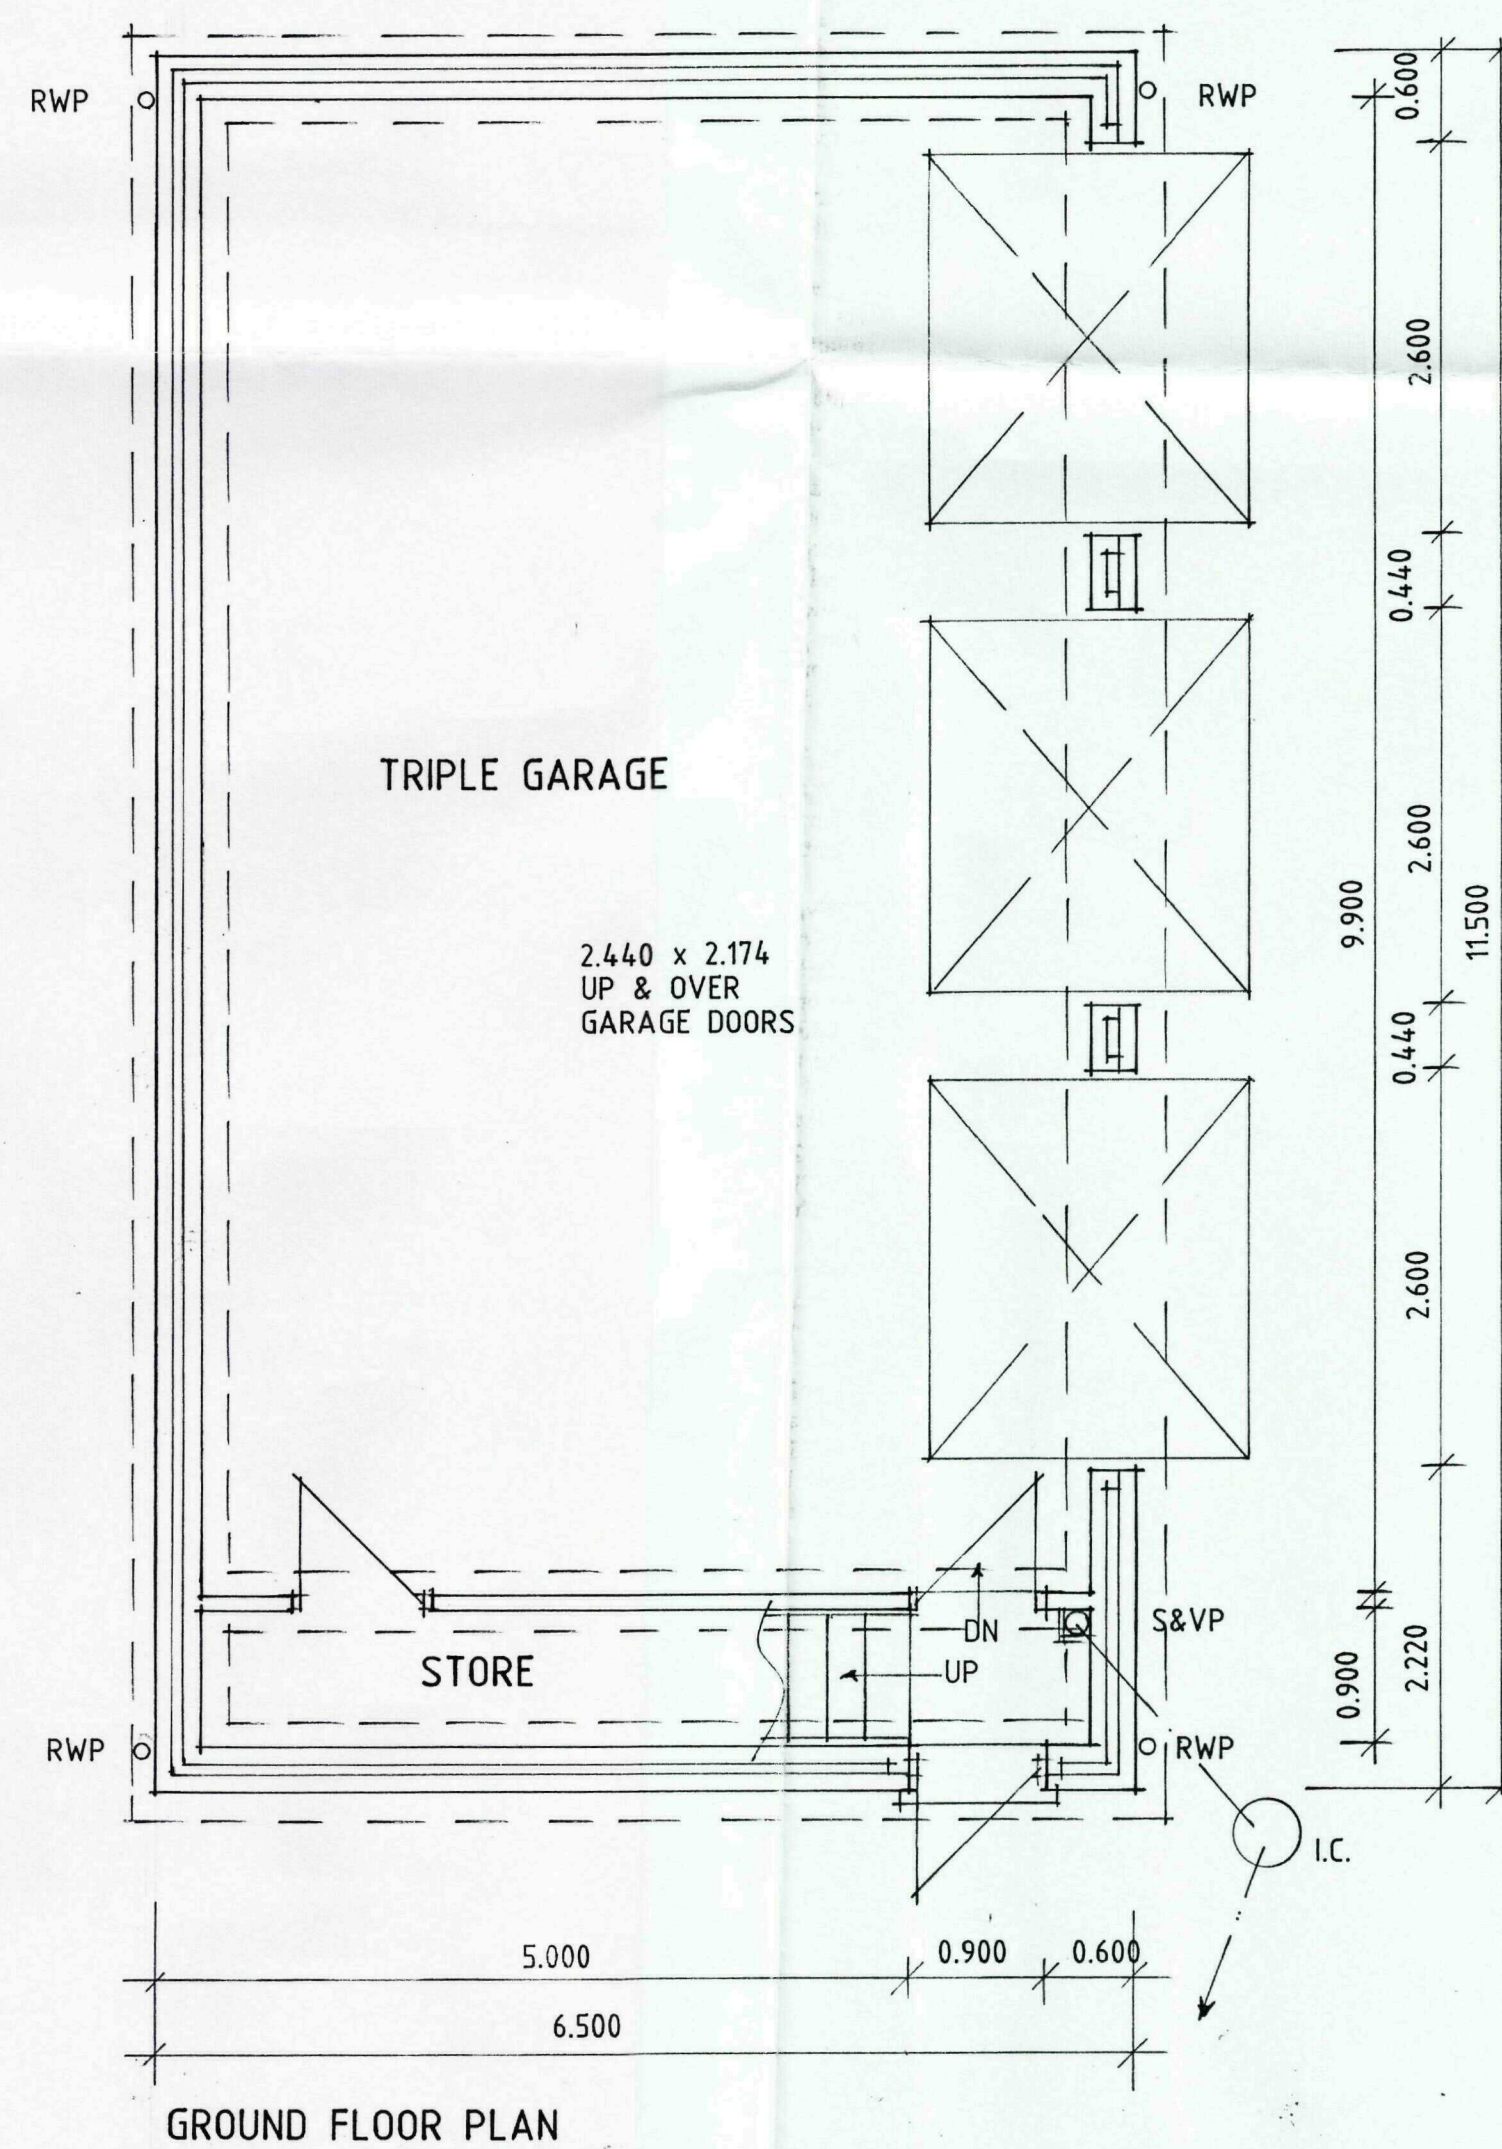

EXTENSION

Existing garage & conservatory to be demolished and cleared away and ground surface to be reinstated.

Demolish part of existing rear lean-to where shown to suit size of extension.

Existing flat roof over kitchen area to be removed.

Remove walls and chimneybreast to kitchen, as shown; support over with steelwork, etc., all as per SRC calculations/details. All new steelwork to be encased to give ½ hour fire protection.

Adjust openings or create new openings for new windows, as shown; support over with IG box 200 lintel.

To all exposed adjusted openings/bricked up openings use facing bricks to match those of existing.

Form new internal doorways, where shown, in 215mm walls; support over with IG box 200 lintels.

Doors between kitchen and lounge to be partly blocked up to suit size of door, as shown.

Existing bathroom to have existing wall removed; check for any roof supports and if found necessary provide suitable beam over.

To landing area, where shown, form new en-suite and airing cupboard using 100mm stud partitions. Form new doorway into en-suite, as shown; support over with IG internal lintel. En-suite window to be obscure glazed.

Form extension in the manner shown.

Facing bricks to match those of existing. Provide slates to new roof.

Roof overhang, verges, eaves, etc., to match those of existing house.

Floor level to match that of existing house.

Provide external steps as necessary.

At junction of roofs and existing house wall form valley to fall towards the rear and to be suitably lead flashed with 4th lead to make completely watertight and to discharge onto new roof with lead apron.

New Garden Room to be with same internal width to match that of the kitchen, as shown.

To existing rear wall form large opening leading into new Garden Room; provide suitable sliding doors; support over with steelwork, as per SRC calculations/details.

Existing side window of lounge to be removed and replaced with new 1.085m wide window, as shown; brick up as necessary.

To side wall of kitchen remove existing door and window and create new opening to suit 1.67m x 1.05m window; brick up as necessary.

Existing window to landing and side window to bathroom to be bricked up.

Provide suitable Velux roof light to landing area, where shown. Trim opening through to first-floor ceiling and clad out with plasterboard and skim, all as necessary.

GENERAL

Existing bay windows and roofs to be replaced.

External walls to bay windows to be rendered.

Existing front door to be repaired or replaced, as necessary, to cure water leaks.

All works to be carried out and improvements made, etc., all in accordance with SRC letter dated 5 October 2009 Ref 3090 and schedules 30909/SK1, 30909/BH1 & 30909/BH2.

Connect foul drains to existing septic tank.

Make good to all disturbed and affected areas.

Roof/Wall Abutments
Provide Code 4 lead flashings and lap over roof covering. Dress up wall a minimum of 150mm (stepped on pitched abutments) and provide d.p.c. cavity tray to make completely watertight.

New/Old Walling
Where new walling meets old provide proprietary give ½ hour fire protection.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Valleys
Use proprietary fibreglass valleys or provide Code 4 lead to valleys to make completely watertight.

Kitchen Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 60 l/sec. Alternatively provide proprietary cooker hood capable of extracting 30 l/sec.

Bathroom/En-suite Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 15 l/sec. System to offer intermittent operation.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5839 Part 6, 2006 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Kitchen/Utility/Bathroom/WC Trickle Ventilation
Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Utility Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 30 l/sec. System to offer intermittent operation.

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U-value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Foul Water Drainage
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document D) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

Inspection Chamber Construction
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

Roof Intersections
If compound truss used; where main trusses fix to compound truss provide proprietary truss connectors. Provide 32 x 175mm valley lay boards and fix reducing trusses over to complete roof intersection. Fix in accordance with roof truss manufacturers instructions.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggin to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Ground Floor Construction
65mm sand/cement screed on 100mm Celotex insulation with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Roof Ventilation to Sloping Ceiling
At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.

Roof Insulation to Sloping Ceiling
To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

Roof rafters over utility to be 100mm x 50mm SC3 grade at 400mm centres.

Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Foundations
As indicated on plan, provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be S73 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Commissioning of Heating and HWS Systems
A competent person, i.e. the main contractor or sub-contractor shall supply a Certificate of Satisfactory Compliance with Building Regulations Part L. A copy of which shall be made available to both the client and the Building Control body.

A suitable set of operating and maintenance instructions are to be made available to the client to explain to the householders how to operate the systems so that they can perform efficiently and what routine maintenance is advisable for the purpose of the conservation of fuel and power.

Internal Lighting
Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Provide energy efficient lights of one per 25m² of floor area or one per four fittings whichever is the largest.

Excludes garages, lofts and outhouses.

Electrical Work
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:-
a) an electrical installation certificate issued under a competent person's scheme has been issued or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

Wall Construction (300mm Cavity)
300mm cavity walls to consist of:-
100mm facing brickwork (see site plan for details)
100mm cavity - to be filled with Crown Dritherm 32
100mm internal skin of Tarmac Durox Supabloc or similar approved.
Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243:1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

External Cavity Wall Lintels for 300mm Cavity Walls
IG type L1/S100 unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Internal Lintels
IG type internal 100mm lintels to openings in 100mm internal walls unless stated otherwise

Purge ventilation to windows
For a hinged or pivot window that opens 30° or more the height and width should be at least 1/20th of the floor area of the room.
For a hinged or pivot window that opens less than 30° the height and width should be at least 1/10th of the floor area.

Background Ventilation
Background ventilation is to be provided by trickle ventilators to the tops of windows. Use trickle vents offering 8000mm² per window head. Ventilation for whole extension to be 35,000mm²

Brickwork below d.p.c. to be F.L. quality

Outlets from balanced flue boilers to be at least 300mm from any openings.

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

Hot water cylinder to be minimum 115lt capacity.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Escape windows to be within 1.1m of floor.

Smoke detectors to be to BS5839/6:2004, Grade D, Category LD3.

For thermal bridging details refer to details:-

MC1-RE-01
MC1-WD-03
MC1-WD-04
MC1-WD-05

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.
All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.


This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.


The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc. Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

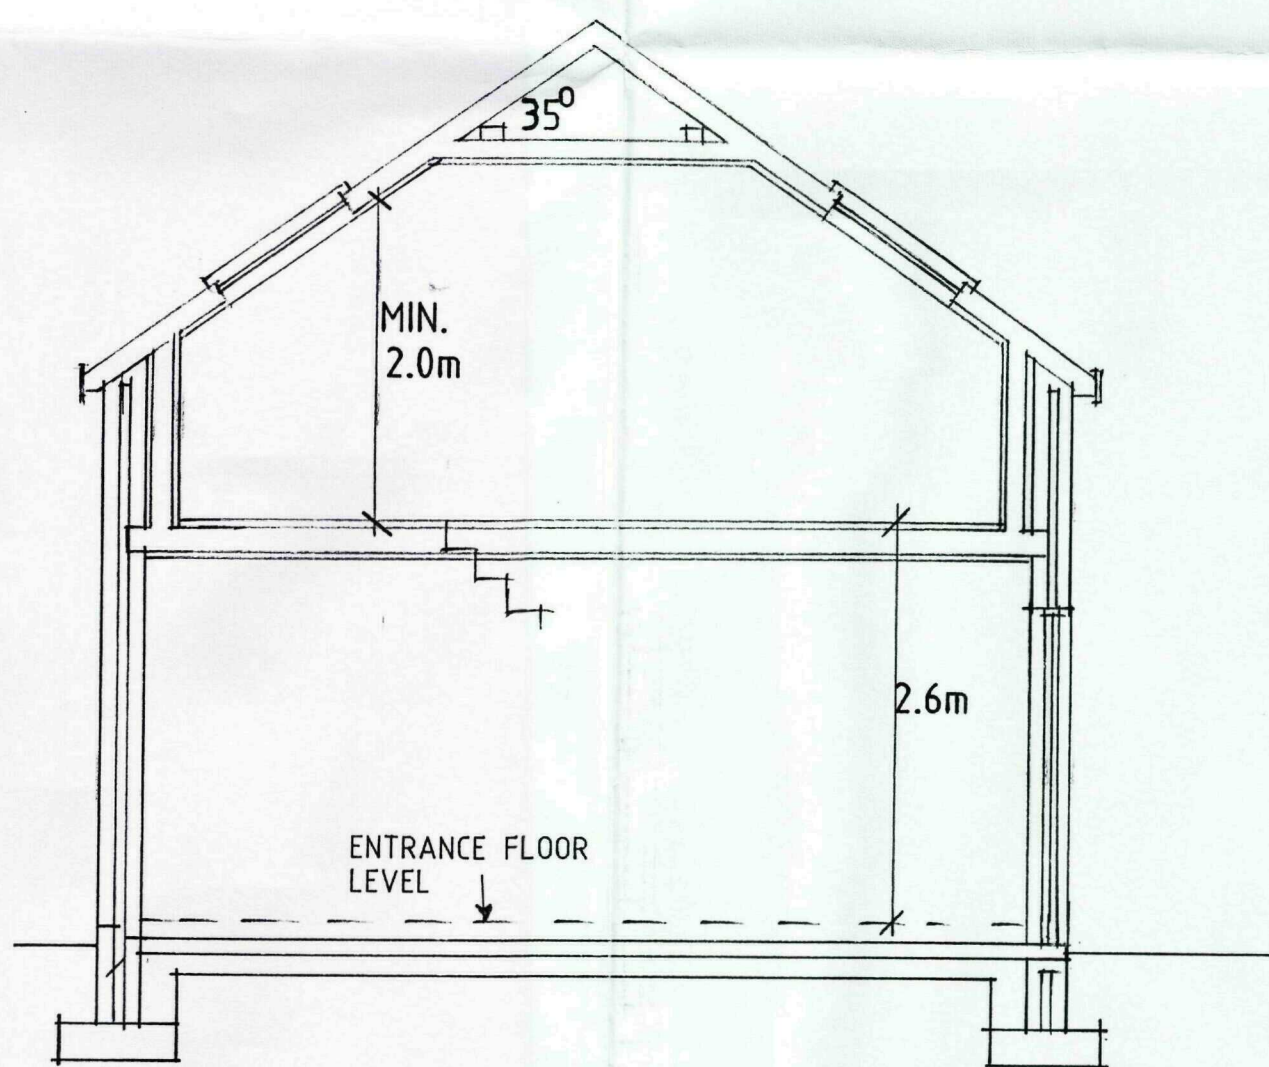

SECTION THRO GARAGE/GAMES ROOM

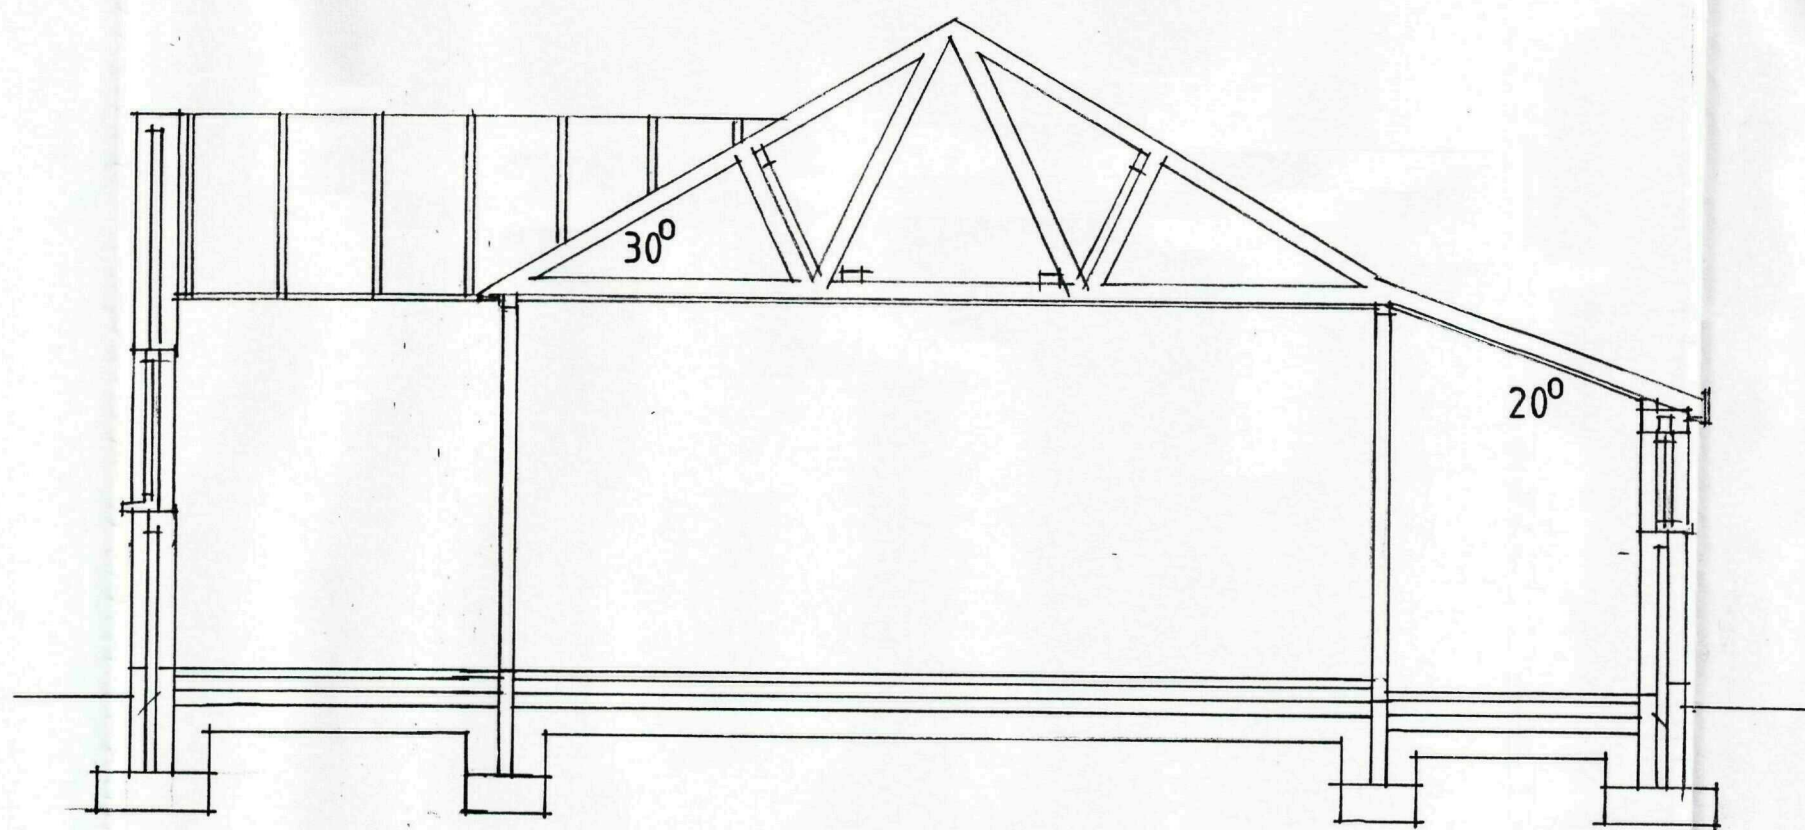

SECTION THRO EXTENSION

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

SHDC
Planning & Development
12 JAN 2010
Ref: 002410

PROPOSED ALTERATIONS,
EXTENSION & NEW GARAGE
AT WEMBLEY HOUSE,
DOZENS BANK, WEST
PINCHBECK FOR

MR. & MRS. S. ALLARD.

SECTIONS

1:50

SD09-029/12

DEC-09

B.GILHAM.