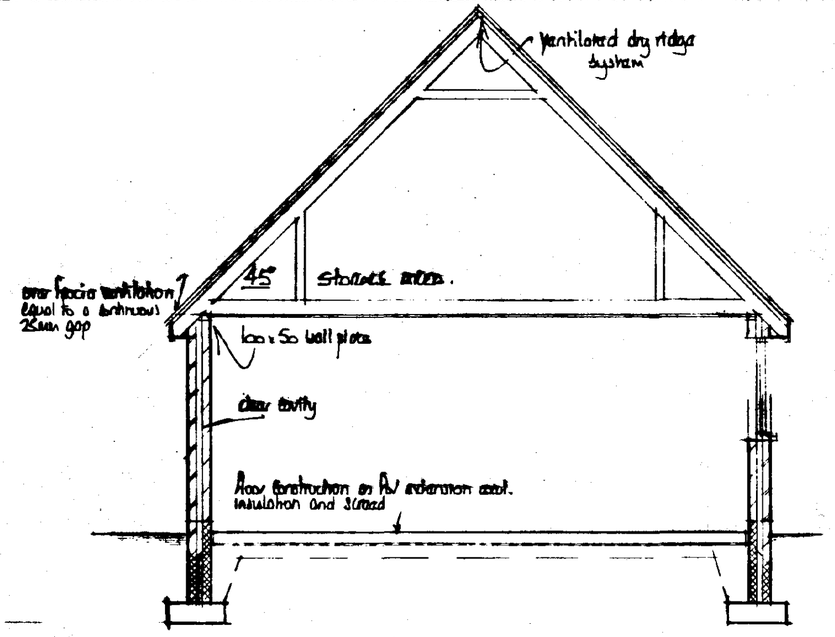

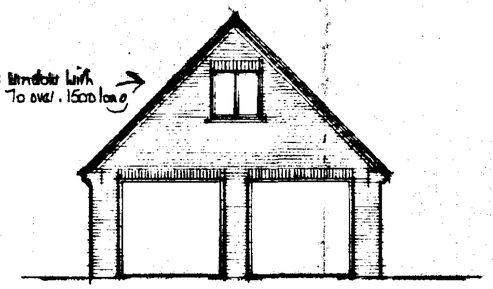

EAST

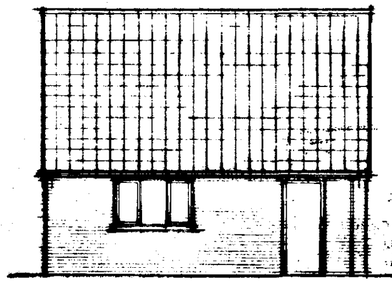

NORTH

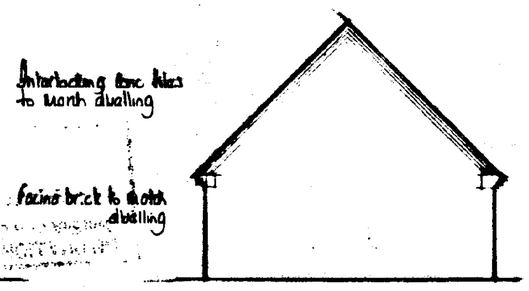

WEST

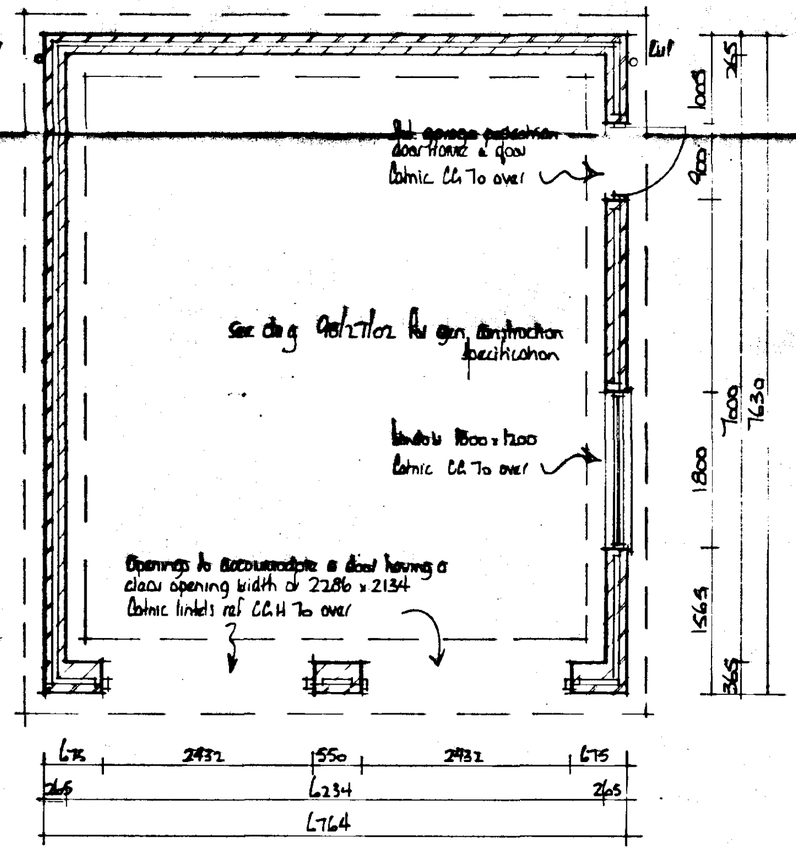

FLOOR PLAN

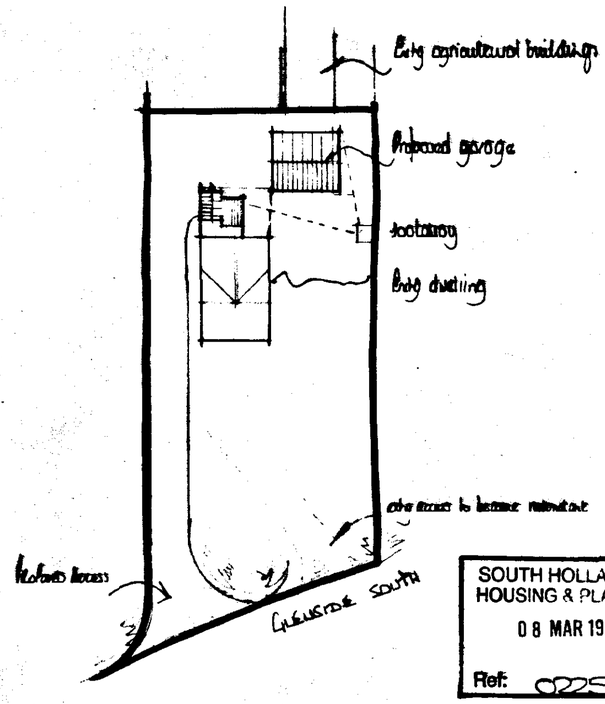

SOUTH HOLLAND DC
HOUSING & PLANNING
08 MAR 1999
Ref: 0225/99.

BLOCK PLAN

UNDETERMINED PLAN

A		
	Date	Revisions

© copyright

East Midlands Design Associates

"Willow Lodge",
Horseshoe Road,
Spalding,
Lincs. PE11 3QR
Tel: Spalding (0775) 767968

Client
R. CAMPBELL & SONS

Job Title
Proposed Garage at
Gleedmoor South
West Pinchbeck
Spalding.

Drawing Title
Plans
Section
&
Elevations

Scale 1:50 . 1:100

Date MAY 98 | Drawn by

Drg. No. 98/27/01 | Rev

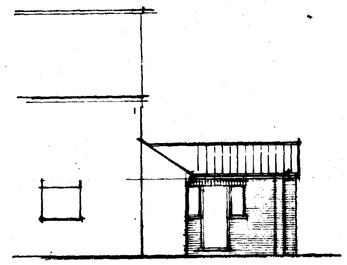

WEST

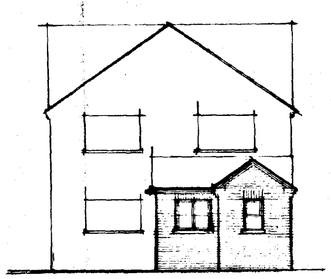

SOUTH

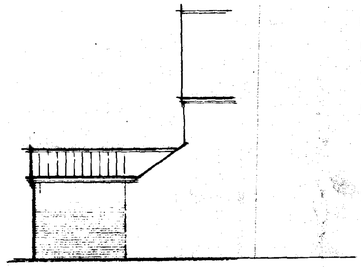

EAST

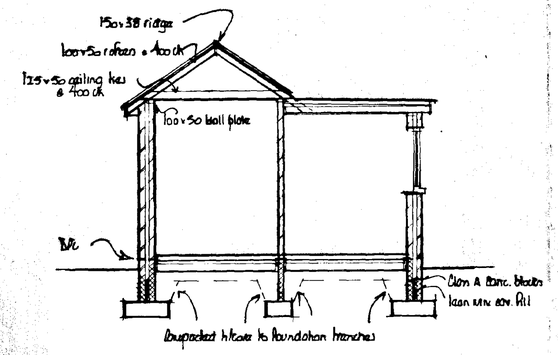

SECTION A - A

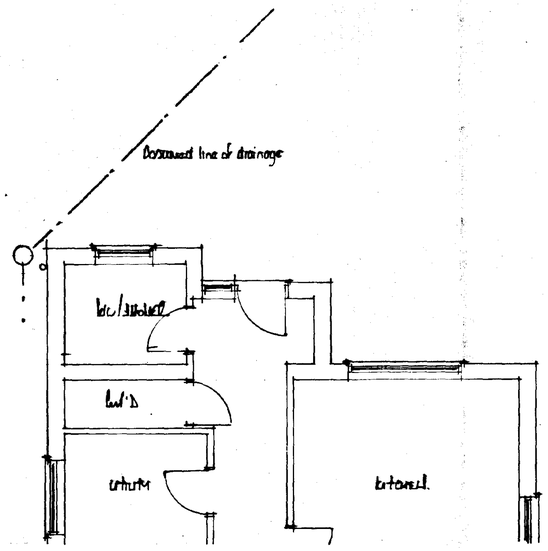

EXISTING

GROUND FLOOR PLAN

HEALTH AND SAFETY

The Employer/Client is responsible to ensure that the contractor is fully conversant with and adopts all necessary measures to afford compliance with the Health and Safety Legislation for building sites and work places.
The contractor is to carry out the works in a safe and practical manner with regard to all matters concerning Health and Safety incorporating safe working systems and practices.

FOUNDATIONS

Foundations to be ST4 grade concrete

For 265mm walls foundations to be 700 x 230mm
For 100mm " " " 450 x 230mm

Foundations to be taken down to a firm loadbearing strata, a min. 1.0m if in shrinkable sub soil, in accordance with the requirements of the Local Authority Building Control Dept. and in accord with the NHBC guidelines for building near trees
Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken

FLOOR CONSTRUCTION

Ground
65mm sand/cement screed reinforced with chicken wire mesh
500g polythene separating membrane
50mm Jablite SD floor insulation (k = 0.037W/m°C)
100mm ST4 grade oversite concrete
1200g polythene damp proof membrane
25mm sand blinding
100mm compacted hard-core - if in excess of 100mm fill to a max. 600mm, the hard-core is to be laid and compacted in layers not exceeding 150mm
Where 100mm internal walls are constructed off the floor slab the slab is to be thickened to 230mm for a min. width of 450mm
Strip off all vegetable soil beneath proposal.

WALL CONSTRUCTION

Below Ground
To be 100mm Class A concrete blocks
Cavity to be filled to 225mm below lowest dpc level with lean mix concrete

Above Ground
To be 265mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
65 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Hemelite (k = 0.44)

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally 450mm vertically and staggered. To be at every block course vertically at all returns and reveals

Internal finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.414W/mK

Internal Walls
To be 100mm blockwork constructed off a dpc off the foundation

DPC in Walls
To be a min. 150mm above finished ground level
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.
A dpc cavity tray, stepped as applicable, is to be constructed within the wall immediately above an abutment.

LINTELS

Lintels to be Catnic, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels over internal openings to be Catnic CN102 lintels unless specified otherwise.

Lintels to be protected with min. 16mm gypsum plaster skim finish to give a min. half hour fire protection.

WINDOWS & DOORS

Windows and doors to be purpose made UPVC to match extg, double glazed with 20mm air gap to sealed units and weather stripped.

Windows to habitable rooms are to incorporate a controllable trickle vent of 8000mm², 4000mm², to non habitable rooms.

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

All internal rooms are to be mechanically ventilated direct to the external air. Extractors are to be capable of a min. 3No. air changes per hour and are to incorporate a 15 minute over-run period when installed in WC's, bath/ shower rooms.

SMOKE DETECTION

Self contained smoke alarms complying with BS5446 : Pt 1 : 1990 are to be installed where indicated SD on the drawing. An alarm must be positioned within 3.0m of bedroom doors.

The alarms are to be permanently wired to a separately fixed circuit at the distribution board operating at a low voltage via a mains transformer.

Where more than one smoke alarm is required the units are to be interconnected so that the detection of smoke by one unit operates the alarm signal in all units.

The wiring installation is to comply with the I.E.E. Regulations.

HOT WATER SYSTEM

A room thermostat or radiator valves are to be installed.

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.45W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

DRAINAGE

Surface
Excavate for and lay in where indicated 100mm diam. flexible jointed UPVC drains on 100mm pea gravel bed from 100mm diam. upturned bend at base of downpipe to surface water soakaway.

Form soakaway where indicated a min. 5.0m from the nearest building. Excavate 1200 x 1200 x 1200mm deep, backfill with brick rubble to 300mm below ground level, lay in sheet polythene and make up with vegetable soil.

Foul

Where 100mm diam. drains pass through walls they are to be protected by the use of a lintel over. Both sides the wall to be masked with rigid sheet material with 50mm clearance of the pipe. Where the pipe passes beneath the building it is to be excavated, inspected and replaced if defective and surrounded with 150mm pea gravel.

Above ground drainage to comply with BS5272 : 1978
Below ground drainage to comply with BS8301 : 1985

All drainage items are to be installed in strict accordance with the manufacturers instructions.

ROOF CONSTRUCTION

Tiles
The roof is to be covered with interlocking concrete roof tiles fixed in strict accordance with manufacturers instructions.

Battens
Approved quality tanalised s/w battens, 38 x 25mm, are to be laid at a gauge suitable for the tiles and fixed with 90 x 3.35mm wire nails. Battens should be at least 1.2m in length and should be of sufficient length to be supported at each end and intermediately by at least three rafters, trusses or walls. Butt joints over intermediate supports should be staggered and the ends must be sawn.

Underlay
Approved reinforced roofing felt, type 1F to BS 747, is to be laid over the rafters lapped 150mm at the joins and secured with clout nails. The underlay should extend over the fascia board and into the eaves gutter. In order to prevent water traps behind the fascia it is recommended that a strip of 6mm marine plywood is provided to support the underlay. The ply is to be laid over the rafters and under the roofing felt positioned as close as possible to the tail tiling batten and secured to the fascia.

Eaves
Eaves are to be formed with standard size tiles and purpose made eave fillers must be nailed to the fascia board. Eave tiles must be laid at the same pitch as the main body of tiling and should overhang the fascia by an amount sufficient to ensure that the water discharges into the centre of the gutter.

Verges
Verges are to be formed with 150mm wide asbestos cement strip onto which is bedded the tiles which form the verge projecting approx. 50mm over bargeboards or gable brickwork.

Ridge
The ridge is to be covered with segmental ridge tiles of the same colour as the main body of tiling, unless specified otherwise, and secured using a proprietary ventilated dry ridge system having ventilation equivalent to a continuous 6mm gap.

Mortar
All bedding mortar is to consist of 3 parts sharp sand to 1 part Portland cement and should be struck off to give a smooth face and pointed in one operation.

Insulation
To be Rockwool Rollbatts (k = 0.037 W/mK), 150mm laid between joists with a further layer of 80mm laid at right angles over the top.

Ceilings
12.7mm foil backed plasterboard, fixed in accordance with manuf. instructions with all necessary noggins etc., and finish with artex/skim finish in accord with clients instructions.
Ceiling to garage to be 12.7mm Gypsum Fireline Board with 50mm cover strips to joints to give a half hour fire resistance.

Ventilation
Provide a 25mm continuous gap covered with insect proof gauze to the soffit to provide cross ventilation to the roof space.

Rainwater Goods
Supply and fix 103mm PVC gutters to fascia with all necessary brackets, stop ends, outlets etc.

Supply and fix 64mm PVC downpipes securely clipped to walls at 1800mm cts with all necessary offsets, swannecks, adaptors etc. and taken into 100mm diam. upturned bend at base.

STRAPPING

Where rafters, floor joist and ceiling ties run parallel to walls they are to be strapped at 1800mm cts. Straps to be fixed to a min. 3No. rafters etc., having nogged between beforehand, and hooked into the cavity a min. 150mm.
Similar straps to be used at 1800mm cts to hold down the wall plate.

Straps to be 30 x 6mm galv. m.s.

FLAT ROOF CONSTRUCTION

12.5mm white spar chippings bitumen bedded on 3 layer built up roofing felt, bottom layer to be astos based, dressed up pitched roof a min. 450mm.
70mm Jablite roof insulation
Building paper vapour barrier
18mm exterior grade plywood decking
Firrin pieces to give a fall of 1 : 80
100 x 50mm SC3 grade joists at 400mm cts
12.7mm foil backed plasterboard and skim finish

Where joists run parallel to walls they are to be strapped at 1800mm cts with 30 x 6mm galv m.s. straps fixed to a min 3No. joists, having nogged between beforehand, and securely fixed to walls. Similar straps to be used at 1800mm cts to hold down the wall plate.

Supply and install 103mm pvc gutters and fix to falls on fascia with all necessary brackets, stop ends, outlets etc. Supply and install 64mm downpipes securely clipped to walls at 1800mm cts together with all necessary offsets, swannecks, adaptors etc. and taken into 100mm diam. upturned bend at base.

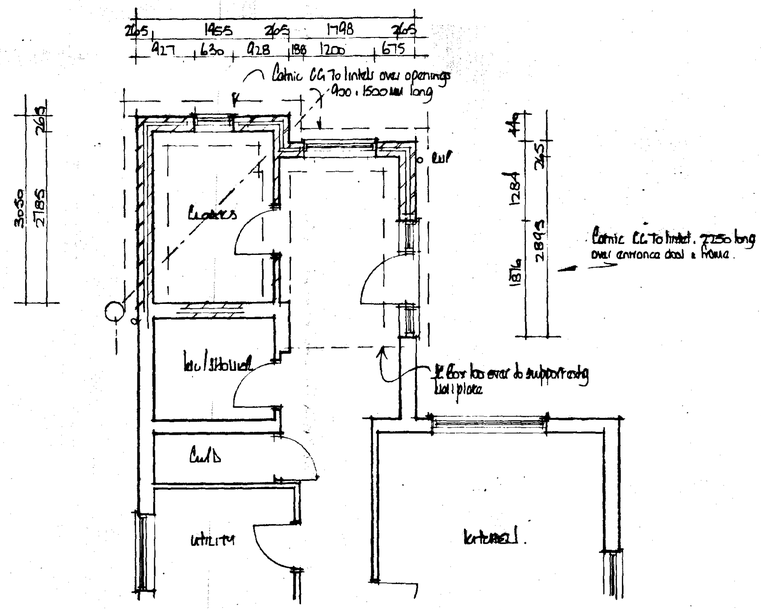

PROPOSED

DETERMINED PLAN

SOUTH HOLLAND DC
HOUSING & PLANNING
08 MAR 1999
Ref: 0225/99

A		
	Date	Revisions

© copyright

East Midlands Design Associates
"Willow Lodge",
Horseshoe Road,
Spalding,
Lincs. PE11 3JA
Tel: Spalding (0775) 767966

Client
Mr D & Mrs J Campbell

Job Title
Extension to Dwelling at
Clarkshaw South
West Pinchbeck
Spalding.

Drawing Title
Plans
Section
&
Elevations

Scale 1:50 . 1:100

Date MAY 98 | Drawn by AL

Drg. No. 98/27/02 | Rev