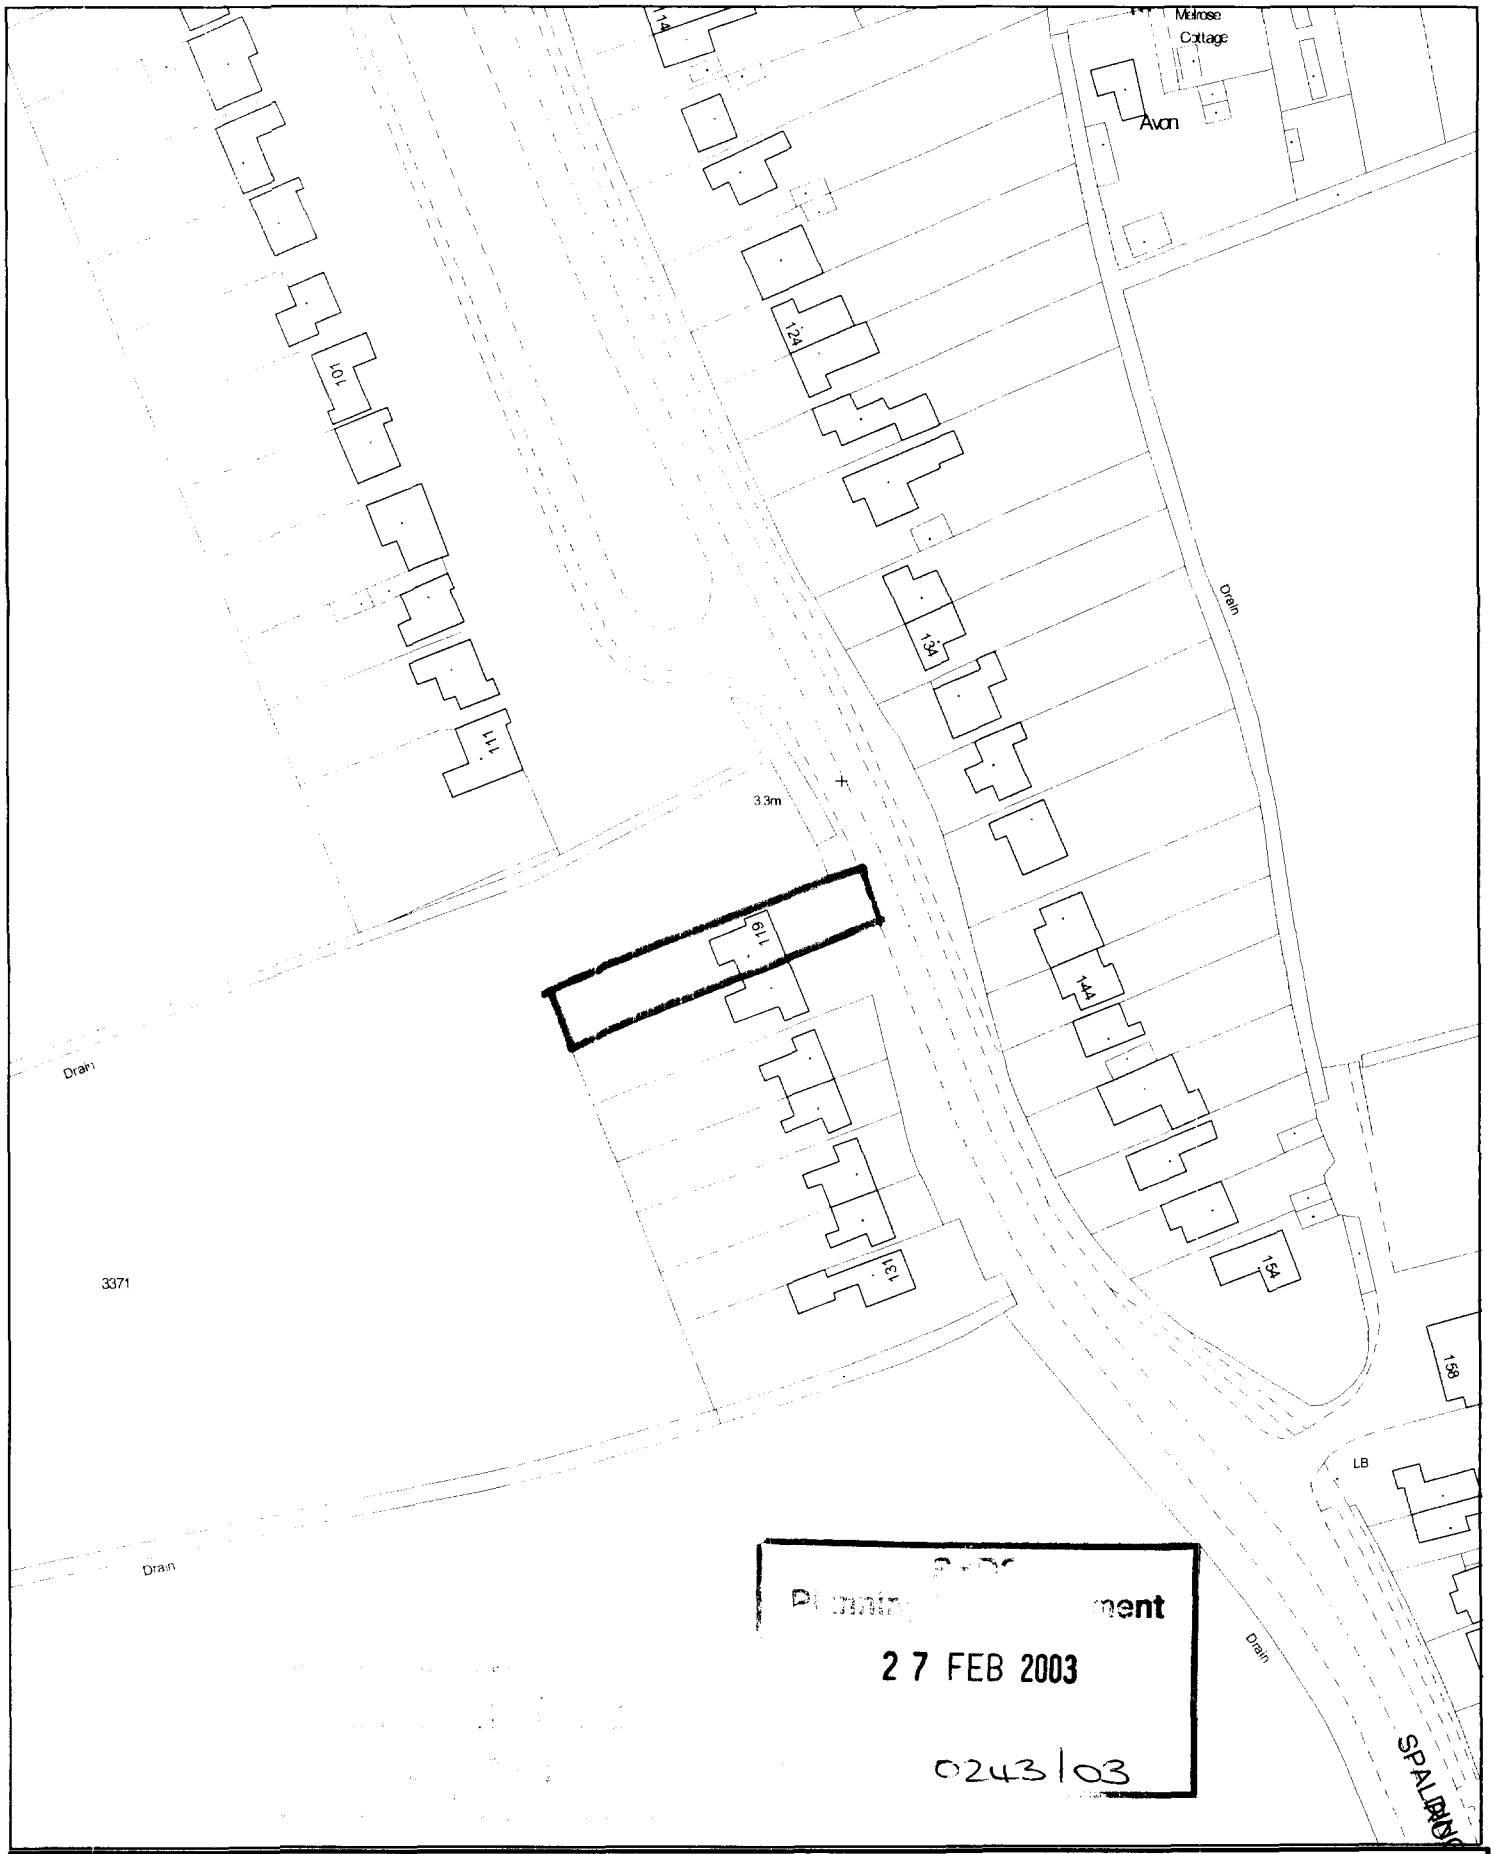

nent
27 FEB 2003
0243/03

[redacted]

This copy has been produced specifically for the map return scheme purposes only. No further copies may be made.

Scale: 1:1250

Council Offices, Priory Road, Spalding,
Lincolnshire PE11 2XE

This map is reproduced from Ordnance Survey material with permission of Ordnance Survey on behalf of Her Majesty's Stationery Office (c) Crown copyright. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings. South Holland District Council LA079413 2003

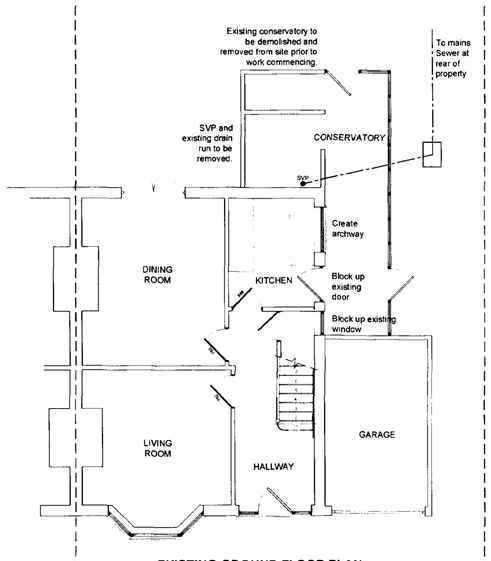

EXISTING GROUND FLOOR PLAN
Not to Scale

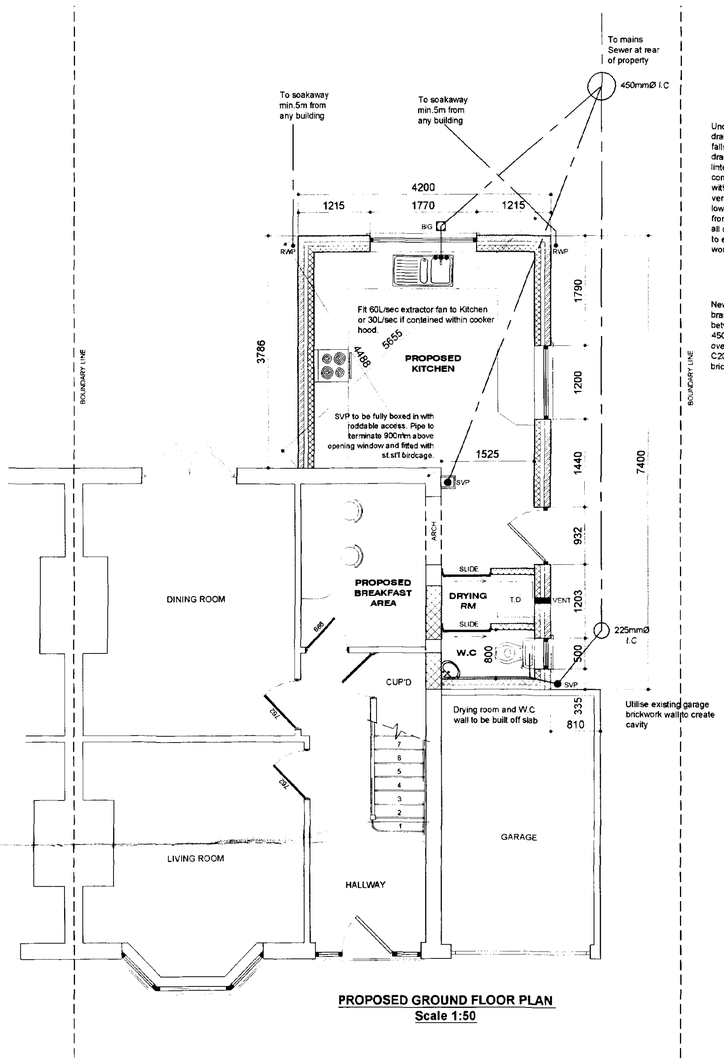

PROPOSED GROUND FLOOR PLAN
Scale 1:50

Underground drains to be as rainwater drainage but with min.1:80 and max.1:40 falls.Fall of drains from gullies to be 1:40.All drains passing thro' walls to have concrete lintel over with 50mm space around filled with compressible material and opening masked with durable rigid sheet to prevent ingress of vermin or back fill.Drain runs must not be any lower than foundation depth unless min.of 1m from any building.Provide roddable access to all change in bends and junctions.Contractor to ensure no live drains run beneath proposed works.

New I.C less than 650mm deep and only one branch connection to be 225mmØ and I.C between 600mm and 1000mm deep to be 450mmØ uPVC Osma or equal approved.I.C over 1000mm deep to be 1200x750 on 150mm C20P concrete base with 215mm Class B brick walls with Grade B medium duty cover

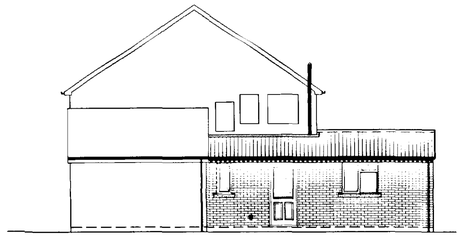

PROPOSED SIDE ELEVATION
Scale 1:100

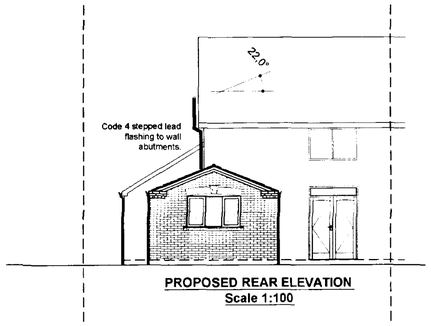

PROPOSED REAR ELEVATION
Scale 1:100

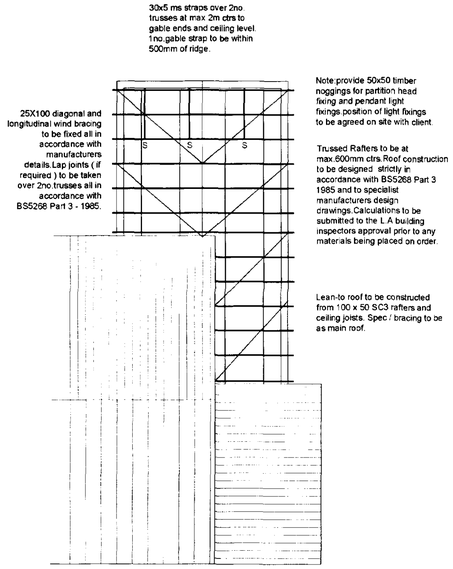

PROPOSED ROOF PLAN
Not to Scale

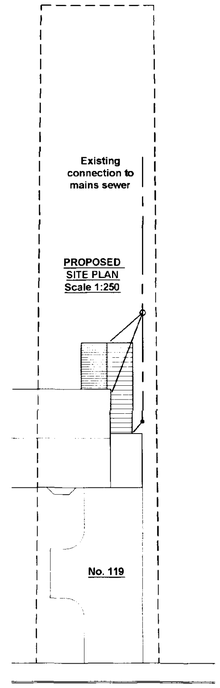

FOUNDATIONS
Existing building area to be stripped of all vegetable matter and rubbish to a min depth of 150mm before excavation commences.Concrete mix for foundations to be GEN3 in accordance with BS5328:1981.Foundations to external wall to be min.700mm wide x 225mm deep.Excavate down to solid firm strata i.e 750mm deep (min.1000mm if soil is of a shrinkable nature) Exact depth to suit conditions on site and to the strict approval of the L.A Building Inspector.*Any irregularities in subsoil during excavation to be brought to the* immediate attention of the Building Inspector & advice to be sought from a Chartered Structural Engineer.

WALLS BELOW D.P.C.
3no Courses of Class B brickwork below D.P.C on outer face and 1no.coarse of 7N/mm2 on inner skin of cavity face.Elsewhere to be either 7N/mm2 concrete blockwork or full width trench blocks.Both to be within 225mm of DPC level.Cavity to be filled to within 225mm min. of below DPC with lean concrete mix.

GROUND FLOOR
65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge polythene separating layer on a 60mm Celotex Double R GA2000 rigid insulation board or similar approved. provide 30mm thick perimeter insulation between screed and floor insulation upto d.p.c level on 100mm thick GEN3 concrete sub-floor on a 1200 gauge DPM lapped onto DPC within walls on min.150mm clean and well compacted hardcore.Depth of hardcore must not exceed 600mm.All service entries to be sealed with pressure sensitive tape. Floor to achieve a min'U' Value of 0.25w/m²K.

DAMP PROOF COARSE (D.P.C).
Horizontal heavy duty polythene DPC to all walls in accordance with BS 6515 and set min.150mm above all external ground levels.DPC in walls must be linked / lapped with DPM in ground floor.Provide performed cavity wall trays above windows & doors with weep vents at a max.of 2m centres with a min.of 2no.per opening.

EXTERNAL WALLS
All external walls to be 265mm overall thickness comprising of:
-100mm Brickwork to match existing
-65mm cavity filled with Crown Dritherm (or equal approved) built in as work progresses.
-100mm Thermalite Shield insulating blockwork.
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties.
External wall to achieve a min 'U' value of 0.35w/m²K.

ROOF VENTILATION
Roof ventilation to be achieved via ventilated ridge ventilators and eaves level ventilators complete with integral insect proof mesh which will supply the roof space with ventilation equivalent to a continuous 25mm gap which are to be fitted in accordance with manufacturers instructions.Lean to roof to be ventilated as above but with proprietory tile ventilators to match proposed tiles as close as possible.

CEILINGS
All ceilings to be 12.7mm plasterboard to BS1230
Ceilings to be have Coving and an Artex finish to match existing or to clients requirements.Plasterboard sheets to be fixed with joints staggered and must be layed perpendicular to all joist runs.Fix boards at a min.150mm centres.

SMOKE ALARMS
To be self contained,interconnected and wired to a separately fused circuit with a battery back up.Smoke alarms to be fitted to uside of plasterboard ceiling to the ground floor max.7m from the kitchen / lounge and to be max. 3m from any bedroom door. All alarms to be strictly in accordance with BS 5446 and to be wired that when one alarm is triggered all alarms are activated.

NOGGINGS
Fix 38x38mm timber noggings to all potential loose plasterboard ceiling edges and light fittings.Position of light fittings to be advised by client on site.

INTERNAL JOINERY ,SKIRTING & ARCHITRAVES
All internal finished timber to be free from all defects and to clients approval prior to ordering any materials.

CAVITIES
Close all cavity walls at jambs with Thermabate insulated cavity closers fitted strictly in accordance with manufacturers instructions. Close top of cavity walls with 75mm Dritherm or similar approved insulation batt supported on wall ties.

MORTAR
All mortar to be 6:1:1 sand:cement:lime or equally approved and *to be a close match to existing as possible.*

WALL TIES
Cavity wall ties to BS1243:1978.To be built into cavity wall as works proceeds and spaced at 900mm centres horizontally,450mm centres vertically and 300mm staggered around all openings.

LINTELS
All lintels to cavity wall to be factory insulated I.G.L1 range unless noted otherwise or equalled approved.All lintels must have a min.150mm endbearing and installed in accordance with manufacturer's instructions. Note: lintels are not to have a continuous baseplate.

WINDOWS
All windows to be White uPVC double glazed to match existing with 8000mm² trickle ventilators all in accordance with clients requirements.Opening vents to give $\frac{1}{20}$th of floor area rapid ventilation to all rooms.All glazing to meet the requirements of section N of the Building Regulations and BS6206 class B All double glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a Low 'E' glass inner pane to achieve a min'U' value of 2.0 w/m²K.Note all windows to have a perimeter weatherseal both internally and externally.

ROOF CONSTRUCTION
To be Trussed Rafters designed and constructed in accordance with BS 5268 Part 3:1985 all by specialist approved manufacturer.Trusses to be set at max.600mm centres with all necessary 100x25 bracing.Truss manufacturer to provide all necessary calculations and details to the Client / Contractor for L.A Building Inspectors approval prior to installation of any roof truss.

TIMBER WALLPLATES
All timber wall plates supporting roof trusses to be 100mm x 50mm bedded on top of wall.Timber to be SC3 grade.Provide anchor straps as described in notes elewhere.

LATERAL RESTRAINT STRAPS
Tie roof structure to brickwork wall with 30X5 galvanised mild steel straps at max 1.8m ctrs where rafters and ceiling joists run parallel to blockwork walls.Also fit at max 1.8m ctrs to anchor wallplate to blockwork wall with min 3no. fixings per strap.

SOAKAWAYS
All soakaways to be min.of 5m from any building & a min of 1m³ filled with rubble to within 450mm of external ground level.Overlay rubble with polythene sheet and backfill with clean topsoil.Note the soakaway inlet pipe must discharge to the centre of the soakaway in all directions.

RAINWATER DRAINAGE
White uPVC guttering and downpipes to match existing.Falls for guttering to be 1:600 and rise and fall brackets fixed at max. 1.5m ctrs.Downpipes to be connected into underground drains via reducing adapter.Underground drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm peagravel and min 150mm surrounds laid to 1:100 falls to new soakaway.Soakaway specification detailed above.

ROOF INSULATION
Lay 300mm mineral fibre insulation to roof area to achieve a 'U' value of 0.16w/m²K 100mm between rafters and 200mm over rafters at right angles to first layer.Fix Dovetail rafter tray in accordance with manufacturers instructions or similar approved where insulation meets roof slope to maintain roof ventilation.

ROOF FINISH
Concrete interlocking roof tiles to match existing in accordance with manufacturers instructions on 38x25 preservative treated timber battens on untearable sarking felt with min.150mm overlaps.

HEATING
Provided from existing with new radiators to have thermostatic radiator control valves.

WASTE SIZES FOR NEW PLUMBING
All new plumbing to have the following waste sizes:
W.C=100mm ø Multikwik or similar approved
W.H.B=32mm ø uPVC with 75mm Deep sealed trap
SINK=40mm ø uPVC with 75mm Deep sealed trap
SHOWER=40mm ø uPVC with 75mm Deep sealed trap
Provide access points to all changes in direction.Provide anti-siphon traps where pipe runs exceed 3m and W.H.B pipe run exceeds 1.8m.

ELECTRICAL INSTALLATION
To be in strict accordance with the latest I.E.E Regulations and Engineer to advise if any appliance or position of appliance does not conform to regulations. Contractor to seek advice from Client with regard to lighting requirements.

Plann[illegible]nt
27 FEB 2003
02/0303
DETERMINED
PLAN

GENERAL CONDITIONS
Contractors are responsible for checking all dimensions on site when work commences and before ordering any materials.Any discrepancies should be brought to the attention of the Client for remedial action before commencing further.

All details shown are based on typical site conditions for that area. any abnormal conditions should be brought to the attention of the Client and Local Authority.

The notes shown are mainly to cover the *requirements of Building Regulations* and should not be treated as full specification.

No allowance has been made for any Structural Calculations,a "SAP" calculation, Soil Investigation or Flood Risk Assessment.If deemed necessary then these will be a chargeable extra.All steel beam sizes shown on drawing are all subject to confirmation from Structural Engineer.

All materials not specified to be of a standard suitable for the work proposed

remway design
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Project:
Proposed Grd Floor Side Kitchen Extension

Client:
Mr & Mrs Houghton
119. Spalding Road
Pinchbeck
PE11 3UE