

S EAST

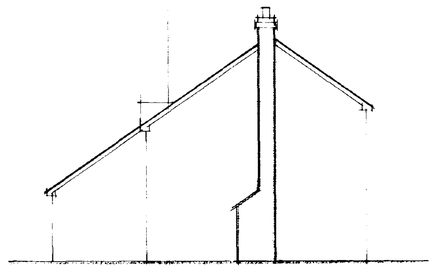

N EAST

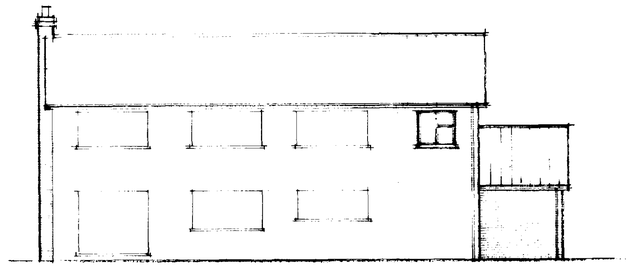

N WEST

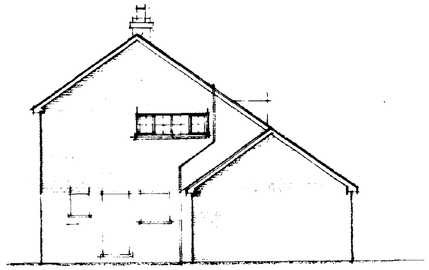

S WEST

FOUNDATIONS

Foundations to be ST4 grade concrete

For 265mm walls foundations to be 700 x 230mm

Foundations to be taken down to a firm loadbearing strata, a min. 1.0m if in shrinkable sub soil, in accordance with the requirements of the Local Authority Building Control Dept. and in accord with the NHBC guidelines for building near trees.
Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.
Any investigation work relating to extg foundations should be carried out prior to the commencement of any works.

FLOOR CONSTRUCTION

Ground - extg garage
extg concrete garage floor.
2 coats min. Synthapruf damp proof material to manuf. specifications and instructions.
Ground - garage floor.
100mm ST4 grade oversite concrete
1200g polythene damp proof membrane
25mm sand blinding
100mm compacted hard-core - if in excess of 100mm fill, to a max. 600mm, the hard-core is to be laid and compacted in layers not exceeding 150mm.
Strip off all vegetable soil beneath proposal.

First
18mm Weyroc floor panels to finish at same level as adjacent bedroom.
150 x 50mm SC3 grade tanalised timber joists at 400mm cts with min. 1 row herringbone strutting midspan
12.7mm plasterboard, fixed in accord with manufacturers instructions, with all necessary noggins etc. and finished with either artex or skim in accord. with clients instructions.

WALL CONSTRUCTION

Below Ground
To be 100mm Class A concrete blocks
Cavity to be filled to 225mm below lowest dpc level with lean mix concrete

Above Ground
To be 265mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
65 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Hemelite (k = 0.44)

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally, 450mm vertically and staggered. To be at every block course vertically at all returns and reveals.

Internal finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.414W/mK

Stud Partitions
to be constructed as follows :-

75 x 50mm head and sole plate
75 x 50mm studs at 400mm cts with min. 2 rows
75 x 50mm noggins equally spaced
75mm glassfibre insulation within framework
face both sides with 12.7mm plasterboard, tape joint and skim finish

stud partitions to be constructed off doubled up floor joists (bolted together at 1.0m cts) at first floor level when running parallel to joists, and off 75 x 50mm sole plate, with solid blocking between joists, when running perpendicular to joists.

DPC in Walls
To be a min. 150mm above finished ground level
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.
A dpc cavity tray, stepped as applicable, is to be constructed within the wall immediately above an abutment.

LINTELS

Lintels to be IG, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels over internal openings to be IG Internal 100 lintels unless specified otherwise.

Lintels to be protected with min. 15mm gypsum plaster skim finish to give a min. half hour fire protection.

WINDOWS & DOORS

Windows to be purpose made UPVC, double glazed with 12mm air gap to sealed units and weather stripped.

Windows to incorporate a controllable trickle vent of 4000 sq. mm.

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

The en suite shower room is to be mechanically ventilated direct to the external air. The capacity of the extractor is to be 15 litres/sec.

All internal rooms are to be mechanically ventilated direct to the external air. Extractors are to be capable of a min. 3No. air changes per hour and are to incorporate a 15 minute over-run period when installed in bathroom.

ELECTRICAL INSTALLATION

The Electrical Contractor is to ensure that the electrical installation is in full compliance with the latest edition of the I.E.E. Regulations
Any electrical fitting indicated on the drawing in a position contravening these regulations must be relocated in order to achieve full compliance.

HOT WATER SYSTEM

A room thermostat or radiator valves are to be installed.

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.45W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

DRAINAGE

Surface
Excavate for and lay in where indicated 100mm diam. flexible jointed UPVC drains on 100mm pea gravel bed from 100mm diam. upturned bend at base of downpipe to surface water soakaway.

Form soakaway where indicated a min. 5.0m from the nearest building. Excavate 1200 x 1200 x 1200mm deep, backfill with brick rubble to 300mm below ground level, lay in sheet polythene and make up with vegetable soil.

Foul
Supply and install proprietary upvc inspection chambers on 100mm pea gravel bed in strict accordance with manufacturers instructions. Inspection chambers to conform to the following sizes : -

Depth	Internal diam	Cover diam
.6m or less	190mm	190mm
1.0m or less	450 mm	450mm

Excavate for and lay in where indicated 100mm diam. flexible jointed upvc drains on 100mm pea gravel bed at a gradient of 1 : 70.

Where 100mm diam. drains pass through walls they are to be protected by the use of a lintel over. Both sides the wall to be masked with rigid sheet material with 50mm clearance of the pipe.

Where 100mm diam drains pass beneath the building they are to be exposed, inspected for damage, renewed as necessary prior to being encased in 150mm pea gravel.

Install where indicated a 100mm diam. soil and vent pipe jointed to 100mm diam. upturned bend at base. Finish at top, a min. 900mm above window head height, with a durable cage.

Install 40mm diam. pvc waste to shower, *(NOTE : shower tray to be constructed on a suitable plinth to maintain access to trap and waste)*, 32mm diam. pvc waste to hand basins all with 75mm deep traps. 40mm diam. pvc waste to bath with combined trapped waste and overflow. *Unless specified other wise on plan.*

All waste pipes to have rodding access at each change of direction and be readily accessible throughout their length.

Above ground drainage to comply with BS5272 : 1978
Below ground drainage to comply with BS8301 : 1985

All drainage items are to be installed in strict accordance with the manufacturers instructions.

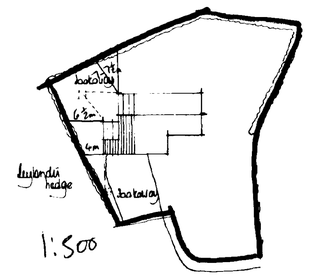

BLOCK PLAN

GROUND FLOOR PLAN

CHIMNEY CONSTRUCTION

The chimney is to be constructed incorporating clay flue liners to BS1181 : 1989. Liners to be a min. 200mm internal diameter and laid socket uppermost. Weak mix concrete is to be used to fill the voids between the masonry brickwork of the chimney and the flue liner. Chimney to terminate as indicated on elevation and flashed to the roof using Code 4 lead flashing, stepped as applicable, dressed up the chimney a min. 150mm.

Hearth to open fire to be min. 125mm o/a thickness, project 500mm from the face of the fire and extend 150mm past the jambs of the fire.

Fireguard fixing points to be provided.

A permanent air entry opening, to BS8303 : 1986, of at least 50% of the throat area is to be provided where indicated.

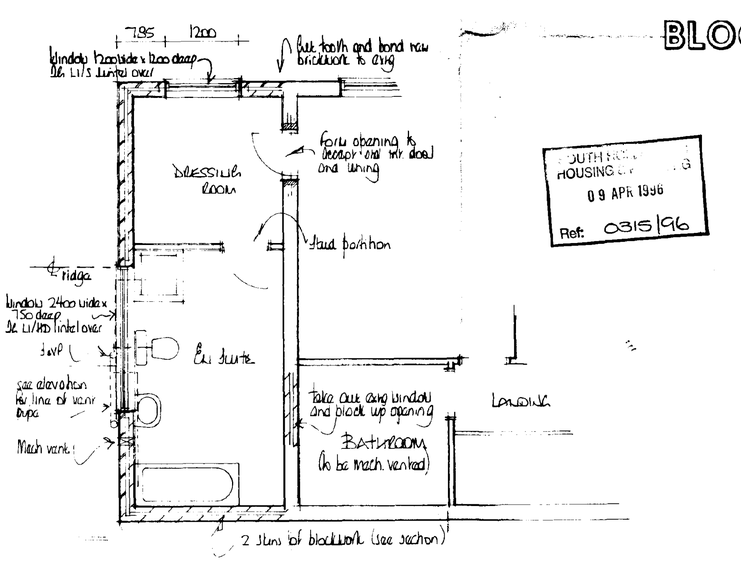

FIRST FLOOR PLAN

SOUTH... HOUSING ... G
09 APR 1996
Ref: 0315/96

A		
	Date	Revisions

© copyright

East Midlands Design Associates
"Willow Lodge",
Horseshoe Road,
Spalding,
Lincs. PE11 3JA
Tel: Spalding (0775) 767968

Client
MR A. MRS M. BROWNE

Job Title
Extension. Alterations including construction of chimney at
25 Vicarow Drive
Pinchbeck

Drawing Title
Plans. Elevations

Scale
1:50. 1:100

Date
April 96

Drawn by
DL

Drg No
96/12/01

Rev

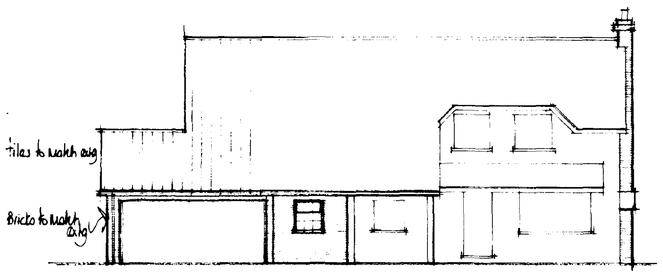

S EAST

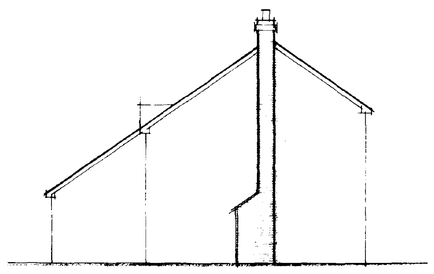

N EAST

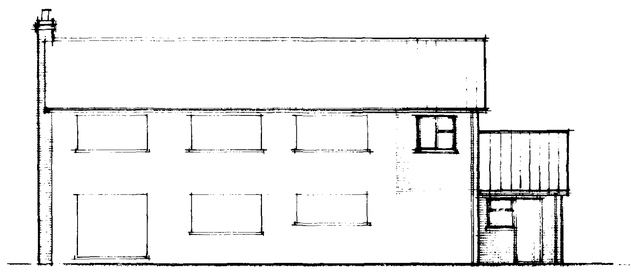

N WEST

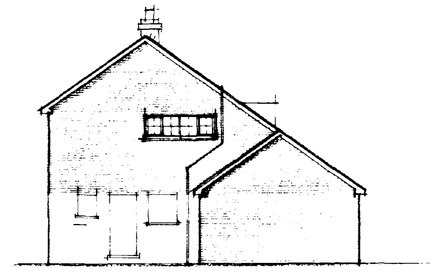

S WEST

FOUNDATIONS

Foundations to be ST4 grade concrete

For 265mm walls foundations to be 700 x 230mm

Foundations to be taken down to a firm loadbearing strata, a min. 1.0m if in shrinkable sub soil, in accordance with the requirements of the Local Authority Building Control Dept. and in accord with the NHBC guidelines for building near trees.
Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.
Any investigation work relating to extg foundations should be carried out prior to the commencement of any works.

FLOOR CONSTRUCTION

Ground - extg garage
extg concrete garage floor.
2 coats min. Synthapruf damp proof material to manuf. specifications and instructions.
Ground - garage floor,
100mm ST4 grade oversite concrete
1200g polythene damp proof membrane
25mm sand blinding
100mm compacted hard-core - if in excess of 100mm fill, to a max. 600mm, the hard-core is to be laid and compacted in layers not exceeding 150mm.
Strip off all vegetable soil beneath proposal.

First
18mm Weyroc floor panels to finish at same level as adjacent bedroom.
150 x 50mm SC3 grade tanalised timber joists at 400mm cts with min. 1 row herringbone strutting mkspan 12.7mm plasterboard, fixed in accord with manufacturers instructions, with all necessary noggins etc. and finished with either artex or skim in accord. with clients instructions.

WALL CONSTRUCTION

Below Ground
To be 100mm Class A concrete blocks
Cavity to be filled to 225mm below lowest dpc level with lean mix concrete

Above Ground
To be 265mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
65 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Hemelite (k = 0.44)

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally, 450mm vertically and staggered. To be at every block course vertically at all returns and reveals.

Internal finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.414W/mK

Stud Partitions
to be constructed as follows :-

75 x 50mm head and sole plate
75 x 50mm studs at 400mm cts with min. 2 rows
75 x 50mm noggins equally spaced
75mm glassfibre insulation within framework
face both sides with 12.7mm plasterboard, tape joint and skim finish

stud partitions to be constructed off doubled up floor joists (bolted together at 1.0m cts) at first floor level when running parallel to joists, and off 75 x 50mm sole plate, with solid blocking between joists, when running perpendicular to joists.

DPC in Walls
To be a min. 150mm above finished ground level
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.
A dpc cavity tray, stepped as applicable, is to be constructed within the wall immediately above an abutment.

LINTELS

Lintels to be IG, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels over internal openings to be IG Internal 100 lintels unless specified otherwise.

Lintels to be protected with min. 15mm gypsum plaster skim finish to give a min. half hour fire protection.

WINDOWS & DOORS

Windows to be purpose made UPVC, double glazed with 12mm air gap to sealed units and weather stripped.

Windows to incorporate a controllable trickle vent of 4000 sq. mm.

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

The en suite shower room is to be mechanically ventilated direct to the external air. The capacity of the extractor is to be 15 litres/sec.

All internal rooms are to be mechanically ventilated direct to the external air. Extractors are to be capable of a min. 3No. air changes per hour and are to incorporate a 15 minute over-run period when installed in bathroom.

ELECTRICAL INSTALLATION

The Electrical Contractor is to ensure that the electrical installation is in full compliance with the latest edition of the I.E.E. Regulations
Any electrical fitting indicated on the drawing in a position contravening these regulations must be relocated in order to achieve full compliance.

HOT WATER SYSTEM

A room thermostat or radiator valves are to be installed.

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.45W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

DRAINAGE

Surface
Excavate for and lay in where indicated 100mm diam. flexible jointed UPVC drains on 100mm pea gravel bed from 100mm diam. upturned bend at base of downpipe to surface water soakaway.

Form soakaway where indicated a min. 5.0m from the nearest building. Excavate 1200 x 1200 x 1200mm deep, backfill with brick rubble to 300mm below ground level, lay in sheet polythene and make up with vegetable soil.

Foul
Supply and install proprietary upvc inspection chambers on 100mm pea gravel bed in strict accordance with manufacturers instructions. Inspection chambers to conform to the following sizes : -

Depth	Internal diam	Cover diam
.6m or less	190mm	190mm
1.0m or less	450 mm	450mm

Excavate for and lay in where indicated 100mm diam. flexible jointed upvc drains on 100mm pea gravel bed at a gradient of 1 : 70.

Where 100mm diam. drains pass through walls they are to be protected by the use of a lintel over. Both sides the wall to be masked with rigid sheet material with 50mm clearance of the pipe.

Where 100mm diam drains pass beneath the building they are to be exposed, inspected for damage, renewed as necessary prior to being encased in 150mm pea gravel.

Install where indicated a 100mm diam. soil and vent pipe jointed to 100mm diam. upturned bend at base. Finish at top, a min. 900mm above window head height, with a durable cage.

Install 40mm diam. pvc waste to shower, *(NOTE : shower tray to be constructed on a suitable plinth to maintain access to trap and waste)*, 32mm diam. pvc waste to hand basins all with 75mm deep traps, 40mm diam. pvc waste to bath with combined trapped waste and overflow. *Unless specified other wise on plan.*

All waste pipes to have rodding access at each change of direction and be readily accessible throughout their length.

Above ground drainage to comply with BS5272 : 1978
Below ground drainage to comply with BS8301 : 1985

All drainage items are to be installed in strict accordance with the manufacturers instructions.

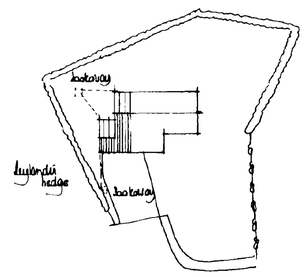

BLOCK PLAN

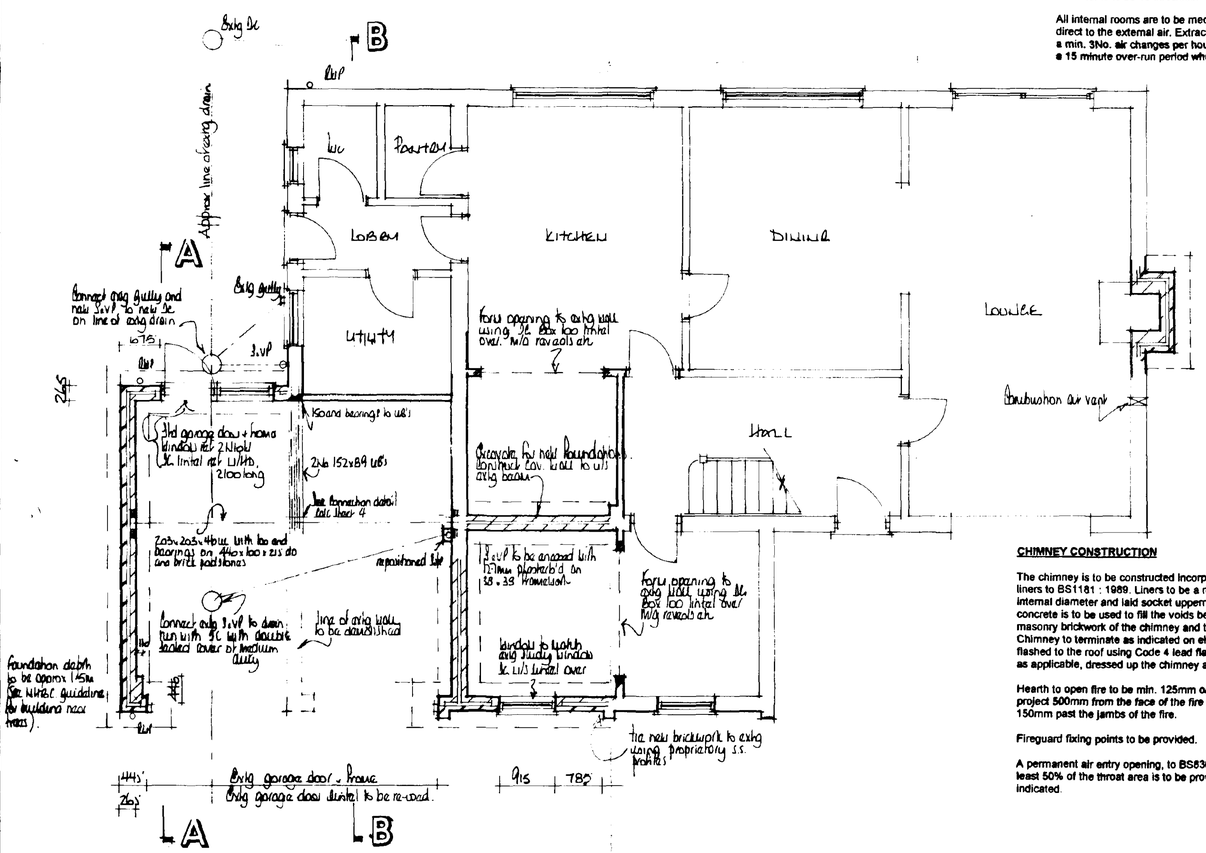

GROUND FLOOR PLAN

CHIMNEY CONSTRUCTION

The chimney is to be constructed incorporating clay flue liners to BS1181 : 1989. Liners to be a min. 200mm internal diameter and laid socket uppermost. Weak mix concrete is to be used to fill the voids between the masonry brickwork of the chimney and the flue liner. Chimney to terminate as indicated on elevation and flashed to the roof using Code 4 lead flashing, stepped as applicable, dressed up the chimney a min. 150mm.

Hearth to open fire to be min. 125mm o/a thickness, project 500mm from the face of the fire and extend 150mm past the jambs of the fire.

Fireguard fixing points to be provided.

A permanent air entry opening, to BS8303 1986, of at least 50% of the throat area is to be provided where indicated.

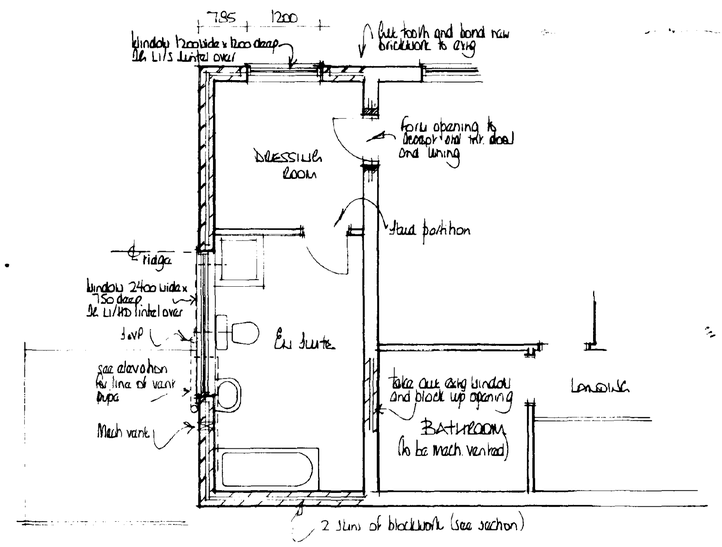

FIRST FLOOR PLAN

SOUTH HOLLAND DC
HOUSING & PLANNING
17 JUN 1996
Ref: 0315/96

AMENDED PLAN
Ref. A1

C	14/06/96	Window + door added to garage
B	23/05/96	Amended to L.A. Building Control requirements
A	19/04/96	Plan redrawn from garage
	Date	Revisions

© copyright

East Midlands Design Associates
"Willow Lodge",
Horseshoe Road,
Spalding,
Lincs. PE11 3JA
Tel: Spalding (0775) 767968

Client
MR A. MRS M. BROWNE

Job Title
EXTENSION & ALTERATIONS INCLUDING CONSTRUCTION OF CHIMNEY AT
25 WILLOW DRIVE
PINCHBECK

Drawing Title
PLANS & ELEVATIONS

Scale 1:50 & 1:100

Date April 96

Drawn by AL

Drg. No. 96/12/01

Rev B