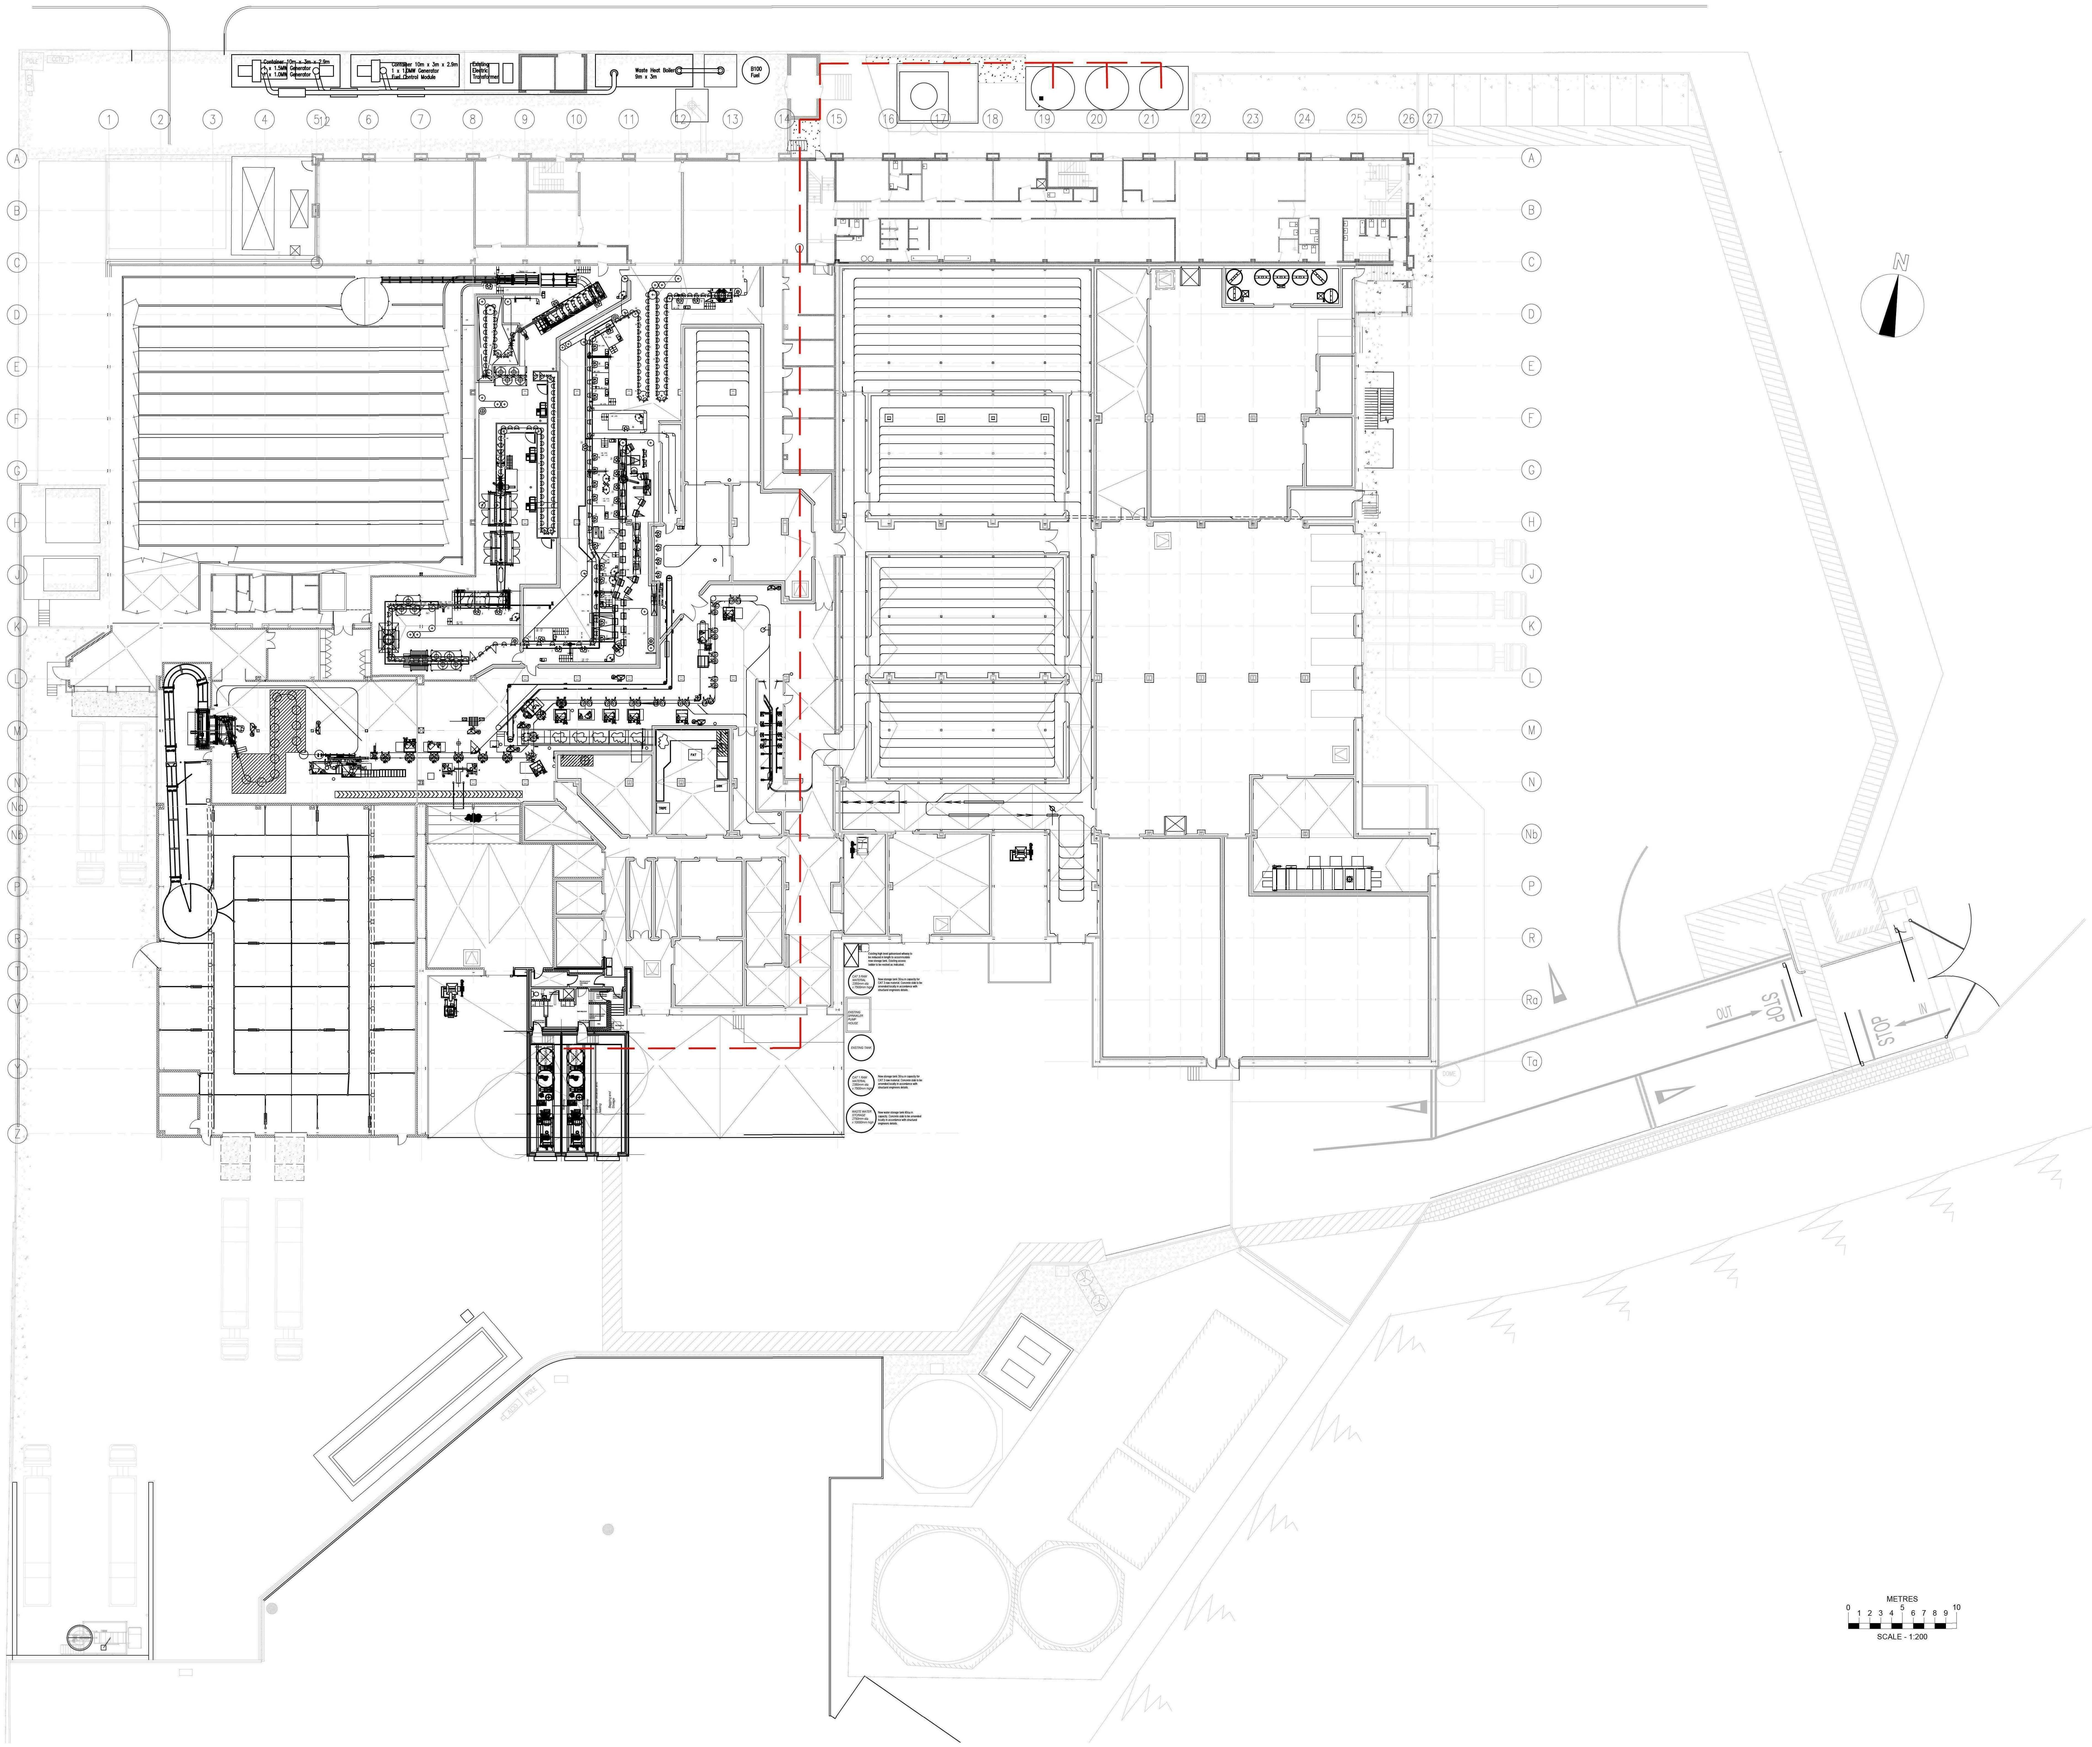

Container 12m x 2m x 2.9m
1 x 12kW Generator
1 x 12kW Generator
Container 10m x 3m x 2.9m
1 x 12kW Generator
Fuel Control Module
Existing Electric Substation
Waste Heat Boiler
9m x 3m
B100
Fuel
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27
A B C D E F G H J K L M N Na Nb P R T V Y Z
Existing high level galvanised railing to be retained. Existing gates to be removed. New railing panels made to be noted as indicated.
EXISTING NATURAL VENTILATION (150mm dia)
New storage tank 30cu.m capacity for waste heat boiler. Tank to be bunded to 110% of tank capacity in accordance with relevant legislation issues.
EXISTING CIRCULAR FLUE
EXISTING FLUE
EXT 1 000 EXISTING VENTILATION (150mm dia)
New storage tank 30cu.m capacity for waste heat boiler. Tank to be bunded to 110% of tank capacity in accordance with relevant legislation issues.
EXIST INTAKE VENTILATION (150mm dia)
New waste storage tank 30cu.m capacity. Tank to be bunded to 110% of tank capacity in accordance with relevant legislation issues.
Existing Boiler House
Existing Workshop
Existing Workshop
Existing Workshop