



**LAND OFF SURFLEET ROAD, PINCHBECK  
COMBINED FLOOD RISK ASSESSMENT &  
DRAINAGE STRATEGY**

**On behalf of Minister Property Group  
June 2022**

**Document Control Sheet**

**Project Name** Land off Surfleet Road, Pinchbeck (PE11 3XY)

**Report Title** Combined Flood Risk Assessment & Drainage Strategy

**Client** Minister Property Group

**Date of Origin** 09 June 2022

**Project Number** 1-198

| Revision | Date     | Issued for | Prepared by | Approved by |
|----------|----------|------------|-------------|-------------|
| -        | 18/01/22 | Planning   | DT          | DRM         |
| A        | 28/01/22 | Planning   | DT          | DRM         |
| B        | 17/05/22 | Planning   | DT          | DRM         |
| C        | 09/06/22 | Planning   | DT          | DRM         |

## Contents

|     |                                              |    |
|-----|----------------------------------------------|----|
| 1   | Introduction.....                            | 5  |
| 2   | Existing Site.....                           | 6  |
| 2.1 | Site Location .....                          | 6  |
| 2.2 | Site Hydrology.....                          | 6  |
| 2.2 | Site Topography.....                         | 6  |
| 2.3 | Site Geology .....                           | 6  |
| 3   | Development Proposals .....                  | 8  |
| 4   | Flood Risk .....                             | 9  |
| 4.1 | Policy & Best Practice .....                 | 9  |
| 4.2 | Fluvial Flooding.....                        | 9  |
| 4.3 | Surface Water Flooding.....                  | 9  |
| 4.4 | Groundwater Flooding.....                    | 10 |
| 4.5 | Artificial Flooding.....                     | 10 |
| 4.6 | Reservoir Flooding .....                     | 10 |
| 4.7 | Flood Vulnerability.....                     | 11 |
| 5   | Flood Mitigation .....                       | 12 |
| 5.1 | Flooding Mitigation Measures.....            | 12 |
| 5.2 | Flood Warning.....                           | 12 |
| 6   | Surface Water (SuDS) Drainage Strategy ..... | 13 |
| 6.1 | Surface Water Drainage Disposal .....        | 13 |
| 6.2 | Surface Water Runoff Rate & Volume .....     | 14 |
| 6.2 | Surface Water Drainage Proposals .....       | 14 |
| 6.3 | Exceedance Events .....                      | 14 |
| 6.4 | Surface Water Management & Maintenance ..... | 14 |
| 7   | Proposed Foul Water Drainage .....           | 17 |
| 8   | Conclusion .....                             | 18 |

## Appendices

Appendix A – Site Location Plan

Appendix B – Existing Anglian Water asset mapping

Appendix C – Topographical Survey

Appendix D – British Geology Survey Information Extracts

Appendix E – Development Masterplan

Appendix F – Fluvial Flooding Information

Appendix G – Surface Water Flooding Information

Appendix H – Reservoir Flooding Information

Appendix I – Flood & Evacuation Plan

Appendix J – Drainage Strategy Plan and Associated Information

Appendix K – Anglian Water Pre-development Enquiry Response

# 1 Introduction

Civilistix Consulting Engineers has been commissioned by Minister Property Group to prepare a Combined Flood Risk Assessment (FRA) and Drainage Strategy to support a planning application for a proposed residential development consisting of 37 residential plots, 4 self-build plots and associated infrastructure at Land off Surfleet Road, Pinchbeck (PE11 3XY).

In total, the development redline boundary occupies a total area of 1.749ha. Of this area, it is proposed 0.7764ha will become impermeable when the development is completed. When compared to the existing impermeable area of 0ha, as the site is greenfield, this presents an increase of 0.7764ha generating 44% of impermeable area.

The purpose of this combined FRA and Drainage Strategy is to demonstrate how this impermeable area can be satisfactorily drained without increasing flood risk onsite and elsewhere. The strategy has been developed in full accordance with National and Local standards as well as best practice documentation.

Specifically, this FRA and Drainage Strategy demonstrates that the proposed development does not lead to an increase in;

- Peak runoff rate of storm water runoff leaving the site
- Volume of runoff leaving the site
- Pollution to receiving waters from storm water runoff
- Flood risk to nearby or neighbouring sites

## 2 Existing Site

### 2.1 Site Location

The site is located at grid reference (524519, 326592) and is 1.749 ha in total area.

The address of the site is Land off Surfleet Road, Pinchbeck, Crossgate, PE11 3XY, United Kingdom.

The existing site is fully greenfield.

The site is bound by residential development to the south, west and north and a solar farm to the east.

A site location plan is shown in [Appendix A](#)

### 2.2 Site Hydrology

A private watercourse abuts the south and east boundary which conveys runoff south-east and ultimately to “Captains Drain” around 150m south of the development site.

Based on onsite observation and topographical survey information, it is believed the existing site drains via a combination of infiltration and discharge to the perimeter ditch network.

Existing Anglian Water asset mapping is shown in [Appendix B](#)

### 2.2 Site Topography

A Topographical survey of the site and surrounding area was prepared by EMP Drainage Ltd (ref; 4273/T/01-02), dated November 2021.

The Topographical survey indicates levels at the location of the existing land to be ~3.05 Above Ordnance Datum (AOD)

Levels show a fall from north to south of around 1:250, from around 3.61 AOD and 2.84 AOD respectively.

The Topographical survey is shown in [Appendix C](#)

### 2.3 Site Geology

An intrusive Ground Investigation was undertaken by Elemental GI Ltd, (ref; E21142) dated 12<sup>th</sup> November 2021. Key findings are shown below:

- Borehole No WS01 identifies 0.40m made ground/topsoil on top of sandy CLAY/SILT 0.95m Deep and on top of silty SAND 2.0m deep. Water encountered from 1.0m deep.
- Borehole No WS02 identifies 0.35m made ground/topsoil on top of sandy SILT 3.0m deep. Water encountered from 0.95m deep.
- Borehole No WS03 identifies 0.40m made ground/topsoil on top of silty SAND 3.0m deep. Water encountered from 1.20m deep.
- Borehole No WS04 identifies 2.0m made ground/topsoil comprising gravelly sandy silt on top of SAND 3.0m deep. Water encountered from 0.80m deep.
- Borehole No WS05 identifies 0.30m made ground/topsoil on top of CLAY/SILT 0.65m deep and on top of SAND 1.0m. Water encountered from 0.70m deep.
- Borehole No WS06 identifies 1.40m made ground/topsoil on top of CLAY/SILT 3.10m deep and on top of SAND 4.0m. Water encountered from 1.10m deep.
- Borehole No WS06A identifies 0.50m made ground/topsoil on top of SILT 0.80m deep, on top of CLAY/SILT 2.0m and on top of SAND 3.0m deep. Water encountered from 1.45m deep.

- Borehole No WS07 identifies 0.70m made ground/topsoil on top of CLAY 0.75m deep, on top of CLAY/SILT 1.50m and on top of SAND 5.0m deep. Water encountered from 1.50m deep.

Results of British Geological Survey identifies Kellaways Formation and Oxford Clay Formation, Mudstone, Siltstone and Sandstone.

Environment Agency (EA) information indicates the site to be within a Third aquifer zone and within a high groundwater vulnerability area.

Locations and Logs in context to the site are provided in [Appendix D](#)

### 3 Development Proposals

Development proposals are for a residential development consisting of 37 residential units, 4 self build plots and associated external hard and soft landscaping and associated infrastructure. In summary, development proposals consist of the following;

- Construction of 37 residential plots and 4 self build plots (0.2215 ha in area)
- Creation of an adoptable estate road (0.2150 ha in area)
- Prepared private external hardstanding area (0.3399 ha in area)

In total development proposals provide an additional impermeable area of 0.7764ha. When compared to the existing site which is fully greenfield, this presents an increase in impermeable area of 0.7764ha.

Development plans of the site are provided in **Appendix E**

## 4 Flood Risk

### 4.1 Policy & Best Practice

This Combined Flood Risk Assessment & Drainage Strategy has been primarily designed in accordance with the following best practice drainage documentation;

- Cambridge Level 1 Strategic Flood Risk Assessment (SFRA), September 2010
- Department for Communities and Local Government National Planning Policy Framework, 2012.
- Environment Agency (EA) publications and modelling outputs
- CIRIA 753, 2015: The SuDS Manual; This document provides current best practice and National guidance on the planning, design, construction, operation and maintenance of SuDS to facilitate their effective implementation within developments.
- Building Regulations Part H (2010); Drainage and Water Disposal.

### 4.2 Fluvial Flooding

The EA information shows that the site is protected by flood defences along each side of the River Glen. These are in the form of earth embankments and concrete floodwalls (these are identified by the EA as being in a “fair condition”). EA flood mapping shows these flood defences to offer a level of protection at least up to the 1:1000 year + climate change AEP event. Due to the distance of the site from the River Glen (~450), the development would only potentially be at risk of fluvial flooding if the existing defences along the River Glen catastrophically failed.

The fluvial flood level at the location of the site is inconclusive and is not provided within the EA model. The closest flood level provided is at node ref; “GLEN 5860” located directly within the River Glen channel, ~450m from the site. Flood level information taken at GLEN 5860 indicates a flood level of 4.81 AOD during the 100 year + 20% climate change event. This flood level however has been calculated directly within the channel of the river where water levels would rise significantly due to the restriction applied by the existing adjacent flood defences. On this basis, this level is suggested not to be accurate if the flood defences catastrophically failed since the restricting effect to flood water would decrease as water dispersed across the land between the site and the River Glen. Using this level to even gauge a ball park flood level at the location of the site (450m away from GLEN 5860) is therefore not seen to be possible however it can reliably be estimated to be significantly lower than that provided by GLEN 5860.

To offer some level of protection however from shallow flood levels (which it is considered may become apparent if the existing flood defences along the River Glen failed), proposed Finished Floor Levels (FFLS) will be raised a min of 0.30m above existing ground levels. It is believed this measure would offer protection against shallow flood levels allowing floodwater to continue to be naturally conveyed west to east in an instance of flood defence failure (following the natural topography of the existing ground levels).

No historic flood event within vicinity of the site from fluvial flooding has been recorded by the EA.

The site is not at risk from tidal flooding.

Fluvial flooding information is shown in **Appendix F**

### 4.3 Surface Water Flooding

Review of EA surface water flood mapping identifies the development to be within the “low / very low” flooding extents with flooding depth below 300mm.

Surface water flooding information is shown in **Appendix G**

It is believed therefore the existing site is at low / *very low* risk of surface water flooding.

Risks of surface water flooding will be further reduced by the implementation of a SuDS surface water drainage strategy identified in [Section 6](#).

#### 4.4 Groundwater Flooding

Based on the Ground Investigation by Elemental GI Ltd, (ref; E21142) dated 12<sup>th</sup> November 2021, the following was observed

- Borehole No WS01 identifies 0.40m made ground/topsoil on top of sandy CLAY/SILT 0.95m Deep and on top of silty SAND 2.0m deep. Water encountered from 1.0m deep.
- Borehole No WS02 identifies 0.35m made ground/topsoil on top of sandy SILT 3.0m deep. Water encountered from 0.95m deep.
- Borehole No WS03 identifies 0.40m made ground/topsoil on top of silty SAND 3.0m deep. Water encountered from 1.20m deep.
- Borehole No WS04 identifies 2.0m made ground/topsoil comprising gravelly sandy silt on top of SAND 3.0m deep. Water encountered from 0.80m deep.
- Borehole No WS05 identifies 0.30m made ground/topsoil on top of CLAY/SILT 0.65m deep and on top of SAND 1.0m. Water encountered from 0.70m deep.
- Borehole No WS06 identifies 1.40m made ground/topsoil on top of CLAY/SILT 3.10m deep and on top of SAND 4.0m. Water encountered from 1.10m deep.
- Borehole No WS06A identifies 0.50m made ground/topsoil on top of SILT 0.80m deep, on top of CLAY/SILT 2.0m and on top of SAND 3.0m deep. Water encountered from 1.45m deep.
- Borehole No WS07 identifies 0.70m made ground/topsoil on top of CLAY 0.75m deep, on top of CLAY/SILT 1.50m and on top of SAND 5.0m deep. Water encountered from 1.50m deep.

Locations and Logs in context to the site are provided in [Appendix D](#).

A summary of the Ground Investigation by Elemental GI Ltd, (ref; E21142) dated 12<sup>th</sup> November 2021 showing water level strikes is shown in [Appendix A](#)

Environment Agency (EA) information indicates the site to be within a Third aquifer zone and within a groundwater flooding area.

It is believed therefore the existing development site is at *low / medium* risk of groundwater flooding.

Risks of surface water flooding will be further reduced by the implementation of a SuDS surface water drainage strategy identified in [Section 6](#).

#### 4.5 Artificial Flooding

No public surface or foul water sewers are within vicinity of the site (Refer to [Appendix B](#) showing AW asset mapping).

It is believed therefore the existing site is at *very low* risk of artificial flooding.

#### 4.6 Reservoir Flooding

EA Reservoir Flood mapping identifies the site to be at very low risk of reservoir flooding.

Reservoir flooding information is shown in [Appendix H](#)

It is believed therefore all development is at *very low* risk\* of reservoir flooding.

\*(Due to the way reservoir flood mapping is formulated on the EA flood mapping portal and the absence of bespoke EA hydraulic modelling within vicinity of the site, the flood risk category of reservoir flooding is unknown in this instance) \*

## 4.7 Flood Vulnerability

Technical guidance to the National Planning Policy Framework (NPPF) 2012, divides land use into five classifications as follows;

- Essential infrastructure e.g essential transport infrastructure and utility infrastructure, wind turbines
- Highly vulnerable e.g caravans, mobile homes and park home intended for permanent residential use
- More vulnerable e.g hospitals, residential institutions, dwelling houses
- Less vulnerable e.g shops, land and buildings used for agriculture, non-residential institutions, assembly and leisure
- Water compatible e.g docks, marinas and wharves, amenity open space, sports grounds (and essential facilities such as changing rooms)

The flood risk vulnerability categorisation for the development is “more vulnerable” development. “More vulnerable” development is permissible within flood zone 3a on the basis the exception test is passed and that it can be demonstrated, the development and its occupants will be safe across the lifetime of the development.

| Vulnerability classification |         | Essential Infrastructure | Highly vulnerable | More vulnerable | Less Vulnerable | Water compatible |
|------------------------------|---------|--------------------------|-------------------|-----------------|-----------------|------------------|
| Flood Zone                   | Zone 1  | ✓                        | ✓                 | ✓               | ✓               | ✓                |
|                              | Zone 2  | ✓                        | Exception Test    | ✓               | ✓               | ✓                |
|                              | Zone 3a | Exception Test           | x                 | Exception Test  | ✓               | ✓                |
|                              | Zone 3b | Exception Test           | x                 | x               | x               | ✓                |

Key: ✓ Development is appropriate x Development should not be permitted (Source: PPS25 Table D3)

Figure 2 – NPPF Flood Risk Vulnerability & Flood Zone Compatibility

## 5 Flood Mitigation

### 5.1 Flooding Mitigation Measures

To reduce the impacts of flooding, specifically from fluvial and potential groundwater flooding, the developer will undertake the following mitigation measures;

- Ensure proposed finished floor levels are a min of 0.30m higher than estimated 100year +40%cc flood levels.
- Preparation of an onsite SuDS Surface Water Drainage Strategy (refer to [Section 6](#))
- Ensure an emergency flood plan and safe access and escape routes are in place across the lifetime of the development (see [Section 5.2 & 5.3](#))

### 5.2 Flood Warning

The applicant will implement flood warnings and subscribe to the EA and local area flood warning service.

The flood warning service has 3 types of warning that will help the applicant prepare for flooding and take action;

- Flood alert
- Flood warning
- Severe flood warning

### 5.3 Flood & Evacuation Plan

Occupants should plan for flooding before and after a flooding event occurs. It is proposed the applicant will follow the guidance contained within [Appendix I](#)

Upon an imminent flood event occurring or during a flooding event and if safe to do so, occupants will group and subsequently exit the site onto Surfleet Road (towards the centre of Crossgate).

### 5.4 Existing and Proposed Flood Risk

A summary of the flood risk posed from each flood source before and after development (including with the implemented proposed mitigation measures) are provided within [Table 1](#) below;

| Type of Flooding       | Existing Risk Category | Proposed Risk Category |
|------------------------|------------------------|------------------------|
| Fluvial flooding       | High Risk              | Low/Medium Risk        |
| Surface Water flooding | Very Low Risk          | Very Low Risk          |
| Groundwater flooding   | Low / Medium Risk      | Low Risk               |
| Artificial flooding    | Very Low Risk          | Very Low Risk          |
| Reservoir flooding     | Very Low Risk          | Very Low Risk          |

**Table 1 – Flood Risk Summary from all sources before and after development**

## 6 Surface Water (SuDS) Drainage Strategy

### 6.1 Surface Water Drainage Disposal

Part H of the Building Regulations (2010) recommends surface water run-off shall discharge to one of the following, listed in order of priority:

- An adequate soakaway or some other adequate infiltration system, or where that is not reasonably practicable,
- A watercourse, or, where that is not reasonably practicable,
- A sewer.

Each disposal mechanism in turn has been reviewed in context of the development site;

#### Infiltration Disposal

An intrusive Ground Investigation carried out by Elemental GI Ltd, (ref; E21142) dated 12<sup>th</sup> November 2021 indicated the following;

- Borehole No WS01 identifies 0.40m made ground/topsoil on top of sandy CLAY/SILT 0.95m deep and on top of silty SAND 2.0m deep. Water encountered from 1.0m deep.
- Borehole No WS02 identifies 0.35m made ground/topsoil on top of sandy SILT 3.0m deep. Water encountered from 0.95m deep.
- Borehole No WS03 identifies 0.40m made ground/topsoil on top of silty SAND 3.0m deep. Water encountered from 1.20m deep.
- Borehole No WS04 identifies 2.0m made ground/topsoil comprising gravelly sandy silt on top of SAND 3.0m deep. Water encountered from 0.80m deep.
- Borehole No WS05 identifies 0.30m made ground/topsoil on top of CLAY/SILT 0.65m deep and on top of SAND 1.0m. Water encountered from 0.70m deep.
- Borehole No WS06 identifies 1.40m made ground/topsoil on top of CLAY/SILT 3.10m deep and on top of SAND 4.0m. Water encountered from 1.10m deep.
- Borehole No WS06A identifies 0.50m made ground/topsoil on top of SILT 0.80m deep, on top of CLAY/SILT 2.0m and on top of SAND 3.0m deep. Water encountered from 1.45m deep.
- Borehole No WS07 identifies 0.70m made ground/topsoil on top of CLAY 0.75m deep, on top of CLAY/SILT 1.50m and on top of SAND 5.0m deep. Water encountered from 1.50m deep.

Locations and Logs in context to the site are contained within **Appendix D**

A summary of the Ground Investigation by Elemental GI Ltd, (ref; E21142) dated 12<sup>th</sup> November 2021 showing water level strikes is shown in **Appendix A**

Due to groundwater being identified within 1.00m from ground level in several locations across the site, it is concluded infiltration discharge of surface water is not feasible. This is because it would not be possible to ensure a minimum of 1.0m separation (the minimum allowable within the SuDS manual) between groundwater and the formation level of infiltration structures.

#### Watercourse Connection

The site is adjacent to a private watercourse to the south-east and it is proposed the proposed development site will discharge into this at greenfield runoff rates.

## 6.2 Surface Water Runoff Rate & Volume

It is proposed all runoff from the proposed residential development and associated perimeter hardstanding areas will be attenuated and controlled at the 1:1 year greenfield runoff rate (equivalent to 1.4 l/s) for all storm events up to and including the critical 100 year plus 40% climate change event.

## 6.2 Surface Water Drainage Proposals

It is proposed the residential development and external hardstanding area (equivalent to an impermeable area of 0.7034 ha) will be connected via a carrier pipe network conveying flows to an attenuation pond. All flows will then be controlled to 1.4l/s/ha via a pumping station discharging to the existing watercourse. A surface water pump station is required due to extensive site build-up (in excess of 1.0m of fill material) if a full gravity system was implemented due to a shallow existing ditch invert level and existing site levels.

All private external hardstanding areas will be constructed using permeable paving.

Further to providing attenuation to accommodate the critical 100 year plus 40% climate change event, the attenuation pond will also ensure runoff is fully treated in line with best guidance contained within The SuDS Manual prior to being discharged offsite.

## 6.3 Exceedance Events

Whilst it is a requirement to fully attenuate the 1 in 100 year critical storm event plus 40% climate change, it is also necessary to ensure storms which exceed this severity do not cause flooding to building areas or exacerbate flooding elsewhere.

It is proposed final hardstanding levels will be designed to provide conveyance routes taking storm flows away from building areas and towards areas which are less sensitive to flooding. Exceedance event flow routes have been shown on the drainage layout contained in [Appendix I](#).

## 6.4 Surface Water Management & Maintenance

For any surface water drainage system to operate as originally designed, it is necessary to ensure that it is adequately maintained to ensure its continued performance throughout its design life.

It is proposed the SuDS features used within this development will be fully maintained and managed by a private management company.

**Table 3** and **Table 4** stipulate the proposed maintenance activities and frequencies the private management company would carry out over the lifetime of the development (as contractually obliged).

**Table 3: Operation and Maintenance Requirements for Pervious Pavements**

| Maintenance Schedule | Required Action                                                     | Typical Frequency                                                                                                                                                                                                                                                                   |
|----------------------|---------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Regular Maintenance  | Brushing and vacuuming (standard cosmetic sweep over whole surface) | Once a year, after autumn leaf fall, or reduced frequency as required, based on site-specific observations of clogging or manufacturer's recommendations – pay particular attention to areas where water runs onto pervious surface from adjacent impermeable areas as this area is |

|                        |                                                                                                                                                                                      |                                                                                                          |
|------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------|
|                        |                                                                                                                                                                                      | most likely to collect the most sediment                                                                 |
| Occasional Maintenance | Stabilise and mow contributing and adjacent areas                                                                                                                                    | As required                                                                                              |
|                        | Removal of weeds or management using glyphosphate applied directly into the weeds by an applicator rather than spraying                                                              | As required – once per year on less frequently used pavements                                            |
| Remedial Actions       | Remediate any landscaping which, through vegetation maintenance or soil slip, has been raised to within 50mm of the level of the paving                                              | As required                                                                                              |
|                        | Remedial work to any depressions, rutting and cracked or broken blocks considered detrimental to the structural performance or a hazard to users, and replace lost jointing material | As required                                                                                              |
|                        | Rehabilitation of surface and upper substructure by remedial sweeping                                                                                                                | Every 10 to 15 years or as required (if infiltration performance is reduced due to significant clogging) |
| Monitoring             | Initial inspection                                                                                                                                                                   | Monthly for three months after installation                                                              |
|                        | Inspect for evidence of poor operation and/or weed growth – if required, take remedial action                                                                                        | Three-monthly, 48 hours after large storms in first six months                                           |
|                        | Inspect silt accumulation rates and establish appropriate brushing frequencies                                                                                                       | Annually                                                                                                 |
|                        | Monitor inspection chambers                                                                                                                                                          | Annually                                                                                                 |

**Table 4: Operation and Maintenance Requirements for Attenuation Basin**

| <b>Maintenance Schedule</b> | <b>Required Action</b>                                                                                                                           | <b>Typical Frequency</b>              |
|-----------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------|
| Regular Maintenance         | Remove litter and debris                                                                                                                         | Monthly                               |
|                             | Cut the grass                                                                                                                                    | Monthly (during growing season)       |
|                             | Inspect marginal and bankside vegetation and remove nuisance plants (for first 3 years)                                                          | Monthly (at start then as required)   |
|                             | Inspect inlets, outlets, bankside, structures pipework etc for evidence of blockage and damage                                                   | Monthly                               |
|                             | Inspect water body for signs of poor water quality                                                                                               | Monthly                               |
|                             | Inspect silt accumulation rates in main body of pond. Undertake contamination testing once some build up has occurred to inform disposal options | Half yearly                           |
|                             | Hand cut submerged and emergent aquatic plants (at minimum of 0.1m above pond bas, include max 25% of pond surface)                              | Annually                              |
|                             | Remove 25% of bank vegetation from water edge to min of 1m above water level                                                                     | Annually                              |
|                             | Tidy all dead growth before start of growing season                                                                                              | Annually                              |
| Occasional Maintenance      | Remove sediment from the main body when pool volume is reduced by 20%                                                                            | Typically required every 20 -50 years |
| Remedial Actions            | Repair erosion or other damage                                                                                                                   | As required                           |
|                             | Replant where necessary                                                                                                                          | As required                           |
|                             | Aerate pond when signs of eutrophication are detected                                                                                            | As required                           |
|                             | Realign rip-rap or repair other damage                                                                                                           | As required                           |
|                             | Repair / rehabilitate inlets, outlets and overflows                                                                                              | As required                           |

## 7 Proposed Foul Water Drainage

It is proposed all foul water flows from development proposals will gravitate to the existing Anglian Water foul water drainage system to manhole ref 3401 located around 150m south of the development site.

As of OFWOT guidance (April 2018), a right to connect to the public foul sewer exists and will be agreed via a S106 agreement with Anglian Water as part of detailed design.

At this time however a pre-development enquiry has been submitted to Anglian Water to notify them of development proposals and to verify capacity within the existing sewer. Anglian Waters response confirms capacity exists within their existing combined sewer for proposed foul water flows.

Anglian Waters Predevelopment response is shown in [Appendix K](#).

The total foul water flow rate from the proposed development proposals can be calculated based on guidance given within Design and Construction Guidance (DCG).

Design and Construction Guidance (Appendix C B3.1) assumes a flow rate of 4000 litres per dwelling per day (l/d/d) for residential dwellings.

Based on a total of 41no. dwellings and over a 24-hour period the following foul water flow rates can be calculated;

- DWF Flow rate =  $(41 \times 4000) / 86,400 = 1.90 \text{ l/s}$
- Peak flow rate (assuming a peak factor of 6) =  $1.90 \times 6 = 11.40 \text{ l/s}$

It is recommended detailed design drawings are provided to Anglian Water in due course as part of a S106 application to formally agree the sewerage connections.

## 8 Conclusion

Civilistix Consulting Engineers has been commissioned by Minister Property Group to prepare a Combined Flood Risk Assessment (FRA) and Drainage Strategy to support a planning application for a proposed residential development consisting of 37 residential plots, 4 self-build plots and associated infrastructure at Land off Surfleet Road, Pinchbeck (PE11 3XY).

A summary of flood risk from each type of flooding source before and after flood mitigation measures are incorporated are shown below;

| Type of Flooding       | Existing Risk Category | Proposed Risk Category |
|------------------------|------------------------|------------------------|
| Fluvial flooding       | High Risk              | Low/Medium Risk        |
| Surface Water flooding | Very Low Risk          | Very Low Risk          |
| Groundwater flooding   | Medium Risk            | Low Risk               |
| Artificial flooding    | Very Low Risk          | Very Low Risk          |
| Reservoir flooding     | Very Low Risk          | Very Low Risk          |

To reduce fluvial and groundwater flooding, it is proposed the following mitigation measures are implemented;

- Ensure proposed finished floor levels are raised 0.30m above the 100-year+40% climate change AEP flood level
- Preparation of an onsite SuDS Drainage Strategy
- Ensure an emergency flood plan and safe access and escape routes are in place across the lifetime of the development


The drainage strategy identifies how a proposed surface and foul water drainage regime can be accommodated in full accordance with Local and National best practice drainage guidance, specifically demonstrating how;

- Existing runoff rate and volume are not exceeded
- Suitable maintenance measures are in place over the drainage systems design life
- Exceedance storm events can be satisfactorily mitigated

This report makes the following key conclusions;

- The use of infiltration to dispose of surface water is not possible due to high groundwater. Discharge of surface water is therefore proposed to the existing watercourse to the south-east of the site
- It is proposed the site discharges at the 1:1 year greenfield runoff rate (equivalent to 1.4l/s) for all storm events up to and including the 100 year plus 40% climate change event
- All foul water will be conveyed offsite by gravity to Anglian Water (AW) manhole (ref 3401) around 150m south of the site, agreed with AW as part of a predevelopment enquiry

## **Appendix A – Site Location Plan**

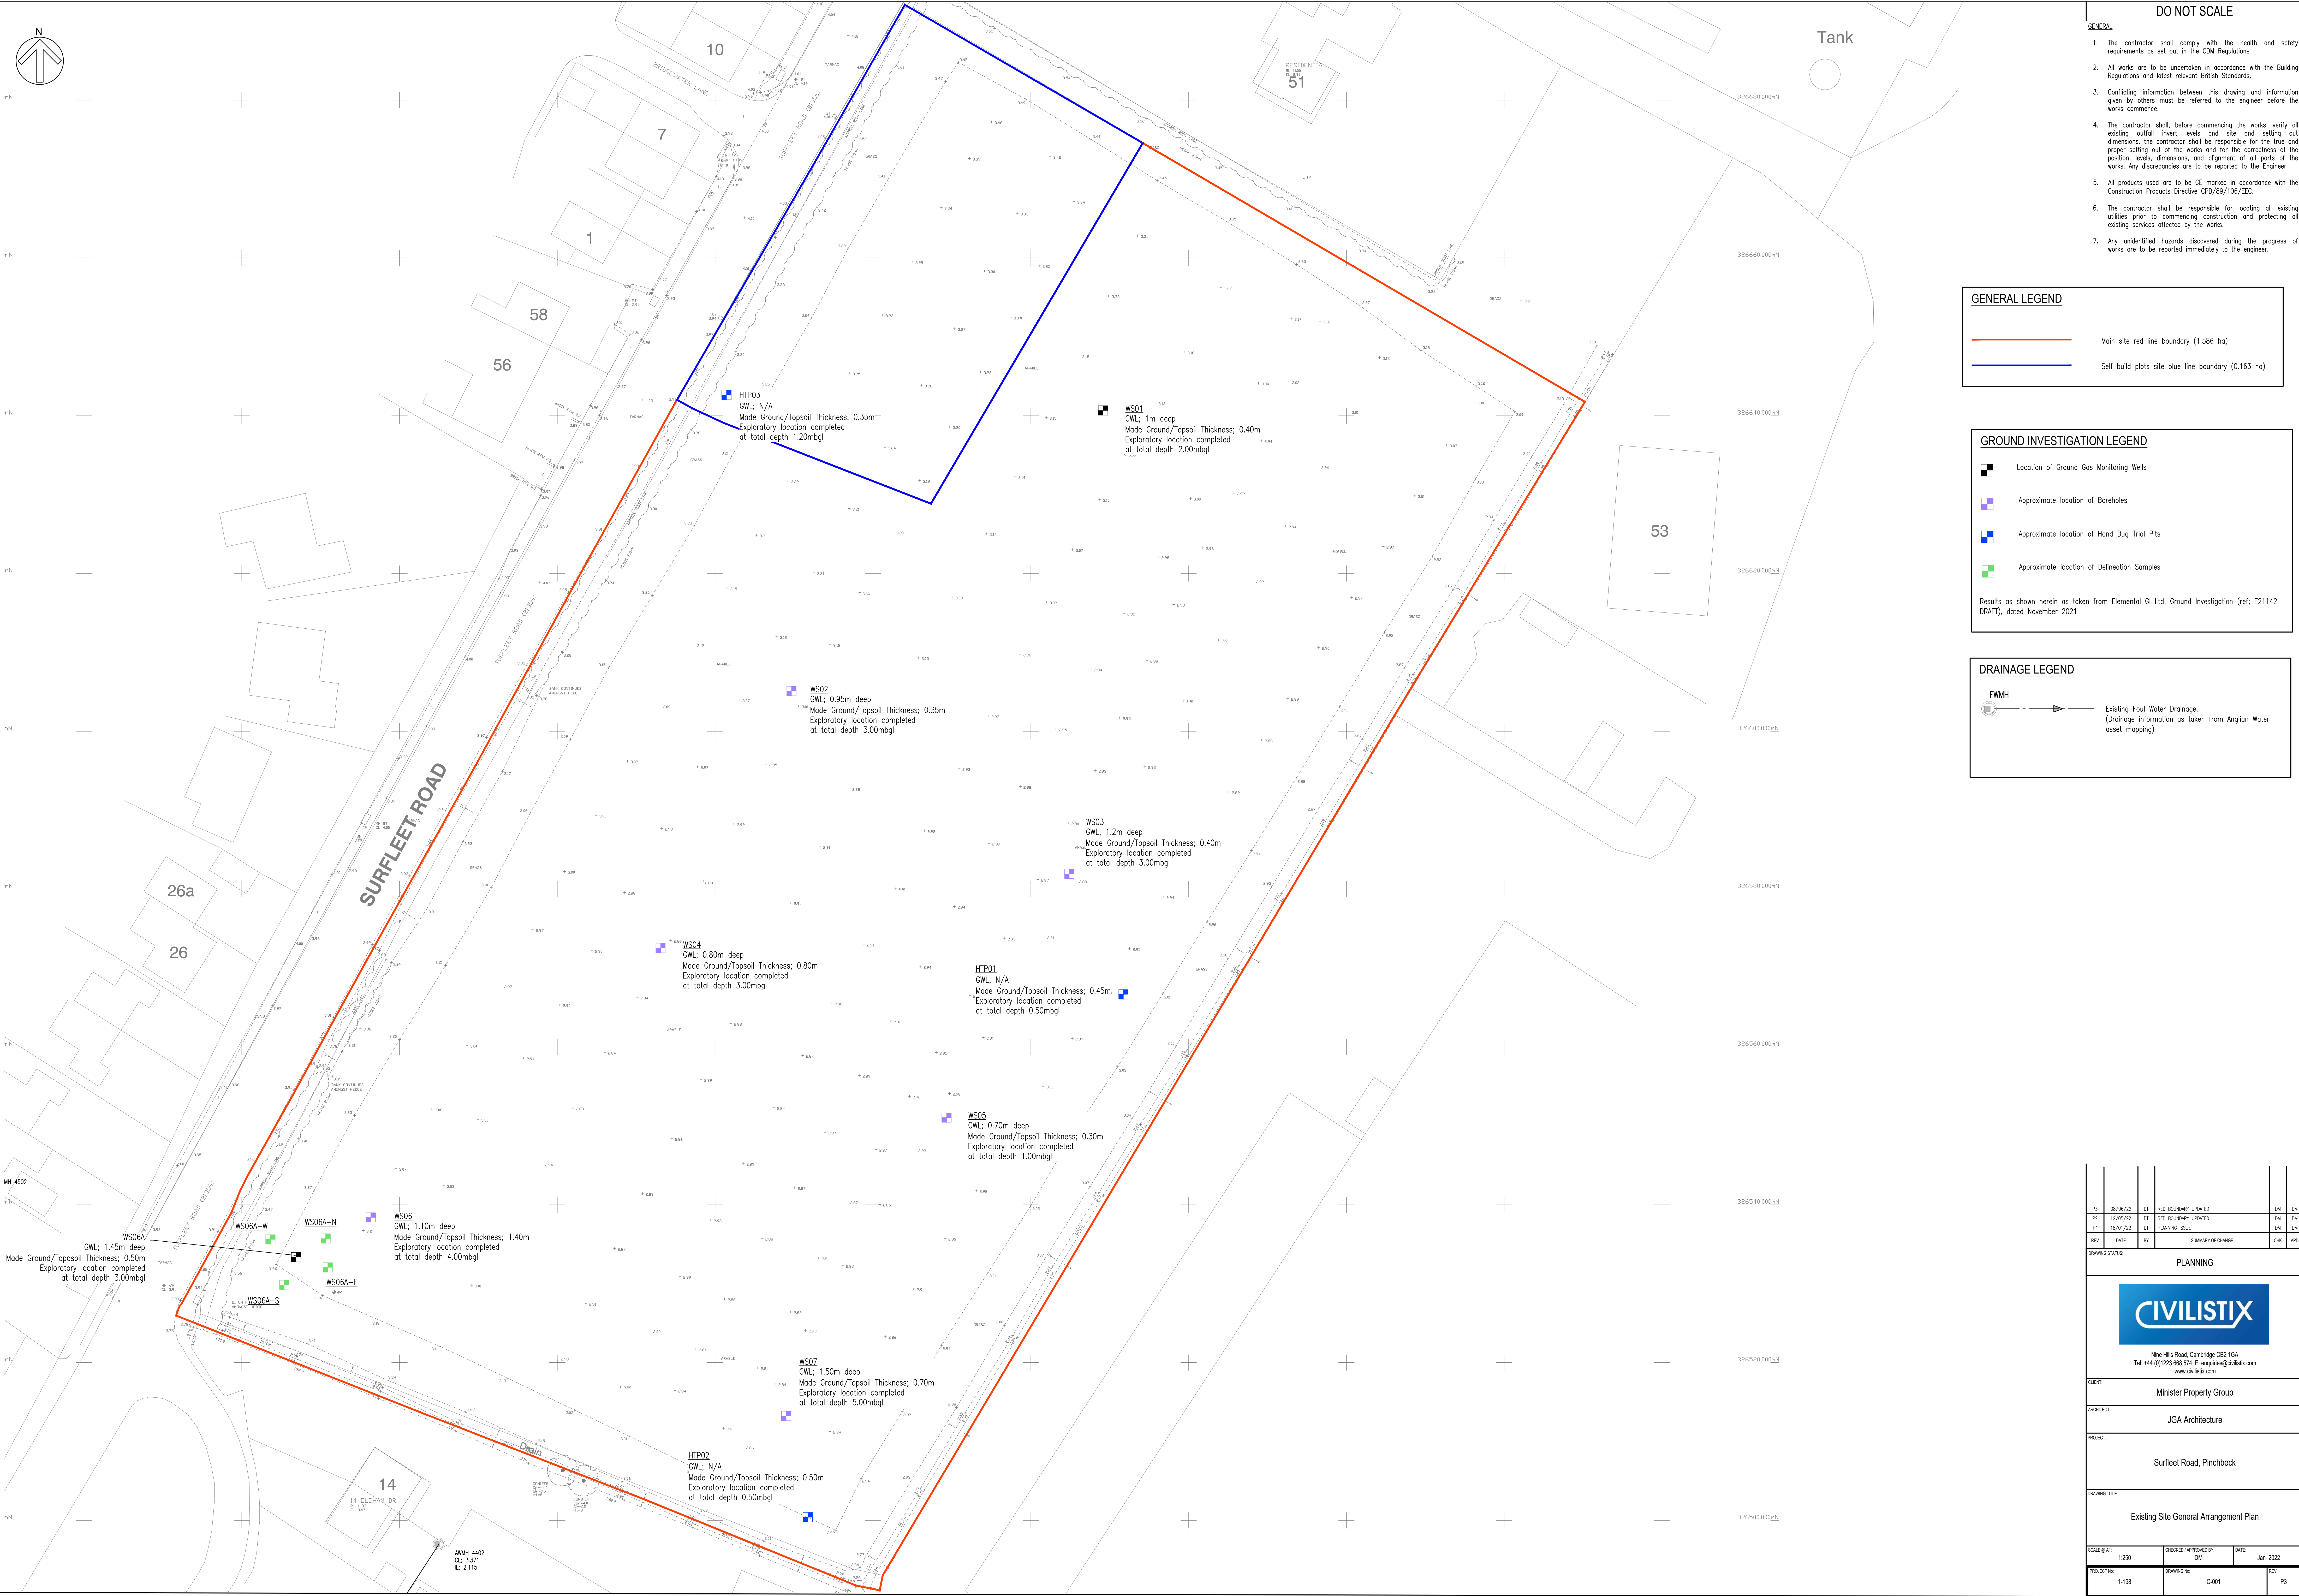

- GENERAL**
- The contractor shall comply with the health and safety requirements as set out in the CDM Regulations
  - All works are to be undertaken in accordance with the Building Regulations and latest relevant British Standards.
  - Conflicting information between this drawing and information given by others must be referred to the engineer before the works commence.
  - The contractor shall, before commencing the works, verify all existing outfall invert levels and site and setting out dimensions. The contractor shall be responsible for the true and proper setting out of the works and for the correctness of the position, levels, dimensions, and alignment of all parts of the works. Any discrepancies are to be reported to the Engineer
  - All products used are to be CE marked in accordance with the Construction Products Directive CPO/89/106/EEC.
  - The contractor shall be responsible for locating all existing utilities prior to commencing construction and protecting all existing services affected by the works.
  - Any unidentified hazards discovered during the progress of works are to be reported immediately to the engineer.

**GENERAL LEGEND**

- Main site red line boundary (1.586 ha)
- Self build plots site blue line boundary (0.163 ha)

**GROUND INVESTIGATION LEGEND**

- Location of Ground Gas Monitoring Wells
- Approximate location of Boreholes
- Approximate location of Hand Dug Trial Pits
- Approximate location of Delineation Samples


Results as shown herein are taken from Elemental GI Ltd, Ground Investigation (ref: E21142 DRAFT), dated November 2021

**DRAINAGE LEGEND**

- FWMH
- Existing Foul Water Drainage. (Drainage information as taken from Anglian Water asset mapping)

|                                                                                                                  |          |    |                      |     |     |
|------------------------------------------------------------------------------------------------------------------|----------|----|----------------------|-----|-----|
|                                                                                                                  |          |    |                      |     |     |
| P3                                                                                                               | 08/06/22 | DT | RED BOUNDARY UPDATED | DM  | DM  |
| P2                                                                                                               | 12/05/22 | DT | RED BOUNDARY UPDATED | DM  | DM  |
| P1                                                                                                               | 18/05/22 | DT | PLANNING ISSUE       | DM  | DM  |
| REV                                                                                                              | DATE     | BY | SUMMARY OF CHANGE    | CHK | APP |
| DRAWING STATUS:                                                                                                  |          |    |                      |     |     |
| PLANNING                                                                                                         |          |    |                      |     |     |
|                                                                                                                  |          |    |                      |     |     |
| Nine Hills Road, Cambridge CB2 1GA<br>Tel: +44 (0)1223 668 574 E: enquiries@civilistix.com<br>www.civilistix.com |          |    |                      |     |     |
| CLIENT: Minister Property Group                                                                                  |          |    |                      |     |     |
| ARCHITECT: JGA Architecture                                                                                      |          |    |                      |     |     |
| PROJECT: Surfleet Road, Pinchbeck                                                                                |          |    |                      |     |     |
| DRAWING TITLE: Existing Site General Arrangement Plan                                                            |          |    |                      |     |     |
| SCALE @ A1: 1:250 CHECKED/ APPROVED BY: DM DATE: Jan 2022                                                        |          |    |                      |     |     |
| PROJECT No: 1-198 DRAWING No: C-001 REV: P3                                                                      |          |    |                      |     |     |

## **Appendix B – Existing Anglian Water Asset Mapping**

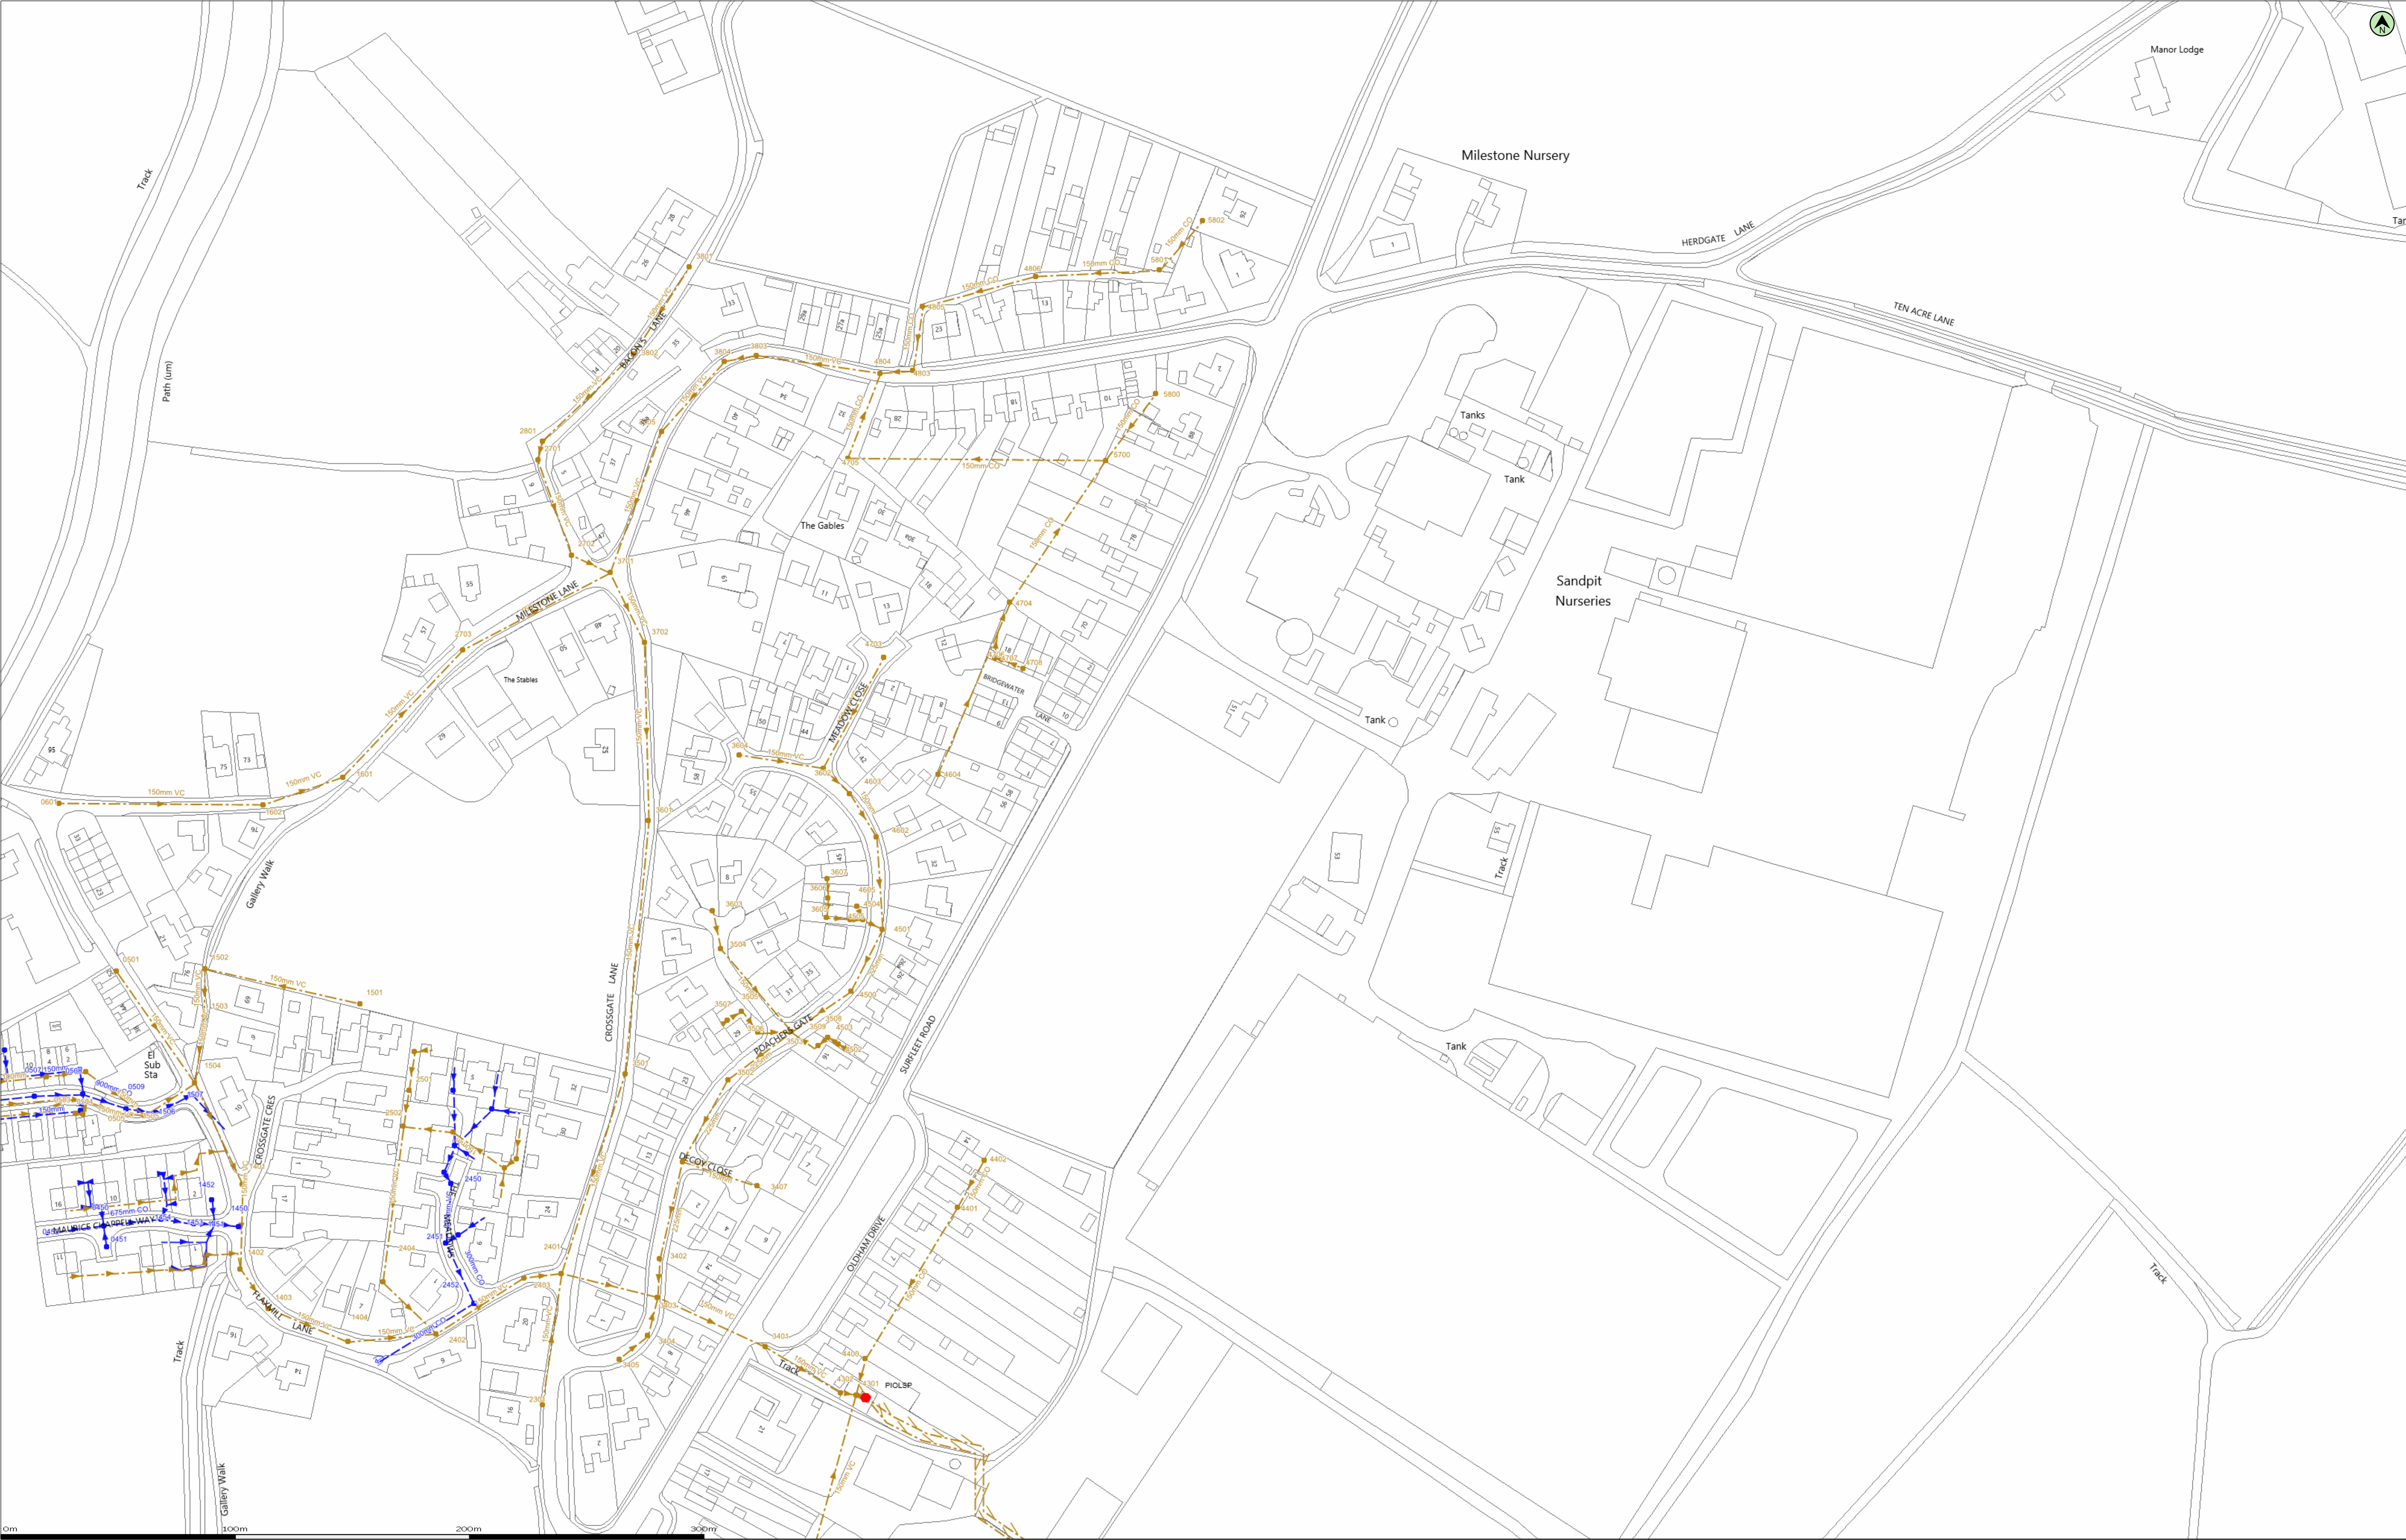

(c) Crown copyright and database rights 2021 Ordnance Survey 100022432

Date: 03/12/21

Scale: 1:1250

Map Centre: 524559.326664

Data updated: 30/11/21

Our Ref: 728922 - 1

Wastewater Plan A1

This plan is provided by Anglian Water pursuant to its obligations under the Water Industry Act 1991 sections 198 or 199. It must be used in conjunction with any search results attached. The information on this plan is based on data currently recorded but position must be regarded as approximate. Service pipes, private sewers and drains are generally not shown. Users of this map are strongly advised to commission their own survey of the area shown on the plan before carrying out any works. The actual position of all apparatus MUST be established by trial holes. No liability whatsoever, including liability for negligence, is accepted by Anglian Water for any error or inaccuracy or omission, including the failure to accurately record, or record at all, the location of any water main, discharge pipe, sewer or disposal main or any item of apparatus. This information is valid for the date printed. This plan is produced by Anglian Water Services Limited (c) Crown copyright and database rights 2021 Ordnance Survey 100022432. This map is to be used for the purposes of viewing the location of Anglian Water plant only. Any other users of the map data or further copies is not permitted. This notice is not intended to exclude or restrict liability for death or personal injury resulting from negligence.

|                       |           |          |
|-----------------------|-----------|----------|
| Foul Sewer            | — — — — — | Outfall* |
| Surface Sewer         | — — — — — |          |
| Combined Sewer        | — — — — — |          |
| Final Effluent        | — — — — — | Inlet*   |
| Rising Main*          | — — — — — |          |
| Private Sewer*        | — — — — — | Manhole* |
| Decommissioned Sewer* | — — — — — |          |

- Sewage Treatment Works
- Public Pumping Station
- Decommissioned Pumping Station

(Colour denotes effluent type)


enquiries@civilstx.com

1-190 - Surfleet





## **Appendix C – Topographical Survey**

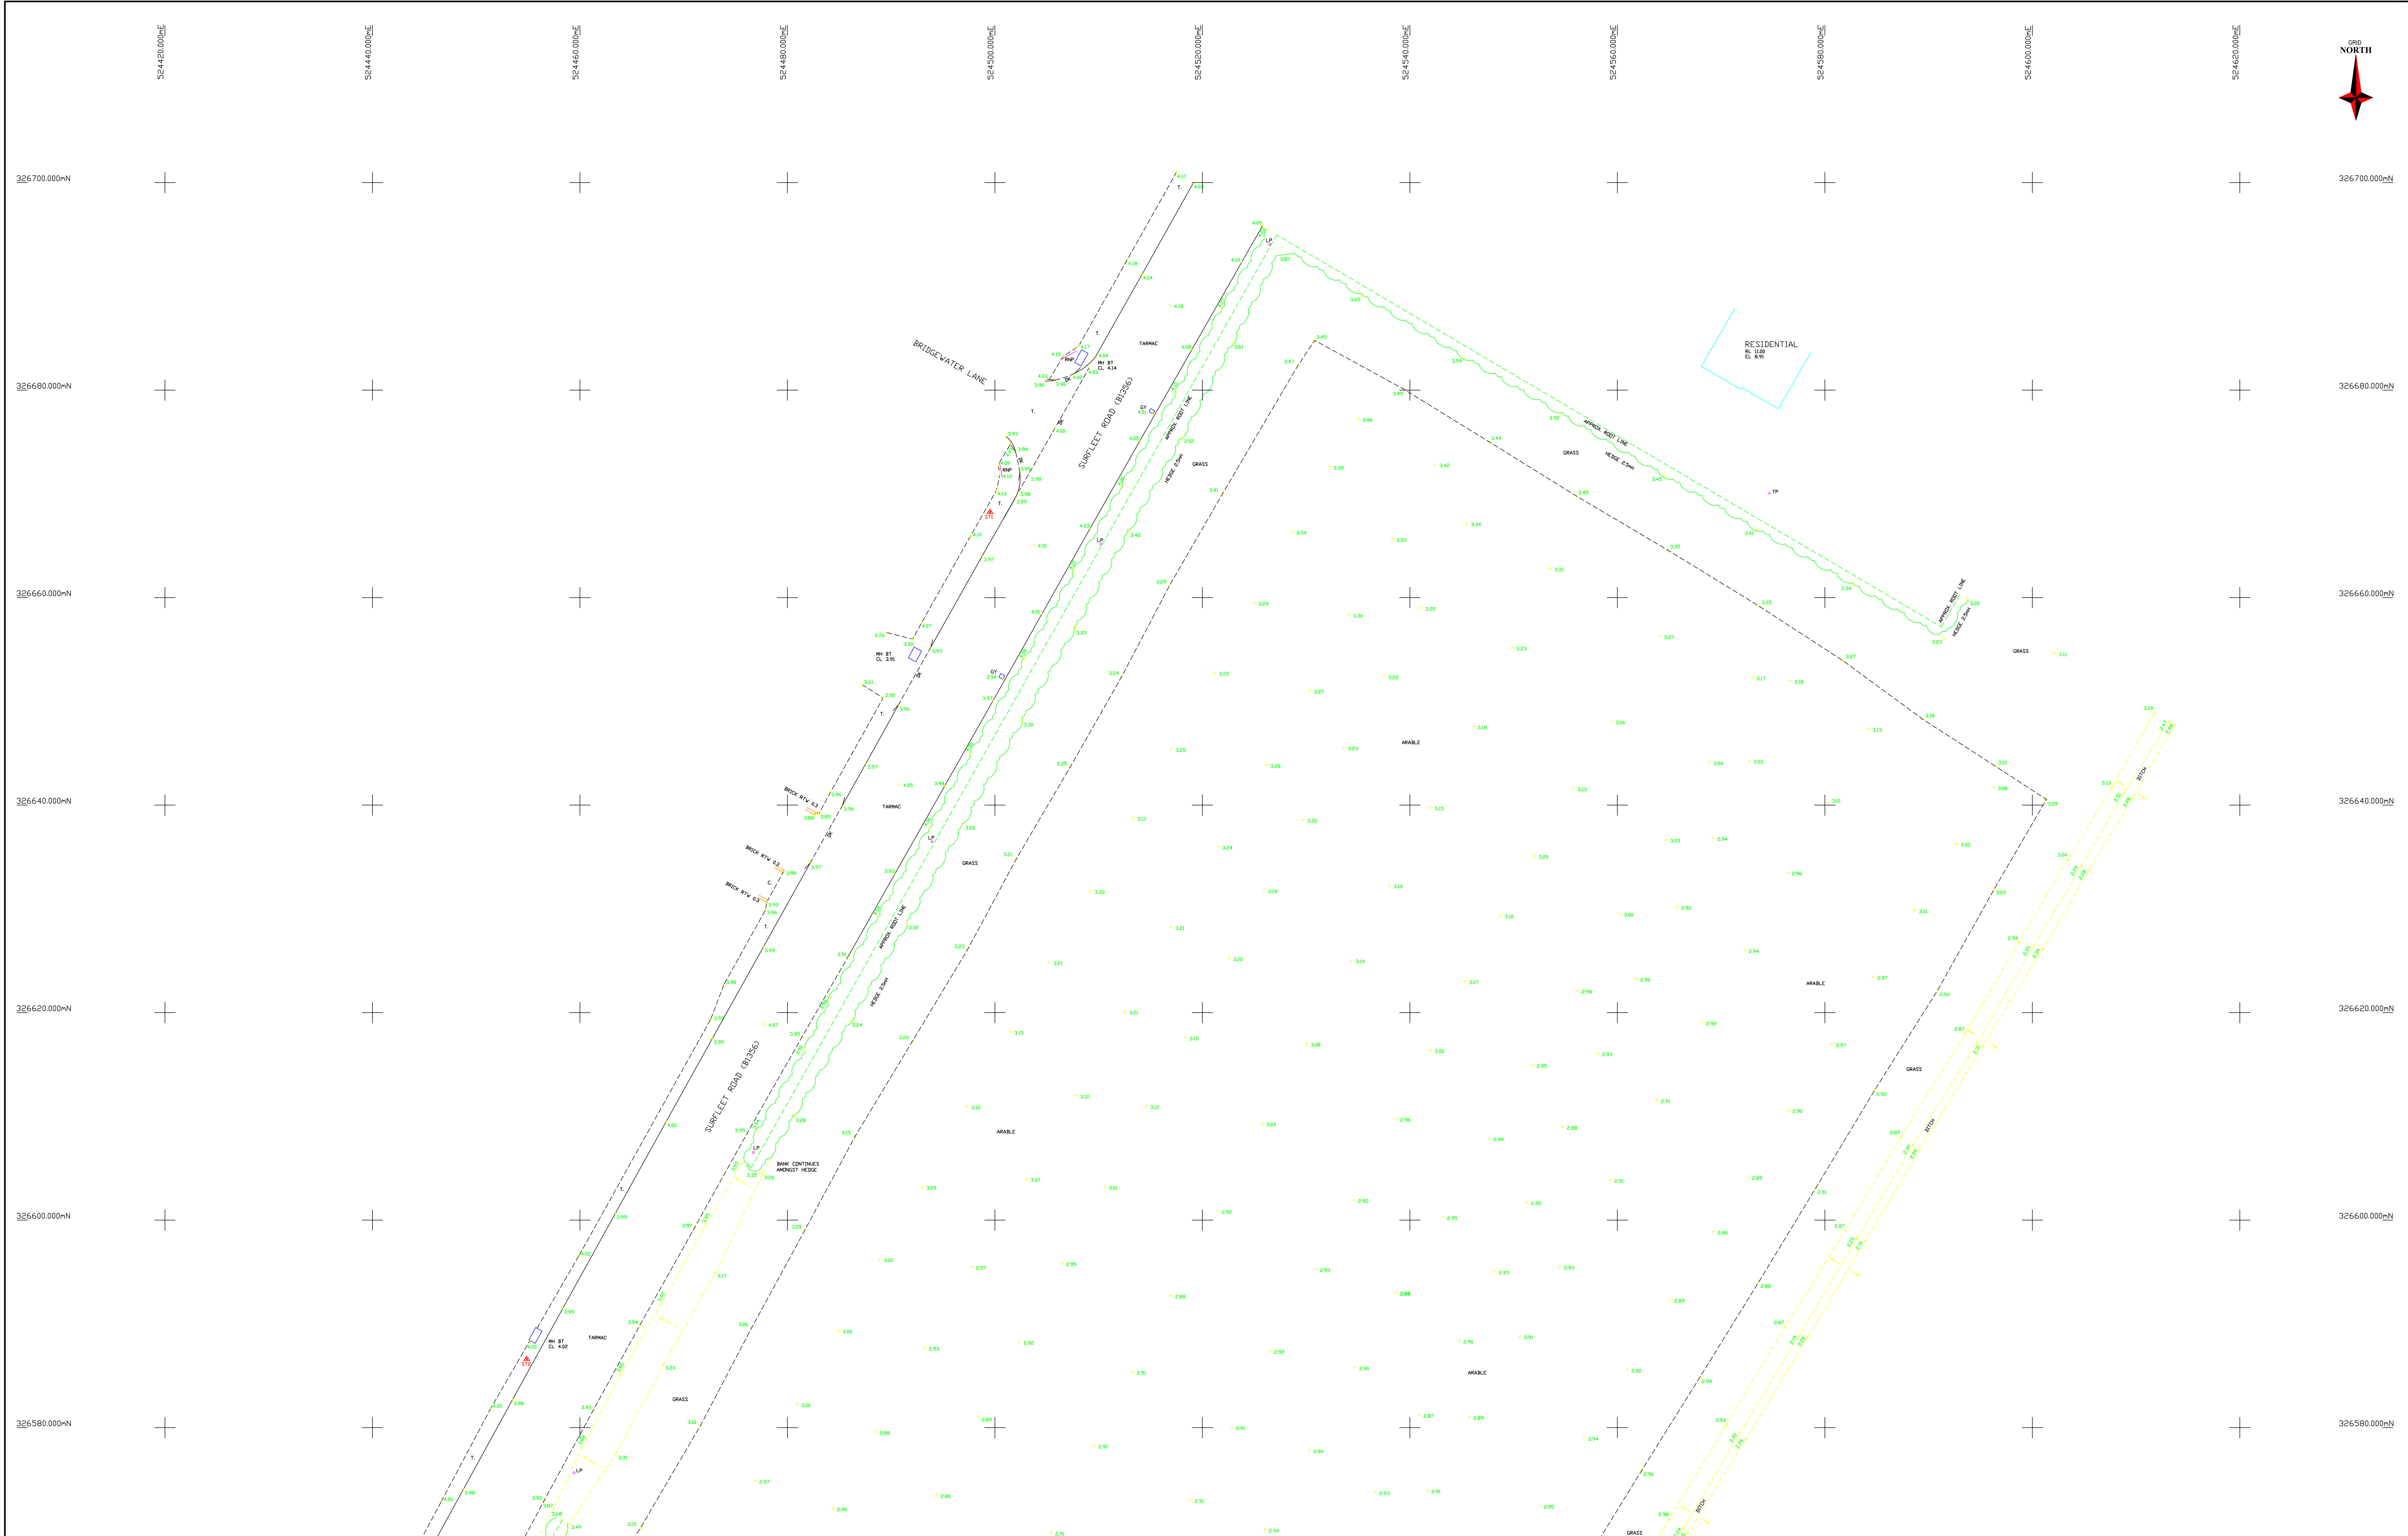

**EMP Drainage Ltd**

Company details:  
 Address: 25 High Street, Springfield, Ipswich, IP9 3AF  
 Email: info@empdrainage.co.uk or g.p@empdrainage.co.uk  
 Contact No: 01473 774 720 or 01793 880 841

**NOTES:**

The accuracy and content of this drawing are dependent on the original specification and drawings provided and should be consulted before use at other sites.

All other underground services are shown, at reasonable care, from taken within the limits of the specification and requirements. Before use of this information the user should satisfy themselves of the completeness and accuracy of such details and consult EMP before undertaking any works. Due to the nature of the work and the fact that the drawings are a general illustration only, the drawings are not guaranteed to be given that all services have been recorded. All drawings are of a standard of accuracy that is acceptable for the purposes of the specification and requirements.

Our aim is to produce the best possible results within the specification and cost constraints of our clients. All responsible care has been taken in the survey and all information on this drawing, any discrepancies must be reported immediately to EMP and any other contractors are most welcome to advise on any errors or omissions.

**DISCLAIMER:** All towns and coordinates are related to the datum described.

The horizontal and vertical control of this survey is based on the Ordnance Survey National Grid and level datum is Newlyn Mean Sea Level.

We have applied no revenue scale factor to this survey.

**Legend**

**Services**

1. Sewer  
2. Stormwater  
3. Gas  
4. Electric  
5. Water  
6. Cable  
7. Drain  
8. Drain  
9. Drain  
10. Drain  
11. Drain  
12. Drain  
13. Drain  
14. Drain  
15. Drain  
16. Drain  
17. Drain  
18. Drain  
19. Drain  
20. Drain  
21. Drain  
22. Drain  
23. Drain  
24. Drain  
25. Drain  
26. Drain  
27. Drain  
28. Drain  
29. Drain  
30. Drain  
31. Drain  
32. Drain  
33. Drain  
34. Drain  
35. Drain  
36. Drain  
37. Drain  
38. Drain  
39. Drain  
40. Drain  
41. Drain  
42. Drain  
43. Drain  
44. Drain  
45. Drain  
46. Drain  
47. Drain  
48. Drain  
49. Drain  
50. Drain  
51. Drain  
52. Drain  
53. Drain  
54. Drain  
55. Drain  
56. Drain  
57. Drain  
58. Drain  
59. Drain  
60. Drain  
61. Drain  
62. Drain  
63. Drain  
64. Drain  
65. Drain  
66. Drain  
67. Drain  
68. Drain  
69. Drain  
70. Drain  
71. Drain  
72. Drain  
73. Drain  
74. Drain  
75. Drain  
76. Drain  
77. Drain  
78. Drain  
79. Drain  
80. Drain  
81. Drain  
82. Drain  
83. Drain  
84. Drain  
85. Drain  
86. Drain  
87. Drain  
88. Drain  
89. Drain  
90. Drain  
91. Drain  
92. Drain  
93. Drain  
94. Drain  
95. Drain  
96. Drain  
97. Drain  
98. Drain  
99. Drain  
100. Drain

**Surfaces & Features**

1. Pavement  
2. Grass  
3. Road  
4. Path  
5. Fence  
6. Wall  
7. Gate  
8. Drain  
9. Drain  
10. Drain  
11. Drain  
12. Drain  
13. Drain  
14. Drain  
15. Drain  
16. Drain  
17. Drain  
18. Drain  
19. Drain  
20. Drain  
21. Drain  
22. Drain  
23. Drain  
24. Drain  
25. Drain  
26. Drain  
27. Drain  
28. Drain  
29. Drain  
30. Drain  
31. Drain  
32. Drain  
33. Drain  
34. Drain  
35. Drain  
36. Drain  
37. Drain  
38. Drain  
39. Drain  
40. Drain  
41. Drain  
42. Drain  
43. Drain  
44. Drain  
45. Drain  
46. Drain  
47. Drain  
48. Drain  
49. Drain  
50. Drain  
51. Drain  
52. Drain  
53. Drain  
54. Drain  
55. Drain  
56. Drain  
57. Drain  
58. Drain  
59. Drain  
60. Drain  
61. Drain  
62. Drain  
63. Drain  
64. Drain  
65. Drain  
66. Drain  
67. Drain  
68. Drain  
69. Drain  
70. Drain  
71. Drain  
72. Drain  
73. Drain  
74. Drain  
75. Drain  
76. Drain  
77. Drain  
78. Drain  
79. Drain  
80. Drain  
81. Drain  
82. Drain  
83. Drain  
84. Drain  
85. Drain  
86. Drain  
87. Drain  
88. Drain  
89. Drain  
90. Drain  
91. Drain  
92. Drain  
93. Drain  
94. Drain  
95. Drain  
96. Drain  
97. Drain  
98. Drain  
99. Drain  
100. Drain

**Boundaries**

1. Boundary  
2. Boundary  
3. Boundary  
4. Boundary  
5. Boundary  
6. Boundary  
7. Boundary  
8. Boundary  
9. Boundary  
10. Boundary  
11. Boundary  
12. Boundary  
13. Boundary  
14. Boundary  
15. Boundary  
16. Boundary  
17. Boundary  
18. Boundary  
19. Boundary  
20. Boundary  
21. Boundary  
22. Boundary  
23. Boundary  
24. Boundary  
25. Boundary  
26. Boundary  
27. Boundary  
28. Boundary  
29. Boundary  
30. Boundary  
31. Boundary  
32. Boundary  
33. Boundary  
34. Boundary  
35. Boundary  
36. Boundary  
37. Boundary  
38. Boundary  
39. Boundary  
40. Boundary  
41. Boundary  
42. Boundary  
43. Boundary  
44. Boundary  
45. Boundary  
46. Boundary  
47. Boundary  
48. Boundary  
49. Boundary  
50. Boundary  
51. Boundary  
52. Boundary  
53. Boundary  
54. Boundary  
55. Boundary  
56. Boundary  
57. Boundary  
58. Boundary  
59. Boundary  
60. Boundary  
61. Boundary  
62. Boundary  
63. Boundary  
64. Boundary  
65. Boundary  
66. Boundary  
67. Boundary  
68. Boundary  
69. Boundary  
70. Boundary  
71. Boundary  
72. Boundary  
73. Boundary  
74. Boundary  
75. Boundary  
76. Boundary  
77. Boundary  
78. Boundary  
79. Boundary  
80. Boundary  
81. Boundary  
82. Boundary  
83. Boundary  
84. Boundary  
85. Boundary  
86. Boundary  
87. Boundary  
88. Boundary  
89. Boundary  
90. Boundary  
91. Boundary  
92. Boundary  
93. Boundary  
94. Boundary  
95. Boundary  
96. Boundary  
97. Boundary  
98. Boundary  
99. Boundary  
100. Boundary

**Services**

1. Sewer  
2. Stormwater  
3. Gas  
4. Electric  
5. Water  
6. Cable  
7. Drain  
8. Drain  
9. Drain  
10. Drain  
11. Drain  
12. Drain  
13. Drain  
14. Drain  
15. Drain  
16. Drain  
17. Drain  
18. Drain  
19. Drain  
20. Drain  
21. Drain  
22. Drain  
23. Drain  
24. Drain  
25. Drain  
26. Drain  
27. Drain  
28. Drain  
29. Drain  
30. Drain  
31. Drain  
32. Drain  
33. Drain  
34. Drain  
35. Drain  
36. Drain  
37. Drain  
38. Drain  
39. Drain  
40. Drain  
41. Drain  
42. Drain  
43. Drain  
44. Drain  
45. Drain  
46. Drain  
47. Drain  
48. Drain  
49. Drain  
50. Drain  
51. Drain  
52. Drain  
53. Drain  
54. Drain  
55. Drain  
56. Drain  
57. Drain  
58. Drain  
59. Drain  
60. Drain  
61. Drain  
62. Drain  
63. Drain  
64. Drain  
65. Drain  
66. Drain  
67. Drain  
68. Drain  
69. Drain  
70. Drain  
71. Drain  
72. Drain  
73. Drain  
74. Drain  
75. Drain  
76. Drain  
77. Drain  
78. Drain  
79. Drain  
80. Drain  
81. Drain  
82. Drain  
83. Drain  
84. Drain  
85. Drain  
86. Drain  
87. Drain  
88. Drain  
89. Drain  
90. Drain  
91. Drain  
92. Drain  
93. Drain  
94. Drain  
95. Drain  
96. Drain  
97. Drain  
98. Drain  
99. Drain  
100. Drain


**Survey Station**

1. Survey Station  
2. Survey Station  
3. Survey Station  
4. Survey Station  
5. Survey Station  
6. Survey Station  
7. Survey Station  
8. Survey Station  
9. Survey Station  
10. Survey Station  
11. Survey Station  
12. Survey Station  
13. Survey Station  
14. Survey Station  
15. Survey Station  
16. Survey Station  
17. Survey Station  
18. Survey Station  
19. Survey Station  
20. Survey Station  
21. Survey Station  
22. Survey Station  
23. Survey Station  
24. Survey Station  
25. Survey Station  
26. Survey Station  
27. Survey Station  
28. Survey Station  
29. Survey Station  
30. Survey Station  
31. Survey Station  
32. Survey Station  
33. Survey Station  
34. Survey Station  
35. Survey Station  
36. Survey Station  
37. Survey Station  
38. Survey Station  
39. Survey Station  
40. Survey Station  
41. Survey Station  
42. Survey Station  
43. Survey Station  
44. Survey Station  
45. Survey Station  
46. Survey Station  
47. Survey Station  
48. Survey Station  
49. Survey Station  
50. Survey Station  
51. Survey Station  
52. Survey Station  
53. Survey Station  
54. Survey Station  
55. Survey Station  
56. Survey Station  
57. Survey Station  
58. Survey Station  
59. Survey Station  
60. Survey Station  
61. Survey Station  
62. Survey Station  
63. Survey Station  
64. Survey Station  
65. Survey Station  
66. Survey Station  
67. Survey Station  
68. Survey Station  
69. Survey Station  
70. Survey Station  
71. Survey Station  
72. Survey Station  
73. Survey Station  
74. Survey Station  
75. Survey Station  
76. Survey Station  
77. Survey Station  
78. Survey Station  
79. Survey Station  
80. Survey Station  
81. Survey Station  
82. Survey Station  
83. Survey Station  
84. Survey Station  
85. Survey Station  
86. Survey Station  
87. Survey Station  
88. Survey Station  
89. Survey Station  
90. Survey Station  
91. Survey Station  
92. Survey Station



## **Appendix D –Site Investigation Boreholes**

- NOTES:
-  Approx. Site Boundary
  -  Approx. Location of Boreholes
  -  Approx. Location of Ground Gas Monitoring Wells
  -  Approx. Location of Hand Dug Trial Pits
  -  Approx. Location of Delineation Samples

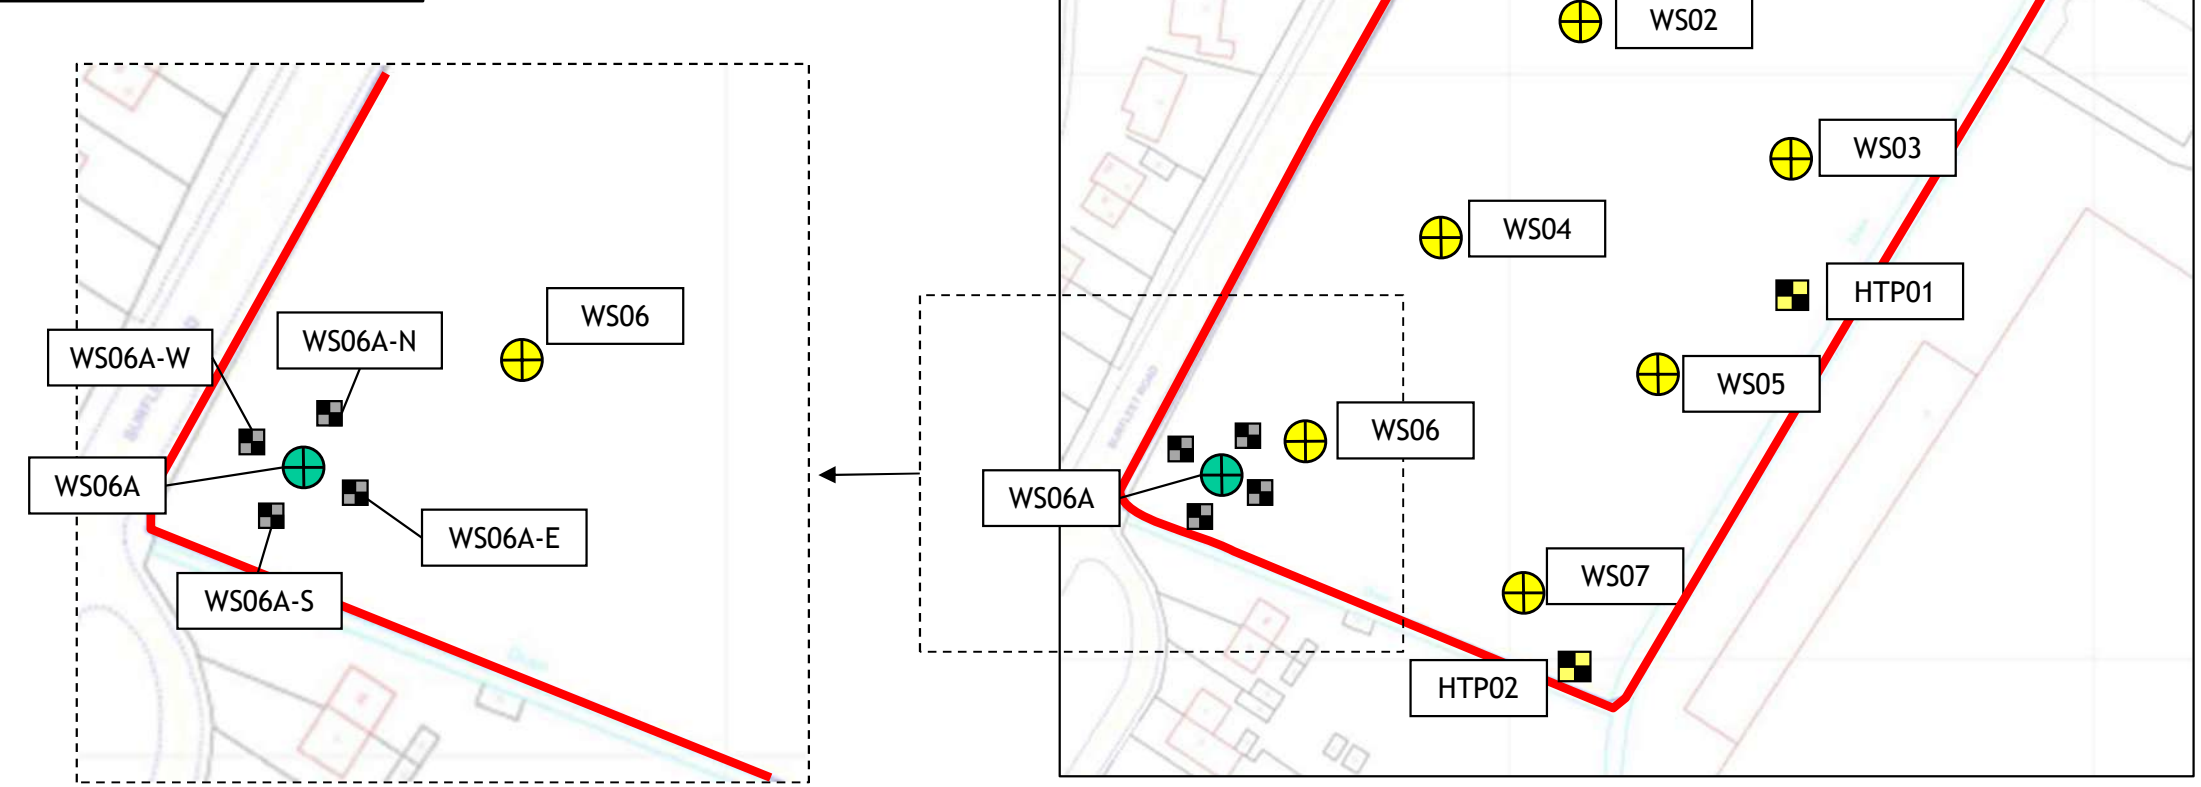

|                                                                                                                                                                                                                             |                                   |                 |                          |                                                                                                                                         |                 |      |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|-----------------|--------------------------|-----------------------------------------------------------------------------------------------------------------------------------------|-----------------|------|
| Site:                                                                                                                                                                                                                       | Site off Surfleet Road, Pinchbeck |                 |                          | <div> <div>Elemental</div> <div>GI Ltd</div> </div>                                                                                     |                 |      |
| Client:                                                                                                                                                                                                                     | Minster Property Group            |                 |                          |                                                                                                                                         |                 |      |
| Contractor: RP Drilling                                                                                                                                                                                                     |                                   |                 | Project No: E21142 DRAFT | Sheet: 1 of 1                                                                                                                           | <div>WS01</div> |      |
| Equipment: Window Sampler Drilling Rig                                                                                                                                                                                      |                                   |                 | Logged by: JR            | Date: 12th November 2021                                                                                                                |                 |      |
| Field Monitoring and Sampling                                                                                                                                                                                               |                                   |                 | Strata                   |                                                                                                                                         | Legend          | Well |
| Depth<br>(m)                                                                                                                                                                                                                | Type                              | Result<br>(SPT) | Depth<br>(m)             | Description                                                                                                                             |                 |      |
| 0.50                                                                                                                                                                                                                        | B                                 | N = 7           | 0.40                     | TOPSOIL comprising vegetation over brown silty sand with occasional rootlets.                                                           |                 |      |
| 1.00                                                                                                                                                                                                                        | JT                                |                 | 0.95                     | Soft to firm brown sandy CLAY/SILT.<br>... becoming very sandy from 0.75m depth.                                                        |                 |      |
|                                                                                                                                                                                                                             |                                   | N = 3           | 2.00                     | Loose brown very silty SAND.<br>... with rare black inclusions noted from 1.20m depth.<br><br>... becoming very loose from 1.40m depth. |                 |      |
|                                                                                                                                                                                                                             |                                   |                 |                          | Exploratory location completed at 2.00m depth.                                                                                          |                 |      |
|                                                                                                                                                                                                                             |                                   |                 | 3m                       |                                                                                                                                         |                 |      |
|                                                                                                                                                                                                                             |                                   |                 | 4m                       |                                                                                                                                         |                 |      |
|                                                                                                                                                                                                                             |                                   |                 | 5m                       |                                                                                                                                         |                 |      |
| Water Observations:<br>Water encountered from 1.00m depth during drilling. Water encountered from 0.90m depth 20mins after drilling.                                                                                        |                                   |                 |                          |                                                                                                                                         |                 |      |
| Remarks:<br>1) Borehole completed as a monitoring well.                                                                                                                                                                     |                                   |                 |                          |                                                                                                                                         |                 |      |
| Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)<br>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm <sup>2</sup> ) |                                   |                 |                          |                                                                                                                                         |                 |      |

|                                                                                                                                                                                                                             |                                   |                 |                          |                                                                                                                                                               |                          |        |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|-----------------|--------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|--------|
| Site:                                                                                                                                                                                                                       | Site off Surfleet Road, Pinchbeck |                 |                          | <div>Elemental GI Ltd</div>                                                                                                                                   |                          |        |
| Client:                                                                                                                                                                                                                     | Minster Property Group            |                 |                          |                                                                                                                                                               |                          |        |
| Contractor: RP Drilling                                                                                                                                                                                                     |                                   |                 | Project No: E21142 DRAFT |                                                                                                                                                               | Sheet: 1 of 1            | WS02   |
| Equipment: Window Sampler Drilling Rig                                                                                                                                                                                      |                                   |                 | Logged by: JR            |                                                                                                                                                               | Date: 12th November 2021 |        |
| Field Monitoring and Sampling                                                                                                                                                                                               |                                   |                 | Strata                   |                                                                                                                                                               |                          | Legend |
| Depth<br>(m)                                                                                                                                                                                                                | Type                              | Result<br>(SPT) | Depth<br>(m)             | Description                                                                                                                                                   |                          |        |
| 0.50                                                                                                                                                                                                                        | JT                                | N = 9           | 0.35                     | TOPSOIL comprising vegetation over brown silty sand with occasional rootlets.                                                                                 |                          |        |
|                                                                                                                                                                                                                             |                                   |                 | 1m                       | Soft brown and orangish brown mottled very sandy SILT.<br>... becoming soft to firm from 1.00m depth.<br><br>... becoming soft to very soft from 1.40m depth. |                          |        |
| 2.50                                                                                                                                                                                                                        | B                                 | N = 4           | 2m                       | ... becoming grey from 1.95m depth.                                                                                                                           |                          |        |
|                                                                                                                                                                                                                             |                                   |                 | 3.00                     | ... becoming soft to firm from 2.80m depth.                                                                                                                   |                          |        |
|                                                                                                                                                                                                                             |                                   | N = 11          | 4m                       | Exploratory location completed at 3.00m depth.                                                                                                                |                          |        |
|                                                                                                                                                                                                                             |                                   |                 | 5m                       |                                                                                                                                                               |                          |        |
| Water Observations:<br>Water encountered from 0.95m depth during drilling. Water encountered from 0.95m depth 20mins after drilling.                                                                                        |                                   |                 |                          |                                                                                                                                                               |                          |        |
| Remarks:<br>1) Borehole terminated on completion of testing at 3.00m depth.                                                                                                                                                 |                                   |                 |                          |                                                                                                                                                               |                          |        |
| Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)<br>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm <sup>2</sup> ) |                                   |                 |                          |                                                                                                                                                               |                          |        |

|                                                                                                                                                                                                                             |                                   |                 |                          |                                                                                           |                          |                 |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|-----------------|--------------------------|-------------------------------------------------------------------------------------------|--------------------------|-----------------|
| Site:                                                                                                                                                                                                                       | Site off Surfleet Road, Pinchbeck |                 |                          | <div>Elemental GI Ltd</div>                                                               |                          |                 |
| Client:                                                                                                                                                                                                                     | Minster Property Group            |                 |                          |                                                                                           |                          |                 |
| Contractor: RP Drilling                                                                                                                                                                                                     |                                   |                 | Project No: E21142 DRAFT |                                                                                           | Sheet: 1 of 1            | <div>WS03</div> |
| Equipment: Window Sampler Drilling Rig                                                                                                                                                                                      |                                   |                 | Logged by: JR            |                                                                                           | Date: 12th November 2021 |                 |
| Field Monitoring and Sampling                                                                                                                                                                                               |                                   |                 | Strata                   |                                                                                           |                          | Legend          |
| Depth<br>(m)                                                                                                                                                                                                                | Type                              | Result<br>(SPT) | Depth<br>(m)             | Description                                                                               |                          |                 |
| 0.10                                                                                                                                                                                                                        | JT                                |                 |                          | TOPSOIL comprising vegetation over brown silty sand with occasional rootlets. <div></div> |                          |                 |
|                                                                                                                                                                                                                             |                                   |                 | 0.40                     | Very loose brown very silty SAND. <div></div>                                             |                          |                 |
| 1.10                                                                                                                                                                                                                        | B                                 | N = 8           | 1m                       | ... becoming loose from 1.0m depth. <div></div>                                           |                          |                 |
|                                                                                                                                                                                                                             |                                   | N = 1           | 2m                       | ... becoming very loose from 1.0m depth. <div></div>                                      |                          |                 |
|                                                                                                                                                                                                                             |                                   | N = 9           | 3.00                     | ... becoming grey from 2.00m depth. <div></div>                                           |                          |                 |
|                                                                                                                                                                                                                             |                                   |                 |                          | Exploratory location completed at 3.00m depth. <div></div>                                |                          |                 |
|                                                                                                                                                                                                                             |                                   |                 | 4m                       |                                                                                           |                          |                 |
|                                                                                                                                                                                                                             |                                   |                 | 5m                       |                                                                                           |                          |                 |
| Water Observations:<br>Water encountered from 1.20m depth during drilling. Water encountered from 0.70m depth 20mins after drilling.                                                                                        |                                   |                 |                          |                                                                                           |                          |                 |
| Remarks:<br>1) Borehole terminated at 3.00m depth on adverse ground conditions (blowing sands).                                                                                                                             |                                   |                 |                          |                                                                                           |                          |                 |
| Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)<br>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm <sup>2</sup> ) |                                   |                 |                          |                                                                                           |                          |                 |

|                                        |                                   |                 |                          |                                                                                                                                                                                                                                                                                                                      |                          |                 |
|----------------------------------------|-----------------------------------|-----------------|--------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|-----------------|
| Site:                                  | Site off Surfleet Road, Pinchbeck |                 |                          | <div>Elemental GI Ltd</div>                                                                                                                                                                                                                                                                                          |                          |                 |
| Client:                                | Minster Property Group            |                 |                          |                                                                                                                                                                                                                                                                                                                      |                          |                 |
| Contractor: RP Drilling                |                                   |                 | Project No: E21142 DRAFT |                                                                                                                                                                                                                                                                                                                      | Sheet: 1 of 1            | <div>WS04</div> |
| Equipment: Window Sampler Drilling Rig |                                   |                 | Logged by: JR            |                                                                                                                                                                                                                                                                                                                      | Date: 12th November 2021 |                 |
| Field Monitoring and Sampling          |                                   |                 | Strata                   |                                                                                                                                                                                                                                                                                                                      |                          | Legend          |
| Depth<br>(m)                           | Type                              | Result<br>(SPT) | Depth<br>(m)             | Description                                                                                                                                                                                                                                                                                                          |                          |                 |
| 1.00                                   | JTB                               | N = 2           | 0.10                     | TOPSOIL comprising vegetation over brown silty sand with occasional rootlets.<br>MADE GROUND (Comprising reworked brown very sandy silt).                                                                                                                                                                            |                          |                 |
|                                        |                                   |                 | 0.80                     | MADE GROUND (Comprising brown gravelly sandy silt. Gravel is medium to coarse and subangular of mixed lithology including brick fragments).<br>... with gravel absent and becoming very loose from 1.00m depth.<br><br>... becoming mottled with black colouring and occasional decayed vegetation from 1.80m depth. |                          |                 |
|                                        |                                   |                 | 2.00                     | Very loose dark grey very silty medium SAND.                                                                                                                                                                                                                                                                         |                          |                 |
|                                        |                                   |                 | 3.00                     | Exploratory location completed at 3.00m depth.                                                                                                                                                                                                                                                                       |                          |                 |
|                                        |                                   |                 | 4m                       |                                                                                                                                                                                                                                                                                                                      |                          |                 |
|                                        |                                   |                 | 5m                       |                                                                                                                                                                                                                                                                                                                      |                          |                 |

Water Observations:  
 Water encountered from 0.80m depth during drilling. Water encountered from 0.84m depth 20mins after drilling.

Remarks:  
 1) Borehole terminated on completion of testing at 3.00m depth.

Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)  
 HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm<sup>2</sup>)

|                                                                                                                                                                                                                                              |                                   |                               |                          |                                                                                                                          |                 |      |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|-------------------------------|--------------------------|--------------------------------------------------------------------------------------------------------------------------|-----------------|------|
| Site:                                                                                                                                                                                                                                        | Site off Surfleet Road, Pinchbeck |                               |                          | <div> <div>Elemental</div> <div>GI Ltd</div> </div>                                                                      |                 |      |
| Client:                                                                                                                                                                                                                                      | Minster Property Group            |                               |                          |                                                                                                                          |                 |      |
| Contractor: RP Drilling                                                                                                                                                                                                                      |                                   |                               | Project No: E21142 DRAFT | Sheet: 1 of 1                                                                                                            | <div>WS05</div> |      |
| Equipment: Window Sampler Drilling Rig                                                                                                                                                                                                       |                                   |                               | Logged by: JR            | Date: 12th November 2021                                                                                                 |                 |      |
| Field Monitoring and Sampling                                                                                                                                                                                                                |                                   |                               | Strata                   |                                                                                                                          | Legend          | Well |
| Depth<br>(m)                                                                                                                                                                                                                                 | Type                              | Result<br>(SPT)               | Depth<br>(m)             | Description                                                                                                              |                 |      |
| 0.10                                                                                                                                                                                                                                         | JT                                | <div>N = 8</div> <div>▼</div> | 0.30                     | <div> <div>TOPSOIL comprising vegetation over brown silty sand with occasional rootlets.</div> <div></div> </div>        |                 |      |
| 0.50                                                                                                                                                                                                                                         | B                                 |                               | 0.65                     | <div> <div>Firm brown very sandy CLAY/SILT.</div> <div></div> </div>                                                     |                 |      |
|                                                                                                                                                                                                                                              |                                   |                               | 1.00                     | <div> <div>Very loose to loose brown and orangish brown mottled very silty fine to medium SAND.</div> <div></div> </div> |                 |      |
|                                                                                                                                                                                                                                              |                                   |                               |                          | <div> <div>Exploratory location completed at 1.00m depth.</div> <div></div> </div>                                       |                 |      |
|                                                                                                                                                                                                                                              |                                   |                               | 2m                       |                                                                                                                          |                 |      |
|                                                                                                                                                                                                                                              |                                   |                               | 3m                       |                                                                                                                          |                 |      |
|                                                                                                                                                                                                                                              |                                   |                               | 4m                       |                                                                                                                          |                 |      |
|                                                                                                                                                                                                                                              |                                   |                               | 5m                       |                                                                                                                          |                 |      |
| <div>Water Observations:</div> <div>Water encountered from 0.70m depth during drilling. Water encountered from 0.72m depth 20mins after drilling.</div>                                                                                      |                                   |                               |                          |                                                                                                                          |                 |      |
| <div>Remarks:</div> <div>1) Borehole terminated on completion of testing at 1.00m depth.</div>                                                                                                                                               |                                   |                               |                          |                                                                                                                          |                 |      |
| <div>Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)</div> <div>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm<sup>2</sup>)</div> |                                   |                               |                          |                                                                                                                          |                 |      |

| Site:                                  | Site off Surfleet Road, Pinchbeck                                   |                 |                          | <div>Elemental GI Ltd</div>                                                                                                                                                   |      |
|----------------------------------------|---------------------------------------------------------------------|-----------------|--------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|
| Client:                                | Minster Property Group                                              |                 |                          |                                                                                                                                                                               |      |
| Contractor: RP Drilling                |                                                                     |                 | Project No: E21142 DRAFT | Sheet: 1 of 1                                                                                                                                                                 | WS06 |
| Equipment: Window Sampler Drilling Rig |                                                                     |                 | Logged by: JR            | Date: 12th November 2021                                                                                                                                                      |      |
| Field Monitoring and Sampling          |                                                                     |                 | Strata                   | Legend                                                                                                                                                                        | Well |
| Depth<br>(m)                           | Type                                                                | Result<br>(SPT) | Depth<br>(m)             | Description                                                                                                                                                                   |      |
| 0.50                                   | JT                                                                  |                 | 0.25                     | MADE GROUND (Comprising vegetation over reworked brown sandy silty topsoil with rare medium and subangular gravel of mixed lithology).                                        |      |
|                                        |                                                                     |                 | 0.70                     | MADE GROUND (Comprising brown and greyish brown sandy silt). (Appears structureless and reworked)                                                                             |      |
|                                        |                                                                     |                 | 1m                       | MADE GROUND (Comprising brown and greyish brown silty medium sand). (Appears structureless and reworked)                                                                      |      |
|                                        |                                                                     |                 | 1.40                     |                                                                                                                                                                               |      |
|                                        |                                                                     |                 | 2m                       | Soft grey and greyish brown very sandy CLAY/SILT with frequent decayed organic matter.<br><br>... becoming black and very soft with abundant organic matter from 1.85m depth. |      |
|                                        |                                                                     |                 | 3m                       |                                                                                                                                                                               |      |
| 3.10                                   | Loose grey very silty fine SAND with rare black organic inclusions. |                 |                          |                                                                                                                                                                               |      |
| 4.00                                   |                                                                     |                 |                          |                                                                                                                                                                               |      |
|                                        |                                                                     |                 | 5m                       | Exploratory location completed at 4.00m depth.                                                                                                                                |      |

Water Observations:

Water encountered from 1.10m depth during drilling. Water encountered from 0.73m depth 20mins after drilling.

Remarks:

1) Borehole terminated on completion of testing at 4.00m depth.

Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)

HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm<sup>2</sup>)

|                                        |      |                                                                 |                          |                                                                                                                                                                            |                                                |
|----------------------------------------|------|-----------------------------------------------------------------|--------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------|
| Site:                                  |      | Site off Surfleet Road, Pinchbeck                               |                          | <div> <div>Elemental</div> <div>GI Ltd</div> </div>                                                                                                                        |                                                |
| Client:                                |      | Minster Property Group                                          |                          |                                                                                                                                                                            |                                                |
| Contractor: RP Drilling                |      |                                                                 | Project No: E21142 DRAFT |                                                                                                                                                                            | Sheet: 1 of 1                                  |
| Equipment: Window Sampler Drilling Rig |      |                                                                 | Logged by: JR            |                                                                                                                                                                            | Date: 12th November 2021                       |
| Field Monitoring and Sampling          |      |                                                                 | Strata                   |                                                                                                                                                                            | <div> <div>Legend</div> <div>Well</div> </div> |
| Depth                                  | Type | Result                                                          | Depth                    | Description                                                                                                                                                                |                                                |
| (m)                                    |      | (SPT)                                                           | (m)                      |                                                                                                                                                                            |                                                |
| 1.00                                   | JTB  | <div> <div>N = 1</div> <div>N = 7</div> <div>N = 5</div> </div> | 0.50                     | <div> <div>TOPSOIL comprising brown sandy silt with rare medium and subangular gravel of mixed lithology.</div> <div></div> </div>                                         |                                                |
|                                        |      |                                                                 | 0.80                     | <div> <div>Soft light brown sandy SILT.</div> <div>... with a dark silt band with rootlets present between 0.75m and 0.80m depth.</div> <div></div> </div>                 |                                                |
|                                        |      |                                                                 | 1m                       | <div> <div>Very soft brown sandy CLAY/SILT.</div> <div>... with frequent small sandy pockets and decayed organic matter present from 0.95m depth.</div> <div></div> </div> |                                                |
|                                        |      |                                                                 | 2.00                     | <div> <div>... becoming black and grey mottled from 1.70m depth.</div> <div></div> </div>                                                                                  |                                                |
|                                        |      |                                                                 | 3.00                     | <div> <div>Loose grey very silty fine SAND with rare black organic inclusions.</div> <div></div> </div>                                                                    |                                                |
|                                        |      |                                                                 | 4m                       | Exploratory location completed at 3.00m depth.                                                                                                                             |                                                |
|                                        |      |                                                                 | 5m                       |                                                                                                                                                                            |                                                |

Water Observations:

Water encountered from 1.45m depth during drilling. Water encountered from 1.05m depth 20mins after drilling.

Remarks:

1) Borehole completed as a monitoring well.



Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)

HSV = Hand Shear Vane (kPa). PP = Pocket Penetrometer (daN/cm<sup>2</sup>)

| Site:                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  | Site off Surfleet Road, Pinchbeck |                          |              | <b>Elemental GI Ltd</b>                                                                                       |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|--------------------------|--------------|---------------------------------------------------------------------------------------------------------------|
| Client:                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                | Minster Property Group            |                          |              |                                                                                                               |
| Contractor: RP Drilling                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |                                   | Project No: E21142 DRAFT |              | Sheet: 1 of 1                                                                                                 |
| Equipment: Window Sampler Drilling Rig                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                                   | Logged by: JR            |              | Date: 12th November 2021                                                                                      |
| Field Monitoring and Sampling                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |                                   |                          |              | Strata                                                                                                        |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          |              | Legend                                                                                                        |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          |              | Well                                                                                                          |
| Depth<br>(m)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | Type                              | Result<br>(SPT)          | Depth<br>(m) | Description                                                                                                   |
| 0.45                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   | JT                                | ▼                        | 0.35         | TOPSOIL comprising vegetation over brown silty sand.                                                          |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 0.70         | MADE GROUND (Comprising reworked light brown sandy silt).<br>... with glass fragments present at 0.60m depth. |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 0.75         | Soft dark brown sandy CLAY.                                                                                   |
| 1.00                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   | B                                 | N = 7                    | 1m           | Soft to firm grey sandy CLAY/SILT.                                                                            |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 1.50         | ... becoming soft from 1.40m depth.                                                                           |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 2m           | Loose grey very silty medium SAND.                                                                            |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 3m           | ... with rare black decayed vegetation present between 1.60m and 2.80m depth.                                 |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 4m           | ... becoming very loose from 2.50m depth.                                                                     |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          | 5.00         | ... becoming medium dense from 4.80m depth.                                                                   |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                   |                          |              | Exploratory location completed at 5.00m depth.                                                                |
| <p>Water Observations:</p> <p>Water encountered from 1.50m depth during drilling. Water encountered from 0.52m depth 20mins after drilling (possible water from collapsed strata).</p> <p>Remarks:</p> <p>1) Borehole collapsed to 0.52m depth 20 mins after drilling.</p> <p>2) Borehole terminated on completion of testing at 5.00m depth.</p> <p>Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)</p> <p>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm<sup>2</sup>)</p> |                                   |                          |              |                                                                                                               |

|                                                                                                                                                                                                                             |                                   |          |                                                |                                                                                                                                                              |        |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|----------|------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------|--------|
| Site:                                                                                                                                                                                                                       | Site off Surfleet Road, Pinchbeck |          |                                                | <div>Elemental GI Ltd</div>                                                                                                                                  |        |
| Client:                                                                                                                                                                                                                     | Minster Property Group            |          |                                                |                                                                                                                                                              |        |
| Contractor: Engineer                                                                                                                                                                                                        |                                   |          | Project No: E21142 DRAFT                       | Sheet: 1 of 1                                                                                                                                                | HTP01  |
| Equipment: Hand Tools                                                                                                                                                                                                       |                                   |          | Logged by: JR                                  | Date: 12th November 2021                                                                                                                                     |        |
| Field Monitoring and Sampling                                                                                                                                                                                               |                                   |          | Strata                                         |                                                                                                                                                              | Legend |
| Depth                                                                                                                                                                                                                       | Type                              | Result   | Depth                                          | Description                                                                                                                                                  |        |
| (m)                                                                                                                                                                                                                         |                                   | (HSV/PP) | (m)                                            |                                                                                                                                                              |        |
|                                                                                                                                                                                                                             |                                   |          | 0.45                                           | MADE GROUND (Comprising vegetation over reworked brown slightly gravelly silty sandy topsoil. Gravel is medium to coarse and subangular of brick fragments). |        |
|                                                                                                                                                                                                                             |                                   |          | 0.50                                           | Soft brown very silty SAND.                                                                                                                                  |        |
|                                                                                                                                                                                                                             |                                   |          | Exploratory location completed at 0.50m depth. |                                                                                                                                                              |        |
|                                                                                                                                                                                                                             |                                   |          | 1m                                             |                                                                                                                                                              |        |
|                                                                                                                                                                                                                             |                                   |          | 2m                                             |                                                                                                                                                              |        |
|                                                                                                                                                                                                                             |                                   |          | 3m                                             |                                                                                                                                                              |        |
|                                                                                                                                                                                                                             |                                   |          | 4m                                             |                                                                                                                                                              |        |
|                                                                                                                                                                                                                             |                                   |          | 5m                                             |                                                                                                                                                              |        |
| Water Observations:<br>No water encountered during excavation.                                                                                                                                                              |                                   |          |                                                |                                                                                                                                                              |        |
| Remarks:<br>1) Completed as a shallow hand dug pit to investigate local soil conditions at 0.50m depth.                                                                                                                     |                                   |          |                                                |                                                                                                                                                              |        |
| Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)<br>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm <sup>2</sup> ) |                                   |          |                                                |                                                                                                                                                              |        |

|                                                                                                                                                                                                                             |                                   |                    |                          |                                                                                                                                                                        |        |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|--------------------|--------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------|
| Site:                                                                                                                                                                                                                       | Site off Surfleet Road, Pinchbeck |                    |                          | <div>Elemental GI Ltd</div>                                                                                                                                            |        |
| Client:                                                                                                                                                                                                                     | Minster Property Group            |                    |                          |                                                                                                                                                                        |        |
| Contractor: Engineer                                                                                                                                                                                                        |                                   |                    | Project No: E21142 DRAFT | Sheet: 1 of 1                                                                                                                                                          | HTP02  |
| Equipment: Hand Tools                                                                                                                                                                                                       |                                   |                    | Logged by: JR            | Date: 12th November 2021                                                                                                                                               |        |
| Field Monitoring and Sampling                                                                                                                                                                                               |                                   |                    | Strata                   |                                                                                                                                                                        | Legend |
| Depth<br>(m)                                                                                                                                                                                                                | Type                              | Result<br>(HSV/PP) | Depth<br>(m)             | Description                                                                                                                                                            |        |
| 0.20                                                                                                                                                                                                                        | JTT                               |                    |                          | MADE GROUND (Comprising vegetation over reworked brown slightly gravelly silty sandy topsoil. Gravel is medium to coarse and subangular of brick fragments and glass). |        |
|                                                                                                                                                                                                                             |                                   |                    | 0.50                     | Exploratory location completed at 0.50m depth.                                                                                                                         |        |
|                                                                                                                                                                                                                             |                                   |                    | 1m                       |                                                                                                                                                                        |        |
|                                                                                                                                                                                                                             |                                   |                    | 2m                       |                                                                                                                                                                        |        |
|                                                                                                                                                                                                                             |                                   |                    | 3m                       |                                                                                                                                                                        |        |
|                                                                                                                                                                                                                             |                                   |                    | 4m                       |                                                                                                                                                                        |        |
|                                                                                                                                                                                                                             |                                   |                    | 5m                       |                                                                                                                                                                        |        |
| Water Observations:<br>No water encountered during excavation.                                                                                                                                                              |                                   |                    |                          |                                                                                                                                                                        |        |
| Remarks:<br>1) Completed as a shallow hand dug pit to investigate local soil conditions at 0.50m depth.                                                                                                                     |                                   |                    |                          |                                                                                                                                                                        |        |
| Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)<br>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm <sup>2</sup> ) |                                   |                    |                          |                                                                                                                                                                        |        |

|                                                                                                                                                                                                                             |                                   |                    |                                                |                                                                                                                                                                   |                  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|--------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|
| Site:                                                                                                                                                                                                                       | Site off Surfleet Road, Pinchbeck |                    |                                                | <div>Elemental GI Ltd</div>                                                                                                                                       |                  |
| Client:                                                                                                                                                                                                                     | Minster Property Group            |                    |                                                |                                                                                                                                                                   |                  |
| Contractor: Engineer                                                                                                                                                                                                        |                                   |                    | Project No: E21142 DRAFT                       | Sheet: 1 of 1                                                                                                                                                     | <div>HTP03</div> |
| Equipment: Hand Tools                                                                                                                                                                                                       |                                   |                    | Logged by: JR                                  | Date: 20th November 2021                                                                                                                                          |                  |
| Field Monitoring and Sampling                                                                                                                                                                                               |                                   |                    | Strata                                         |                                                                                                                                                                   | Legend           |
| Depth<br>(m)                                                                                                                                                                                                                | Type                              | Result<br>(HSV/PP) | Depth<br>(m)                                   | Description                                                                                                                                                       |                  |
| 1.20                                                                                                                                                                                                                        | J                                 |                    | 0.35                                           | TOPSOIL comprising vegetation over brown silty sand with occasional rootlets.  |                  |
|                                                                                                                                                                                                                             |                                   |                    | 1m                                             | Soft to firm light brown and dark brown mottled sandy CLAY/SILT.               |                  |
|                                                                                                                                                                                                                             |                                   |                    | 1.20                                           | ... becoming very sandy and slightly damp from 1.00m depth.                    |                  |
|                                                                                                                                                                                                                             |                                   |                    | Exploratory location completed at 1.20m depth. |                                                                                                                                                                   |                  |
|                                                                                                                                                                                                                             |                                   |                    | 2m                                             |                                                                                                                                                                   |                  |
|                                                                                                                                                                                                                             |                                   |                    | 3m                                             |                                                                                                                                                                   |                  |
|                                                                                                                                                                                                                             |                                   |                    | 4m                                             |                                                                                                                                                                   |                  |
|                                                                                                                                                                                                                             |                                   |                    | 5m                                             |                                                                                                                                                                   |                  |
| Water Observations:<br>No water encountered during excavation.                                                                                                                                                              |                                   |                    |                                                |                                                                                                                                                                   |                  |
| Remarks:<br>1) Completed as a shallow hand dug pit to investigate local soil conditions at 1.20m depth.                                                                                                                     |                                   |                    |                                                |                                                                                                                                                                   |                  |
| Where they are unaccompanied by in situ tests, strength descriptions of granular soils are based on initial Engineer's field description(s)<br>HSV = Hand Shear Vane (kPa), PP = Pocket Penetrometer (daN/cm <sup>2</sup> ) |                                   |                    |                                                |                                                                                                                                                                   |                  |

## **Appendix E – Development Masterplan**

Proposed Site Layout

Scale: 1:500

schedule of accommodation

| housetype  | code | area              | quantity     |
|------------|------|-------------------|--------------|
| 2B4P House | A    | 75m <sup>2</sup>  | 15 no. units |
| 3B5P House | B    | 80m <sup>2</sup>  | 10 no. units |
| 3B5P House | C    | 85m <sup>2</sup>  | 16 no. units |
| 4B6P House | D    | 102m <sup>2</sup> | 02 no. units |
| 1B2P House | E    | 51m <sup>2</sup>  | 04 no. units |

Total Number of Units 37 no. units

|                         |                            |
|-------------------------|----------------------------|
| approximate site area : | 1.59Ha / 3.93 acres        |
| density :               | 23.3 dwellings per hectare |
| parking provision :     | 200%                       |

Key

- Application site boundary
- Proposed Housing
- Existing Surrounding Buildings
- Private Rear Garden Area
- Public Open / Green Space
- Principal Highway / Road
- Private Drive
- Car Parking Spaces
- Pedestrian Footpaths
- Existing Tree Planting
- Existing Tree Planting Removed
- Proposed Tree Planting  
(indicative only - to be designed and specified by Landscape Architect)
- Proposed Hedge / Shrub Planting  
(indicative only - to be designed and specified by Landscape Architect)
- Housetypes - Primary Point of Access



**Disclaimer:** This document and its design content is copyright protected ©. It shall be read in conjunction with all other associated project information including models, specifications, schedules and related consultants documents. Do not scale from documents. All scales noted correct at original paper size. All dimensions to be checked on site. Immediately report any discrepancies, errors or omissions on this document to the originator. If in doubt ask.

Source File:  
20050 Model.pln

| Rev | Date       | Drawn | Note                                                                                                                                                               |
|-----|------------|-------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| P02 | 25/01/2022 | JKG   | Drawing status updated to 'Planning'.                                                                                                                              |
| P03 | 28/01/2022 | JKG   | Sheds and bins shown. Indicative landscaping / planting amended.                                                                                                   |
| P04 | 01/03/2022 | JKG   | Red line amended.                                                                                                                                                  |
| P05 | 04/03/2022 | JKG   | Layout updated.                                                                                                                                                    |
| P06 | 04/05/2022 | JKG   | Updated following comments from LPA. Housetype B removed, parking amended, Housetype E amended. Refuse collection points amended. Hedgerow shown to site frontage. |



Client  
Minster Property Group Ltd.

Project Title  
Proposed Residential Development at  
Land off Surfleet Road,  
Pinchbeck

Drawing Title  
Proposed Site Layout

Drawing Status  
Planning

|                         |                           |
|-------------------------|---------------------------|
| Scale(s)<br>1:500       | Original Paper Size<br>A1 |
| Drawn<br>JKG            | Date<br>24.01.22          |
| Project Number<br>20050 | Drawing Number<br>0102    |
|                         | Revision<br>P06           |

Proposed Site Layout

Scale: 1:500

| schedule of accommodation |      |                            |              |
|---------------------------|------|----------------------------|--------------|
| housetype                 | code | area                       | quantity     |
| 3B5P House                | F    | 92m <sup>2</sup>           | 04 no. units |
| Total Number of Units     |      |                            | 04 no. units |
| approximate site area :   |      | 0.195Ha / 0.48 acres       |              |
| density :                 |      | 20.5 dwellings per hectare |              |
| parking provision :       |      | 200%                       |              |

Key

- Application site boundary
- Proposed Housing
- Existing Surrounding Buildings
- Private Rear Garden Area
- Public Open / Green Space
- Principal Highway / Road
- Private Drive
- Car Parking Spaces
- Pedestrian Footpaths
- Existing Tree Planting
- Existing Tree Planting Removed
- Proposed Tree Planting  
(indicative only - to be designed and specified by Landscape Architect)
- Proposed Hedge / Shrub Planting  
(indicative only - to be designed and specified by Landscape Architect)
- Housetypes - Primary Point of Access

**Disclaimer:** This document and its design content is copyright protected ©. It shall be read in conjunction with all other associated project information including models, specifications, schedules and related consultants documents. Do not scale from documents. All scales noted correct at original paper size. All dimensions to be checked on site. Immediately report any discrepancies, errors or omissions on this document to the originator. If in doubt ask.

Source File:  
20050 Model.pln

| Rev | Date       | Drawn | Note            |
|-----|------------|-------|-----------------|
| P02 | 04/03/2022 | JKG   | Layout updated. |
| P03 | 22/05/2022 | JKG   | Access amended. |



MINSTER  
PROPERTY GROUP





JGA  
ARCHITECTURE & PLANNING  
e: hello@jg-a.co.uk t: 07429 162 747

Client  
Minster Property Group Ltd.

Project Title  
Proposed Residential Development at  
Land off Surfleet Road,  
Pinchbeck

| Drawing Title            |                            | Drawing Status   |                   |
|--------------------------|----------------------------|------------------|-------------------|
| Proposed Site Layout     |                            | Planning         |                   |
| Scale(s):<br>1:500       | Original Paper Size:<br>A1 | Drawn:<br>JKG    | Date:<br>01.03.22 |
| Project Number:<br>20050 | Drawing Number:<br>0152    | Revision:<br>P03 |                   |

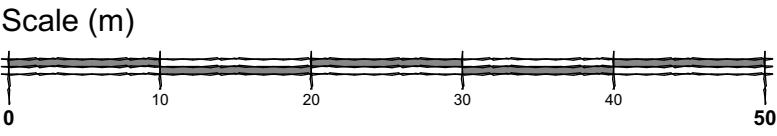


## **Appendix F – Fluvial Flooding Information**

Flood risk

Extent of flooding

Location

Land off Surfleet Road

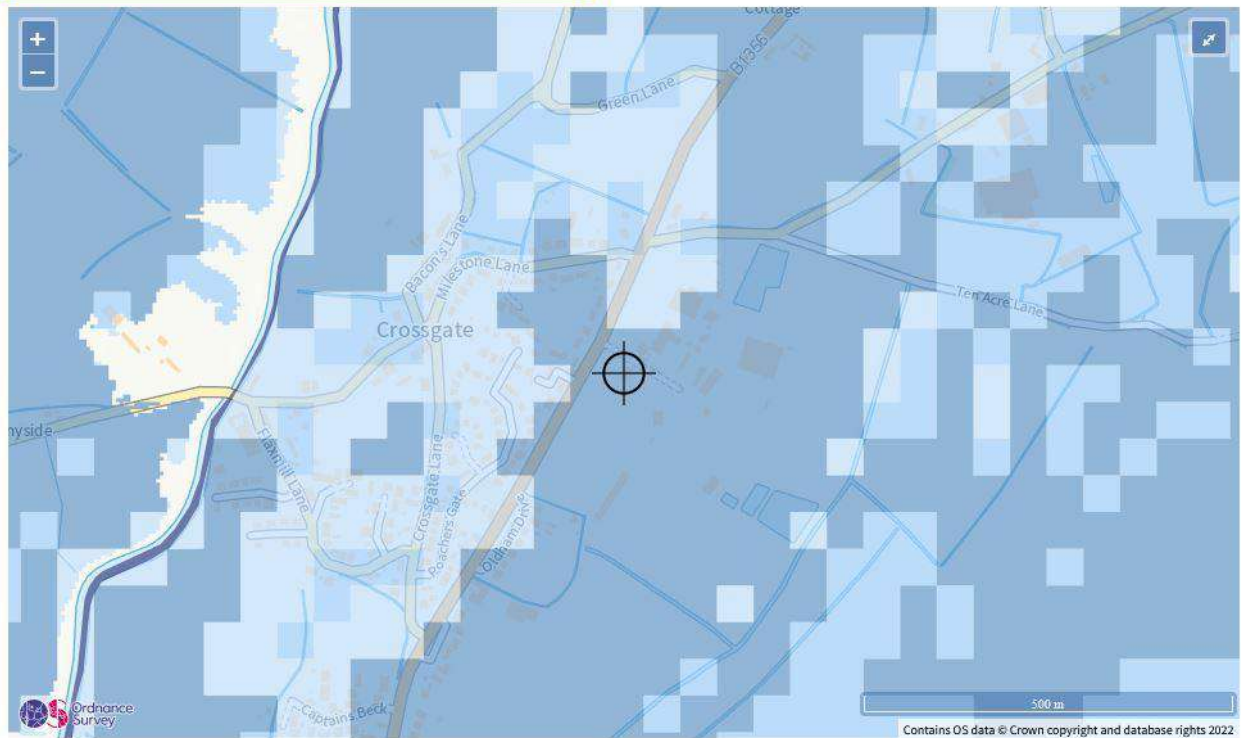

Extent of flooding from rivers or the sea

High Medium Low Very low Location you selected

dorothea@civillistix.com

**Our ref:** CCN-2022-246974

**Date:** 20/1/2022

Dear Dorothea

**Provision of Flood Risk Information for land off Surfleet Road, Pinchbeck.**

Thank you for your request to use our flood risk information for the above site. The information is set out below and attached. It is important you read any contextual notes on the maps provided.

If you are preparing a Flood Risk Assessment (FRA) for this site, please note this information may not be sufficient by itself to produce an adequate FRA to demonstrate the development is safe over its lifetime. Additional information may be required to carry out an appropriate assessment of all risk, such as consequence of a breach in defences.

We aim to review our information on a regular basis, so if you are using this data more than twelve months from the date of this letter, please contact us again to check it is still valid.

**1. Flood Map**

The attached map includes the current Flood Map for your area. The Flood Map indicates the area at risk of flooding, **assuming no flood defences exist**, for a flood with a 0.5% chance of occurring in any year for flooding from the sea, or a 1% chance of occurring for fluvial (river) flooding. It also shows the extent of the Extreme Flood Outline which represents the extent of a flood with a 0.1% chance of occurring in any year, or the highest recorded historic extent if greater.

In some locations, such as around the fens and the large coastal floodplains, showing the area at risk of flooding assuming no defences may give a slightly misleading picture in that if there were no flood defences, water would spread out across these large floodplains. This flooding could cover large areas of land but to relatively shallow depths and could leave pockets of locally slightly higher land as isolated dry islands. It is important to understand the actual risk of the flooding to these dry islands, particularly in the event of defence failure.

The Flood Map also shows the location of formal raised flood defences and flood storage reservoirs. It represents areas at risk of flooding for present day only and does not take account of climate change.

The Flood Map only indicates the extent and likelihood of flooding from rivers or the sea. It should also be remembered flooding may occur from other sources such as surface water sewers, road drainage, etc.

**2. Historic Flood Event Outlines**

With regards to the history of flooding I can advise we do not have any records of flooding in this area. It is possible recent flooding may have occurred which we are currently investigating, therefore this information may be subject to change. It is possible other flooding may have occurred which other risk management authorities, such as the Lead Local Flood Authority (ie top tier council) or Internal Drainage Board (where they exist) have responsibility.

### **3. Schemes in the area**

There are no ongoing capital projects to reduce or sustain the current flood risk to this site.

### **4. Fluvial Flood Risk Information**

#### **4.1 Fluvial Defence Information**

The existing fluvial defences reducing the risk of flooding to this site consist of earth embankments and concrete floodwalls. They are in fair condition and reduce the risk of flooding (at the defence) to a 1% (1 in 100) chance of occurring in any year. We inspect these defences routinely to ensure potential defects are identified.

Refer to paragraph 3 for details of any ongoing capital projects to reduce the flood risk to this site.

#### **4.2 Fluvial Modelled Levels and Flows**

Available modelled fluvial flood levels and flows for the model nodes shown on the attached map are set out in the data table attached. This data is taken from the model named on the data table, which is the most up-to-date model currently available.

Please note these levels are “in-channel” levels and therefore may not represent the flood level on the floodplain, particularly where the channel is embanked or has raised defences.

Our models may not have the most up to date climate change allowances. In time we will update our models for the latest allowances. You should refer to '[Flood risk assessments: climate change allowances](#)' to check if the allowances modelled are appropriate for the type of development you are proposing and its location. You may need to undertake further assessment of future flood risk using different allowances to ensure your assessment of future flood risk is based on best available evidence.

#### **4.3 Fluvial Modelled Flood Extents**

Please find attached a map showing available modelled flood extents, taking into account flood defences, for your area. This data is taken from the model named on the map, which is the most up-to-date model currently available.

#### **4.4 Fluvial Hazard Mapping**

For certain locations we have carried out modelling to map the maximum values of flood depth, velocity and hazard rating (danger to people) resulting from overtopping and / or breaching of defences at specific locations for a number of scenarios.

At present this information is available for fluvial flood risk in Northampton, Lincoln, Wainfleet and some isolated rural locations.

The number of locations we have this information for is expected to increase in time.

Detailed Hazard Mapping is available within the 2017 Update of South Holland Strategic Flood Risk Assessment. This can be downloaded via the following link:

<http://www.southeastlincslocalplan.org/water/>

### **5. Tidal Flood Risk Information**

This site is not considered to be at risk from tidal flooding.

## 6. **Development Planning**

If you would like local guidance on preparing a flood risk assessment for a planning application, please contact our Sustainable Places team at [lnplanning@environment-agency.gov.uk](mailto:lnplanning@environment-agency.gov.uk). It will help if you mention this data request and attach your site location plan.

We provide free preliminary advice; additional/detailed advice, review of draft FRAs and meetings are chargeable at a rate set to cover our costs, currently £100 (plus VAT) per hour of staff time. Further details are available on our website at <https://www.gov.uk/guidance/developers-get-environmental-advice-on-your-planning-proposals>.

General advice on flood risk assessment for planning applications can be found on GOV.UK at <https://www.gov.uk/guidance/flood-risk-assessment-for-planning-applications>

Climate change will increase flood risk due to overtopping of defences. Please note, unless specified otherwise, the climate change data included has an allowance for 20% increase in flow. Updated guidance on how climate change could affect flood risk to new development - 'Flood risk assessments: climate change allowances' was published on GOV.UK in **July 2021**. The appropriate updated climate change allowance should be applied in a Flood Risk Assessment.

You should also consult the Strategic Flood Risk Assessment produced by your local planning authority.

## 7. **Data Licence and Other Supporting Information**

We respond to requests for recorded information we hold under the Freedom of Information Act 2000 (FOIA) and the associated Environmental Information Regulations 2004 (EIR).

This information is provided in accordance with the Open Government Licence which can be found here: <http://www.nationalarchives.gov.uk/doc/open-government-licence/version/3/>

Further information on flood risk can be found on the GOV.UK website at: <https://www.gov.uk/browse/environment-countryside/flooding-extreme-weather>

## 8. **Other Flood Risk Management Authorities**

The information provided with this letter relates to flood risk from main river or the sea. Additional information may be available from other risk management authorities, such as the Lead Local Flood Authority (ie top tier council) or Internal Drainage Board (where they exist).

I hope we have correctly interpreted your request. If you have any queries or would like to discuss the content of this letter further please contact Frederic Stuhldreer using the email address below.


Yours sincerely,



**for Alastair Windler**  
**Welland and Nene Partnerships and Strategic Overview Team Leader**  
e-mail [PSOWN@environment-agency.gov.uk](mailto:PSOWN@environment-agency.gov.uk)

Enc.  
Flood Map with Modelled Node Points  
Modelled Fluvial Levels and Flows Data Sheet  
Modelled Flood Extent Map

# Flood Map centred on TF 24510 26592 - created January 2022 [Ref: CCN-2022-246974]

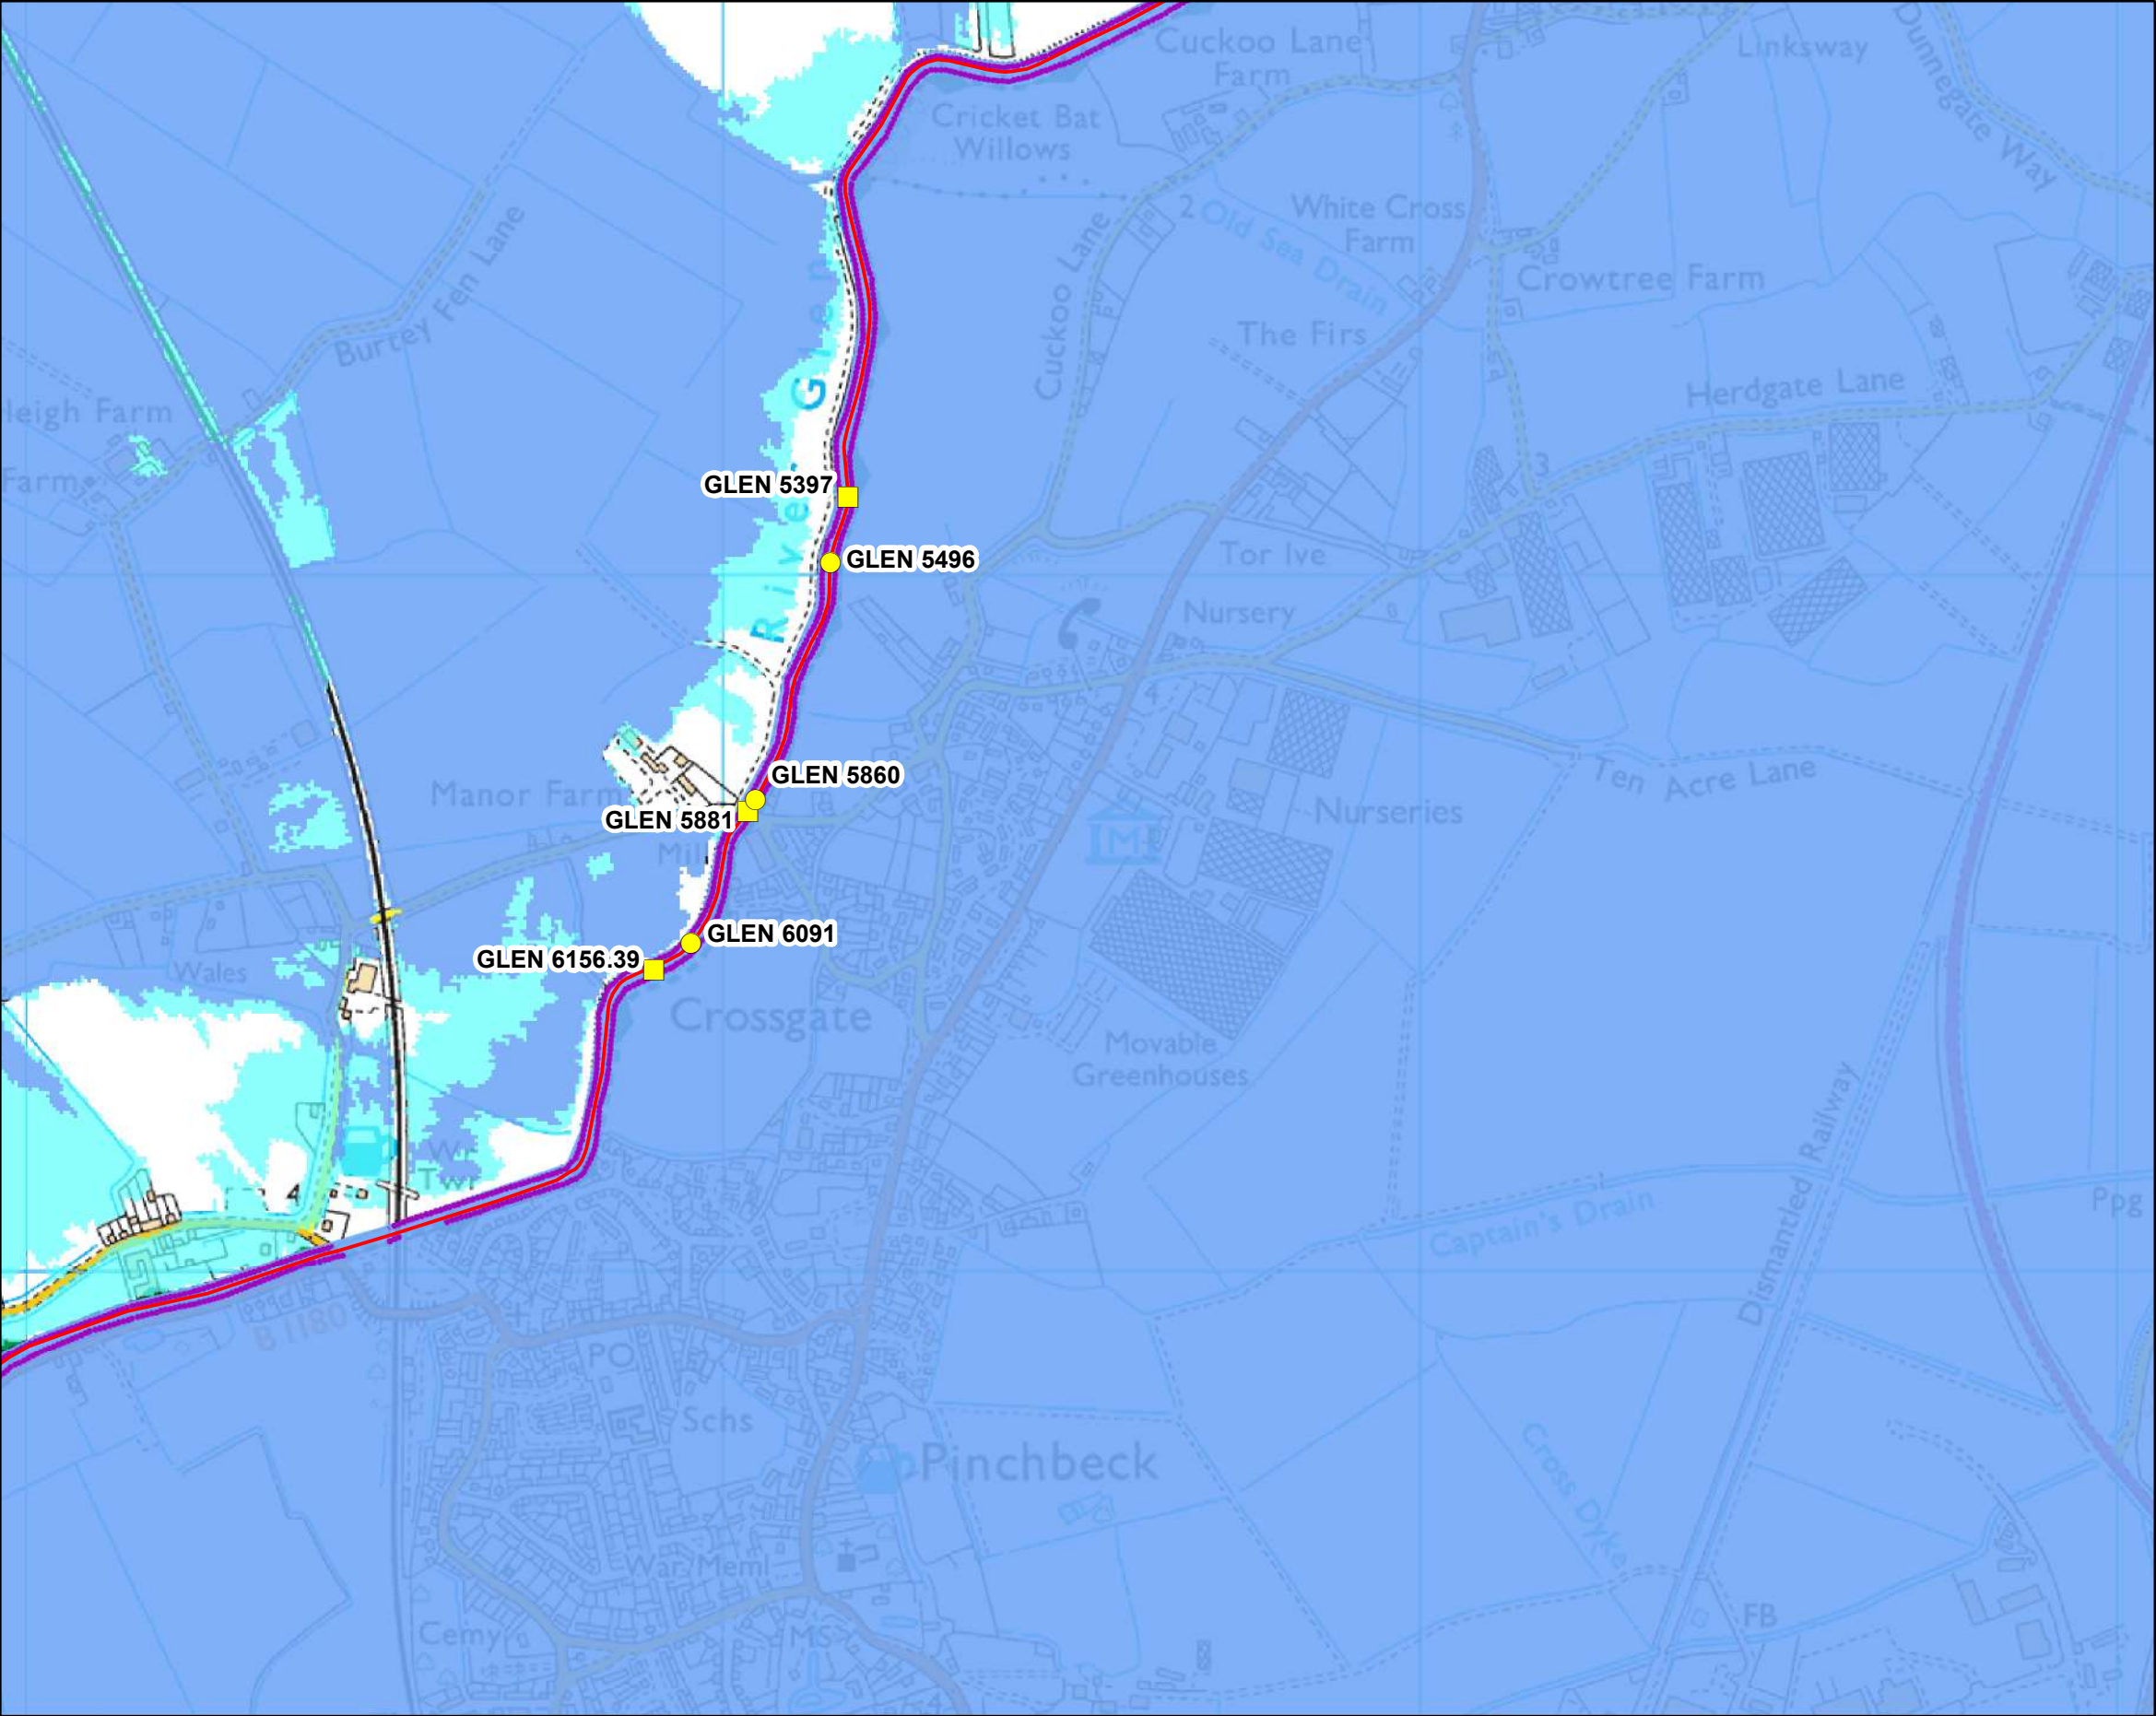

Scale 1:10,000



## Legend

- Main River
- Raised Defences
- Flood Storage Areas
- Area at Risk of Flooding from Rivers or The Sea
- Extreme Flood Outline
- Level Node Points
- Flow Node Points

Dark blue shows the area that could be affected by flooding, either from rivers or the sea, if there were no flood defences. This area could be flooded:

- from the sea by a flood that has a 0.5% (1 in 200) or greater chance of happening each year.
- or from a river by a flood that has a 1% (1 in 100) or greater chance of happening each year.

Light blue shows the extent of the Extreme Flood Outline, which represents the extent of a flood event with a 0.1% chance of occurring in any year, or the highest recorded historic extent if greater.

These two colours show the extent of the natural floodplain if there were no flood defences or certain other manmade structures and channel improvements. Sites outside the two extents, but behind raised defences, may be affected by flooding if the defences are overtopped or fail.

Created by the Partnerships and Strategic Overview Team, Kettering

## Fluvial Flood Levels (mODN)

The fluvial flood levels for the model nodes shown on the attached map are set out in the table below. They are measured in metres above Ordnance Datum Newlyn (mODN).


| Node Label | Easting | Northing | Annual Exceedance Probability - Maximum Water Levels (mODN) |                 |                  |                 |                    |                 |                    |                  |                                               |                    |                     |                                                  |
|------------|---------|----------|-------------------------------------------------------------|-----------------|------------------|-----------------|--------------------|-----------------|--------------------|------------------|-----------------------------------------------|--------------------|---------------------|--------------------------------------------------|
|            |         |          | 50%<br>(1 in 2)                                             | 20%<br>(1 in 5) | 10%<br>(1 in 10) | 5%<br>(1 in 20) | 3.33%<br>(1 in 30) | 2%<br>(1 in 50) | 1.33%<br>(1 in 75) | 1%<br>(1 in 100) | 1%<br>(1 in 100) inc<br>20% Climate<br>Change | 0.5%<br>(1 in 200) | 0.1%<br>(1 in 1000) | 0.1%<br>(1 in 1000) inc<br>20% Climate<br>Change |
| GLEN 5496  | 524155  | 327018   | 3.98                                                        | 4.12            | 4.21             | 4.29            | 4.27               | 4.29            | 4.31               | 4.32             | 4.80                                          | 4.36               | 4.45                | 4.85                                             |
| GLEN 5860  | 524048  | 326677   | 3.98                                                        | 4.13            | 4.21             | 4.29            | 4.28               | 4.29            | 4.32               | 4.33             | 4.81                                          | 4.38               | 4.49                | 4.86                                             |
| GLEN 6091  | 523956  | 326471   | 3.99                                                        | 4.14            | 4.22             | 4.30            | 4.30               | 4.31            | 4.34               | 4.35             | 4.82                                          | 4.40               | 4.53                | 4.90                                             |

## Fluvial Flood Flows (m³/s)

The fluvial flood flows for the model nodes shown on the attached map are set out in the table below. They are measured in metres cubed per second (m³/s).

| Node Label   | Easting | Northing | Annual Exceedance Probability - Maximum Flows (m³/s) |                 |                  |                 |                    |                 |                    |                  |                                               |                    |                     |                                                  |
|--------------|---------|----------|------------------------------------------------------|-----------------|------------------|-----------------|--------------------|-----------------|--------------------|------------------|-----------------------------------------------|--------------------|---------------------|--------------------------------------------------|
|              |         |          | 50%<br>(1 in 2)                                      | 20%<br>(1 in 5) | 10%<br>(1 in 10) | 5%<br>(1 in 20) | 3.33%<br>(1 in 30) | 2%<br>(1 in 50) | 1.33%<br>(1 in 75) | 1%<br>(1 in 100) | 1%<br>(1 in 100) inc<br>20% Climate<br>Change | 0.5%<br>(1 in 200) | 0.1%<br>(1 in 1000) | 0.1%<br>(1 in 1000) inc<br>20% Climate<br>Change |
| GLEN 5397    | 524181  | 327112   | 27.85                                                | 31.09           | 32.77            | 34.95           | 35.50              | 36.34           | 37.04              | 37.64            | 45.94                                         | 40.79              | 49.78               | 57.19                                            |
| GLEN 5881    | 524037  | 326660   | 27.01                                                | 30.30           | 31.96            | 34.08           | 34.67              | 35.52           | 36.24              | 36.81            | 44.92                                         | 39.91              | 49.12               | 57.08                                            |
| GLEN 6156.39 | 523902  | 326434   | 26.57                                                | 29.99           | 31.61            | 33.71           | 34.31              | 35.17           | 35.91              | 36.44            | 44.46                                         | 39.52              | 48.78               | 57.04                                            |

**Welland Glen Modelled Flood Extents (with defences)**  
Map centred on TF 24510 26592 - created January 2022 [Ref: CCN-2022-246974]

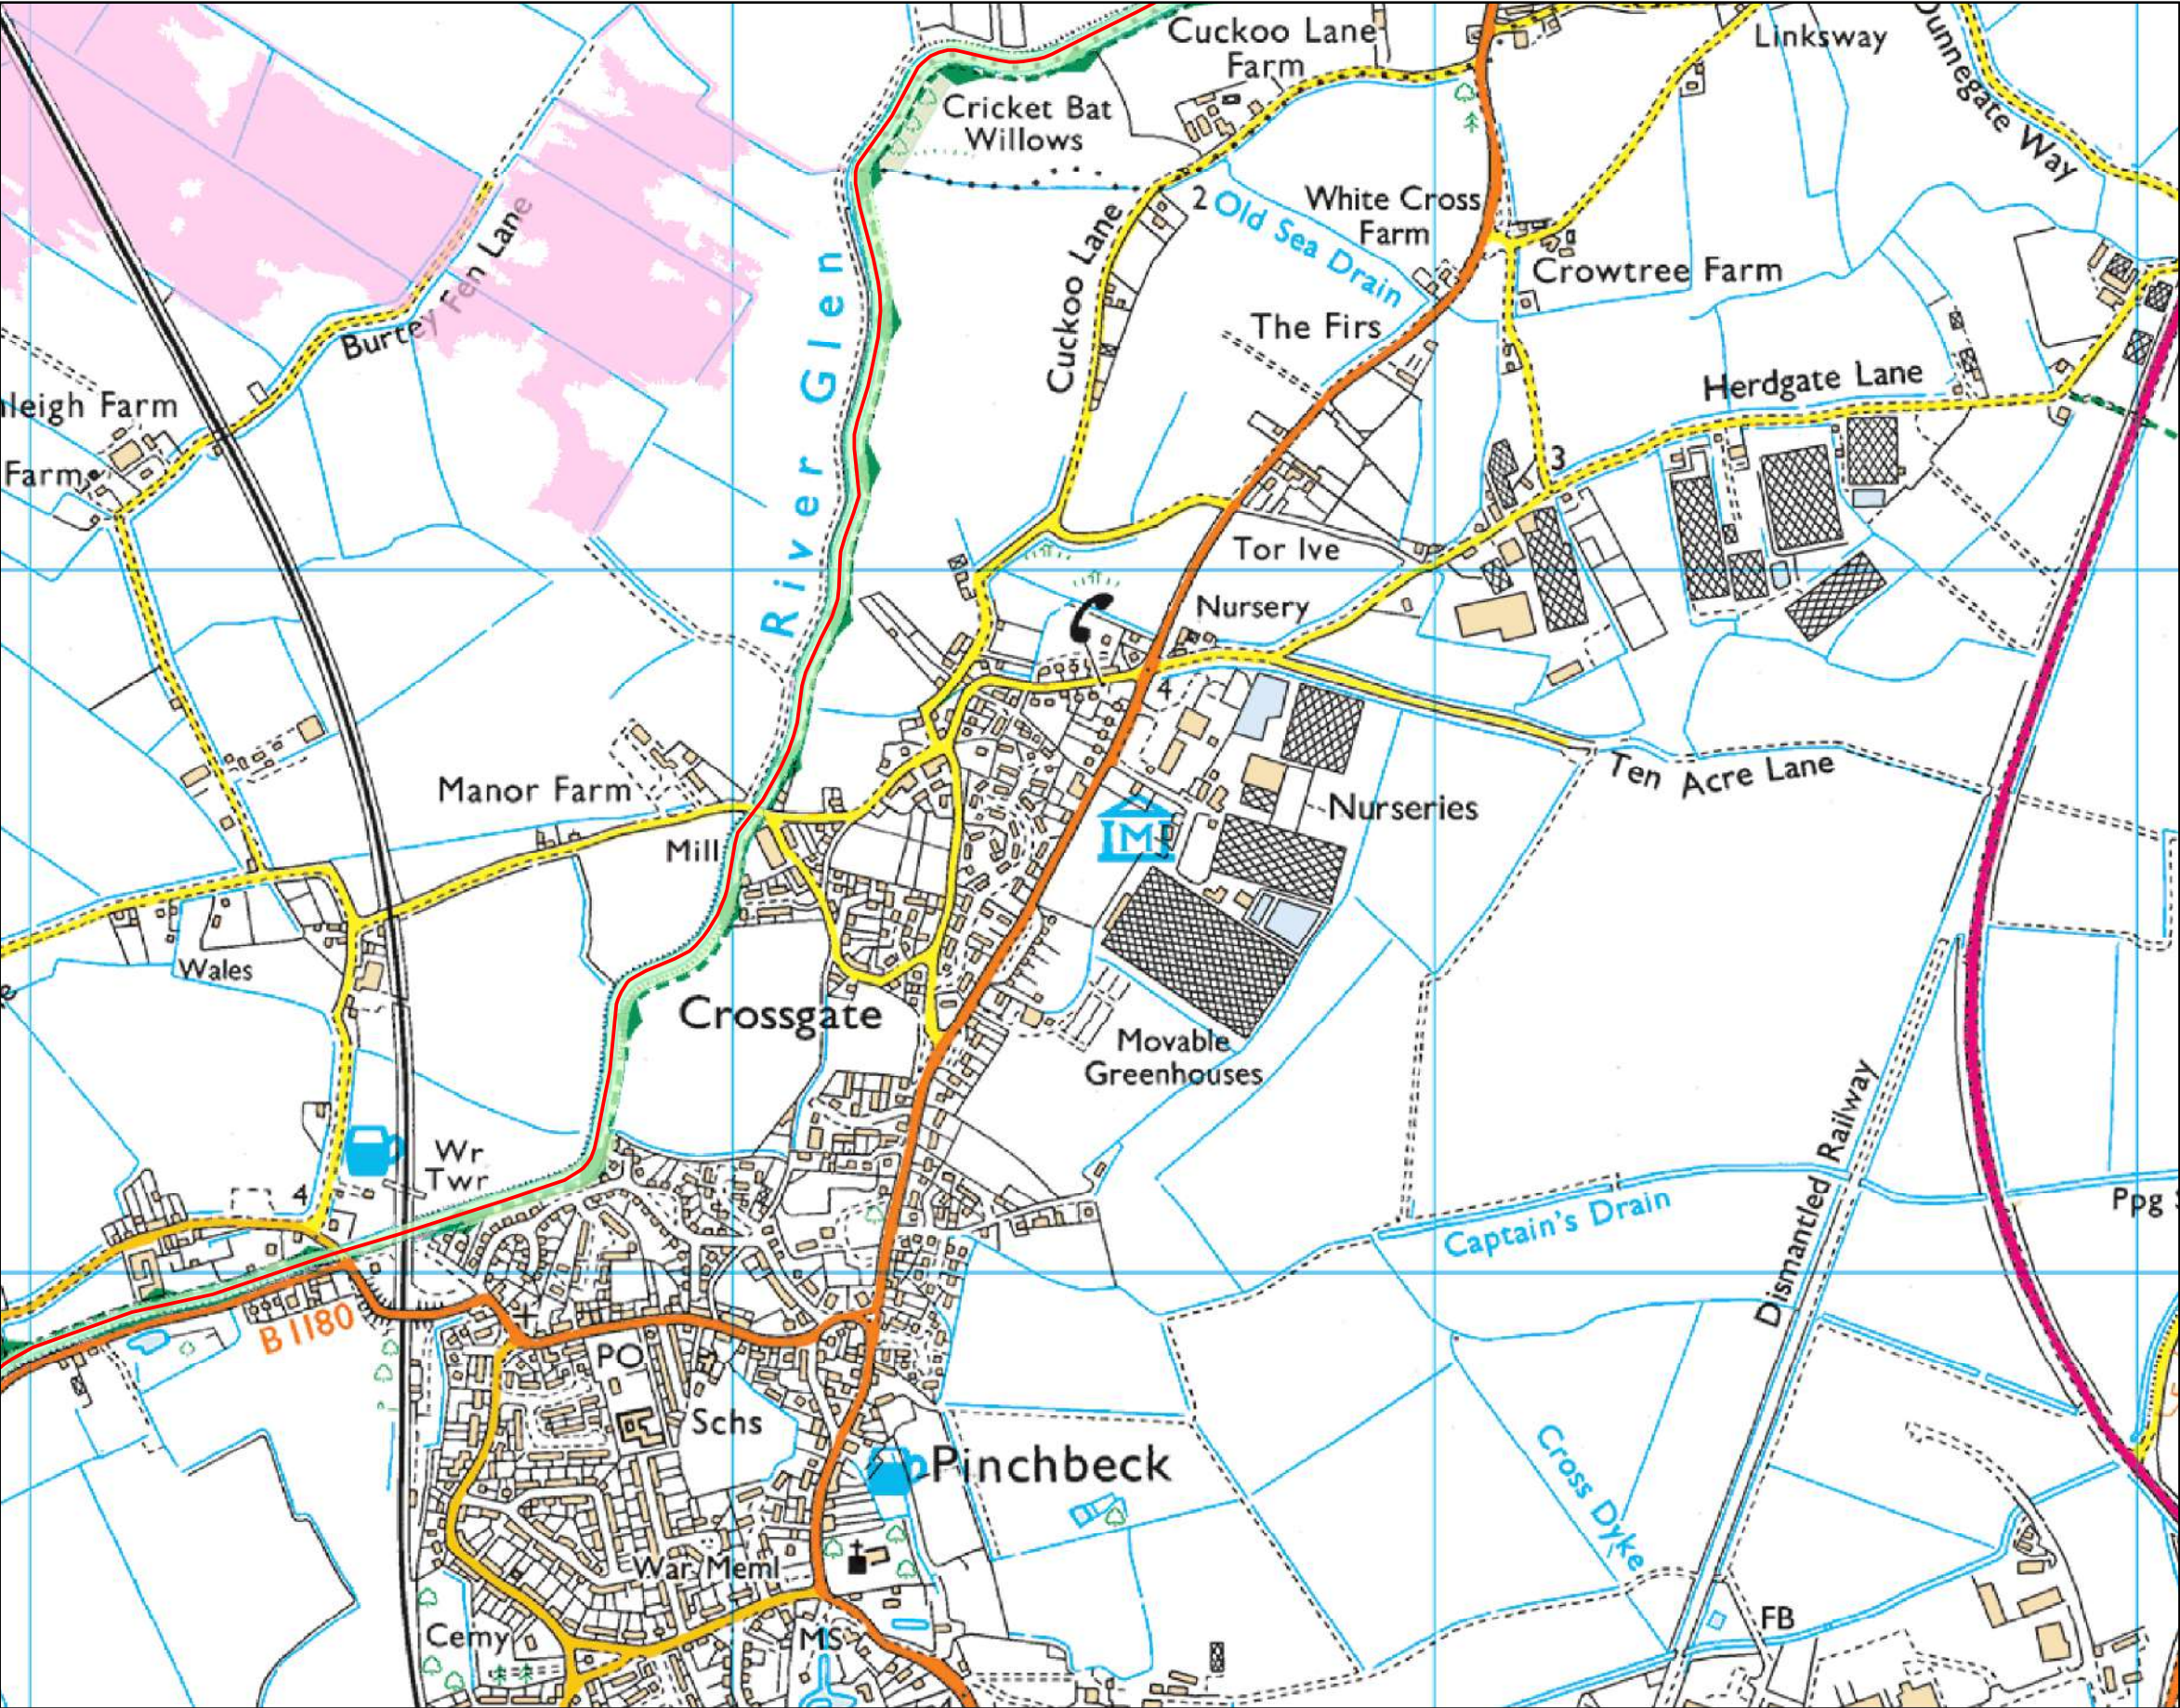



Scale 1:10,000



Modelled Flood Extents (with defences)

- Main River
- 5% (1 in 20) Fluvial Event
- 1% (1 in 100) Fluvial Event
- 1% (1 in 100) Fluvial Event inc Climate Change
- 0.1% (1 in 1000) Fluvial Event
- 0.1% (1 in 1000) Fluvial Event inc Climate Change

Created by the Partnerships & Strategic Overview Team, Kettering

## **Appendix G – Surface Water Flooding Information**

Flood risk

Extent of flooding

Location

Land off Surfleet Road



Extent of flooding from surface water

High Medium Low Very low Location you selected


## **Appendix H - Reservoir Flooding Information**

Flood risk

Extent of flooding

Location

Land off Surfleet Road

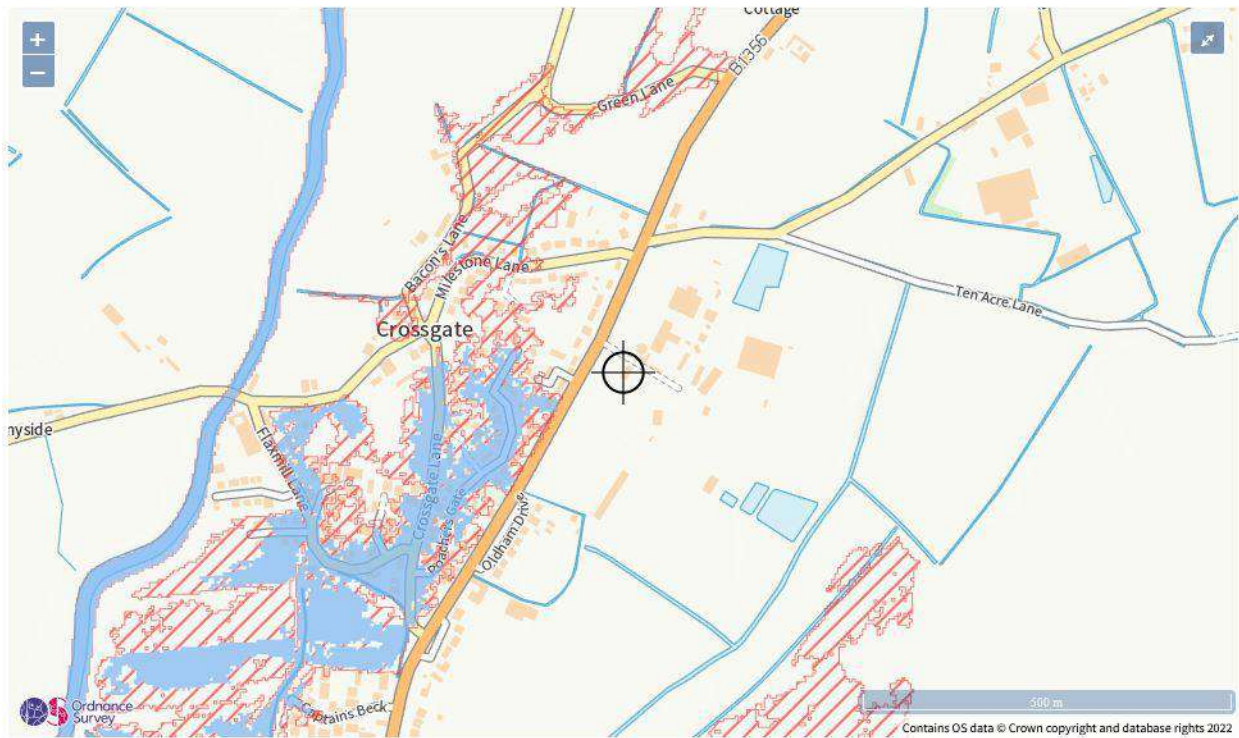

Maximum extent of flooding from reservoirs:

● when river levels are normal    ■ when there is also flooding from rivers    ⊕ Location you selected

## Appendix I - Flood Plan

It is recommended the applicant and future owners; occupiers and landlords of the proposed dwelling prepare a flood plan to protect life and property during a flood event in line with the guidance provided below;

### Before a flood

- Find out if you are at risk of flooding
- Find out if you can receive flood warnings
- Prepare and keep a list of all your important contacts to hand or save them on your mobile phone
- Think about what items you can move now and what you would want to move to safety during a flood such as pets, cars, furniture and electrical equipment
- Know how to turn off gas, electricity and water supplies
- Prepare a flood kit of essential items and keep it handy. It can include copies of important documents, a torch, a battery powered or wind up radio, blankets and warm clothing, waterproofs, rubber gloves and a first aid kit including all essential medication
- Consider buying flood protection products such as flood boards and airbrick covers to help reduce flood water getting into your property

### Imminently before a flood event

- Tune into your local radio station
- Fill jugs and saucepans with water
- Grab your flood kit
- Collect blankets, torch, medication and food
- Move important documents, personal items, valuables and lightweight belongings upstairs
- Raise large items of furniture or put them in large bags
- Move people, outdoor belonging, cars and pets to higher ground
- Switch off gas, water and electricity at the mains when water is about to enter your home
- Fit flood protection products such as flood boards, airbrick covers and sandbags
- Put plugs in sinks and baths and weight them down
- Move family and pets upstairs or to a high place with means to escape
- Listen to the advice of the emergency services and evacuate if told to do so
- Avoid walking or driving through flood water

### After a flood

- If you have been flooded, contact insurance company as soon as possible
- Take photographs and videos of your damaged property as a record to the insurance company
- If you do not have insurance, contact your local authority for information on grants and charities that may help you
- Flood water can contain sewerage and chemicals. Always wear waterproof outerwear including gloves, wellington boots and face mask
- Have your electrics, central heating and water checked by a qualified person before switching them back on

## **Appendix J – Drainage Strategy Plan & Associated Information**

1. The contractor shall comply with the health and safety regulations as set out in the CDM Regulations
2. All works are to be undertaken in accordance with the Building Regulations and latest relevant British Standards.
3. Conflicting information between this drawing and information given by others must be referred to the engineer before the works commence.
4. The contractor shall, before commencing the works, verify all dimensions, invert levels and site and setting out dimensions. The contractor shall be responsible for the true and proper setting out of the works and for the correctness of the position, level and dimensions of all elements of all parts of the works. Any discrepancies are to be reported to the Engineer.
5. All products used are to be CE marked in accordance with the Construction Products Directive (CPD)/89/106/EEC.
6. The contractor shall be responsible for locating all existing utilities prior to commencing construction and protecting all existing services affected by the works.
7. Any unidentified hazards discovered during the progress of works are to be reported immediately to the engineer.

## GENERAL LEGEND

- Main site red line boundary (1.586 ha)
- Self build plots site blue line boundary (0.163 ha)

### DRAINAGE LEGEND

-  Proposed Surface Water Drainage  
(Pipe assumed to fall at 1:125).
-  Proposed Foul Water Rising Main
-  FWMH
-  Proposed Foul Water Drainage  
(Pipe assumed to fall at 1:125).
- Indicates Cover level is indicative and to match proposed finished surface level
-  Proposed Precast concrete headwall
-  Proposed road drainage gully and spur to be put forward for adoption by Anglian Water (Under Section S104).
-  Proposed Permeable Paving Car Park Construction to be designed and specified by Marshall.
-  Exceedence Flow Arrow  
(Storm Events greater than the 100yr + 40% (simulate chosen event))

### DRAINAGE LEGEND

- FWMH
- Existing Foul Water Drainage.  
(Drainage information as taken from Anglian Water asset mapping)

### FINISHED LEVELS LEGEND

- |           |                                                        |
|-----------|--------------------------------------------------------|
| +20.43    | Proposed Finished Ground Level                         |
| +1(20.43) | Proposed Finished Ground Level to match existing level |
| FFL 3.050 | Proposed Finished Floor Levels                         |

|    |          |    |                                              |     |     |
|----|----------|----|----------------------------------------------|-----|-----|
| P4 | 08/06/22 | DT | SELF BUILD PLOTS ADDED. DRAINAGE UPDATED     | DM  | DM  |
| P3 | 17/05/22 | DT | DRAINAGE UPDATED FOLLOWING LATEST MASTERPLAN | DM  | DM  |
| P2 | 28/01/22 | DT | ARCHITECTS LAYOUT UPDATED                    | DM  | DM  |
| P1 | 18/01/22 | DT | PLANNING ISSUE                               | DM  | DM  |
| EV | DATE     | BY | SUMMARY OF CHANGE                            | CHK | APD |

## PLANNING



Nine Hills Road, Cambridge CB2 1GA  
Tel: +44 (0)1223 668 574 E: [enquiries@civillistix.com](mailto:enquiries@civillistix.com)  
[www.civillistix.com](http://www.civillistix.com)

Minister Property Group


ARCHITECT: JGA Architecture

Surfleet Road, Pinchbeck

PROJ. TITLE:  
Proposed Drainage General Arrangement Plan  
(Sheet 1 of 3)

|             |                        |          |
|-------------|------------------------|----------|
| SCALE @ A1: | CHECKED / APPROVED BY: | DATE:    |
| 1/250       | DM                     | Jan 2022 |
| PROJECT No: | DRAWING No:            | REV:     |
| 1-100       | 0-010                  | 01       |

FOR CONTINUATION SEE C-011

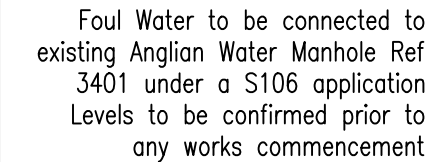

— Main site red line boundary (1.586 ha)

— Self build plots site blue line boundary (0.163 ha)

|                                                                                     |                                                                                                            |
|-------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------|
|  | Proposed Surface Water Drainage<br>(Pipe assumed to fall at 1:125).                                        |
|  | Proposed Foul Water Rising Main                                                                            |
|  | Proposed Foul Water Drainage<br>(Pipe assumed to fall at 1:125).                                           |
| •                                                                                   | Indicates Cover level is indicative and to match proposed finished surface level                           |
|  | Proposed Precast concrete headwall                                                                         |
|  | Proposed road drainage gully and spur to be put forward for adoption by Anglian Water (Under Section 104). |
|  | Proposed Permeable Paving Car Park Construction to be designed and specified by Marshall.                  |
|  | Exceedence Flow Arrow<br>(Storm Events greater than the 100yr + 40% climate change event)                  |

FWMH  Existing Foul Water Drainage.  
(Drainage information as taken from Anglian Water asset mapping)

|                                                                                                 |                                                        |
|-------------------------------------------------------------------------------------------------|--------------------------------------------------------|
|  20.43     | Proposed Finished Ground Level                         |
|  (20.43)   | Proposed Finished Ground Level to match existing level |
|  FFL 3.050 | Proposed Finished Floor Levels                         |

1. The contractor shall comply with the health and safety requirements as set out in the CDM Regulations
2. All works are to be undertaken in accordance with the Building Regulations and latest relevant British Standards.
3. Conflicting information between this drawing and information given by others must be referred to the engineer before the works commence.
4. The contractor shall, before commencing the works, verify all dimensions, levels and siting and settling out dimensions. The contractor shall be responsible for the true and correct setting out of the works and for the correctness of the position, levels, dimensions, and alignment of all parts of the works. The contractor shall be responsible for the Engineer's approval of the setting out.
5. All products used are to be CE marked in accordance with the Construction Products Directive CPO/89/106/CEE.
6. The contractor shall be responsible for locating all existing utilities prior to commencing construction and protecting all existing services affected by the works.
7. Any unidentified hazards discovered during the progress of works are to be reported immediately to the engineer.

|     |          |    |                                              |     |     |
|-----|----------|----|----------------------------------------------|-----|-----|
| P4  | 08/06/22 | DT | SELF BUILD PLOTS ADDED. DRAINAGE UPDATED     | DM  | DM  |
| P3  | 17/06/22 | DT | DRAINAGE UPDATED FOLLOWING LATEST MASTERPLAN | DM  | DM  |
| P2  | 28/01/22 | DT | ARCHITECTS LAYOUT UPDATED                    | DM  | DM  |
| P1  | 18/01/22 | DT | PLANNING ISSUE                               | DM  | DM  |
| REV | DATE     | BY | SUMMARY OF CHANGE                            | CHK | APP |

## PLANNING



Nine Hills Road, Cambridge CB2 1GA  
Tel: +44 (0)1223 668 574 E: [enquiries@civilistix.com](mailto:enquiries@civilistix.com)  
[www.civilistix.com](http://www.civilistix.com)

Minister Property Group

ARCHITECT: JGA Architecture

PROJECT: Surfleet Road, Pinchbeck

DRAWING TITLE

Proposed Drainage General Arrangement Plan  
(Sheet 2 of 3)

SCALE @ A1:

|       |                          |
|-------|--------------------------|
| 1:250 | CHECKED / APPROVED<br>DM |
|-------|--------------------------|

DATE: \_\_\_\_\_

---



**GENERAL LEGEND**

- Main site red line boundary (1.586 ha)
- Self build plots site blue line boundary (0.163 ha)

**DRAINAGE LEGEND**

- SWMH → Proposed Surface Water Drainage (Pipe assumed to fall at 1:125)
- Proposed Foul Water Rising Main
- FWMH → Proposed Foul Water Drainage (Pipe assumed to fall at 1:125)
- Indicates Cover level is indicative and to match proposed finished surface level
- Proposed Precast concrete headwall
- Proposed road drainage gully and spur to be put forward for adoption by Anglian Water (Under Section S104)
- ▨ Proposed Permeable Paving Car Park Construction to be designed and specified by Marshall
- Exceedence Flow Arrow (Storm Events greater than the 100yr + 40% climate change event)

**DRAINAGE LEGEND**

- FWMH → Existing Foul Water Drainage (Drainage information as taken from Anglian Water asset mapping)


**FINISHED LEVELS LEGEND**

- +20.43 Proposed Finished Ground Level
- +20.43 Proposed Finished Ground Level to match existing level
- FFL 3.050 Proposed Finished Floor Levels

**DO NOT SCALE**

- GENERAL**
- The contractor shall comply with the health and safety requirements as set out in the CDM Regulations
  - All works are to be undertaken in accordance with the Building Regulations and latest relevant British Standards.
  - Conflicting information between this drawing and information given by others must be referred to the engineer before the works commence.
  - The contractor shall, before commencing the works, verify all existing outfall invert levels and site and setting out dimensions. The contractor shall be responsible for the true and proper setting out of the works and for the correctness of the position, levels, dimensions, and alignment of all parts of the works. Any discrepancies are to be reported to the Engineer
  - All products used are to be CE marked in accordance with the Construction Products Directive CPO/89/106/EEC.
  - The contractor shall be responsible for locating all existing utilities prior to commencing construction and protecting all existing services affected by the works.
  - Any unidentified hazards discovered during the progress of works are to be reported immediately to the engineer.

|                                                                                                                  |                           |    |                                              |     |     |
|------------------------------------------------------------------------------------------------------------------|---------------------------|----|----------------------------------------------|-----|-----|
| PA                                                                                                               | 08/06/22                  | DT | SELF BUILD PLOTS ADDED, DRAINAGE UPDATED     | DN  | DN  |
| P3                                                                                                               | 17/05/22                  | DT | DRAINAGE UPDATED FOLLOWING LATEST MASTERPLAN | DN  | DN  |
| P2                                                                                                               | 26/03/22                  | DT | ARCHITECTS LAYOUT UPDATED                    | DN  | DN  |
| P1                                                                                                               | 18/03/22                  | DT | PLANNING ISSUE                               | DN  | DN  |
| REV                                                                                                              | DATE                      | BY | SUMMARY OF CHANGE                            | CHK | APP |
| DRAWING STATUS                                                                                                   |                           |    |                                              |     |     |
| PLANNING                                                                                                         |                           |    |                                              |     |     |
|                                                                                                                  |                           |    |                                              |     |     |
| Nine Hills Road, Cambridge CB2 1GA<br>Tel: +44 (0)1223 668 574 E: enquiries@civilistix.com<br>www.civilistix.com |                           |    |                                              |     |     |
| CLIENT: Minister Property Group                                                                                  |                           |    |                                              |     |     |
| ARCHITECT: JGA Architecture                                                                                      |                           |    |                                              |     |     |
| PROJECT: Surfleet Road, Pinchbeck                                                                                |                           |    |                                              |     |     |
| DRAWING TITLE: Proposed Drainage General Arrangement Plan (Sheet 3 of 3)                                         |                           |    |                                              |     |     |
| SCALE @ A1: 1:250                                                                                                | CHECKED / APPROVED BY: DM |    | DATE: Jan 2022                               |     |     |
| PROJECT No: 1-198                                                                                                | DRAWING No: C-012         |    | REV: P4                                      |     |     |



CATCHMENT PLAN LEGEND:

| Catchment Area (ha)                 | Impermeable Area (ha) | Direct Discharge location |
|-------------------------------------|-----------------------|---------------------------|
| Catchment 1 (Roof areas)            | 0.2215 ha             | Attenuation Pond          |
| Catchment 2 (Private footway)       | 0.1182 ha             | Attenuation Pond          |
| Catchment 3 (Parking bays/driveway) | 0.2217 ha             | Attenuation Pond          |
| Catchment 4 (Main road)             | 0.2150 ha             | Attenuation Pond          |
| Total 0.7764 ha                     |                       |                           |

DO NOT SCALE

GENERAL

- The contractor shall comply with the health and safety requirements as set out in the CDM Regulations.
- All works are to be undertaken in accordance with the Building Regulations and latest relevant British Standards.
- Conflicting information between this drawing and information given by others must be referred to the engineer before the works commence.
- The contractor shall, before commencing the works, verify all existing outfall invert levels and site and setting out dimensions. The contractor shall be responsible for the true and proper setting out of the works and for the correctness of the position, levels, dimensions, and alignment of all parts of the works. Any discrepancies are to be reported to the Engineer.
- All products used are to be CE marked in accordance with the Construction Products Directive (CPR) 89/106/EEC.
- The contractor shall be responsible for locating all existing utilities prior to commencing construction and protecting all existing services affected by the works.
- Any unidentified hazards discovered during the progress of works are to be reported immediately to the engineer.

|     |          |    |                                                    |     |     |
|-----|----------|----|----------------------------------------------------|-----|-----|
| PA  | 08/06/22 | DT | SELF BUILT PLOTS ADDED                             | DN  | SW  |
| PA  | 17/05/22 | DT | WATERMAIN AREAS UPDATED FOLLOWING LATEST WATERPLAN | DN  | SW  |
| PA  | 26/01/22 | DT | ARCHITECTS LAYOUT UPDATED                          | DN  | SW  |
| PA  | 18/01/22 | DT | PLANNING ISSUE                                     | DN  | SW  |
| REV | DATE     | BY | SUMMARY OF CHANGE                                  | CHK | APP |

PLANNING



Nine Hills Road, Cambridge CB2 1GA  
Tel: +44 (0)1223 668 574 E: enquiries@civilstix.com  
www.civilstix.com

CLIENT: Minister Property Group

ARCHITECT: JGA Architecture


PROJECT: Surfleet Road, Pinchbeck

DRAWING TITLE: Surface Water Drainage Catchment Plan  
Sheet 1 of 2

SCALE @ A1: 1:250 CHECKED / APPROVED BY: DM DATE: Jan 2022

PROJECT No: 1-198 DRAWING No: C-015 REV: P4

FOR CONTINUATION SEE C-016



FOR CONTINUATION SEE C-015



CATCHMENT PLAN LEGEND:

| Catchment Area (ha)                 | Impermeable Area (ha) | Direct Discharge location |
|-------------------------------------|-----------------------|---------------------------|
| Catchment 1 (Roof areas)            | 0.2215 ha             | Attenuation Pond          |
| Catchment 2 (Private footway)       | 0.1182 ha             | Attenuation Pond          |
| Catchment 3 (Parking bays/driveway) | 0.2217 ha             | Attenuation Pond          |
| Catchment 4 (Main road)             | 0.2150 ha             | Attenuation Pond          |
| Total 0.7764 ha                     |                       |                           |

DO NOT SCALE

GENERAL

- The contractor shall comply with the health and safety requirements as set out in the CDM Regulations
- All works are to be undertaken in accordance with the Building Regulations and latest relevant British Standards.
- Conflicting information between this drawing and information given by others must be referred to the engineer before the works commence.
- The contractor shall, before commencing the works, verify all existing outfall invert levels and site and setting out dimensions. The contractor shall be responsible for the true and proper setting out of the works and for the correctness of the position, levels, dimensions, and alignment of all parts of the works. Any discrepancies are to be reported to the Engineer
- All products used are to be CE marked in accordance with the Construction Products Directive (CPR) 89/106/EEC.
- The contractor shall be responsible for locating all existing utilities prior to commencing construction and protecting all existing services affected by the works.
- Any unidentified hazards discovered during the progress of works are to be reported immediately to the engineer.

|     |          |    |                                                           |     |     |
|-----|----------|----|-----------------------------------------------------------|-----|-----|
| PA  | 08/06/22 | DT | SELF BUILT PLOTS ADDED                                    | DN  | SM  |
| PD  | 17/05/22 | DT | IMPERMEABLE AREAS UPDATED FOLLOWING LATEST WASTEWATERPLAN | DN  | SM  |
| PD  | 28/01/22 | DT | ARCHITECTS LAYOUT UPDATED                                 | DN  | SM  |
| PD  | 18/01/22 | DT | PLANNING ISSUE                                            | DN  | SM  |
| REV | DATE     | BY | SUMMARY OF CHANGE                                         | CHK | APP |

PLANNING



Nine Hills Road, Cambridge CB2 1GA  
Tel: +44 (0)1223 668 574 E: enquiries@civilstix.com  
www.civilstix.com

CLIENT: Minister Property Group

ARCHITECT: JGA Architecture

PROJECT: Surfleet Road, Pinchbeck




DRAWING TITLE:

Surface Water Drainage Catchment Plan  
Sheet 2 of 2





SCALE @ A1: 1:250 CHECKED / APPROVED BY: DM DATE: Jan 2022

PROJECT No: 1-198 DRAWING No: C-015 No: P4

## GENERAL

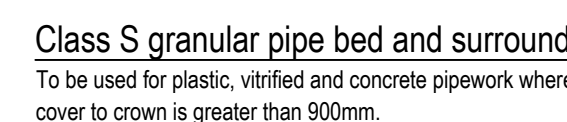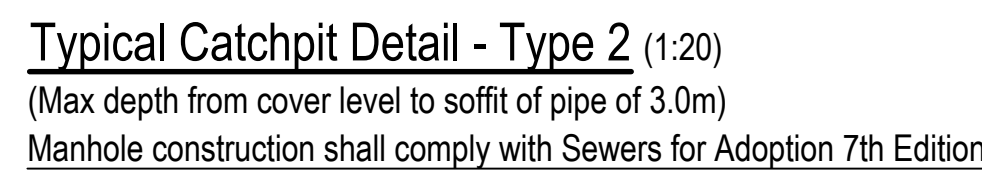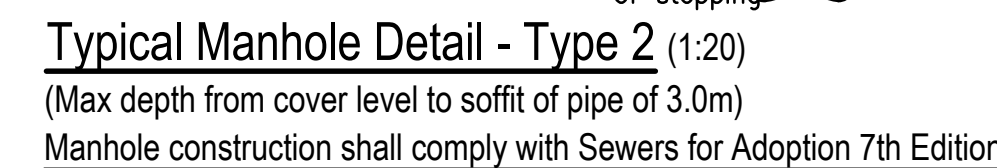

### Pipe Bedding Details (1:10)

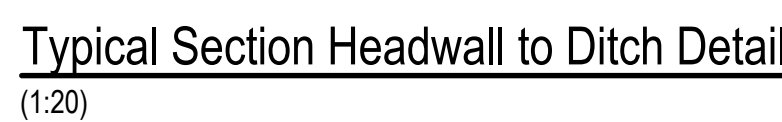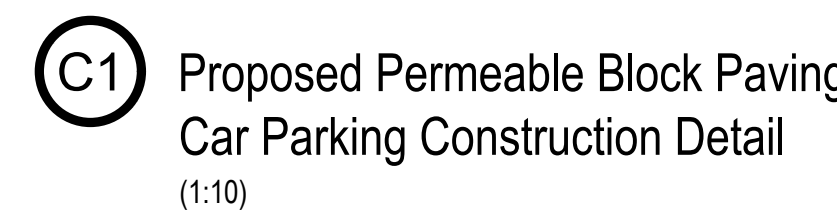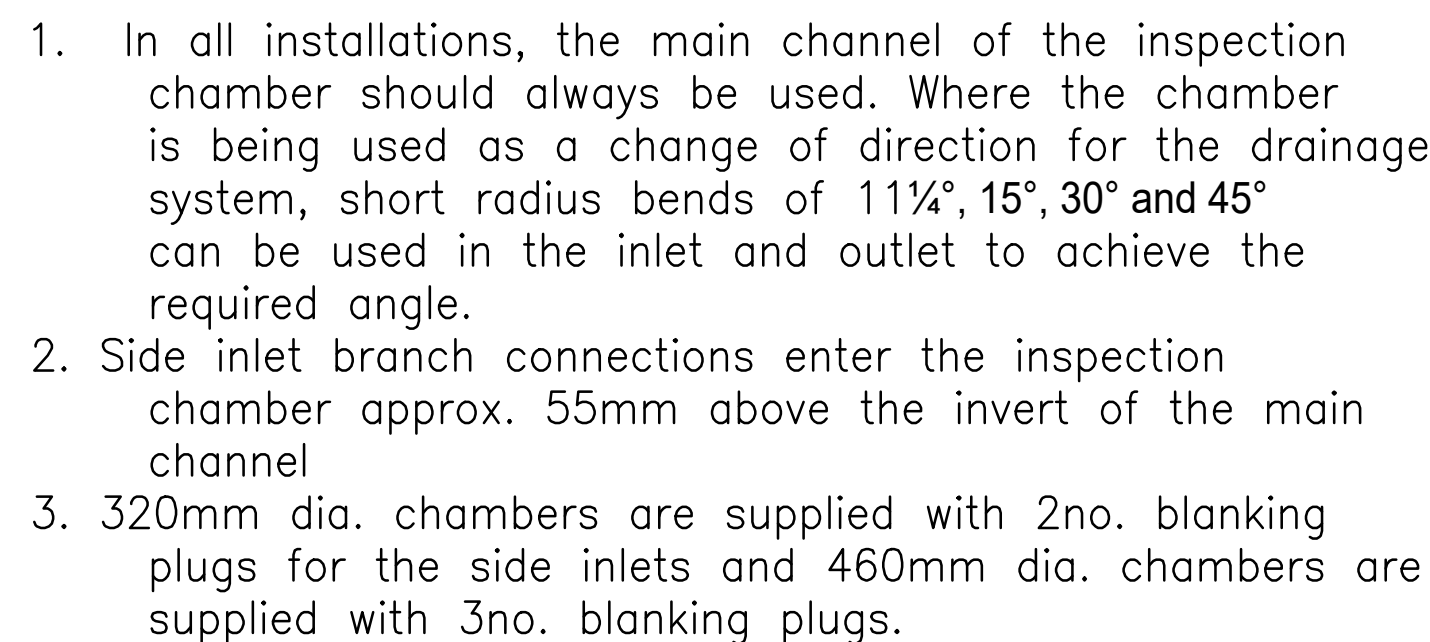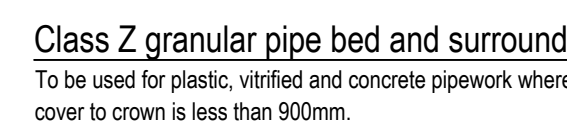

|                                                                                                                                                       |          |                       |                   |          |           |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|----------|-----------------------|-------------------|----------|-----------|
|                                                                                                                                                       |          |                       |                   |          |           |
| #1                                                                                                                                                    | 16/01/22 | ST                    | PLANNING - ISSUE  |          | DM / DM   |
| REV                                                                                                                                                   | DATE     | BY                    | SUMMARY OF CHANGE |          | CHK / APP |
| DRAWING STATUS:                                                                                                                                       |          |                       |                   |          |           |
| PLANNING                                                                                                                                              |          |                       |                   |          |           |
|                                                                                                                                                       |          |                       |                   |          |           |
|                                                                  |          |                       |                   |          |           |
| Nine Hills Road, Cambridge CB2 1GA<br>Tel: +44 (0)1223 668 574 E: enquiries@civilstix.com<br><a href="http://www.civilstix.com">www.civilstix.com</a> |          |                       |                   |          |           |
| CLIENT:                                                                                                                                               |          |                       |                   |          |           |
| Minister Property Group                                                                                                                               |          |                       |                   |          |           |
| ARCHITECT:                                                                                                                                            |          |                       |                   |          |           |
| JGA Architecture                                                                                                                                      |          |                       |                   |          |           |
| PROJECT:                                                                                                                                              |          |                       |                   |          |           |
| Surfleet Road, Pinchbeck                                                                                                                              |          |                       |                   |          |           |
| DRAWING TITLE:                                                                                                                                        |          |                       |                   |          |           |
| Drainage Details                                                                                                                                      |          |                       |                   |          |           |
| SCALE & AL                                                                                                                                            |          | CHECKED / APPROVED BY | DATE              |          |           |
| 1:250                                                                                                                                                 |          | DM                    |                   | Jan 2022 |           |
| PROJECT No.                                                                                                                                           |          | DRAWING No.           | C-000             | REV      | P1        |
| 1-188                                                                                                                                                 |          |                       |                   |          |           |

Calculated by:

Dorothea Tomeli

Site name:

Land off Surfleet Road

Site location:

Pinchbeck PE11 3XY

This is an estimation of the greenfield runoff rates that are used to meet normal best practice criteria in line with Environment Agency guidance “Rainfall runoff management for developments”, SC030219 (2013) , the SuDS Manual C753 (Ciria, 2015) and the non-statutory standards for SuDS (Defra, 2015). This information on greenfield runoff rates may be the basis for setting consents for the drainage of surface water runoff from sites.

Site Details

Latitude:

52.82261° N

Longitude:

0.15338° W

Reference:

1778268657

Date:

Dec 20 2021 09:14

Runoff estimation approach

IH124

Site characteristics

Total site area (ha):

1.7485

Methodology

Q<sub>BAR</sub> estimation method:

Calculate from SPR and SAAR

SPR estimation method:

Calculate from SOIL type

Soil characteristics

|              | Default        | Edited         |
|--------------|----------------|----------------|
| SOIL type:   | <div>2</div>   | <div>2</div>   |
| HOST class:  | <div>N/A</div> | <div>N/A</div> |
| SPR/SPRHOST: | <div>0.3</div> | <div>0.3</div> |

Hydrological characteristics

|                                | Default         | Edited          |
|--------------------------------|-----------------|-----------------|
| SAAR (mm):                     | <div>560</div>  | <div>560</div>  |
| Hydrological region:           | <div>5</div>    | <div>5</div>    |
| Growth curve factor 1 year:    | <div>0.87</div> | <div>0.87</div> |
| Growth curve factor 30 years:  | <div>2.45</div> | <div>2.45</div> |
| Growth curve factor 100 years: | <div>3.56</div> | <div>3.56</div> |
| Growth curve factor 200 years: | <div>4.21</div> | <div>4.21</div> |

Notes

(1) Is Q<sub>BAR</sub> < 2.0 l/s/ha?

When Q<sub>BAR</sub> is < 2.0 l/s/ha then limiting discharge rates are set at 2.0 l/s/ha.

(2) Are flow rates < 5.0 l/s?

Where flow rates are less than 5.0 l/s consent for discharge is usually set at 5.0 l/s if blockage from vegetation and other materials is possible. Lower consent flow rates may be set where the blockage risk is addressed by using appropriate drainage elements.

(3) Is SPR/SPRHOST ≤ 0.3?

Where groundwater levels are low enough the use of soakaways to avoid discharge offsite would normally be preferred for disposal of surface water runoff.

Greenfield runoff rates

|                         | Default          | Edited           |
|-------------------------|------------------|------------------|
| Q <sub>BAR</sub> (l/s): | <div>2.45</div>  | <div>2.45</div>  |
| 1 in 1 year (l/s):      | <div>2.14</div>  | <div>2.14</div>  |
| 1 in 30 years (l/s):    | <div>6.01</div>  | <div>6.01</div>  |
| 1 in 100 year (l/s):    | <div>8.74</div>  | <div>8.74</div>  |
| 1 in 200 years (l/s):   | <div>10.33</div> | <div>10.33</div> |

This report was produced using the greenfield runoff tool developed by HR Wallingford and available at [www.uksuds.com](http://www.uksuds.com). The use of this tool is subject to the UK SuDS terms and conditions and licence agreement , which can both be found at [www.uksuds.com/terms-and-conditions.htm](http://www.uksuds.com/terms-and-conditions.htm). The outputs from this tool are estimates of greenfield runoff rates. The use of these results is the responsibility of the users of this tool. No liability will be accepted by HR Wallingford, the Environment Agency, CEH, Hydrosolutions or any other organisation for the use of this data in the design or operational characteristics of any drainage scheme.

**Design Settings**

|                       |                   |                                      |               |
|-----------------------|-------------------|--------------------------------------|---------------|
| Rainfall Methodology  | FSR               | Maximum Time of Concentration (mins) | 30.00         |
| Return Period (years) | 100               | Maximum Rainfall (mm/hr)             | 125.0         |
| Additional Flow (%)   | 40                | Minimum Velocity (m/s)               | 1.00          |
| FSR Region            | England and Wales | Connection Type                      | Level Soffits |
| M5-60 (mm)            | 20.000            | Minimum Backdrop Height (m)          | 0.000         |
| Ratio-R               | 0.400             | Preferred Cover Depth (m)            | 1.200         |
| CV                    | 0.750             | Include Intermediate Ground          | ✓             |
| Time of Entry (mins)  | 4.00              | Enforce best practice design rules   | ✓             |

**Nodes**

| Name             | Area<br>(ha) | T of E<br>(mins) | Cover<br>Level<br>(m) | Diameter<br>(mm) | Easting<br>(m) | Northing<br>(m) | Depth<br>(m) |
|------------------|--------------|------------------|-----------------------|------------------|----------------|-----------------|--------------|
| SWMH 01          | 0.185        | 4.00             | 3.300                 | 1200             | 524488.747     | 326609.554      | 1.500        |
| SWMH 11          | 0.071        | 4.00             | 3.350                 | 1200             | 524540.392     | 326645.893      | 1.570        |
| SWMH 02          | 0.085        | 4.00             | 3.200                 | 1200             | 524553.025     | 326635.497      | 1.580        |
| SWMH 03          | 0.078        | 4.00             | 3.200                 | 1200             | 524572.748     | 326625.429      | 1.675        |
| SWMH 04          | 0.024        | 4.00             | 3.000                 | 1200             | 524561.686     | 326630.463      | 1.771        |
| SWMH 05          | 0.106        | 4.00             | 2.900                 | 1200             | 524542.223     | 326587.825      | 1.937        |
| SWMH 06          | 0.068        | 4.00             | 2.900                 | 1200             | 524530.643     | 326530.209      | 1.700        |
| SWMH 07          | 0.080        | 4.00             | 2.900                 | 1200             | 524514.294     | 326538.420      | 2.079        |
| SWMH 08          | 0.077        | 4.00             | 2.860                 | 1200             | 524463.130     | 326546.935      | 2.206        |
| Attenuation Pond | 0.104        |                  | 2.850                 | 1                | 524461.733     | 326543.516      | 2.271        |

**Links**

| Name   | US<br>Node | DS<br>Node       | Length<br>(m) | ks (mm) /<br>n | US IL<br>(m) | DS IL<br>(m) | Fall<br>(m) | Slope<br>(1:X) | Dia<br>(mm) | T of C<br>(mins) | Rain<br>(mm/hr) |
|--------|------------|------------------|---------------|----------------|--------------|--------------|-------------|----------------|-------------|------------------|-----------------|
| S1.000 | SWMH 01    | SWMH 05          | 57.722        | 0.600          | 1.800        | 1.113        | 0.687       | 84.0           | 300         | 4.96             | 125.0           |
| S2.000 | SWMH 11    | SWMH 02          | 25.246        | 0.600          | 1.780        | 1.620        | 0.160       | 157.8          | 300         | 4.42             | 125.0           |
| S2.001 | SWMH 02    | SWMH 04          | 10.018        | 0.600          | 1.620        | 1.454        | 0.166       | 60.3           | 225         | 4.59             | 125.0           |
| S3.000 | SWMH 03    | SWMH 04          | 12.154        | 0.600          | 1.525        | 1.454        | 0.071       | 171.2          | 225         | 4.20             | 125.0           |
| S2.002 | SWMH 04    | SWMH 05          | 46.870        | 0.600          | 1.229        | 0.963        | 0.266       | 176.2          | 450         | 5.20             | 125.0           |
| S1.001 | SWMH 05    | SWMH 07          | 56.753        | 0.600          | 0.963        | 0.821        | 0.142       | 399.7          | 450         | 6.07             | 125.0           |
| S4.000 | SWMH 06    | SWMH 07          | 18.295        | 0.600          | 1.200        | 1.046        | 0.154       | 118.8          | 225         | 4.30             | 125.0           |
| S1.002 | SWMH 07    | SWMH 08          | 15.364        | 0.600          | 0.821        | 0.770        | 0.051       | 301.3          | 450         | 6.18             | 125.0           |
| S1.004 | SWMH 08    | Attenuation Pond | 30.179        | 0.600          | 0.654        | 0.579        | 0.075       | 402.4          | 525         | 6.79             | 125.0           |


| Name   | Vel<br>(m/s) | Cap<br>(l/s) | Flow<br>(l/s) | US<br>Depth<br>(m) | DS<br>Depth<br>(m) | Σ Area<br>(ha) | Σ Add<br>Inflow<br>(l/s) |
|--------|--------------|--------------|---------------|--------------------|--------------------|----------------|--------------------------|
| S1.000 | 1.716        | 121.3        | 87.8          | 1.200              | 1.487              | 0.185          | 0.0                      |
| S2.000 | 1.249        | 88.3         | 33.7          | 1.270              | 1.280              | 0.071          | 0.0                      |
| S2.001 | 1.686        | 67.0         | 74.0          | 1.355              | 1.321              | 0.156          | 0.0                      |
| S3.000 | 0.996        | 39.6         | 37.0          | 1.450              | 1.321              | 0.078          | 0.0                      |
| S2.002 | 1.528        | 243.1        | 122.4         | 1.321              | 1.487              | 0.258          | 0.0                      |
| S1.001 | 1.011        | 160.7        | 260.4         | 1.487              | 1.629              | 0.549          | 0.0                      |
| S4.000 | 1.198        | 47.6         | 32.3          | 1.475              | 1.629              | 0.068          | 0.0                      |
| S1.002 | 1.166        | 185.4        | 330.6         | 1.629              | 1.640              | 0.697          | 0.0                      |
| S1.004 | 1.110        | 240.3        | 367.1         | 1.681              | 1.746              | 0.774          | 0.0                      |

### Pipeline Schedule


| Link   | Length<br>(m) | Slope<br>(1:X) | Dia<br>(mm) | Link<br>Type | US CL<br>(m) | US IL<br>(m) | US Depth<br>(m) | DS CL<br>(m) | DS IL<br>(m) | DS Depth<br>(m) |
|--------|---------------|----------------|-------------|--------------|--------------|--------------|-----------------|--------------|--------------|-----------------|
| S1.000 | 57.722        | 84.0           | 300         | Circular     | 3.300        | 1.800        | 1.200           | 2.900        | 1.113        | 1.487           |
| S2.000 | 25.246        | 157.8          | 300         | Circular     | 3.350        | 1.780        | 1.270           | 3.200        | 1.620        | 1.280           |
| S2.001 | 10.018        | 60.3           | 225         | Circular     | 3.200        | 1.620        | 1.355           | 3.000        | 1.454        | 1.321           |
| S3.000 | 12.154        | 171.2          | 225         | Circular     | 3.200        | 1.525        | 1.450           | 3.000        | 1.454        | 1.321           |
| S2.002 | 46.870        | 176.2          | 450         | Circular     | 3.000        | 1.229        | 1.321           | 2.900        | 0.963        | 1.487           |
| S1.001 | 56.753        | 399.7          | 450         | Circular     | 2.900        | 0.963        | 1.487           | 2.900        | 0.821        | 1.629           |
| S4.000 | 18.295        | 118.8          | 225         | Circular     | 2.900        | 1.200        | 1.475           | 2.900        | 1.046        | 1.629           |
| S1.002 | 15.364        | 301.3          | 450         | Circular     | 2.900        | 0.821        | 1.629           | 2.860        | 0.770        | 1.640           |
| S1.004 | 30.179        | 402.4          | 525         | Circular     | 2.860        | 0.654        | 1.681           | 2.850        | 0.579        | 1.746           |

| Link   | US<br>Node | Dia<br>(mm) | Node<br>Type | MH<br>Type | DS<br>Node       | Dia<br>(mm) | Node<br>Type | MH<br>Type |
|--------|------------|-------------|--------------|------------|------------------|-------------|--------------|------------|
| S1.000 | SWMH 01    | 1200        | Manhole      | Adoptable  | SWMH 05          | 1200        | Manhole      | Adoptable  |
| S2.000 | SWMH 11    | 1200        | Manhole      | Adoptable  | SWMH 02          | 1200        | Manhole      | Adoptable  |
| S2.001 | SWMH 02    | 1200        | Manhole      | Adoptable  | SWMH 04          | 1200        | Manhole      | Adoptable  |
| S3.000 | SWMH 03    | 1200        | Manhole      | Adoptable  | SWMH 04          | 1200        | Manhole      | Adoptable  |
| S2.002 | SWMH 04    | 1200        | Manhole      | Adoptable  | SWMH 05          | 1200        | Manhole      | Adoptable  |
| S1.001 | SWMH 05    | 1200        | Manhole      | Adoptable  | SWMH 07          | 1200        | Manhole      | Adoptable  |
| S4.000 | SWMH 06    | 1200        | Manhole      | Adoptable  | SWMH 07          | 1200        | Manhole      | Adoptable  |
| S1.002 | SWMH 07    | 1200        | Manhole      | Adoptable  | SWMH 08          | 1200        | Manhole      | Adoptable  |
| S1.004 | SWMH 08    | 1200        | Manhole      | Adoptable  | Attenuation Pond | 1           | Manhole      | Adoptable  |

### Manhole Schedule

| Node    | Easting<br>(m) | Northing<br>(m) | CL<br>(m) | Depth<br>(m) | Dia<br>(mm) | Connections                                                                          | Link   | IL<br>(m) | Dia<br>(mm) |
|---------|----------------|-----------------|-----------|--------------|-------------|--------------------------------------------------------------------------------------|--------|-----------|-------------|
| SWMH 01 | 524488.747     | 326609.554      | 3.300     | 1.500        | 1200        |  |        |           |             |
|         |                |                 |           |              |             | 0                                                                                    | S1.000 | 1.800     | 300         |
| SWMH 11 | 524540.392     | 326645.893      | 3.350     | 1.570        | 1200        |  |        |           |             |
|         |                |                 |           |              |             | 0                                                                                    | S2.000 | 1.780     | 300         |
| SWMH 02 | 524553.025     | 326635.497      | 3.200     | 1.580        | 1200        |  |        |           |             |
|         |                |                 |           |              |             | 1                                                                                    | S2.000 | 1.620     | 300         |
|         |                |                 |           |              |             | 0                                                                                    | S2.001 | 1.620     | 225         |
| SWMH 03 | 524572.748     | 326625.429      | 3.200     | 1.675        | 1200        |  |        |           |             |
|         |                |                 |           |              |             | 0                                                                                    | S3.000 | 1.525     | 225         |
| SWMH 04 | 524561.686     | 326630.463      | 3.000     | 1.771        | 1200        |  |        |           |             |
|         |                |                 |           |              |             | 1                                                                                    | S3.000 | 1.454     | 225         |
|         |                |                 |           |              |             | 2                                                                                    | S2.001 | 1.454     | 225         |
|         |                |                 |           |              |             | 0                                                                                    | S2.002 | 1.229     | 450         |
| SWMH 05 | 524542.223     | 326587.825      | 2.900     | 1.937        | 1200        |  |        |           |             |
|         |                |                 |           |              |             | 1                                                                                    | S1.000 | 1.113     | 300         |
|         |                |                 |           |              |             | 2                                                                                    | S2.002 | 0.963     | 450         |
|         |                |                 |           |              |             | 0                                                                                    | S1.001 | 0.963     | 450         |

### Manhole Schedule

| Node             | Easting<br>(m) | Northing<br>(m) | CL<br>(m) | Depth<br>(m) | Dia<br>(mm) | Connections                                                                         | Link | IL<br>(m) | Dia<br>(mm) |     |
|------------------|----------------|-----------------|-----------|--------------|-------------|-------------------------------------------------------------------------------------|------|-----------|-------------|-----|
| SWMH 06          | 524530.643     | 326530.209      | 2.900     | 1.700        | 1200        |   | 0    | S4.000    | 1.200       | 225 |
| SWMH 07          | 524514.294     | 326538.420      | 2.900     | 2.079        | 1200        |   | 1    | S4.000    | 1.046       | 225 |
|                  |                |                 |           |              |             |                                                                                     | 2    | S1.001    | 0.821       | 450 |
|                  |                |                 |           |              |             |                                                                                     | 0    | S1.002    | 0.821       | 450 |
| SWMH 08          | 524463.130     | 326546.935      | 2.860     | 2.206        | 1200        |  | 1    | S1.002    | 0.770       | 450 |
| Attenuation Pond | 524461.733     | 326543.516      | 2.850     | 2.271        | 1           |  | 0    | S1.004    | 0.654       | 525 |
|                  |                |                 |           |              |             |                                                                                     | 1    | S1.004    | 0.579       | 525 |

### Simulation Settings

|                      |                   |                            |        |
|----------------------|-------------------|----------------------------|--------|
| Rainfall Methodology | FSR               | Analysis Speed             | Normal |
| FSR Region           | England and Wales | Skip Steady State          | x      |
| M5-60 (mm)           | 20.000            | Drain Down Time (mins)     | 240    |
| Ratio-R              | 0.400             | Additional Storage (m³/ha) | 20.0   |
| Summer CV            | 0.750             | Check Discharge Rate(s)    | x      |
| Winter CV            | 0.840             | Check Discharge Volume     | x      |

### Storm Durations

15 | 30 | 60 | 120 | 180 | 240 | 360 | 480 | 600 | 720 | 960 | 1440 | 2160

| Return Period (years) | Climate Change (CC %) | Additional Area (A %) | Additional Flow (Q %) |
|-----------------------|-----------------------|-----------------------|-----------------------|
| 1                     | 0                     | 0                     | 0                     |
| 30                    | 0                     | 0                     | 0                     |
| 100                   | 40                    | 0                     | 0                     |

### Node Attenuation Pond Online Head/Flow Control

|                          |   |                  |       |                   |     |
|--------------------------|---|------------------|-------|-------------------|-----|
| Flap Valve               | x | Invert Level (m) | 0.579 | Design Flow (l/s) | 1.4 |
| Replaces Downstream Link | ✓ | Design Depth (m) | 1.400 |                   |     |

| Head (m) | Flow (l/s) | Head (m) | Flow (l/s) |
|----------|------------|----------|------------|
| 0.001    | 1.400      | 2.000    | 1.400      |

### Node Attenuation Pond Depth/Area Storage Structure

|                             |         |               |      |                           |       |
|-----------------------------|---------|---------------|------|---------------------------|-------|
| Base Inf Coefficient (m/hr) | 0.00000 | Safety Factor | 3.0  | Invert Level (m)          | 0.579 |
| Side Inf Coefficient (m/hr) | 0.00000 | Porosity      | 1.00 | Time to half empty (mins) | 0     |

| Depth (m) | Area (m²) | Inf Area (m²) | Depth (m) | Area (m²) | Inf Area (m²) |
|-----------|-----------|---------------|-----------|-----------|---------------|
| 0.000     | 580.0     | 0.0           | 1.200     | 1204.0    | 0.0           |

### Rainfall

| Event                     | Peak<br>Intensity<br>(mm/hr) | Average<br>Intensity<br>(mm/hr) | Event                               | Peak<br>Intensity<br>(mm/hr) | Average<br>Intensity<br>(mm/hr) |
|---------------------------|------------------------------|---------------------------------|-------------------------------------|------------------------------|---------------------------------|
| 1 year 15 minute summer   | 109.521                      | 30.991                          | 30 year 360 minute winter           | 20.295                       | 8.034                           |
| 1 year 15 minute winter   | 76.857                       | 30.991                          | 30 year 480 minute summer           | 24.324                       | 6.428                           |
| 1 year 30 minute summer   | 71.439                       | 20.215                          | 30 year 480 minute winter           | 16.160                       | 6.428                           |
| 1 year 30 minute winter   | 50.133                       | 20.215                          | 30 year 600 minute summer           | 19.756                       | 5.404                           |
| 1 year 60 minute summer   | 48.435                       | 12.800                          | 30 year 600 minute winter           | 13.498                       | 5.404                           |
| 1 year 60 minute winter   | 32.179                       | 12.800                          | 30 year 720 minute summer           | 17.490                       | 4.687                           |
| 1 year 120 minute summer  | 30.053                       | 7.942                           | 30 year 720 minute winter           | 11.754                       | 4.687                           |
| 1 year 120 minute winter  | 19.966                       | 7.942                           | 30 year 960 minute summer           | 14.215                       | 3.743                           |
| 1 year 180 minute summer  | 23.233                       | 5.979                           | 30 year 960 minute winter           | 9.416                        | 3.743                           |
| 1 year 180 minute winter  | 15.102                       | 5.979                           | 30 year 1440 minute summer          | 10.161                       | 2.723                           |
| 1 year 240 minute summer  | 18.475                       | 4.882                           | 30 year 1440 minute winter          | 6.829                        | 2.723                           |
| 1 year 240 minute winter  | 12.274                       | 4.882                           | 30 year 2160 minute summer          | 7.160                        | 1.979                           |
| 1 year 360 minute summer  | 14.169                       | 3.646                           | 30 year 2160 minute winter          | 4.933                        | 1.979                           |
| 1 year 360 minute winter  | 9.210                        | 3.646                           | 100 year +40% CC 15 minute summer   | 488.233                      | 138.153                         |
| 1 year 480 minute summer  | 11.185                       | 2.956                           | 100 year +40% CC 15 minute winter   | 342.620                      | 138.153                         |
| 1 year 480 minute winter  | 7.431                        | 2.956                           | 100 year +40% CC 30 minute summer   | 320.551                      | 90.705                          |
| 1 year 600 minute summer  | 9.182                        | 2.511                           | 100 year +40% CC 30 minute winter   | 224.948                      | 90.705                          |
| 1 year 600 minute winter  | 6.274                        | 2.511                           | 100 year +40% CC 60 minute summer   | 214.603                      | 56.713                          |
| 1 year 720 minute summer  | 8.203                        | 2.199                           | 100 year +40% CC 60 minute winter   | 142.577                      | 56.713                          |
| 1 year 720 minute winter  | 5.513                        | 2.199                           | 100 year +40% CC 120 minute summer  | 129.587                      | 34.246                          |
| 1 year 960 minute summer  | 6.768                        | 1.782                           | 100 year +40% CC 120 minute winter  | 86.094                       | 34.246                          |
| 1 year 960 minute winter  | 4.483                        | 1.782                           | 100 year +40% CC 180 minute summer  | 97.729                       | 25.149                          |
| 1 year 1440 minute summer | 4.949                        | 1.326                           | 100 year +40% CC 180 minute winter  | 63.526                       | 25.149                          |
| 1 year 1440 minute winter | 3.326                        | 1.326                           | 100 year +40% CC 240 minute summer  | 75.977                       | 20.078                          |
| 1 year 2160 minute summer | 3.574                        | 0.988                           | 100 year +40% CC 240 minute winter  | 50.477                       | 20.078                          |
| 1 year 2160 minute winter | 2.462                        | 0.988                           | 100 year +40% CC 360 minute summer  | 56.677                       | 14.585                          |
| 30 year 15 minute summer  | 268.706                      | 76.035                          | 100 year +40% CC 360 minute winter  | 36.841                       | 14.585                          |
| 30 year 15 minute winter  | 188.566                      | 76.035                          | 100 year +40% CC 480 minute summer  | 43.979                       | 11.622                          |
| 30 year 30 minute summer  | 174.929                      | 49.499                          | 100 year +40% CC 480 minute winter  | 29.219                       | 11.622                          |
| 30 year 30 minute winter  | 122.757                      | 49.499                          | 100 year +40% CC 600 minute summer  | 35.604                       | 9.738                           |
| 30 year 60 minute summer  | 116.589                      | 30.811                          | 100 year +40% CC 600 minute winter  | 24.327                       | 9.738                           |
| 30 year 60 minute winter  | 77.459                       | 30.811                          | 100 year +40% CC 720 minute summer  | 31.433                       | 8.424                           |
| 30 year 120 minute summer | 70.438                       | 18.615                          | 100 year +40% CC 720 minute winter  | 21.125                       | 8.424                           |
| 30 year 120 minute winter | 46.797                       | 18.615                          | 100 year +40% CC 960 minute summer  | 25.432                       | 6.697                           |
| 30 year 180 minute summer | 53.298                       | 13.715                          | 100 year +40% CC 960 minute winter  | 16.847                       | 6.697                           |
| 30 year 180 minute winter | 34.645                       | 13.715                          | 100 year +40% CC 1440 minute summer | 18.055                       | 4.839                           |
| 30 year 240 minute summer | 41.604                       | 10.995                          | 100 year +40% CC 1440 minute winter | 12.134                       | 4.839                           |
| 30 year 240 minute winter | 27.641                       | 10.995                          | 100 year +40% CC 2160 minute summer | 12.630                       | 3.490                           |
| 30 year 360 minute summer | 31.221                       | 8.034                           | 100 year +40% CC 2160 minute winter | 8.702                        | 3.490                           |

**Results for 1 year Critical Storm Duration. Lowest mass balance: 99.74%**

| Node Event        | US Node          | Peak (mins) | Level (m) | Depth (m) | Inflow (l/s) | Node Vol (m³) | Flood (m³) | Status |
|-------------------|------------------|-------------|-----------|-----------|--------------|---------------|------------|--------|
| 15 minute winter  | SWMH 01          | 10          | 1.898     | 0.098     | 27.5         | 0.3527        | 0.0000     | OK     |
| 15 minute winter  | SWMH 11          | 10          | 1.849     | 0.069     | 10.6         | 0.1414        | 0.0000     | OK     |
| 15 minute winter  | SWMH 02          | 10          | 1.720     | 0.100     | 23.3         | 0.2208        | 0.0000     | OK     |
| 15 minute summer  | SWMH 03          | 10          | 1.613     | 0.088     | 11.6         | 0.1813        | 0.0000     | OK     |
| 15 minute winter  | SWMH 04          | 10          | 1.348     | 0.119     | 38.4         | 0.1662        | 0.0000     | OK     |
| 15 minute winter  | SWMH 05          | 11          | 1.203     | 0.240     | 81.1         | 0.5345        | 0.0000     | OK     |
| 15 minute summer  | SWMH 06          | 10          | 1.272     | 0.072     | 10.1         | 0.1389        | 0.0000     | OK     |
| 15 minute summer  | SWMH 07          | 10          | 1.148     | 0.327     | 93.1         | 0.6207        | 0.0000     | OK     |
| 15 minute summer  | SWMH 08          | 10          | 1.119     | 0.465     | 124.5        | 0.8514        | 0.0000     | OK     |
| 720 minute winter | Attenuation Pond | 690         | 0.792     | 0.213     | 11.3         | 135.8103      | 0.0000     | OK     |

| Link Event (Upstream Depth) | US Node          | Link      | DS Node          | Outflow (l/s) | Velocity (m/s) | Flow/Cap | Link Vol (m³) | Discharge Vol (m³) |
|-----------------------------|------------------|-----------|------------------|---------------|----------------|----------|---------------|--------------------|
| 15 minute winter            | SWMH 01          | S1.000    | SWMH 05          | 27.2          | 1.385          | 0.224    | 1.1344        |                    |
| 15 minute winter            | SWMH 11          | S2.000    | SWMH 02          | 10.6          | 0.649          | 0.120    | 0.4151        |                    |
| 15 minute winter            | SWMH 02          | S2.001    | SWMH 04          | 23.2          | 1.451          | 0.346    | 0.1604        |                    |
| 15 minute summer            | SWMH 03          | S3.000    | SWMH 04          | 11.6          | 0.842          | 0.293    | 0.1675        |                    |
| 15 minute winter            | SWMH 04          | S2.002    | SWMH 05          | 38.1          | 0.713          | 0.157    | 2.7684        |                    |
| 15 minute winter            | SWMH 05          | S1.001    | SWMH 07          | 79.9          | 0.914          | 0.497    | 5.6814        |                    |
| 15 minute summer            | SWMH 06          | S4.000    | SWMH 07          | 10.5          | 0.913          | 0.220    | 0.2588        |                    |
| 15 minute summer            | SWMH 07          | S1.002    | SWMH 08          | 115.0         | 1.184          | 0.620    | 1.9614        |                    |
| 15 minute summer            | SWMH 08          | S1.004    | Attenuation Pond | 148.4         | 2.154          | 0.618    | 3.0877        |                    |
| 720 minute winter           | Attenuation Pond | Head/Flow |                  | 1.4           |                |          |               | 77.2               |

**Results for 30 year Critical Storm Duration. Lowest mass balance: 99.74%**

| Node Event         | US Node          | Peak (mins) | Level (m) | Depth (m) | Inflow (l/s) | Node Vol (m³) | Flood (m³) | Status     |
|--------------------|------------------|-------------|-----------|-----------|--------------|---------------|------------|------------|
| 15 minute summer   | SWMH 01          | 10          | 1.958     | 0.158     | 67.7         | 0.5694        | 0.0000     | OK         |
| 15 minute winter   | SWMH 11          | 10          | 1.890     | 0.110     | 26.0         | 0.2244        | 0.0000     | OK         |
| 15 minute winter   | SWMH 02          | 10          | 1.807     | 0.187     | 57.1         | 0.4125        | 0.0000     | OK         |
| 15 minute summer   | SWMH 03          | 10          | 1.679     | 0.154     | 28.5         | 0.3175        | 0.0000     | OK         |
| 15 minute winter   | SWMH 04          | 11          | 1.550     | 0.321     | 94.2         | 0.4496        | 0.0000     | OK         |
| 15 minute winter   | SWMH 05          | 11          | 1.510     | 0.547     | 197.8        | 1.2165        | 0.0000     | SURCHARGED |
| 15 minute summer   | SWMH 06          | 10          | 1.315     | 0.115     | 24.9         | 0.2226        | 0.0000     | OK         |
| 15 minute winter   | SWMH 07          | 11          | 1.283     | 0.462     | 236.8        | 0.8778        | 0.0000     | SURCHARGED |
| 15 minute winter   | SWMH 08          | 8           | 1.217     | 0.563     | 262.2        | 1.0299        | 0.0000     | SURCHARGED |
| 1440 minute winter | Attenuation Pond | 1410        | 1.073     | 0.494     | 13.8         | 350.6504      | 0.0000     | OK         |

| Link Event (Upstream Depth) | US Node          | Link      | DS Node          | Outflow (l/s) | Velocity (m/s) | Flow/Cap | Link Vol (m³) | Discharge Vol (m³) |
|-----------------------------|------------------|-----------|------------------|---------------|----------------|----------|---------------|--------------------|
| 15 minute summer            | SWMH 01          | S1.000    | SWMH 05          | 67.7          | 1.527          | 0.558    | 3.1201        |                    |
| 15 minute winter            | SWMH 11          | S2.000    | SWMH 02          | 26.0          | 0.760          | 0.294    | 0.8787        |                    |
| 15 minute winter            | SWMH 02          | S2.001    | SWMH 04          | 56.9          | 1.744          | 0.848    | 0.3253        |                    |
| 15 minute summer            | SWMH 03          | S3.000    | SWMH 04          | 28.5          | 1.039          | 0.720    | 0.3332        |                    |
| 15 minute winter            | SWMH 04          | S2.002    | SWMH 05          | 92.4          | 0.777          | 0.380    | 6.5449        |                    |
| 15 minute winter            | SWMH 05          | S1.001    | SWMH 07          | 189.6         | 1.196          | 1.179    | 8.9921        |                    |
| 15 minute summer            | SWMH 06          | S4.000    | SWMH 07          | 24.7          | 0.928          | 0.518    | 0.5508        |                    |
| 15 minute winter            | SWMH 07          | S1.002    | SWMH 08          | 238.1         | 1.591          | 1.284    | 2.4288        |                    |
| 15 minute winter            | SWMH 08          | S1.004    | Attenuation Pond | 268.0         | 2.625          | 1.115    | 3.3188        |                    |
| 1440 minute winter          | Attenuation Pond | Head/Flow |                  | 1.4           |                |          |               | 136.2              |

**Results for 100 year +40% CC Critical Storm Duration. Lowest mass balance: 99.74%**

| Node Event         | US Node          | Peak (mins) | Level (m) | Depth (m) | Inflow (l/s) | Node Vol (m³) | Flood (m³) | Status     |
|--------------------|------------------|-------------|-----------|-----------|--------------|---------------|------------|------------|
| 15 minute winter   | SWMH 01          | 11          | 3.091     | 1.291     | 122.7        | 4.6461        | 0.0000     | FLOOD RISK |
| 15 minute winter   | SWMH 11          | 11          | 3.055     | 1.275     | 47.1         | 2.5955        | 0.0000     | FLOOD RISK |
| 15 minute winter   | SWMH 02          | 11          | 3.010     | 1.390     | 92.5         | 3.0685        | 0.0000     | FLOOD RISK |
| 15 minute winter   | SWMH 03          | 11          | 2.709     | 1.184     | 51.8         | 2.4415        | 0.0000     | SURCHARGED |
| 15 minute winter   | SWMH 04          | 11          | 2.575     | 1.346     | 148.3        | 1.8869        | 0.0000     | SURCHARGED |
| 15 minute winter   | SWMH 05          | 11          | 2.446     | 1.483     | 319.1        | 3.2989        | 0.0000     | SURCHARGED |
| 15 minute winter   | SWMH 06          | 10          | 1.921     | 0.721     | 45.1         | 1.3932        | 0.0000     | SURCHARGED |
| 15 minute winter   | SWMH 07          | 11          | 1.767     | 0.946     | 408.1        | 1.7986        | 0.0000     | SURCHARGED |
| 2160 minute winter | SWMH 08          | 2160        | 1.469     | 0.815     | 15.1         | 1.4911        | 0.0000     | SURCHARGED |
| 2160 minute winter | Attenuation Pond | 2160        | 1.469     | 0.890     | 17.0         | 723.2245      | 0.0000     | OK         |

| Link Event (Upstream Depth) | US Node          | Link      | DS Node          | Outflow (l/s) | Velocity (m/s) | Flow/Cap | Link Vol (m³) | Discharge Vol (m³) |
|-----------------------------|------------------|-----------|------------------|---------------|----------------|----------|---------------|--------------------|
| 15 minute winter            | SWMH 01          | S1.000    | SWMH 05          | 109.4         | 1.554          | 0.902    | 4.0647        |                    |
| 15 minute winter            | SWMH 11          | S2.000    | SWMH 02          | 41.8          | 0.780          | 0.473    | 1.7778        |                    |
| 15 minute winter            | SWMH 02          | S2.001    | SWMH 04          | 90.3          | 2.270          | 1.346    | 0.3984        |                    |
| 15 minute winter            | SWMH 03          | S3.000    | SWMH 04          | 46.0          | 1.156          | 1.161    | 0.4834        |                    |
| 15 minute winter            | SWMH 04          | S2.002    | SWMH 05          | 152.6         | 0.963          | 0.628    | 7.4262        |                    |
| 15 minute winter            | SWMH 05          | S1.001    | SWMH 07          | 321.3         | 2.028          | 1.999    | 8.9921        |                    |
| 15 minute winter            | SWMH 06          | S4.000    | SWMH 07          | 41.8          | 1.051          | 0.878    | 0.7276        |                    |
| 15 minute winter            | SWMH 07          | S1.002    | SWMH 08          | 410.2         | 2.589          | 2.213    | 2.4343        |                    |
| 2160 minute winter          | SWMH 08          | S1.004    | Attenuation Pond | 14.9          | 0.648          | 0.062    | 6.5197        |                    |
| 2160 minute winter          | Attenuation Pond | Head/Flow |                  | 1.4           |                |          |               | 194.0              |





# Pre-Planning Assessment Report

Proposed Residential Development at Land off Surfleet Road, Pinchbeck

InFlow Reference: PPE-0137197

Assessment Type: Used Water

Report published: 31/12/2021



Thank you for submitting a pre-planning enquiry.

This has been produced for Minster Property Group Ltd..

Your reference number is **PPE-0137197**.

This report can be submitted as a drainage strategy for the development should it seek planning permission.

If you have any questions upon receipt of this report, you can submit a further question via InFlow. Alternatively, please contact the Planning & Capacity team on **07929 786 955** or email [planningliaison@anglianwater.co.uk](mailto:planningliaison@anglianwater.co.uk)

---

## Section 1 - Proposed development

The response within this report has been based on the following information which was submitted as part of your application:

| List of planned developments |              |
|------------------------------|--------------|
| Type of development          | No. Of units |
| Dwellings                    | 37           |

The anticipated residential build rate is:

| Year       | Y1 |
|------------|----|
| Build rate | 37 |

**Development type:** Greenfield  
**Planning application status:** Unknown  
**Site grid reference number:** TF2453026596

The comments contained within this report relate to the public water mains and sewers indicated on our records. Your attention is drawn to the disclaimer in the useful information section of this report.

## Section 2 - Assets affected

Our records indicate that there are no public water mains/public sewers or other assets owned by Anglian Water within the boundary of your development site. However, it is highly recommended that you carry out a thorough investigation of your proposed working area to establish whether any unmapped public or private sewers and lateral drains are in existence.

Due to the private sewer transfer in October 2011 many newly adopted public used water assets and their history are not indicated on our records. You also need to be aware that your development site may contain private water mains, drains or other assets not shown on our records. These are private assets and not the responsibility of Anglian Water but that of the landowner.

## Section 3 - Water recycling services

In examining the used water system we assess the ability for your site to connect to the public sewerage network without causing a detriment to the operation of the system. We also assess the receiving water recycling centre and determine whether the water recycling centre can cope with the increased flow and effluent quality arising from your development.

### Water recycling centre

The foul drainage from this development is in the catchment of Spalding Water Recycling Centre, which currently has capacity to treat the flows from your development site. Anglian Water cannot reserve capacity and the available capacity at the water recycling centre can be reduced at any time due to growth, environmental and regulation driven.

## Used water network

Our assessment has been based on development flows connecting to the nearest foul water sewer of the same size or greater pipe diameter to that required to drain the site. The infrastructure to convey foul water flows to the receiving sewerage network is assumed to be the responsibility of the developer. Conveyance to the connection point is considered as Onsite Work and includes all work carried out upstream from of the point of connection, including making the connection to our existing network. This connection point has been determined in reference to the calculated discharge flow and on this basis, a 150mm internal diameter pipe is required to drain the development site. The nearest practicable connection is to the 150mm diameter sewer at manhole 3401 on Surfleet Road at National Grid Reference NGR TF 24372 26417. The cover level is 3m and the invert level is -1m. Anglian Water has assessed the impact of gravity flows from the planned development to the public foul sewerage network. We can confirm that this is acceptable as the foul sewerage system, at present, has available capacity for your site. Please note that Anglian Water will request a suitably worded condition at planning application stage to ensure this strategy is implemented to mitigate the risk of flooding.

It is assumed that the developer will provide the necessary infrastructure to convey flows from the site to the network. Consequently, this report does not include any costs for the conveyance of flows.

## Surface water disposal

You indicated on the Pre-Planning Application form that a connection to the public surface water sewer network is not required. Therefore a capacity assessment has not been made on the public surface water network.

As you may be aware, Anglian Water will consider the adoption of SuDs provided that they meet the criteria outline in our SuDs adoption manual. This can be found on our [website](#). We will adopt features located in public open space that are designed and constructed, in conjunction with the Local Authority and Lead Local Flood Authority (LLFA), to the criteria within our SuDs adoption manual. Specifically, developers must be able to demonstrate:

1. Effective upstream source control,
2. Effective exceedance design, and
3. Effective maintenance schedule demonstrating that the assets can be maintained both now and in the future with adequate access.

If you wish to look at the adoption of any SuDs then an expression of interest form can be found on our [website](#)

As the proposed method of surface water disposal is not relevant to Anglian Water; we suggest that you contact the relevant Local Authority, Lead Local Flood Authority, the Environment Agency or the Internal Drainage Board, as appropriate.

## Trade Effluent

We note that you do not have any trade effluent requirements. Should this be required in the future you will need our written formal consent. This is in accordance with Section 118 of the Water Industry Act (1991).

## Used Water Budget Costs

Your development site will be required to pay an infrastructure charge for each new property connecting to the public sewer that benefits from Full planning permission.

You will be required to pay an infrastructure charge upon connection for each new plot on your development site. The infrastructure charge are types of charges set out in Section 146(2) of the Water Industry Act 1991

The charge should be paid by anyone who wishes to build or develop a property and is payable upon request of connection.

Payment of the infrastructure charge must be made before premises are connected to the public sewer.

|                                            |          |
|--------------------------------------------|----------|
| Infrastructure charge for water recycling: | £ 573.00 |
|--------------------------------------------|----------|

### The Water Recycling Infrastructure charge for your dwellings is:

| Infrastructure charge | Number of units | Total   |
|-----------------------|-----------------|---------|
| £ 573.00              | 37              | £ 21201 |

Infrastructure charges are raised on a standard basis of one charge per new connection (one for water and one for sewerage). However, if the new connection is to non-household premises, the fixed element is calculated according to the number and type of water fittings in the premises. This is called the "relevant multiplier" method of calculating the charge.

Details of the relevant multiplier for each fitting can be found at our [website](#).

It has been assumed that the onsite used water network will be provided under Section 104 of the Water Industry Act

It is recommended that you also budget for connection costs.

Please note that we offer alternative types of connections depending on your needs and these costs are available at our [website](#).

### Section 4 - Map of Proposed Connection Points

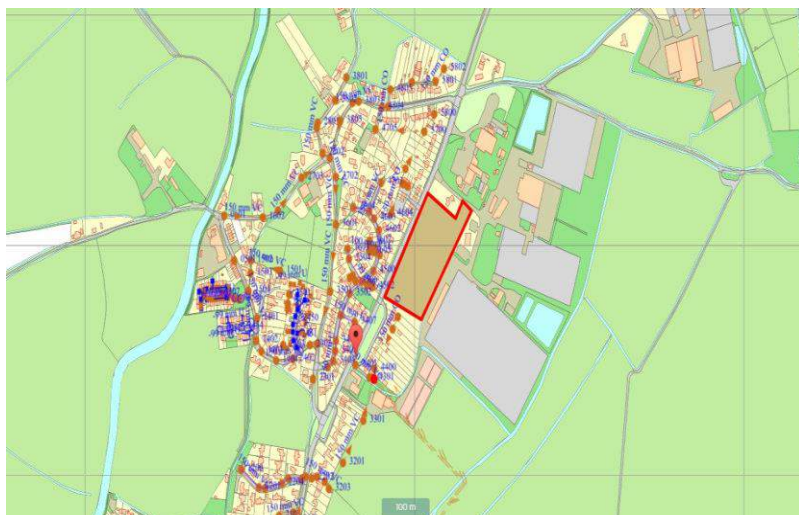


Figure 1: Showing your used water point of connection

### Section 5 - Useful information

Water Industry Act – Key used water sections

#### Section 98:

This provides you with the right to requisition a new public sewer. The new public sewer can be constructed by Anglian Water on your behalf. Alternatively, you can construct the sewer yourself under section 30 of the Anglian Water Authority Act 1977.

#### Section 102:

This provides you with the right to have an existing sewerage asset vested by us. It is your responsibility to bring the infrastructure to an adoptable condition ahead of the asset being vested.

#### Section 104:

This provides you with the right to have a design technically vetted and an agreement reached that will see us adopt your assets following their satisfactory construction and connection to the public sewer.

#### Section 106:

This provides you with the right to have your constructed sewer connected to the public sewer.

#### Section 185

This provides you with the right to have a public sewerage asset diverted.

Details on how to make a formal application for a new sewer, new connection or diversion are available on our [website](#) or via our Development Services team on **0345 60 66 087**.

#### **Sustainable drainage systems**

Many existing urban drainage systems can cause problems of flooding, pollution or damage to the environment and are not resilient to climate change in the long term. .

Our preferred method of surface water disposal is through the use of Sustainable Drainage Systems or SuDS.

SuDS are a range of techniques that aim to mimic the way surface water drains in natural systems within urban areas. For more information on SuDS, please visit our [website](#)

We recommend that you contact the Local Authority and Lead Local Flood Authority (LLFA) for your site to discuss your application.

#### **Private sewer transfers**

Sewers and lateral drains connected to the public sewer on the 1 July 2011 transferred into Water Company ownership on the 1 October 2011. This follows the implementation of the Floods and Water Management Act (FWMA). This included sewers and lateral drains that were subject to an existing Section 104 Adoption Agreement and those that were not. There were exemptions and the main non-transferable assets were as follows:

Surface water sewers and lateral drains that do not discharge to the public sewer, e.g. those that discharged to a watercourse.

Foul sewers and lateral drains that discharged to a privately owned sewage treatment/collection facility.

Pumping stations and rising mains will transfer between 1 October 2011 and 1 October 2016.

The implementation of Section 42 of the FWMA will ensure that future private sewers will not be created. It is anticipated that all new sewer applications will need to have an approved section 104 application ahead of a section 106 connection.

It is anticipated that all new sewer applications will need to have an approved Section104 application ahead of a Section 106 connection

#### **Encroachment**

Anglian Water operates a risk based approach to development encroaching close to our used water infrastructure. We assess the issue of encroachment if you are planning to build within 400 metres of a water recycling centre or, within 15 metres to 100 metres of a pumping station. We have more information available on our [website](#)

#### **Locating our assets**

Maps detailing the location of our water and used water infrastructure including both underground assets and above ground assets such as pumping stations and recycling centres are available from [digdat](#)

All requests from members of the public or non-statutory bodies for maps showing the location of our assets will be subject to an appropriate administrative charge.

We have more information on our [website](#)

#### **Charging arrangements**

Our charging arrangements and summary for this year's water and used water connection and infrastructure charges can be found on our [website](#)

#### **Section 6 - Disclaimer**

The information provided in this report is based on data currently held by Anglian Water Services Limited ('Anglian Water') or provided by a third party. Accordingly, the information in this report is provided with no guarantee of accuracy, timeliness, completeness and is without indemnity or warranty of any kind (express or implied).

This report should not be considered in isolation and does not nullify the need for the enquirer to make additional appropriate searches, inspections and enquiries. Anglian Water supports the plan led approach to sustainable development that is set out in the National Planning Policy Framework ('NPPF') and any infrastructure needs identified in this report must be considered in the context of current, adopted and/or emerging local plans. Where local plans are absent, silent or have expired these needs should be considered against the definition of sustainability holistically as set out in the NPPF.



Whilst the information in this report is based on the presumption that proposed development obtains planning permission, nothing in this report confirms that planning permission will be granted or that Anglian Water will be bound to carry out the works/proposals contained within this report.

No liability whatsoever, including liability for negligence is accepted by Anglian Water or its partners, employees or agents, for any error or omission, or for the results obtained from the use of this report and/or its content. Furthermore, in no event will any of those parties be liable to the applicant or any third party for any decision made or action taken as a result of reliance on this report.

**This report is valid for the date printed and the enquirer is advised to resubmit their request for an up to date report should there be a delay in submitting any subsequent application for water supply/sewer connection(s).**

Inflow reference: PPE-0137197

Used Water Connection Point: to the 150mm diameter sewer at manhole 3401 on Surfleet Road

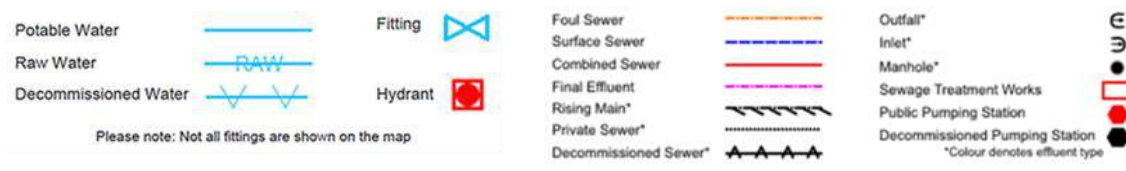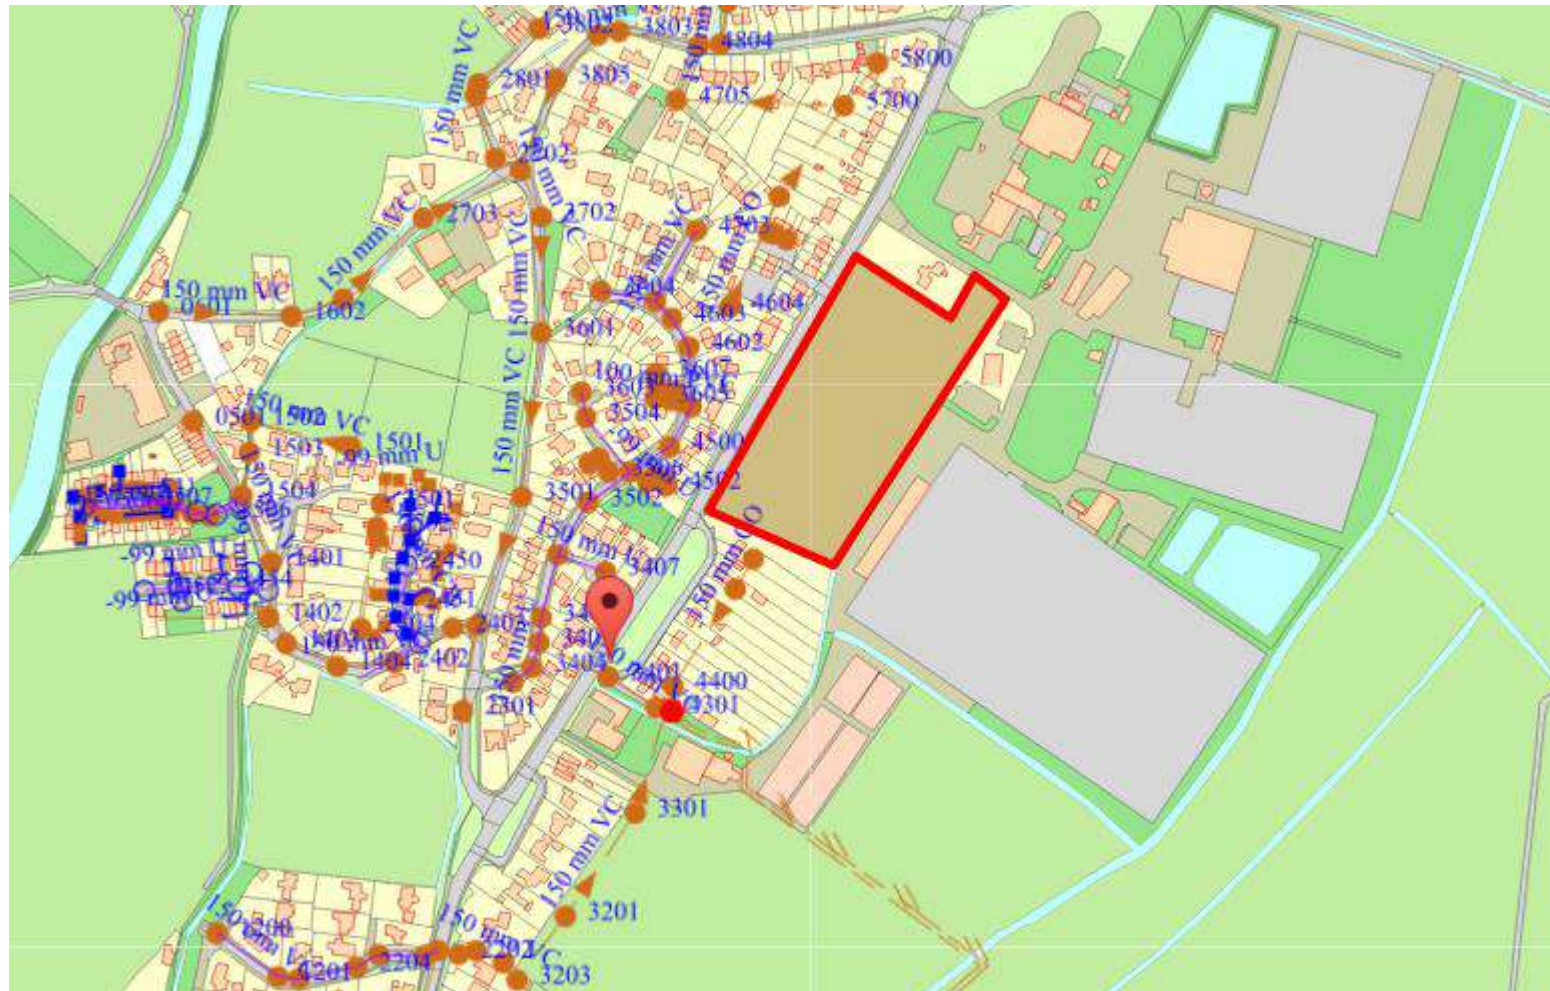

@ Crown Copyright 2014. All rights reserved.  
Ordnance Survey License Number 100022432