



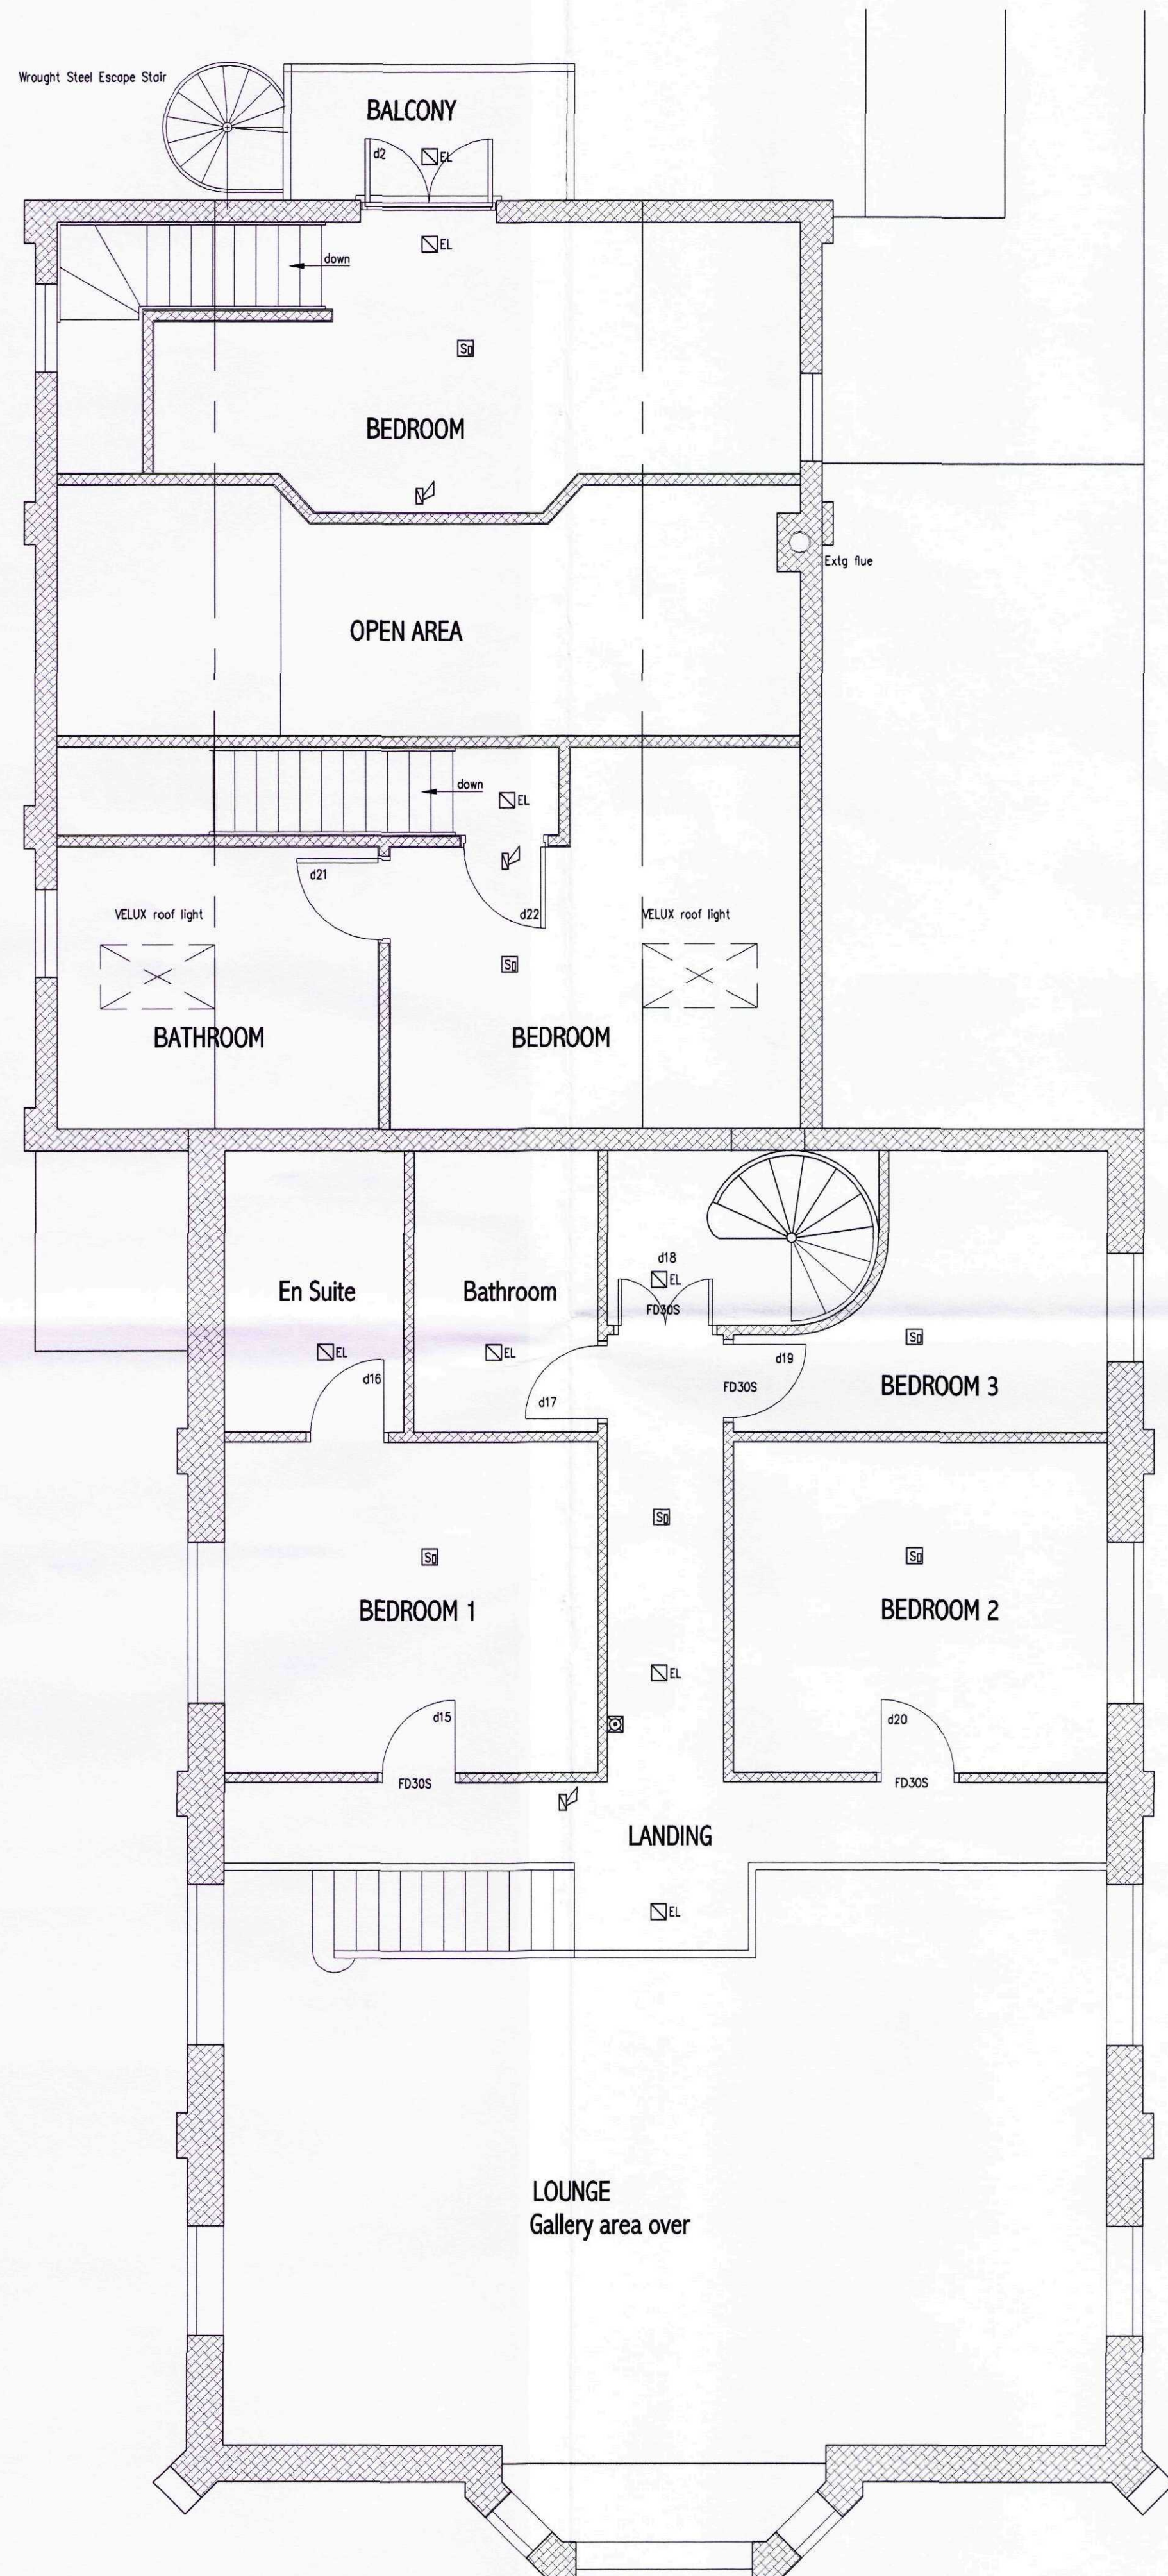

first floor plan

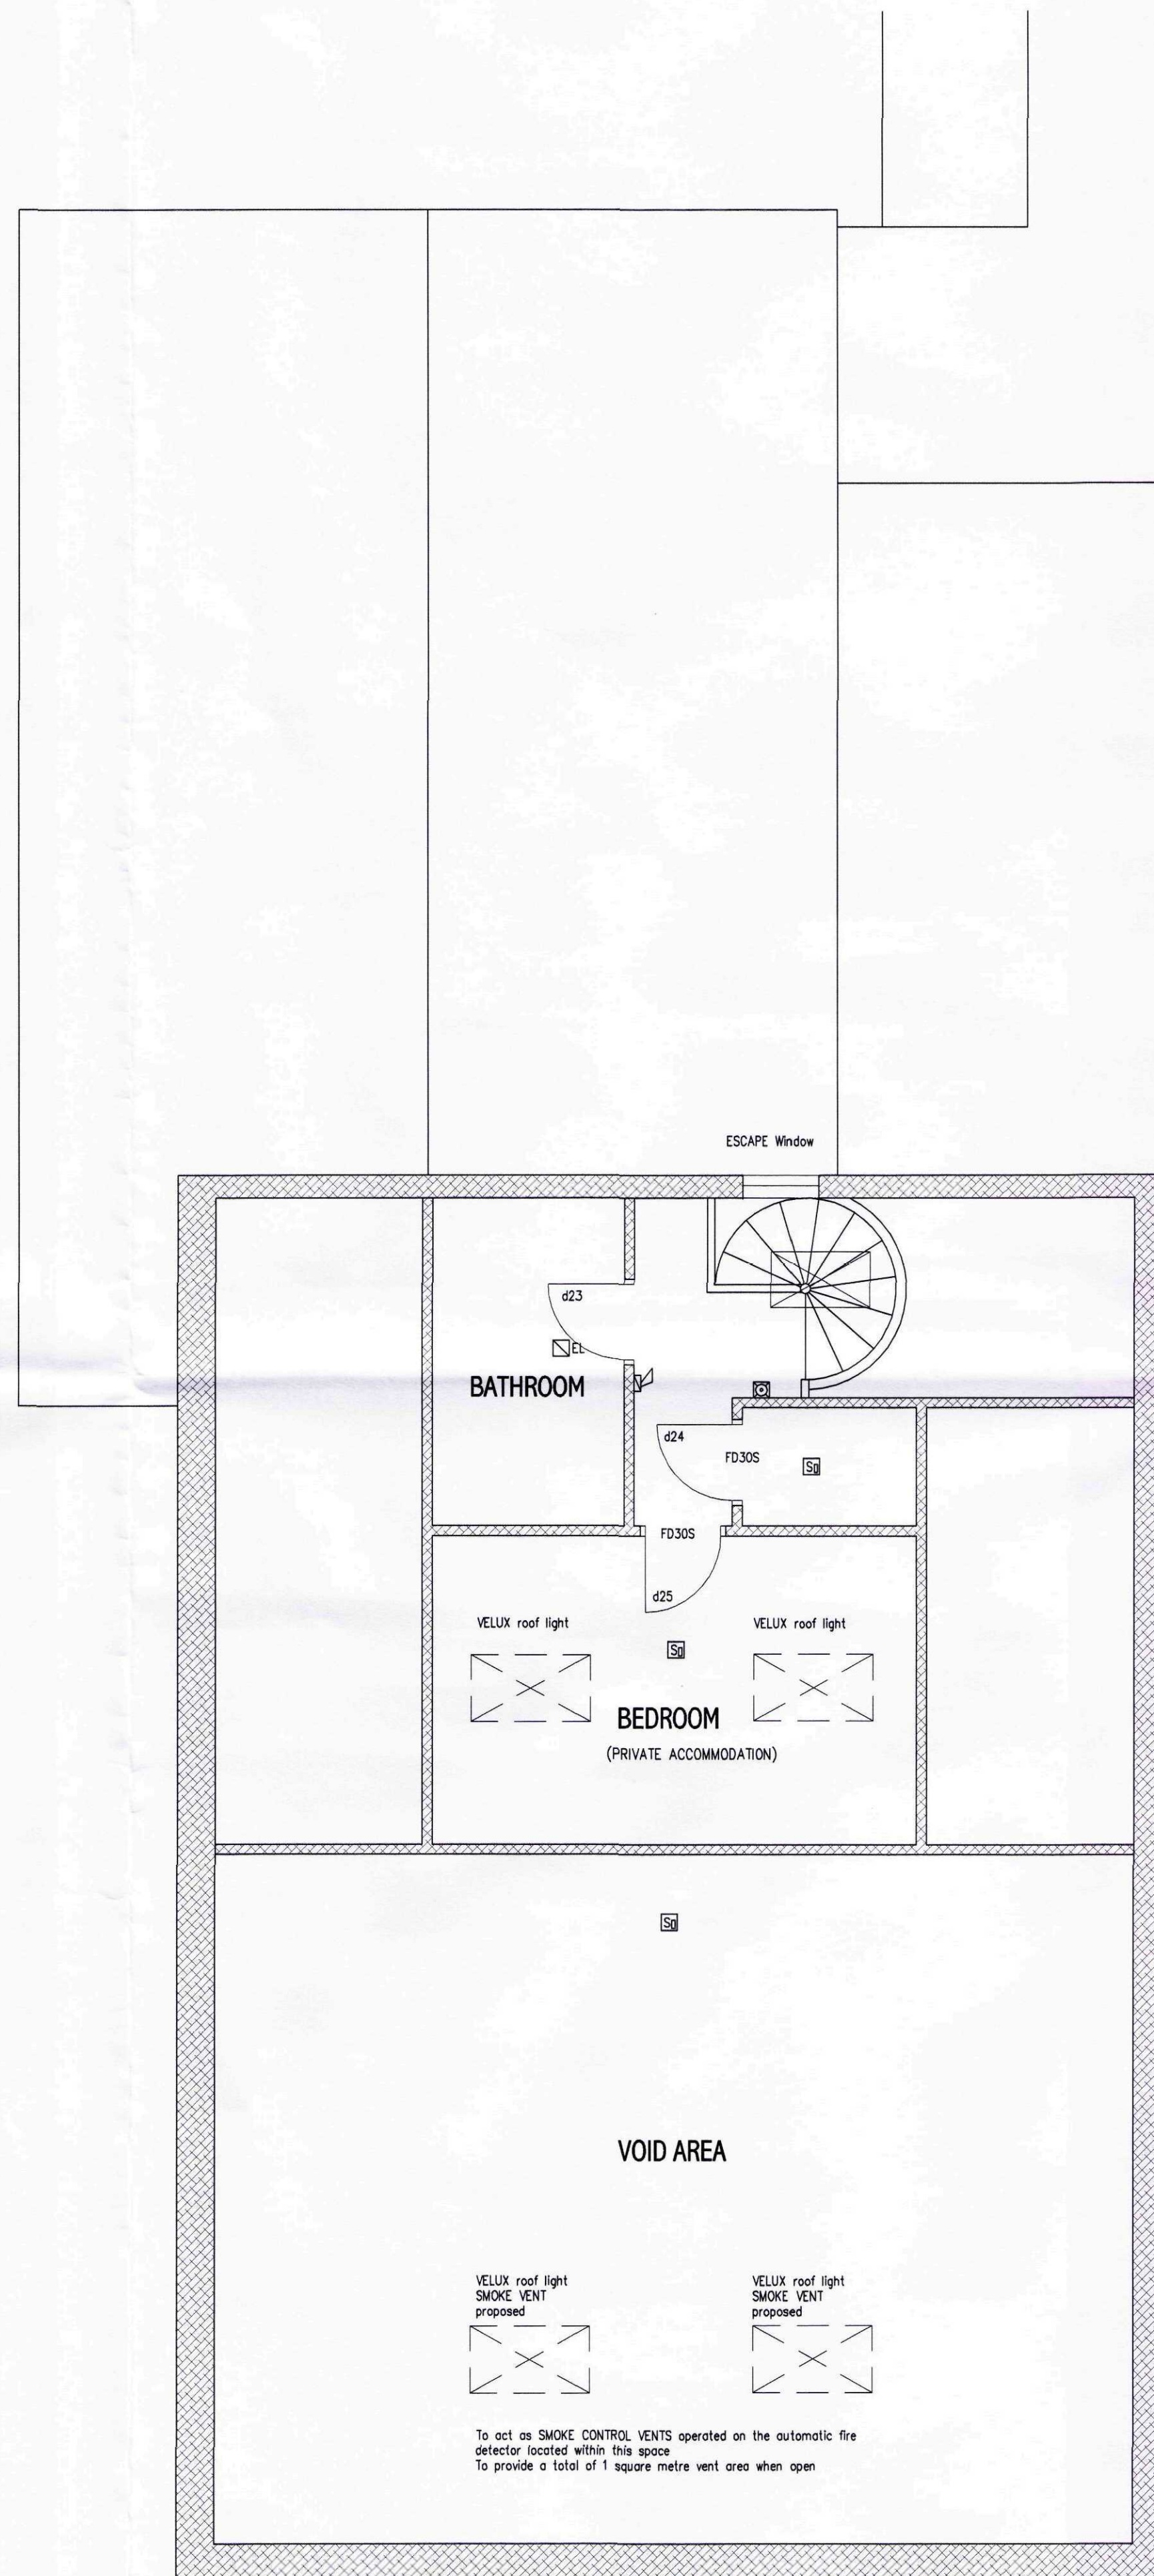

second floor plan

SYMBOLLOGY

-  Fire Alarm Call Point
-  Smoke Detector
-  Heat Detector
-  Alarm Sounder
-  Fire Alarm Panel - addressable system
-  Emergency Light

FIRE PRECAUTIONS WORK UPGRADING

DOORS

Where doors require upgrading to achieve 30 minutes fire resistance this can be done by applying an intumescent surface paint of a proprietary make and provide certification to the BCB that this is in accordance with the manufacturer's system. Include blade seals (cold smoke seals).

Where glass fanlights and glazed panels need to be upgraded provide PYROGUARD Fireglass C730, 7mm thickness to the room side using 15mm x 15mm hardwood beading glued and pinned or screwed incorporating Firestrip FD30 glazing 'tape'.

EMERGENCY LIGHTING SYSTEM

Provide an escape lighting system that is designed, installed, tested and certified all in accordance with BS 5266-1:2005.

FIRE DETECTION AND ALARM SYSTEM

Provide and install a fully addressable Fire Detection and Alarm System Type LD1 by specialist installer that is designed, installed, tested and certified all in accordance with BS 5839-6:2002.

EXISTING INTERNAL WALLS

All internal walls blockwork and studwork achieve a 30 minute FIRE RESISTANCE.



L. A. Building Design

Architectural and Surveying Practice
55 Hannam Boulevard
Spalding
Lincolnshire PE11 1LB
Telephone/Fax: Spalding: (01775) 711437

Peter S Lithgow MCIOB MCIT

Member of the Chartered Institute of Building and
Member of the Chartered Institute of Architectural Technologists

project
Proposed CHANGE OF USE of Existing CONVERTED CHAPEL
ANJELI CHAPEL, Northgate, West Pinchbeck,
SPALDING, Lincolnshire, PE11 3TB.

client

MS J CHAPTER + MS A CHAPTER

drawing

PLANNING DRAWING
GENERAL ARRANGEMENT
FIRST AND SECOND FLOOR PLANS

date	scale(s)
FEBRUARY 2011	1:50
drawn by	checked
Peter Lithgow	PSL
job no	drawing no
11/01	02