


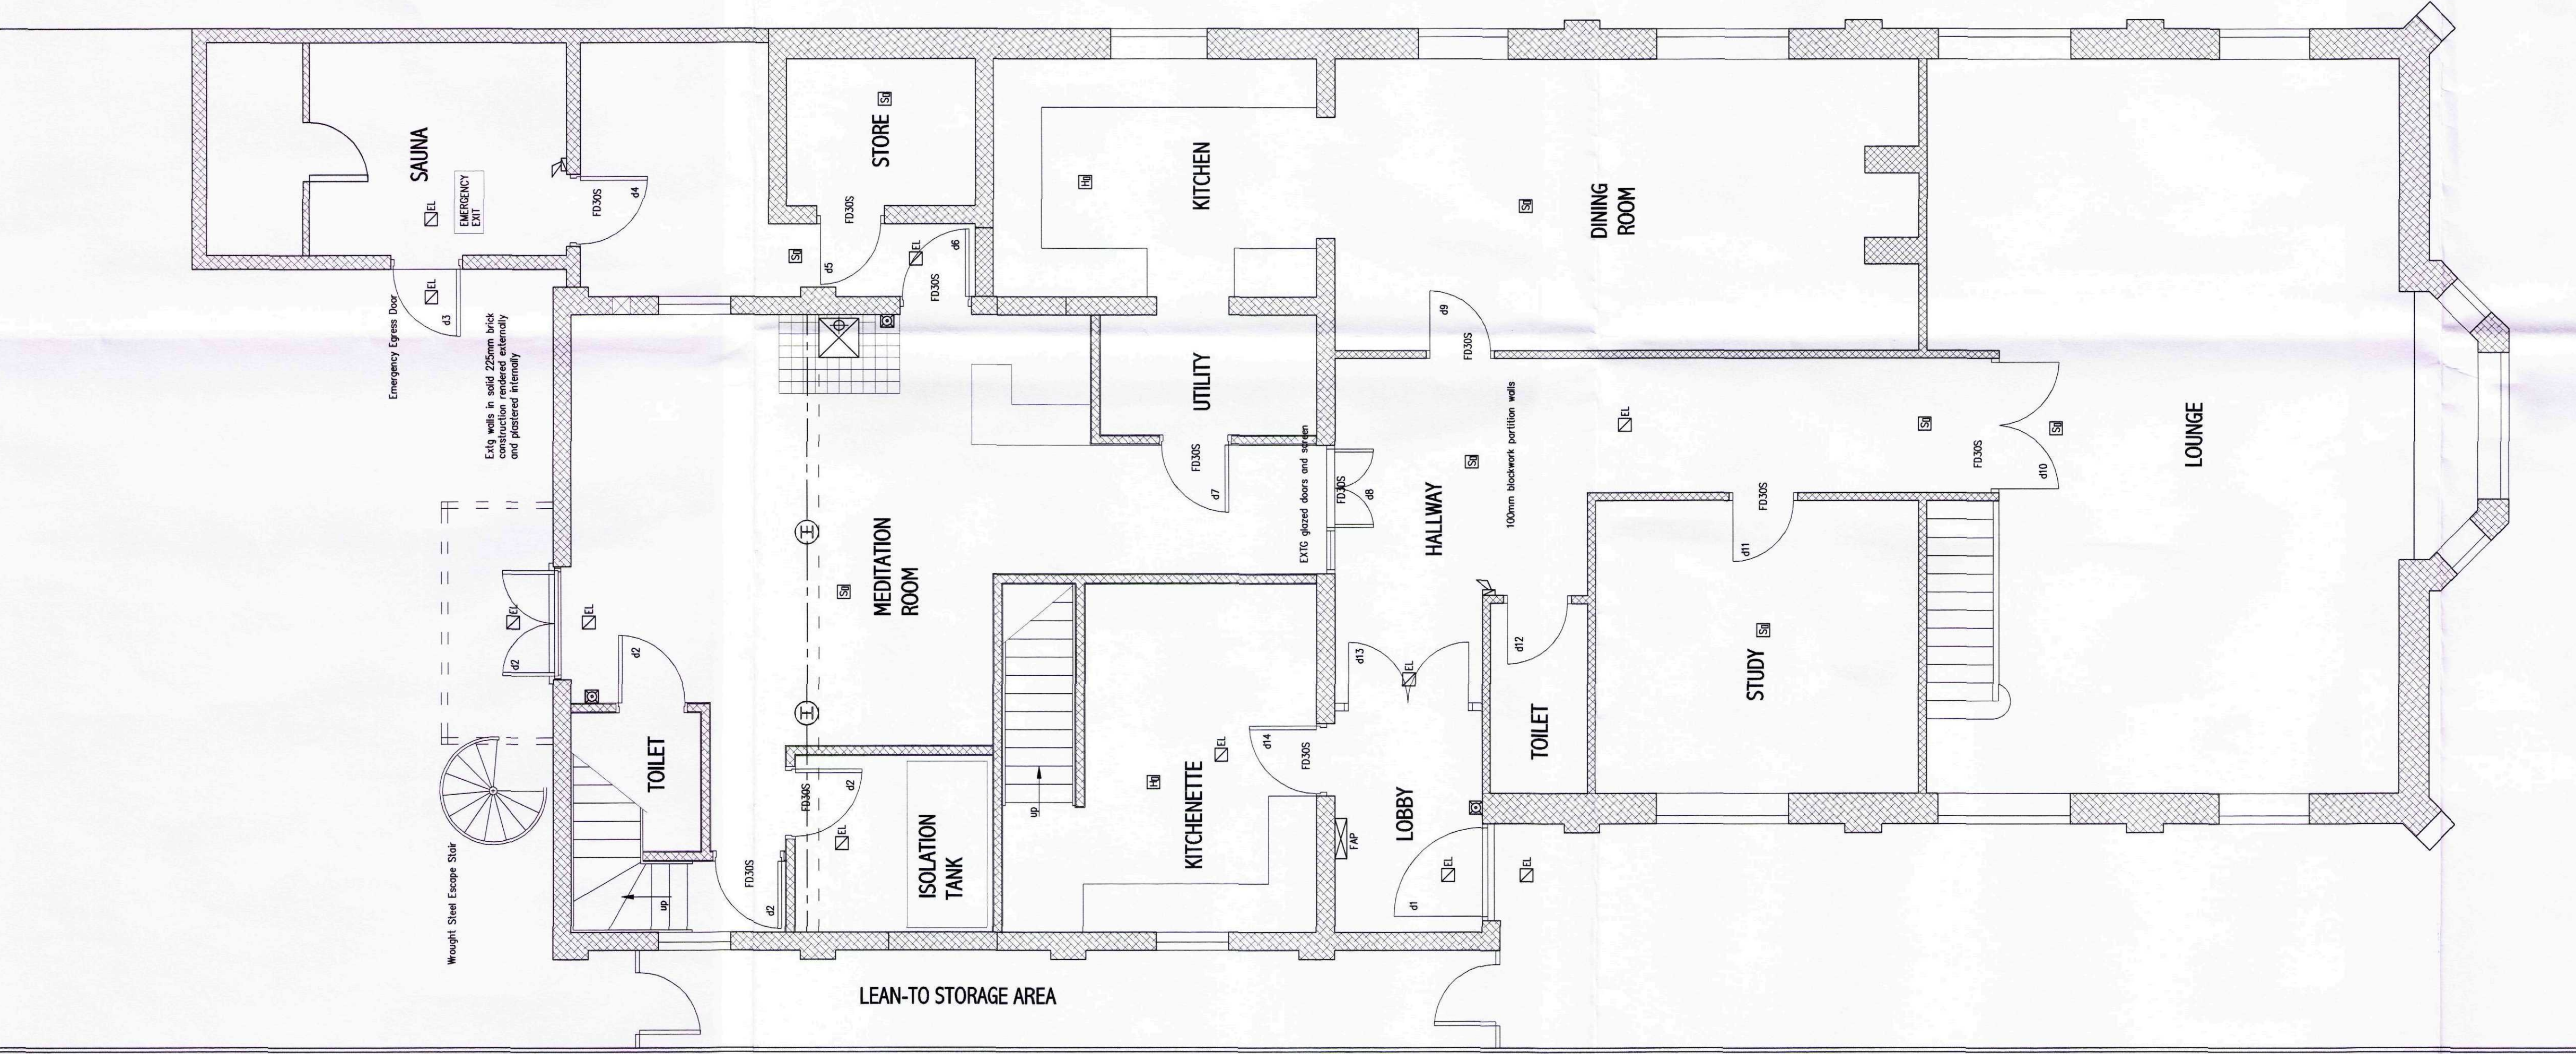

ground floor plan

SYMBOLLOGY

- Fire Alarm Call Point
- Smoke Detector
- Heat Detector
- Alarm Sounder
- Fire Alarm Panel – addressable system
- Emergency Light

FIRE PRECAUTIONS WORK
UPGRADING

- DOORS**
Where doors require upgrading to achieve 30 minutes fire resistance this can be done by applying an intumescent surface paint of a proprietary make and provide certification to the BCB that this is in accordance with the manufacturer's system. Include blade seals (cold smoke seals).
Where glass fanlights and glazed panels need to be upgraded provide PYROGUARD Fireglass C730, 7mm thickness to the room side using 15mm x 15mm hardwood beading glued and pinned or screwed incorporating Firestrip F030 glazing 'tape'
- EMERGENCY LIGHTING SYSTEM**
Provide an escape lighting system that is designed, installed, tested and certified all in accordance with BS 5266-1:2005.
- FIRE DETECTION AND ALARM SYSTEM**
Provide and install a fully addressable Fire Detection and Alarm System Type L01 by specialist installer that is designed, installed, tested and certified all in accordance with BS 5839-6:2002
- EXISTING INTERNAL WALLS**
All internal walls blockwork and studwork achieve a 30 minute FIRE RESISTANCE

SHDC
Planning & Development
12 SEP 2011
Ref: 0707-11

L. A. Building Design
Architectural and Surveying Practice
55 Hannam Boulevard
Spalding
Lincolnshire PE11 1JB
Telephone/Fax: Spalding: (01775) 711437

Peter S Lithgow MCIOB MCAT
Member of the Chartered Institute of Building and
Member of the Chartered Institute of Architectural Technologists
proposed
CHANGE OF USE OF EXISTING CONVERTED CHAPEL
ANJELI CHAPEL, Northgate, West Pinchbeck,
SPALDING, Lincolnshire, PE11 3TB.
client
MS J CHAPTER + MS A CHAPTER

drawing PLANNING DRAWING GENERAL ARRANGEMENT GROUND FLOOR PLAN	
date FEBRUARY 2011	scale(s) 1:50
drawn by Peter Lithgow	checked PSL
job no 11/01	drawing no 01