

Street Lighting Key

Proposed 6 metre T/S galvanised column with root protection to G1a (LCC) specification. Column to have vertically mounted TRT Aspect 1 ECO 19W neutral white (4000k) FOPR lens. Lantern to SELC 8480 35 lux part night photocell (Off 00:00 - 06:00 hrs). Lantern to be installed with 5° upward tilt.

Proposed 6 metre T/S galvanised column with root protection to G1a (LCC) specification. Column to have vertically mounted TRT Aspect 1 ECO 19W neutral white (4000k) FOPR lens. Lantern to SELC 8480 35 lux part night photocell (Off 22:00 - 06:00 hrs). Lantern to be installed with 5° upward tilt.

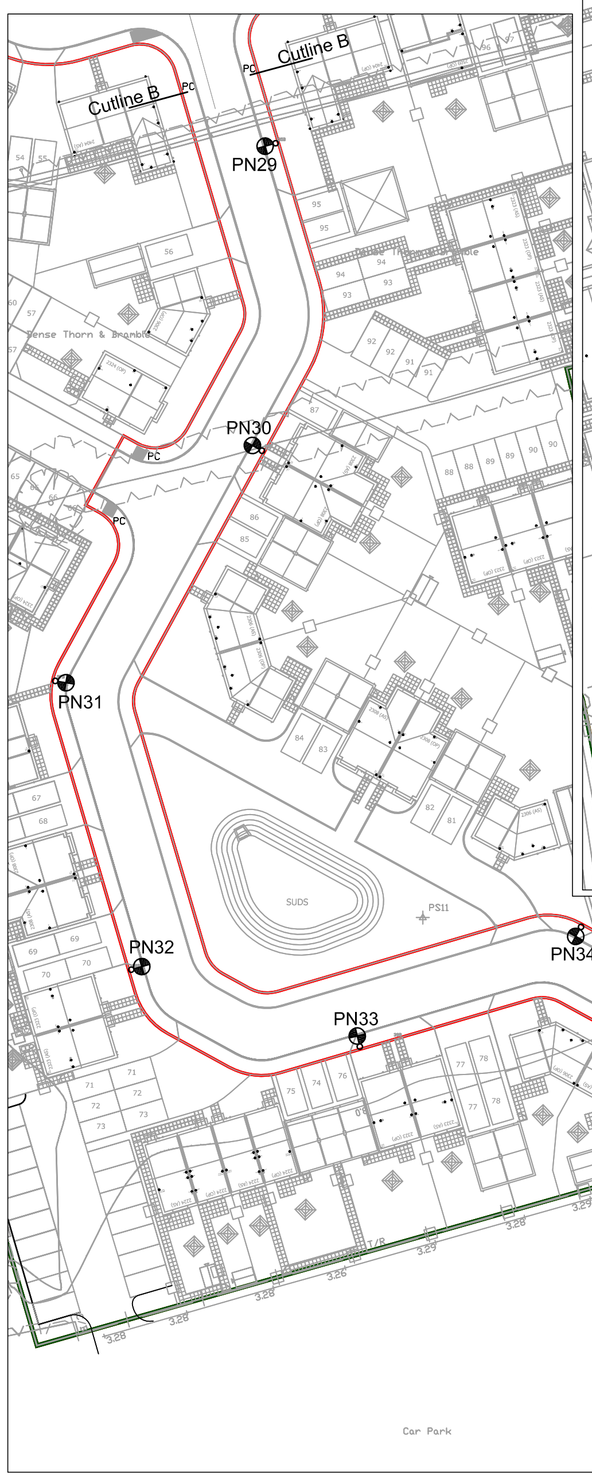

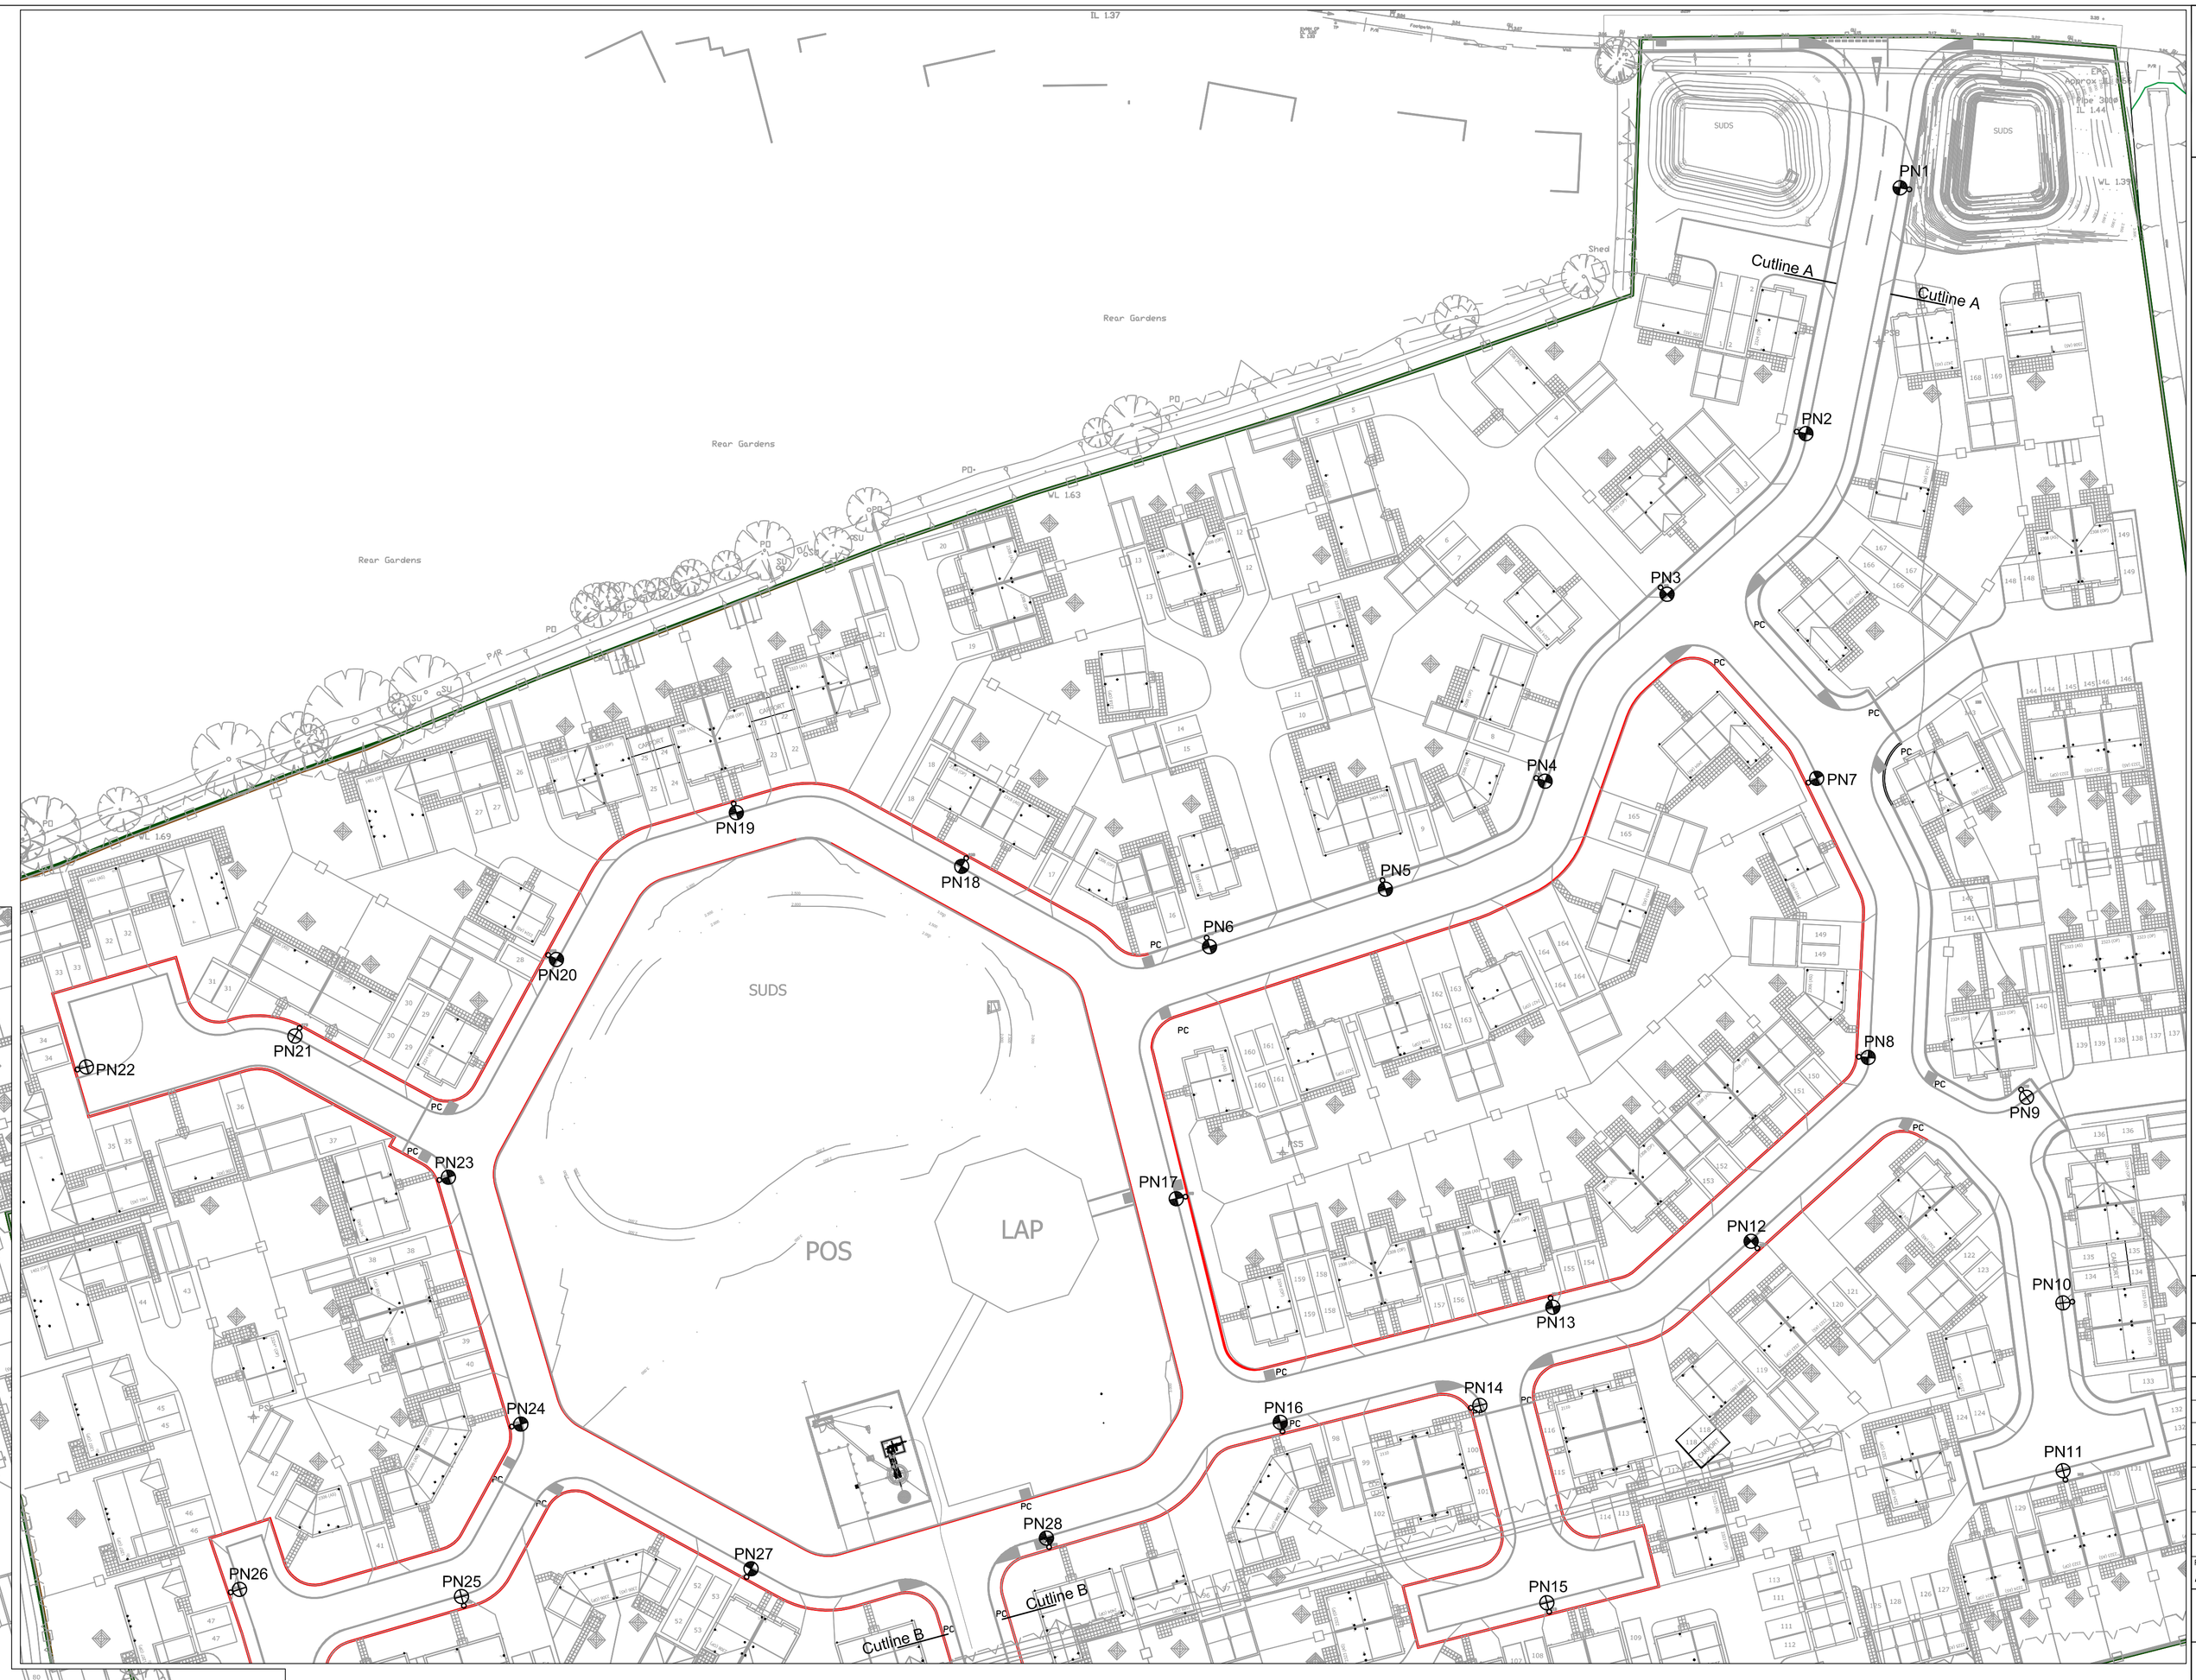

X-Refs & Blocks used in this Drawing
x-cont base
x-SL

S38 Street Lighting Notes

1. Column foundations to be as per SD/14/2A
2. All columns to be provided with Distribution Network Operator (D.N.O.) Services and Termination Type A to LCC Standard Detail SD/14/4A unless otherwise specified. DNO Cutouts to be fitted with 16Amp BS88 Fuse Link. Double Pole Isolator to be fitted with BS 88 Fuse Link to L.C.C Appendix 14/4.
3. Column setbacks shall comply with Table 2 Section 4.3.3.3 of BS 5489-1:2013.
4. Columns shall not be installed within Drop Kerb areas and shall have a minimum clearance of 1.5m from Drives/Accesses.
5. It is preferred that all Street Lighting works are undertaken by L.C.C Approved Contractors.
6. Lanterns to be cleaned and re-lamped (during maintenance period) prior to adoption as detailed in S38 Agreement unless the specification is for LED lanterns which will require clean only.
7. Developer to liaise with Distribution Network Operator (D.N.O.) with regards to connections and disconnections of columns and appropriate black ducting. Where an independent D.N.O. (I.D.N.O.) has been used the cutout must be clearly and indelibly marked with the I.D.N.O. name and contact number.
8. It is the Developers responsibility to inform property owners of part night street lighting switching where applicable.
9. All private cabling shall have correct core colour identification as detailed in BS7671. Sleeving of conductors is not permitted.
10. Due to ongoing technical innovations within the industry, if the street lighting equipment is to be ordered in excess of three years after the drawing approval date, the Authority reserves the right to upgrade the equipment specification.

Lincolnshire Highway Alliance d rawing created using base information supplied by external party detailed below:

Base Information Provided By: Allison Homes

Client Provided Drawing Number: MA10002 / 605-2 rev J

APPROVED FOR
CONSTRUCTION

FOR THIRD PARTY USE, THIS DRAWING SHALL BE DEEMED CURRENT ONLY AT THE DATE OF APPROVAL. PLEASE CHECK FOR AMENDMENTS BEFORE USE

Revision:	Description:	Drawn By:	CAD By:	Approved By:	Approval Date
	Amendment Details				

Drawing 1st Approval

1st Approval by: PC | Date: 13/5/16

Drawn/Designed by: NP

CAD Drawing Creation — Created By: DS | Date: 02/03/16

Scale: (@A1) 0 10m 20m 30m 40m @1:500

Primary: 1:500

Secondary:

(Do not scale from this drawing)

LincoInshire COUNTY COUNCIL
Highways Alliance
TECHNICAL SERVICES PARTNERSHIP
CROWN HOUSE
GRANTHAM STREET
LINCOLN
LN2 1BD
Customer Service Centre : (01522) 782070

bsi. Certificate No. FS20705

Drawing Number: 0169 Scheme Reference / 01 ID Number / 5000 Drawing Series No. — Revision Number: if suitable:

Alternative Scheme Code:

Parish: PINCHBECK

Road No: | Structure No:

Description:

DEVELOPMENT OFF WARDENTREE LANE

S38 STREET LIGHTING WORKS

LINCOLNSHIRE COUNTY COUNCIL - Reproduced fr om Ordnance Survey material with the permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationery Office © Crown copyright. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings. OS Licence 100025370

TSP Border Issue 2013