


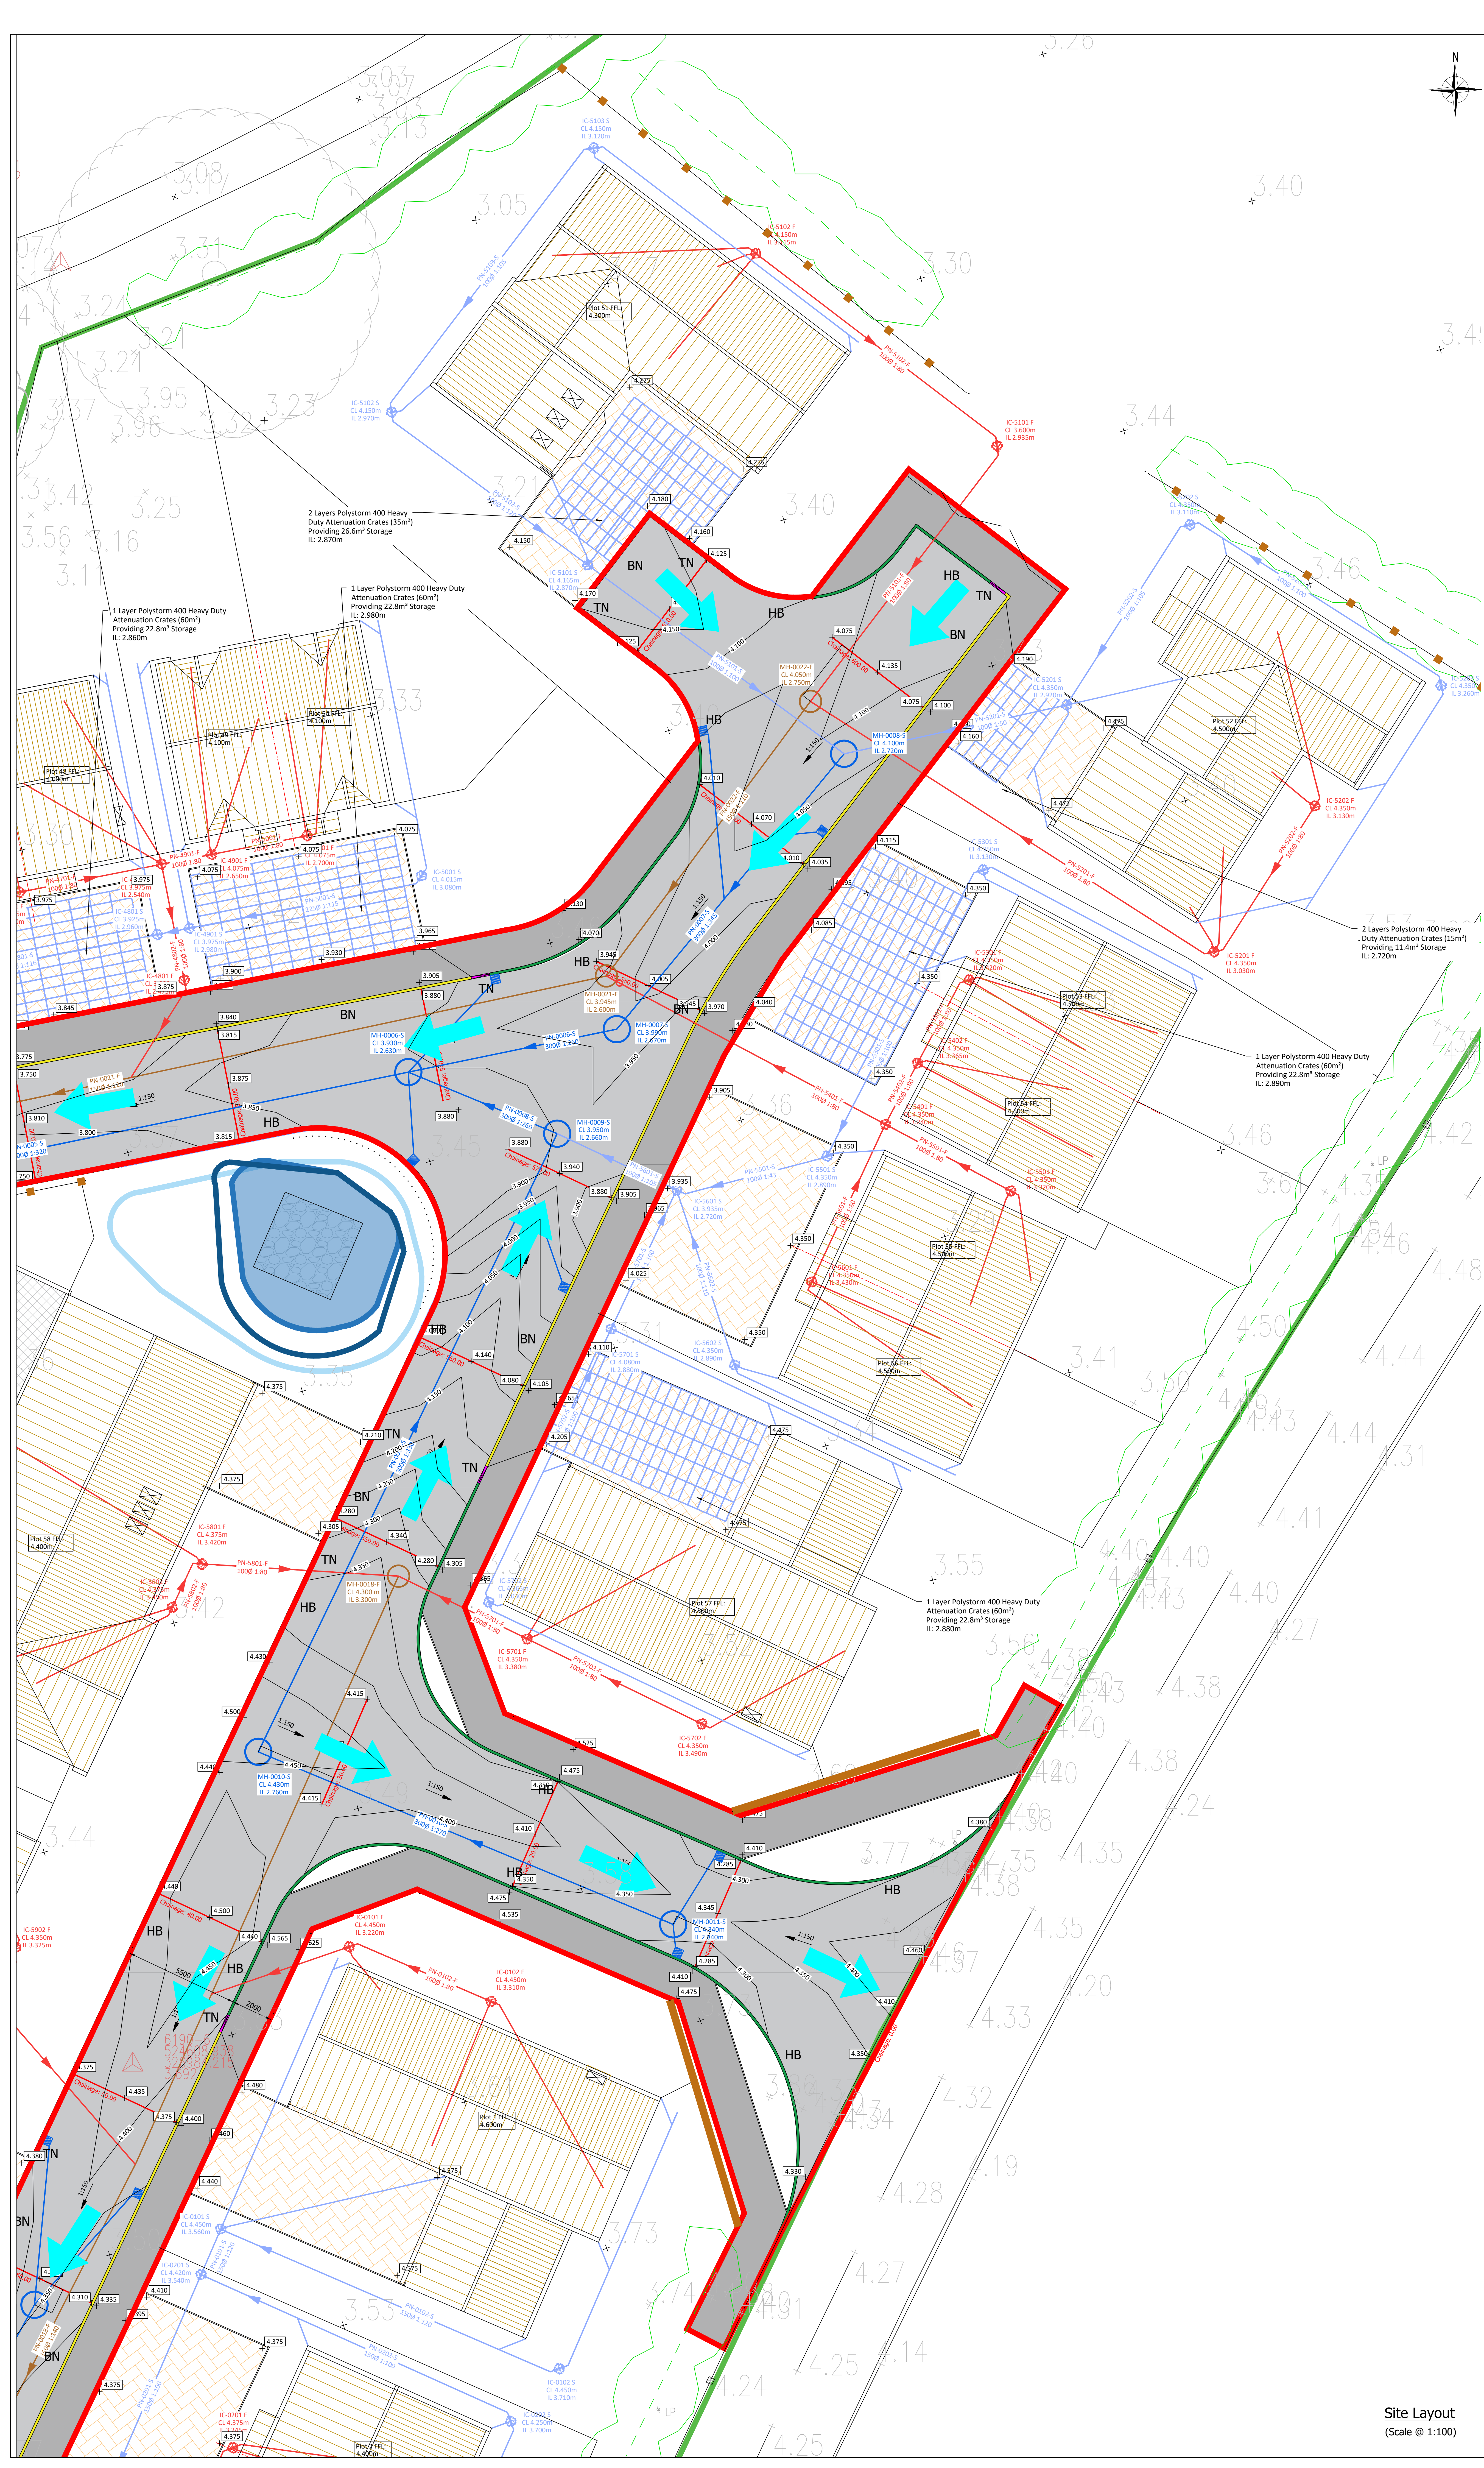

UNLESS STATED WITHIN THE CONTRACT THESE DRAWINGS ARE COPYRIGHT AND THE PROPERTY OF PARSONS CONSULTING ENGINEERS LTD. COPYING OF THE DESIGN, DRAWINGS OR INTELLECTUAL PROPERTY RIGHTS IS NOT PERMITTED.

NOTES

- Do not scale this drawing.
- All dimensions are in millimetres unless stated otherwise.
- This drawing to be read in conjunction with all other relevant drawings and specifications.
- All proprietary items to be installed in strict compliance with manufacturers instructions and recommendations.

STANDARD DRAINAGE NOTES:

- Except where specifically shown otherwise all below ground pipes / connections shall be 100mm dia PVC (to BS 4560) or VC (to BS 5481) with flexible joints and laid to minimum falls of 1 in 40, except where connected to WC when falls may be 1 in 80.
- All gravity pipe runs to be tested to a standing head of 1500mm head of water above the invert at the head of the pipe run (but not exceeding 4000mm at the lower end).
- For details of bed and surround requirements refer to long-sections and standard details. In all other situations provide 150mm of 10mm single-sized rounded gravel bedding and surround.
- Except where specifically shown otherwise, pipes to be a minimum of 900mm below roads/driveways and 600mm below gardens/fields.
- Ventilating pipes to be provided at the head of each drain and to any branch longer than 6m where a single appliance is connected, or 12m where a group of appliances is connected.
- Step-ions shall not be fitted in any chambers unless specified otherwise.
- Manhole/Gully covers shall be regulated to suit finished levels and crossfalls.
- All proprietary items to be installed in strict compliance with manufacturers instructions and recommendations.
- Drains passing beneath buildings to have minimum 100mm granular fill or flexible filling around pipe. Where the pipe crown is within 300mm of the underside of the slab, pipe shall be encased in concrete integral with the slab.
- Drains passing through walls below ground level to have minimum 50mm clearance all round and opening in walls to be masked all round with rigid sheet material to prevent ingress of fill or vermin. Openings in walls for pipes shall have concrete lintels to support wall construction above.
- Unless stated otherwise, pipes to be 100mm Diameter.

STANDARD ROADS / FOOTPATH NOTES:

- Existing structures to be broken out to minimum 450mm below top of finished surface level. Existing footpath to be broken out and rubble and existing subbase to be removed off-site.
- Subgrade to be proof rolled with one pass of a smooth-wheeled roller having a mass per M-width of roll of not less than 2,100-kg or a Vibrating Roller having a mass per M-width of roll of not less than 700-kg or a Vibrating Plate Compactor having a mass per m2 of not less than 1400-kg. Any soft spots shall be removed and replaced with Type 1 compacted in layers not exceeding 150mm thickness.
- All formations are to be treated with an approved herbicide before placing sub-base material on a geotextile separation membrane (Tertan 1000 or similar approved).
- All sub-base material is to be non-frost-susceptible. All concrete to be sulphate resisting.

CONSTRUCTION DESIGN AND MANAGEMENT REGULATIONS 2015

THE CONTRACTORS ATTENTION IS DRAWN TO THE ABNORMAL RISKS IDENTIFIED BELOW, ANNOTATED ON THE DRAWING AND EXPANDED IN THE ASSOCIATED DESIGN RISK REGISTERS

LEGEND

Legend symbols and descriptions:

- YOU MUST NOT DO (Red circle with slash)
- HAZARD OR DANGER (Yellow triangle with exclamation mark)
- YOU MUST DO (Blue circle with checkmark)
- CAUTION (Blue circle with exclamation mark)
- ABNORMAL RISKS IDENTIFIED: (List of risks with corresponding symbols)

Key

Key symbols and descriptions:

- HB-HALF BATTERED KERB
- BN-BULLDOZE KERN
- TN-TRANSITION KERB
- EF-EDGING OF FOOTPATH
- Permeable Paving
- Tarmac
- Grass
- Proposed Levels
- Surface Water Polypropylene Inspection Chamber
- Private Storm Water Manhole (Anglian Water)
- Adoptable Storm Water Manhole (Anglian Water)
- Surface Water Pipeline
- Rodding Eye
- Backdrop
- Arrow Gradient
- Foul Water Polypropylene Inspection Chamber
- Adoptable Foul Water Manhole
- Foul Water Pipeline

P01	First Issue	TBP	30-09-22
Rev	Amendments	Rev'd by	Date

Client
R Bratley (Quadrang) Ltd

Project
Green Lane, Pinchbeck

Title
**Engineering Layout
Sheet 1 of 7**

Job No	22157		
Drawing No	22157-004		
Status	Preliminary	Rev	P1
Scale	1:100 @ A0	Date	30-09-22
Project Engineer	TBP	Drawn By	AJP
		Checked By	TBP
		Approved By	



Site Layout
(Scale @ 1:100)

4 Angel House, Eastgate, Whitteley
Peterborough, PE7 1SE
07961 783825
www.parsonsengeers.co.uk