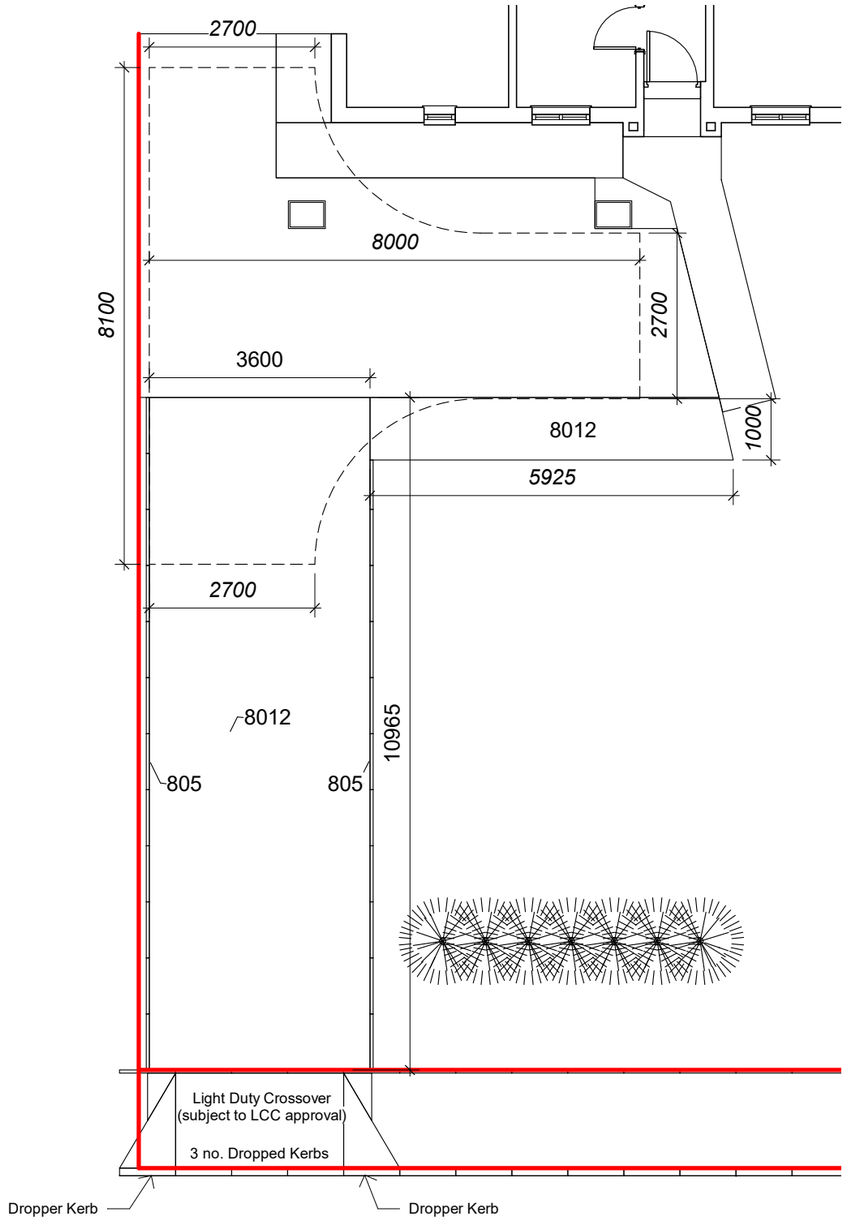


1 Ground Floor - (Proposed)

1 : 100

Rev.	Description	Date
A	Turning head added and concrete extended to accommodate	25/10/2021

Keynote Legend	
Key Value	Keynote Text
805	900mm long x 225mm high x 50mm th path edgings on and including GEN3 concrete bed and haunching.
8012	150mm Thick Reinforced Concrete Hardstanding.

Reinforcement for Gorund Supported Concrete

Minimum cover for reinforcement

Position of the concrete	Minimum cover (mm)
In contact with the ground	75
External conditions	50
Cast against dpm on sand blinding	40
Against adequate blinding concrete	40
Protected or internal conditions	25

Application	Reinforcement Type
Pathway	A142 mesh fabric
Driveway	A193 mesh fabric
Ground Floor Slabs	A252 mesh fabric

Fabric mesh sheets should have a minimum overlap of 350mm and be tied together using steel wire.

Supports should be either concrete blocks (no more than 50 x 50mm) or ready-made steel or plastic shoes placed at roughly 600mm centres.

SOUTH HOLLAND DISTRICT COUNCIL
Building Consultancy
South Holland

CLIENT	Mrs P Cowling	PROJECT Accessibility Adaptation	Date 19/07/2021	Project number DFG/21/1252	Scale (@ A3) As indicated
ADDRESS	78 Surfleet Road Pinchbeck PE11 3XY	SHEET Proposed Ground	Drawn by SG	DRAWING NUMBER 04	REV A