

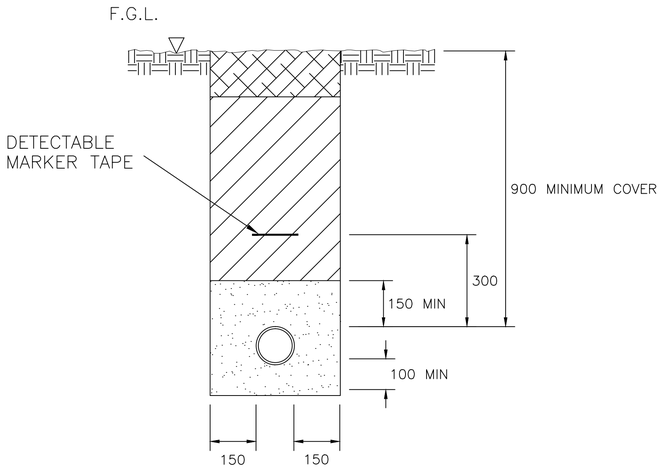



VACUUM SEWER PIPE
STANDARD BEDDING DETAIL

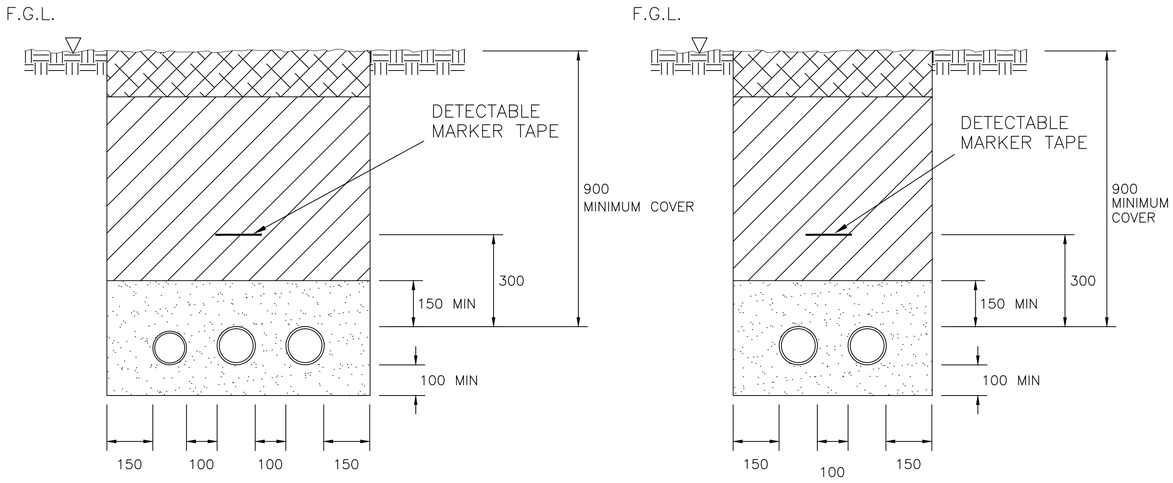

BEDDING OF MULTIPLE VACUUM SEWERS

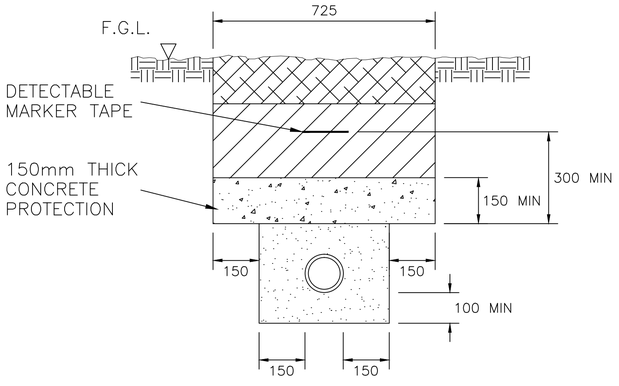

BEDDING DETAIL WHERE COVER IS LESS THAN 900mm AND GREATER THAN 550mm

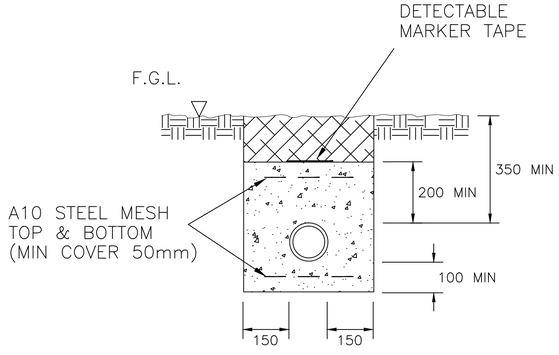

BEDDING DETAIL WHERE COVER IS LESS THAN 550mm

This drawing and the information it contains is the property of Iseki Vacuum Systems Limited. It must not be copied or reproduced, nor may its contents be disclosed to third parties without the prior written consent of Iseki Vacuum Systems Ltd.

© Iseki Vacuum Systems Limited

NOTES

1. DO NOT SCALE MEASUREMENTS FROM THIS DRAWING
2. FOUNDATION REQUIREMENTS OF SEWERS TO BE ADVISED BY OTHERS

KEY

- 10mm SINGLE SIZED GRAVEL OR EQUIVALENT
- SELECTED BACKFILL COMPACTED IN ACCORDANCE WITH LOCAL SPECIFICATIONS
- CAST IN-SITU CONCRETE GRADE TO BE ADVISED BY OTHERS
- REINSTATEMENT AS REQUIRED BY TRENCH LOCATION

Rev	Amendments	Date
C	Concrete protection bedding detail updated 2018-DC-047 (DH)	05/10/18
B	Concrete protection bedding detail updated 2014-DC-012 (ALF)	05/02/14
A	Border updated. 2012-DC-043 (TS)	02/05/12

REDIVAC™
HIGH MARCH
DAVENTRY
NORTHAMPTONSHIRE
NN11 4QE
UNITED KINGDOM
www.redivac-vacuum.com
Tel: +44 (0)1327 878777
Iseki Vacuum Systems Ltd
Vacuum Fluid Handling Systems

VACUUM SEWERAGE SYSTEM
STANDARD DETAILS

DRAWING TITLE

TYPICAL VACUUM SEWER
PIPE BEDDING DETAILS

DRG. NO.		
IVS/SD/31-04		
DRN. MB	DATE 03/07/00	CHK'D TS
PROJECT No. N/A	SCALE (A3) 1:20	REV. C

FILE REF : UK STANDARDS/DRGS/SD-31-04