

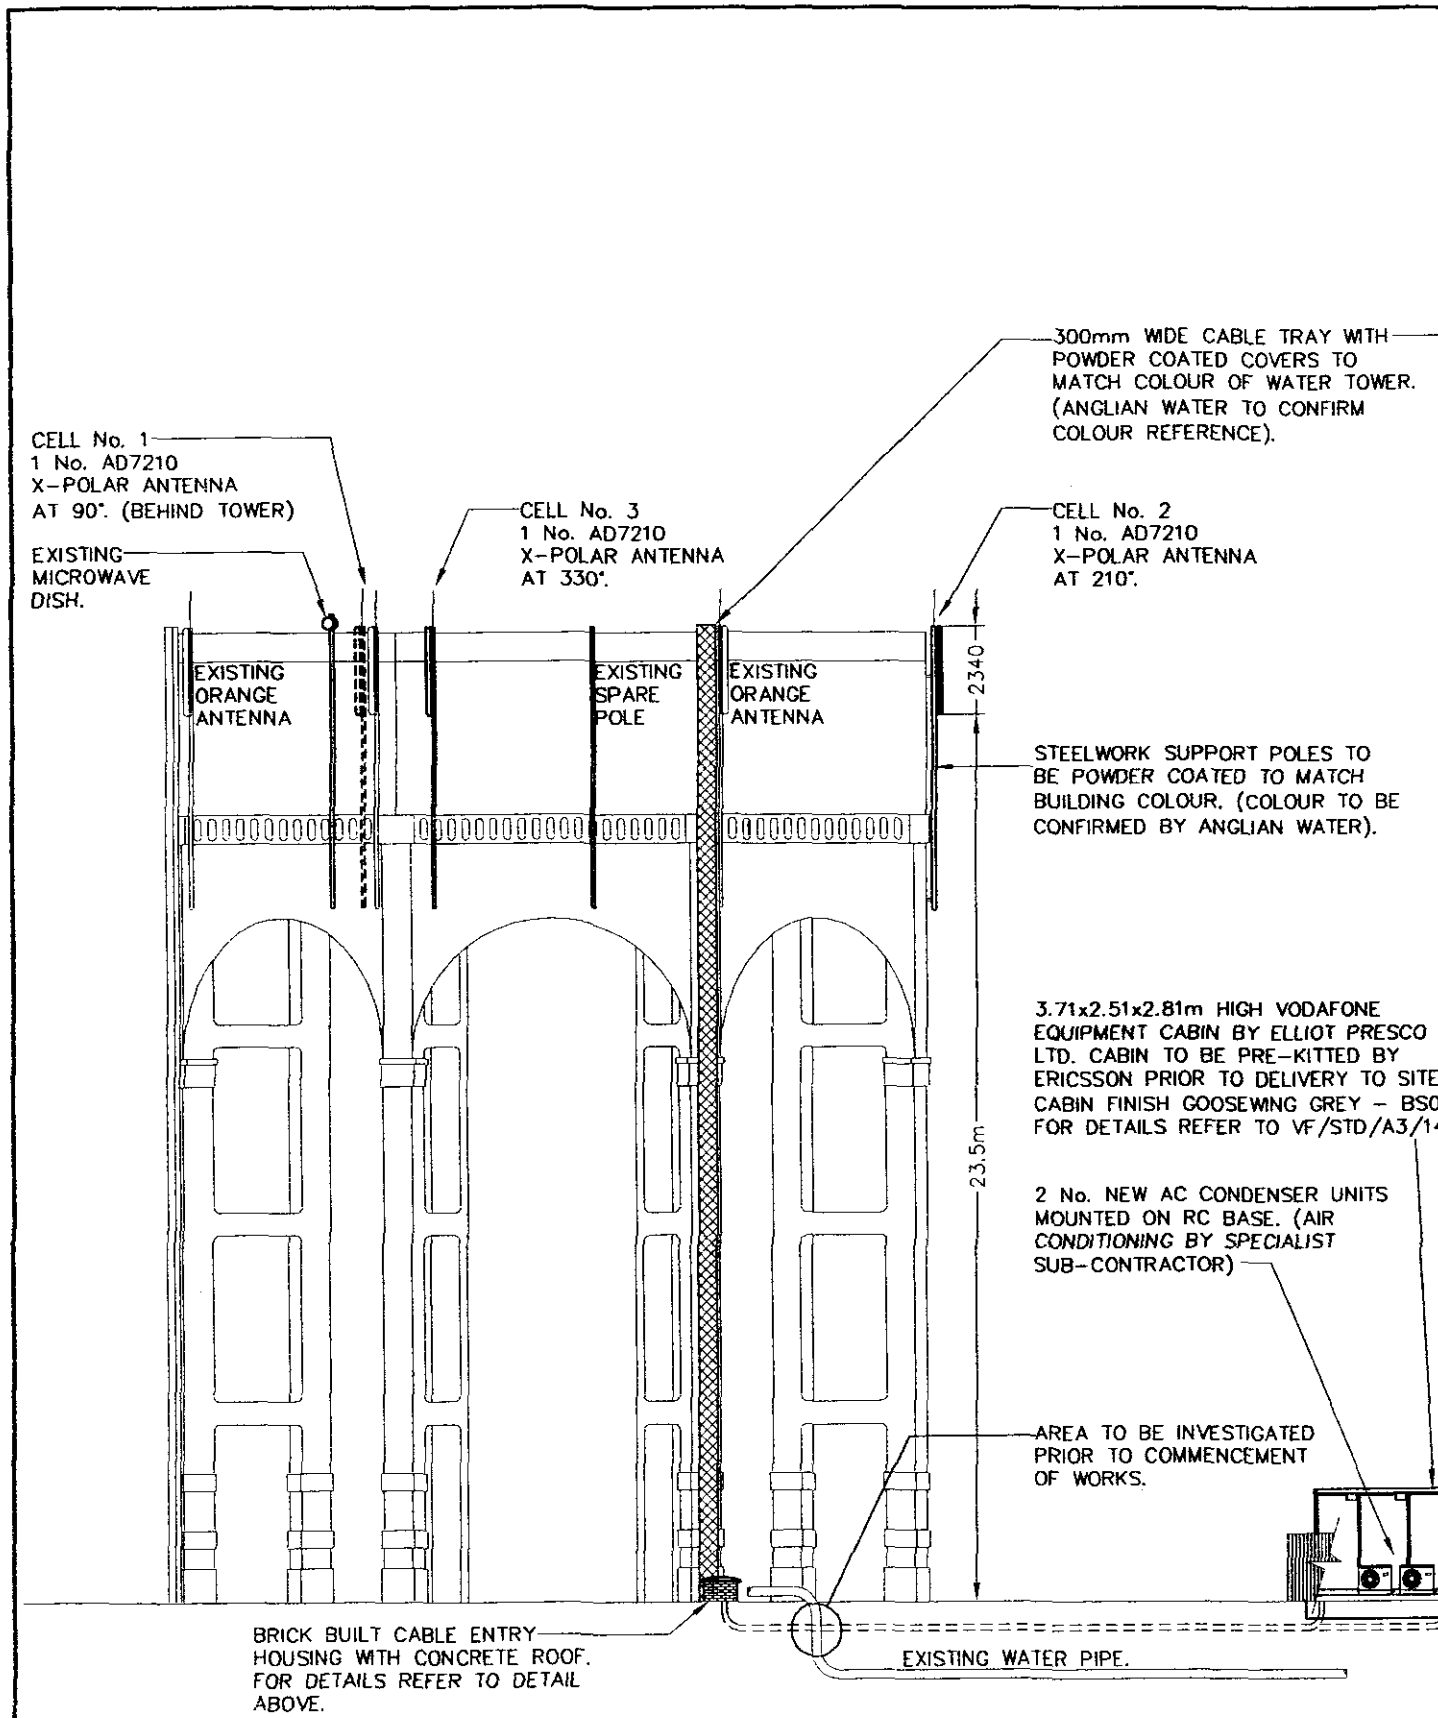


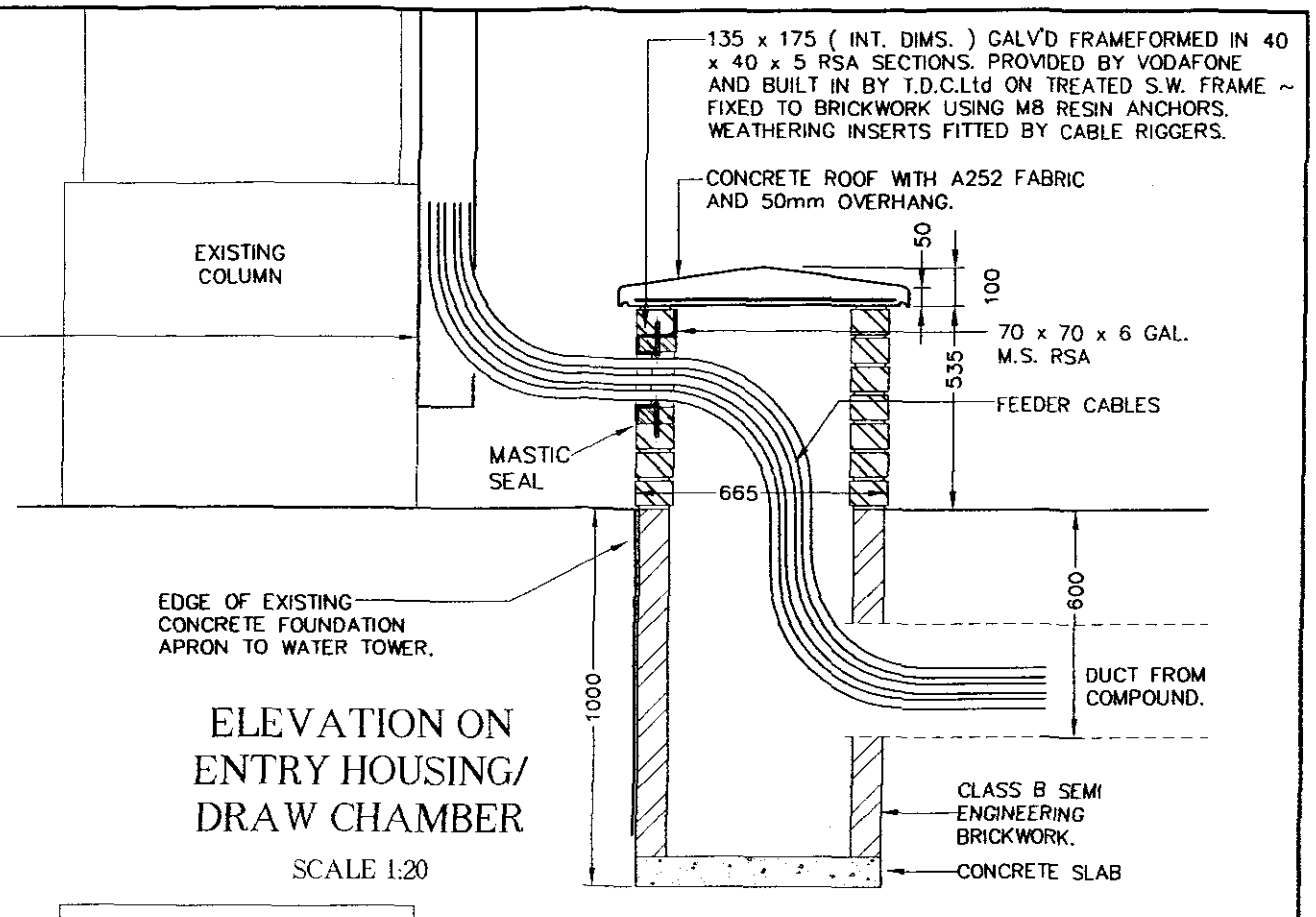

ELEVATION ON
ENTRY HOUSING/
DRAW CHAMBER

SCALE 1:20

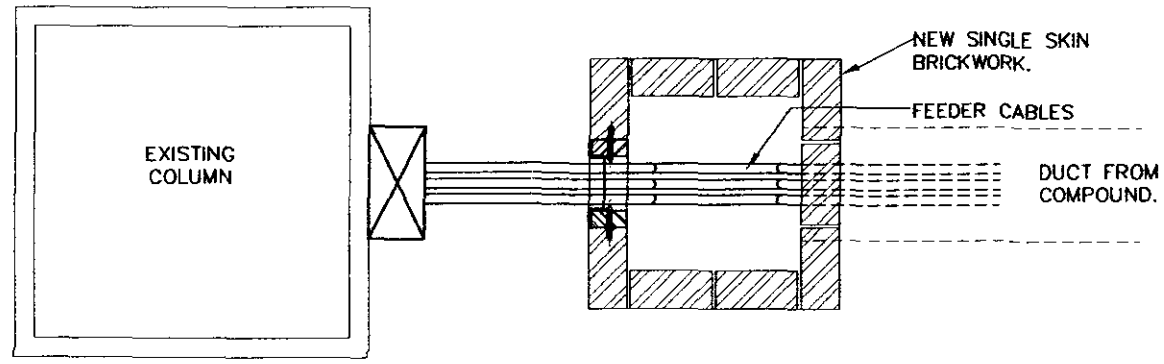

PLAN ON ENTRY
HOUSING/DRAW CHAMBER

SCALE 1:20

SOUTH HOLLAND DC
HOUSING & PLANNING
23 DEC 1999
1295/99

THIS DRAWING TO BE READ IN CONJUNCTION
WITH THE FOLLOWING DRAWINGS NUMBERS:
4000/0806/A3/01, 02, 03

VF/STD/A3/14
VF/STD/A3/56
VF/STD/A3/110

REV.	DATE	REMARKS	BY	CHK.

CLIENT

vodafone

FILENAME 30559A_04_TD3_0806.dwg

C.S.I. No. 30559A

THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH R.B.S. DESIGN MANUAL ISSUE 2, VODAFONE R.B.S. PROJECTS BUILDING REQUIREMENTS WORK AND ELECTRICAL SPECIFICATION.

SITE ADDRESS
PINCHBECK WATER TOWER
ANGLIAN WATER
PINCHBECK
SPALDING, LINCONSHIRE

SITE NAME
PINCHBECK WATER TOWER

DESIGN OFFICE
395 GEORGE ROAD, ERDINGTON,
BIRMINGHAM. B23 7RZ.
TEL. 0121 344-4888
FAX. 0121 344-4801

Tilbury Douglas
CONSTRUCTION

COMPUTER AIDED DRAWING - AVOID MANUAL MODIFICATION

DRAWN	CHECKED	DATE	SCALE
J.C.		25-11-99	1:200

DRAWING TITLE
NORTH WEST ELEVATION


DRAWING No.
4000/0806/A3/04


REVISION

NOTE:
APPROX LENGTH OF SINGLE FEEDER CABLE FROM ANTENNA TO CABIN

CELL No 1 = 86m (LDF 7-50)
CELL No 2 = 62m (LDF 7-50)
CELL No 3 = 62m (LDF 7-50)

THESE DIMENSIONS ARE APPROXIMATE ONLY & ARE NOT TO BE USED FOR PROCUREMENT OR CONSTRUCTION PURPOSES

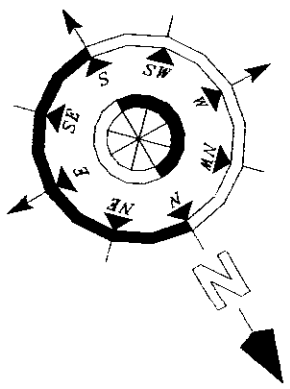

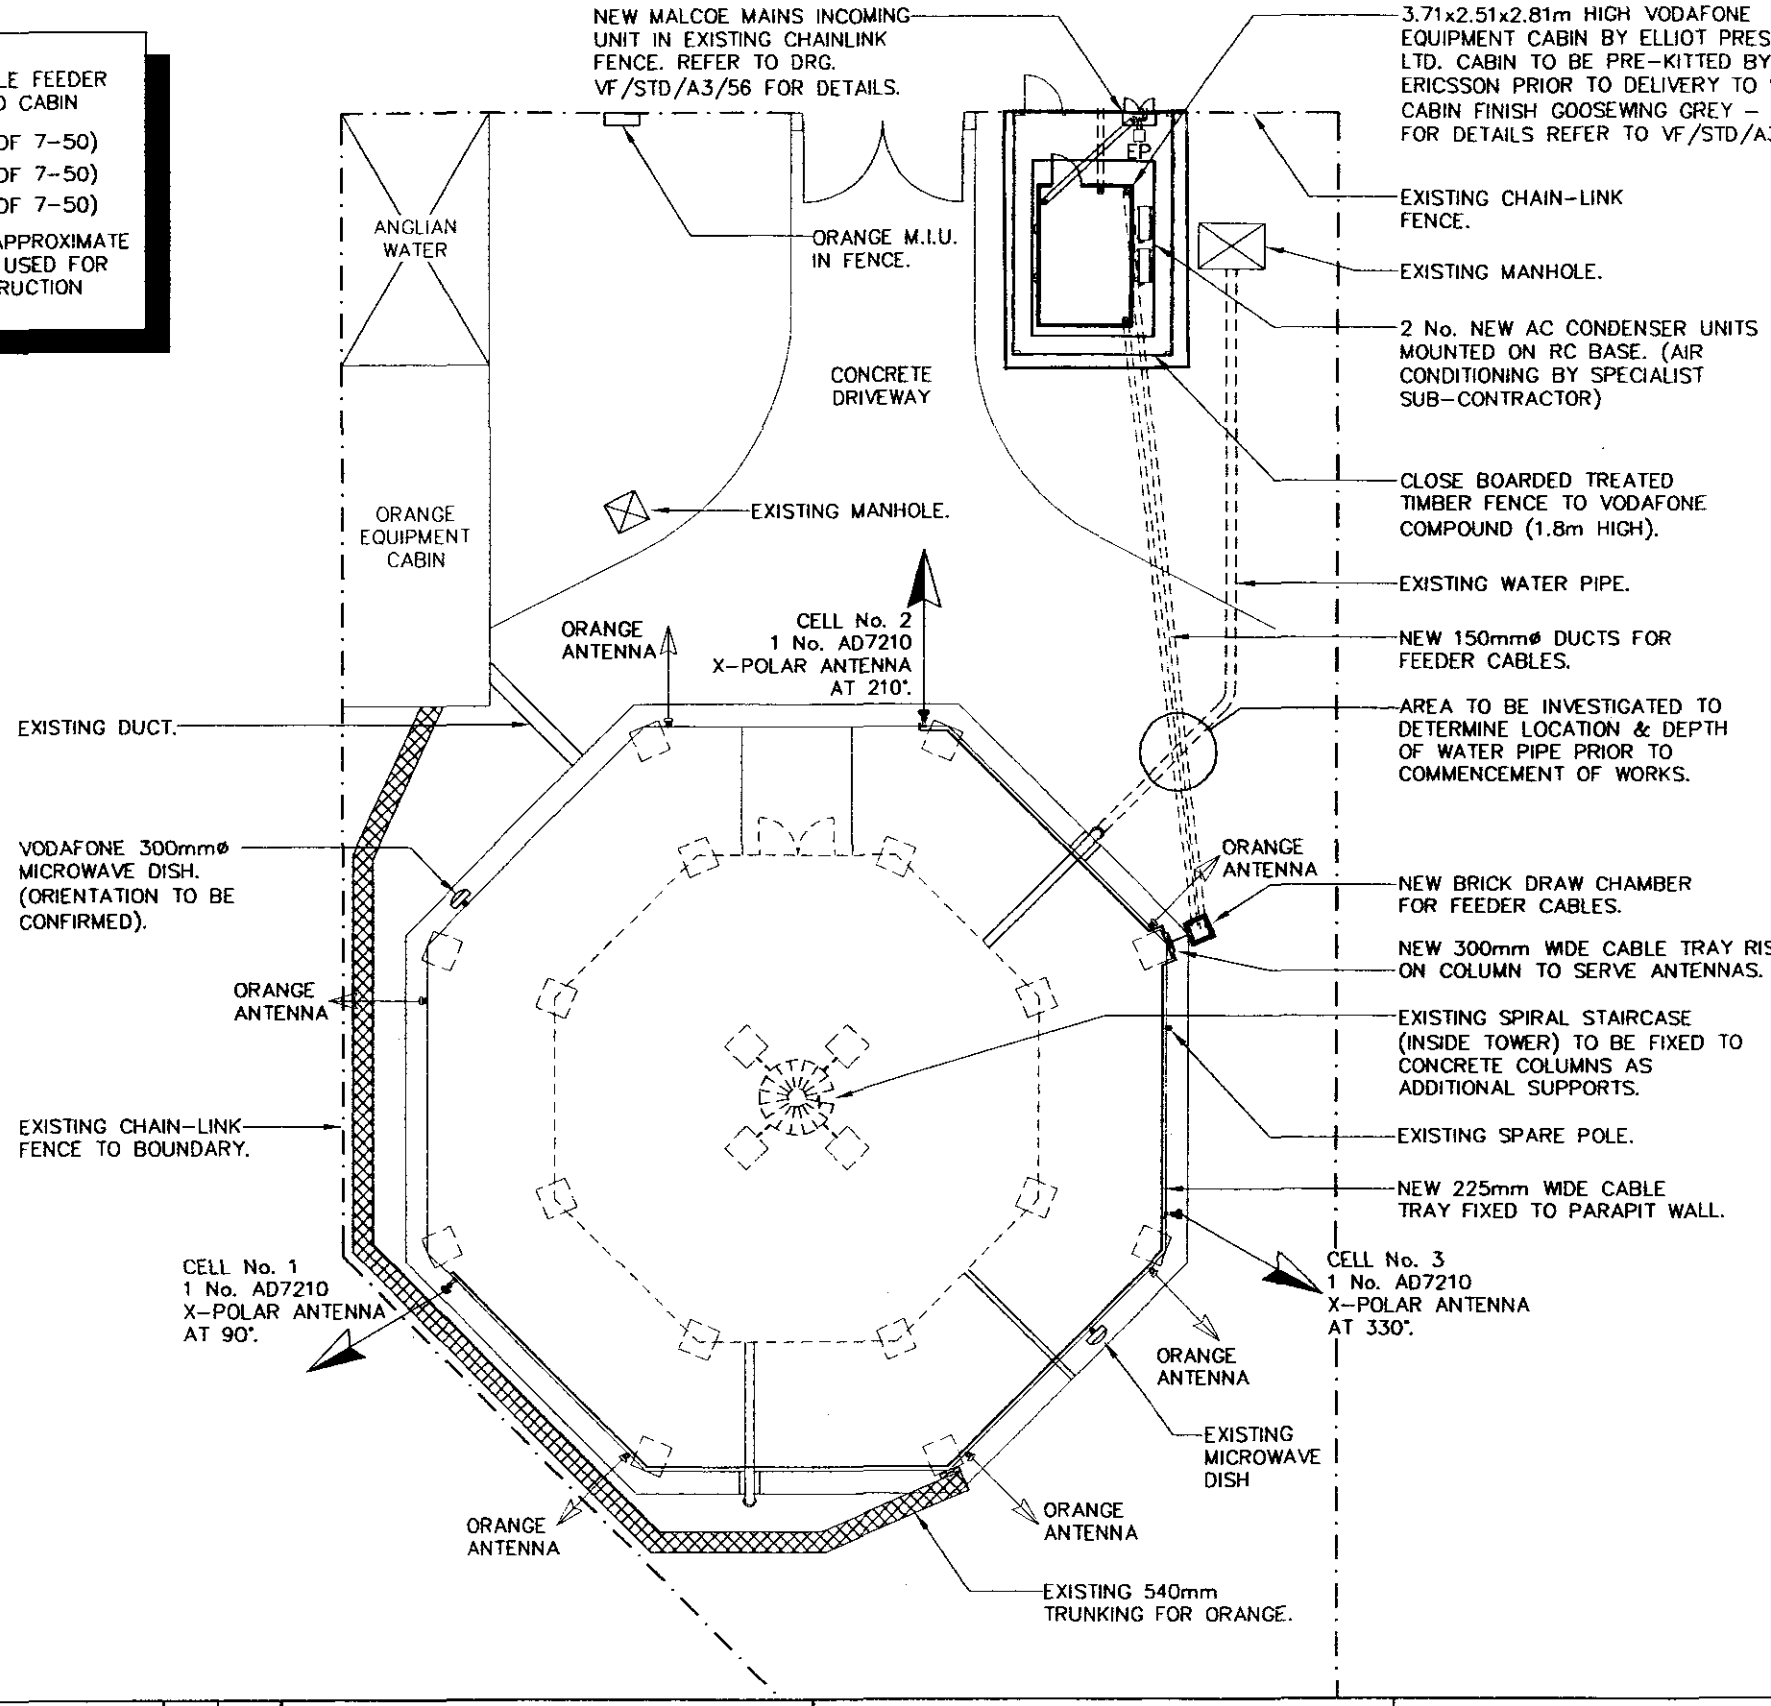

THIS DRAWING TO BE READ IN CONJUNCTION WITH THE FOLLOWING DRAWINGS NUMBERS:
4000/0806/A3/01, 03, 04
VF/STD/A3/14 VF/STD/A3/110
VF/STD/A3/56

CABLE TRAYS TO BE HEAVY DUTY RETURN FLANGE GALVANISED MS (SWIFT OR SIMILAR) WITH PURPOSE MADE FULL PROFILE GALVANISED MS COVERS. FOR DETAILS SEE DRG No VF/STD/A3/123.
NOTE: VERTICAL RISES TO BE COLOUR CODED TO MATCH EXTG BRICK WORK.

A 3ø 45 KVA POWER SUPPLY IS REQUIRED FOR THE VODAFONE CABIN. MAINS CABLE TO RUN FROM NEW MALCOE UNIT INTO ADJACENT CABIN.

PROVIDE SMOKE ALARM AT HEAD OF PROTECTED STAIRWELL LINKED TO AUDIBLE SOUNDER IN VODAFONE EQPT CABIN BY TDCL. ELECTRICAL DEPARTMENT.

VODAFONE INSTALLATION TO BE CONNECTED TO EARTHING SYSTEM BY SPECIALIST CONTRACTOR TO BS 6651.

T.D.C. ELECTRICIANS TO PROVIDE AND TEST, FULL EARTHING/LIGHTNING PROTECTION SYSTEM.

ALL LIGHTNING PROTECTION TO BE IN ACCORDANCE WITH BS6651.

COMPOUND FINISH: -

EXISTING SURFACE TO BE REMOVED TO FORMATION LEVEL AND AREA TO BE TREATED WITH WEED KILLER PRIOR TO LAYING FINISH. FINISH TO BE 100mm OF 28-30mm SIZE LOCAL STONE OVER TERRAM 700 OVER COMPACTED HARDCORE AS NECESSARY. REMOVE AND REPLACE SOFTSPOTS WITH COMPACTED HARDCORE.

ALL UNDERGROUND SERVICES / DRAINAGE RUNS TO BE LOCATED & IDENTIFIED PRIOR TO COMMENCEMENT OF WORKS. FINDINGS TO BE REPORTED BACK TO T.D.C.LTD DESIGN OFFICE.

"EP" DENOTES EARTHING PIT. EARTH ROD WITHIN 300mm sq. x APPROX. 450mm DEEP EARTHING PIT, INC. INSPECTION COVER. SET IN LEAN MIX CONCRETE SURROUND. PIT TO BE INSTALLED COMPLETE WITH LIGHTNING PROTECTION ROD AND TAPE ANCHOR POINT.

ALL SUPPORT POLES & ANTENNAS TO BE PAINTED TO MATCH COLOUR OF WATER TOWER STRUCTURE.

23 DEC 1999
1295/99

REV.	DATE	REMARKS	BY	CHK.

CLIENT: vodafone

FILENAME: 30559A_02_TD3_0806.dwg
C.S.I. No: 30559A

THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH R.B.S. DESIGN MANUAL ISSUE 2, VODAFONE R.B.S. PROJECTS BUILDING REQUIREMENTS WORK AND ELECTRICAL SPECIFICATION.

SITE ADDRESS
PINCHBECK WATER TOWER
ANGLIAN WATER
PINCHBECK
SPALDING, LINCONSHIRE

SITE NAME: PINCHBECK WATER TOWER

DESIGN OFFICE
325 GEORGE ROAD, ERDINGTON.
BIRMINGHAM. B23 7RZ.
TEL. 0121 344-4888
FAX. 0121 344-4801
Tilbury Douglas CONSTRUCTION

COMPUTER AIDED DRAWING - AVOID MANUAL MODIFICATION

DRAWN	CHECKED	DATE	SCALE
J.C.	MJW	25-11-99	1:200

DRAWING TITLE: SITE PLAN

DRAWING No.: 4000/0806/A3/02

REVISION: